

**CITY OF DAYTON**  
**Public Works Design Standards**

---

**Standard Detail Drawings & Sample Test Report Forms**

**Appendix A**

---

Note:

1) Per PWDS 1.11.b.11, the applicable City standard details shall be included on construction drawings submitted for City review and approval. See also PWDS 1.3.a.3 for detail sheet stamping requirements where engineered drawings are required.

2) Per PWDS 1.2.b, the City standard details are intended to assist but not to substitute for competent work by design professionals where applicable. As noted in the PWDS, the City standard details illustrate the minimum requirements and materials required by the Public Works Department for the construction of certain standard system components, and are thus not considered to be final documents until incorporated into a design approved by the City,



**CITY OF DAYTON  
PUBLIC WORKS DESIGN STANDARDS**

**TABLE OF CONTENTS, CITY STANDARD DETAILS**

<b>• <u>A1 - General Requirements</u></b>		Latest Revision
101	Typical Utility Locations (Curbed Streets) .....	1/24
102	Typical Utility Locations (Turnpike and 3/4 Streets) .....	1/24
115	Survey Monument Box (in Streets or Public Sidewalks).....	9/20
 <b>• <u>A2 - Streets</u></b>		 Latest Revision
201-1	30' Residential Street (Local Class I), Minimum Section .....	8/19
201-2	32' Residential Street (Local Class II), Minimum Section .....	8/19
201-3	34' Residential Street (Local Class III), Minimum Section .....	8/19
202	36' Collector Street, 36' Commercial Street, Minimum Section .....	8/19
203	36' Industrial Street, Minimum Section .....	8/19
204	Arterial Street, Minimum Section .....	1/24
205	Standard Cul-de-sac (Residential) .....	12/15
206	Offset Cul-de-sac (Residential) .....	12/15
207	Eyebrow Cul-de-sac (Residential) .....	1/24
210	Type "A" Curb and Gutter and Weephole .....	1/24
211	Type "C" Curb and Weephole.....	1/24
212	Curblin Sidewalks and Driveway Apron.....	3/24
212A	Residential D/W Apron at Adverse Grade Driveways, Curblin Sidewalk.....	1/24
212B	Fully Depressed D/W at Alley or Positive Grade Driveways, Curblin Sidewalk.....	1/24
213	Property Line Sidewalks and Driveway Apron.....	2/24
213A	CBU Mailbox & Ramp w/ Property Line Sidewalk.....	2/24
213B1	48" Square Tree Well Cover Panels .....	6/19
213B2	24" Deep, 30"φ, 4 Panel Root Barrier Tree Wells .....	2/19
213C	24" Deep, 38"φ, 5 Panel Root Barrier Tree Wells .....	2/19
214A	Intersection Curb Ramps, Curblin Sidewalks, Local Streets .....	2/24
214A1	Intersection Curb Ramps, Curblin Sidewalks, Local Streets (Alt Layout) .....	2/24
214B	Intersection Curb Ramps, Property Line Sidewalks, Local Streets .....	2/24
214C	Curb Ramps Between Intersections.....	2/24
216	Commercial/Industrial Driveway Approach (High-Volume Truck Option).....	2/24
217	Curb Cut for New Driveways or Pedestrian Ramp on Existing Curb .....	2/22
218	Concrete Valley Gutter (Typ for use in Alleys & Parking Lots) .....	2/24
219	AC Street Cut for Street Widening or Extension.....	2/24
220	Hammerhead Turnaround (Private Drives).....	2/24
225	Street Barricade (Stub Streets) .....	2/24
226	6-inch Bollard (Guard Post) .....	2/24
227	8-inch Bollard (Guard Post) .....	2/24
228	30" Tall Collapsible Padlockable Bollard .....	2/24
230	Typical Street Lamp Post .....	2/24
231	Sign Post for Street Signs, Stop Signs & Traffic Control Signs .....	2/24
232	Sign Post with TeleSpar Base & Anchor (Required in ODOT R.O.W) .....	2/24

235	Offstreet Parking Dimensions, One Way Traffic Flow .....	2/24
236	Offstreet Parking Dimensions, Two Way Traffic Flow .....	2/24
237	Double Accessible Parking Space .....	2/24
238	Accessible Routes and Crossings in Vehicular Areas .....	2/24
239	Precast Wheelstop Detail .....	1/13
240	TrueGrid ProPlus Industrial Grade Modular Non-Paved Surface System.....	2/24
250	Trash and Recycling Enclosure .....	5/14

• **A3 – Trenches & Stormwater Management**

Latest Revision

- ▶ For full size manholes, see Details 401 – 403A
- ▶ For storm sewer service laterals, see Details 415 & 416

301	Trench Backfill, Bedding and Pipe Zone .....	2/24
302	Minor or Private Street & AC Driveway Cut Surface Restoration .....	2/24
302A	AC Street Cut Surface Restoration w/Bench Grind .....	2/24
302D	ODOT Trench Crossing, Trench Backfill & Surface Restoration .....	2/24
303	Gravel Surface Restoration .....	12/15
304	Native Surface Restoration .....	12/15
308	Bore Casing, Carrier Pipe & Casing Spacer Detail .....	3/24
310	Standard Side-Inlet Grated Catch Basin .....	9/20
311	Oversize Side-Inlet Grated Catch Basin .....	9/20
311A	Curb Inlet Catch Basin (Special Use Only) .....	3/24
312	Catch Basin Grate Details .....	6/14
313	Type 3 Ditch Inlet Catch Basin .....	9/20
313A	Storm Outlet Energy Dissipator Basin .....	3/24
315	Parking Lot Catch Basin (Precast Concrete) .....	3/24
316	Parking Lot Catch Basin (Lynch Style) .....	7/12
317	Parking Lot Catch Basin (Traffic Rated PVC w/Trap, Ductile Iron Frame/Grate) .....	1/13
320	Pollution/Flow Control Manhole .....	3/24
330	Kuenzi Manhole .....	7/22
331	Kuenzi Manhole w/Waterline Casing (Existing Waterline).....	7/22
332	Kuenzi Manhole w/Waterline Casing (New Waterline) .....	7/22
350	24" Diameter Storm Manhole .....	10/23
351	24" Diameter Storm Manhole (Traffic Rates PVC w/Solid Ductile Iron Frame/Cover).....	8/23
355	Private Area Drain, Non-Traffic Areas.....	7/22
362	Concrete Pipe End Cap with Grate.....	9/21
370A	Trash Trap & Leach Line Plan .....	2/21
370B	Trash Trap & Leach Line Details .....	2/21

**Test Reports**

- ▶ Storm Drain Mandrel Test Report
- ▶ Storm Drain Pipeline TV Inspection Report

• **A4 – Sanitary Sewers**

Latest Revision

- ▶ For trench backfill and surface restoration, see Details 301 – 304
- ▶ For bore casing detail, see Detail 308

401	Standard Manhole for 21" Pipe and Smaller .....	3/24
402	Flattop Manhole for 21" Pipe and Smaller .....	3/24
403	Manhole for 24" and 27" Pipe .....	3/24
403A	Deep Manhole for 24" and 27" Pipe.....	3/24

404	Inside Drop Connection for Sanitary Sewer Manhole .....	7/21
405	Manhole Frame and Cover (Standard and Suburban) .....	9/23
405A	Adjustable Manhole Frame (Rim Riser) .....	9/23
406	Lockdown Manhole Frame and Cover .....	12/15
407	Manhole Rim Adjustment Details .....	8/22
411	Mainline Cleanout .....	2/24
415	Sewer & Storm Service Lateral .....	7/22
416	Standard Service Lateral Cleanout (Sewer & Storm).....	2/24
419	Inserta-Tee Connection to Existing Sewer or Storm Drain.....	1/24

**Test Reports**

- ▶ Sanitary Sewer Manhole Vacuum Test Report
- ▶ Sanitary Sewer Air Test Report
- ▶ Sanitary Sewer Mandrel Test Report
- ▶ Sanitary Sewer Pipeline TV Inspection Report

**• A5 – Water Distribution**

Latest Revision

- ▶ For trench backfill and surface restoration, see Details 301 - 304
- ▶ For bore casing detail, see Detail 308

501	Gate Valve and Valve Box Detail .....	12/22
502	Butterfly Valve and Valve Box Detail .....	12/22
503	Standard Fire Hydrant Assembly .....	10/23
505	Tapping Tee and Valve .....	9/18
506	Mainline Blowoff Assembly .....	2/24
507	Standard Blowoff with Plugged End .....	2/24
510	Horizontal Thrust Blocking .....	9/14
511	Straddle Block for 12" & Smaller Pipe .....	12/21
512	Vertical Thrust Blocking .....	9/06
515	Typical 1" Water Service .....	3/24
516	1½" and 2" Meter Set with 1" High Bypass .....	4/24
517A	Tapping Requirements, 1½" and 2" Service (HDPE or Sched 80 PVC Service Line) .....	3/24
517B	Tapping Requirements, 3" & Larger Service .....	3/24
518	1" Combination Air Release Valve (CARV) .....	3/20
519	Potable Water Chlorination Tap Assembly .....	1/24
523	3" Domestic Water Meter .....	4/24
524	4" Domestic Water Meter .....	4/24
525	6" Domestic Water Meter .....	4/24
526	8" Domestic Water Meter .....	4/24
527	Water Meter Vault Bypass Valve Lock.....	8/14
528	Water Meter Test Port Assembly .....	4/24
529	Galvanized Pipe Supports w/Galvanized Ext Pipe.....	1/18
531	2" & Smaller Double Check Valve Assembly .....	8/22
541	2" & Smaller Reduced Pressure Backflow Assembly.....	1/24
543	3" Reduced Pressure Backflow Assembly .....	1/24
544	4" Reduced Pressure Backflow Assembly .....	1/24
545	6" Reduced Pressure Backflow Assembly .....	1/24


550	Fire Service Line Connection Requirements (1½" & Larger Service) .....	5/23
554	4" Double Check Detector Assembly w/FDC.....	1/24
555	6" Double Check Detector Assembly w/FDC.....	1/24
556	8" Double Check Detector Assembly w/FDC.....	1/24
559	4" Forward Flow Test Port inside DCDA Vault (For NFPA 13 & 25 Tests).....	1/24
560	Below Grade Check Valve & Ball Drip Valve, in Close Bottom Drain Structure .....	8/22
561	Below Grade Check Valve & Ball Drip Valve, in Open Bottom Drain Structure.....	9/22
562	FDC Line Ball Drip Drain Valve (Check Valve in Building), Open Bottom Drain Structure .....	9/22
563	FDC on Building Exterior & Forward Flow Test Port, Sample & Notes .....	1/24

**Test Reports**

- ▶ Waterline Pressure Test Report

**• A6 - Erosion Control**

610	Temporary Construction Entrance .....	5/13
611	Sediment Barriers .....	4/14
612	Straw Wattle Sediment Barrier .....	6/15
613	Inlet Sediment Control .....	4/14
614	Ditch & Swale Protection .....	4/14
615	Silt Sack Inlet Detail .....	9/06
616	Temporary Concrete Washout Area (CWA).....	11/18
617	Stockpile Cover Detail.....	1/19

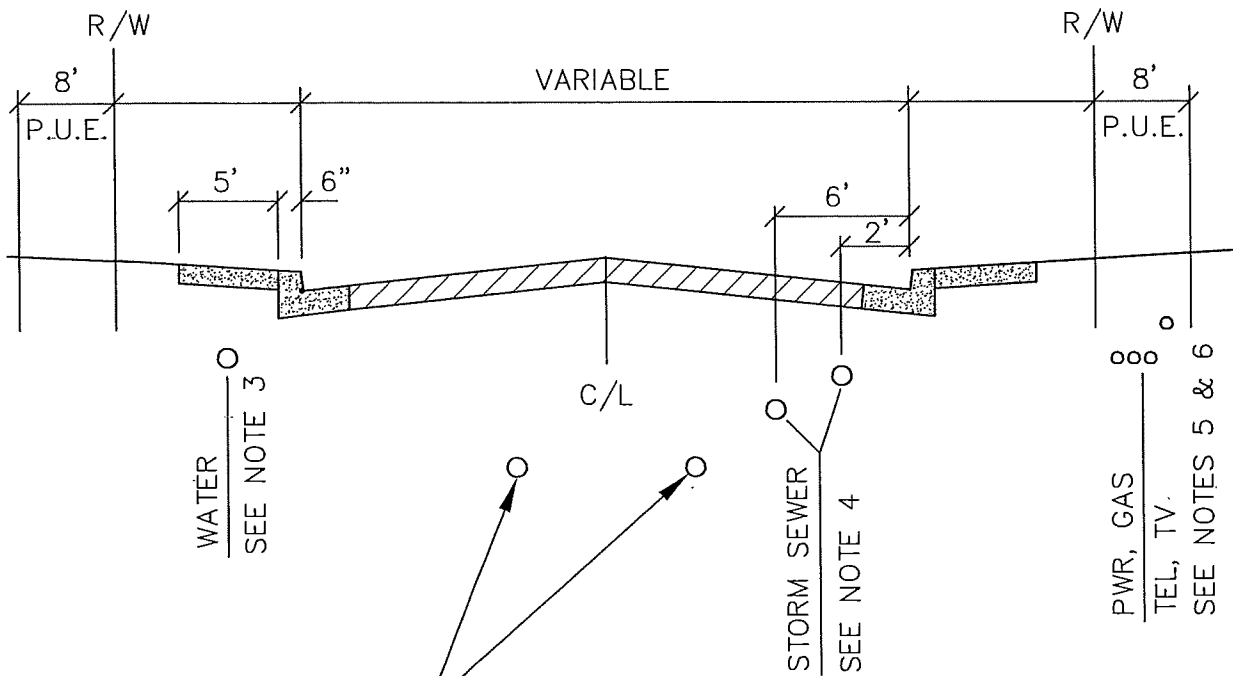

S.S. - 5' FROM C/L (TYP ON LOW SIDE OF STREET).  
 SEE NOTES 1 & 2 (3' MIN CLEAR SEPARATION BETWEEN SEWER & STORM MAINS)


## CURBED STREETS

NOTES:

NTS

1. 6' MIN COVER TYPICALLY REQUIRED FOR SANITARY SEWER MAINS (4' MIN. COVER TYPICALLY REQUIRED FOR LATERALS).
2. LATERALS AND P/L CLEANOUTS SHALL BE INSTALLED DURING CONSTRUCTION OF SANITARY SEWER & STORM MAINS (TO AVOID FUTURE STREET CUTS).
3. WATER TO BE INSTALLED 3' BEHIND FACE OF CURB ON HIGH SIDE OF STREET. 36" MIN. COVER ON ALL WATERLINES. 10' MINIMUM SEPARATION TYPICAL BETWEEN PARALLEL WATER & SEWER MAINS.
4. STORM SEWER TO BE INSTALLED ON LOW SIDE OF STREET:
  - a) 2' FROM FACE OF CURB FOR <4' RIM TO INVERT
  - b) 6' FROM FACE OF CURB FOR >4' RIM TO INVERT (MH SYSTEM)
5. MAINTAIN MIN. 5' HORIZ. SEPARATION BETWEEN PUBLIC UTILITIES & PARALLEL PRIVATE UTILITIES. OTHER VERTICAL AND HORIZONTAL SEPARATION DISTANCES SHALL BE AS SPECIFIED BY DEQ, ODWP, OR PUBLIC/PRIVATE UTILITY COMPANIES.
6. UTILITY TRENCH PER FRANCHISE UTILITY COMPANY REQUIREMENTS, GENERALLY ON OPPOSITE SITE OF STREET FROM WATER LINE WHERE FEASIBLE.

LAST REVISION DATE: JAN 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>TYP. UTILITY LOCATIONS (CURBED STREETS)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>101</b>

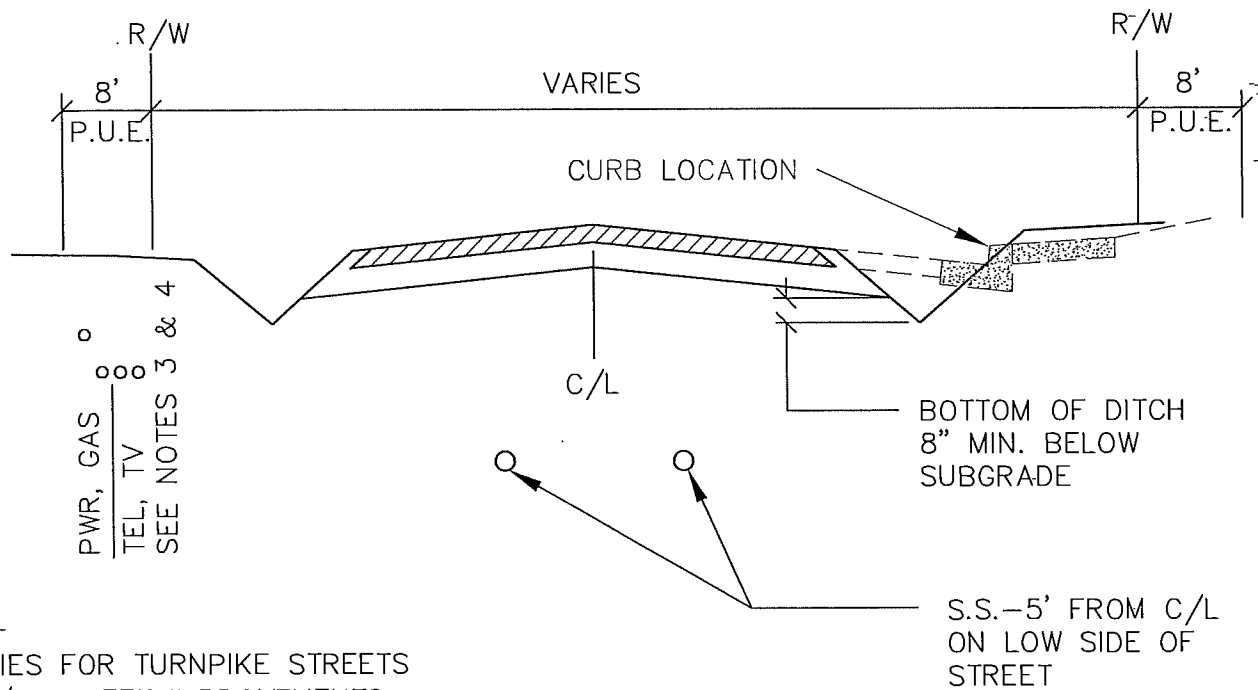

NOTE:

UTILITIES FOR TURNPIKE STREETS OR 3/4 STREET IMPROVEMENTS SHALL BE LOCATED TO ALLOW FUTURE CONSTRUCTION OF CURBED STREETS WITHOUT RELOCATING UTILITIES. SEE DETAIL 101.

## TURNPIKE STREETS

NTS


NOTES:

1. 6' MIN COVER TYPICALLY REQUIRED FOR SANITARY SEWER MAINS (4' MIN. COVER TYPICALLY REQUIRED FOR LATERALS).
2. LATERALS AND P/L CLEANOUTS SHALL BE INSTALLED DURING CONSTRUCTION OF SANITARY SEWER & STORM MAINS (TO AVOID FUTURE STREET CUTS).
3. WATER TO BE INSTALLED 3' BEHIND FACE OF CURB ON IMPROVED SIDE OR 3' BEHIND FUTURE FACE OF CURB LOCATION AS DIRECTED BY THE CITY ENGINEER. 10' MINIMUM SEPARATION TYPICAL BETWEEN PARALLEL WATER & SEWER MAINS.
4. MAINTAIN MIN. 5' HORIZ. SEPARATION BETWEEN PUBLIC UTILITIES & PARALLEL PRIVATE UTILITIES. OTHER VERTICAL AND HORIZONTAL SEPARATION DISTANCES SHALL BE AS SPECIFIED BY DEQ, ODWP, OR PUBLIC/PRIVATE UTILITY COMPANIES.
5. UNITY TRENCH PER FRANCHISE UTILITY COMPANY REQUIREMENTS, GENERALLY ON OPPOSITE SITE OF STREET FROM WATER LINE WHERE FEASIBLE.

LAST REVISION DATE: JAN 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>TYP. UTILITY LOCATIONS (TURNPIKE AND 3/4 STREETS)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>102</b>




NOTE: PER ORS 92.044(7), "UTILITY INFRASTRUCTURE (INCLUDING PIPELINES) MAY NOT BE PLACED WITHIN ONE FOOT OF A SURVEY MONUMENT LOCATION NOTED ON A SUBDIVISION OR PARTITION PLAT."

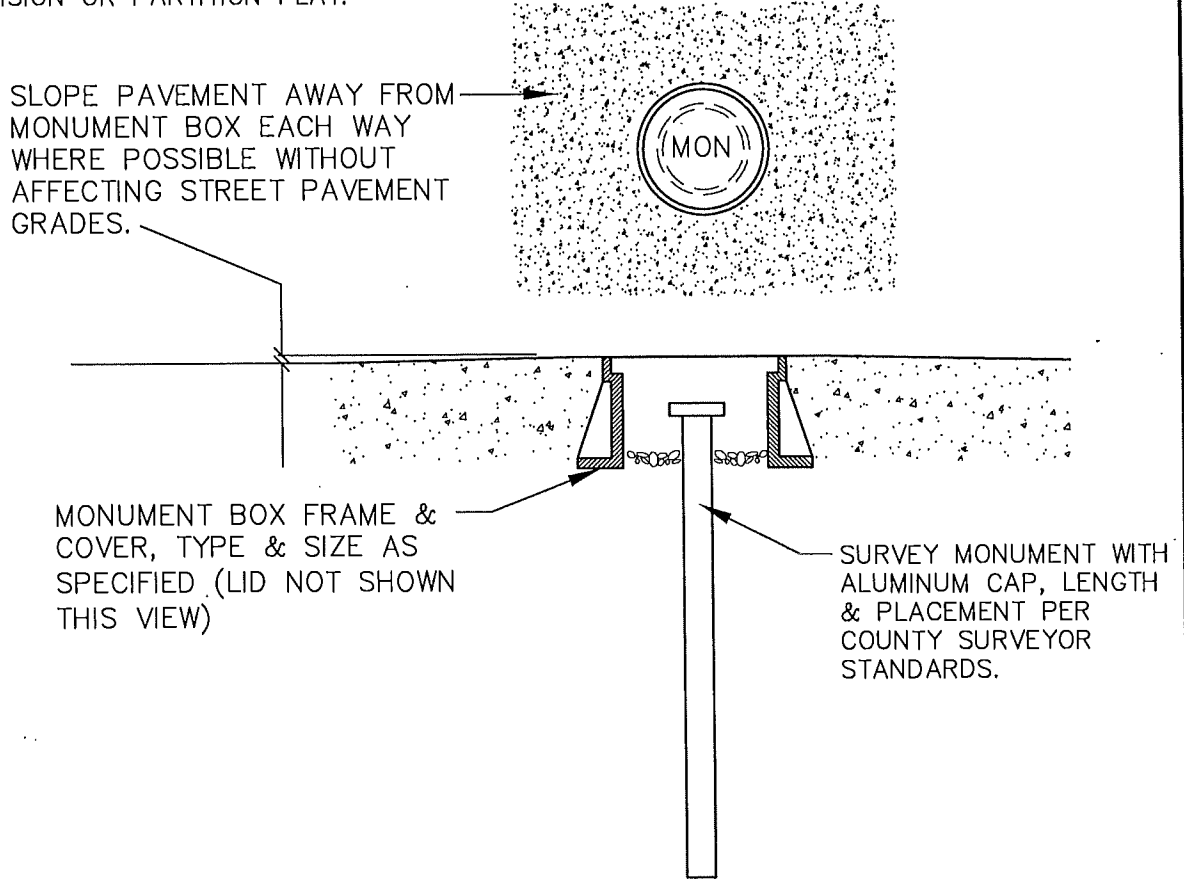

NOTES:

1. VERIFY MONUMENT BOX SIZE WITH COUNTY SURVEYOR PRIOR TO PLACEMENT. UNLESS OTHERWISE REQUIRED BY THE COUNTY SURVEYOR (BASED ON TYPE OF SURVEY MONUMENT), PROVIDE THE FOLLOWING.
  - a) USE 8" DIAMETER (MINIMUM) MONUMENT BOX FOR POSTED SPEEDS LESS THAN 35 MPH. (OLYMPIC M1014 BOX/LID, OR EJ 3614Z BOX W/3614A LID).
  - b) USE 12" DIAMETER MONUMENT BOX FOR POSTED SPEEDS EQUAL TO OR GREATER THAN 35 MPH. (EJ 3673Z BOX W/3673A LID).
2. FOR REPAVING PROJECTS, PROVIDE OVERLAY RISER RINGS FROM SAME MANUFACTURER, HEIGHT AS REQUIRED TO ACCOMODATE OVERLAY THICKNESS.


LAST REVISION DATE: SEPT 2020	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>SURVEY MONUMENT BOX (IN STREETS OR PUBLIC SIDEWALKS)</b> (NTS)	
DAYTON, OR	DETAIL NO. 115

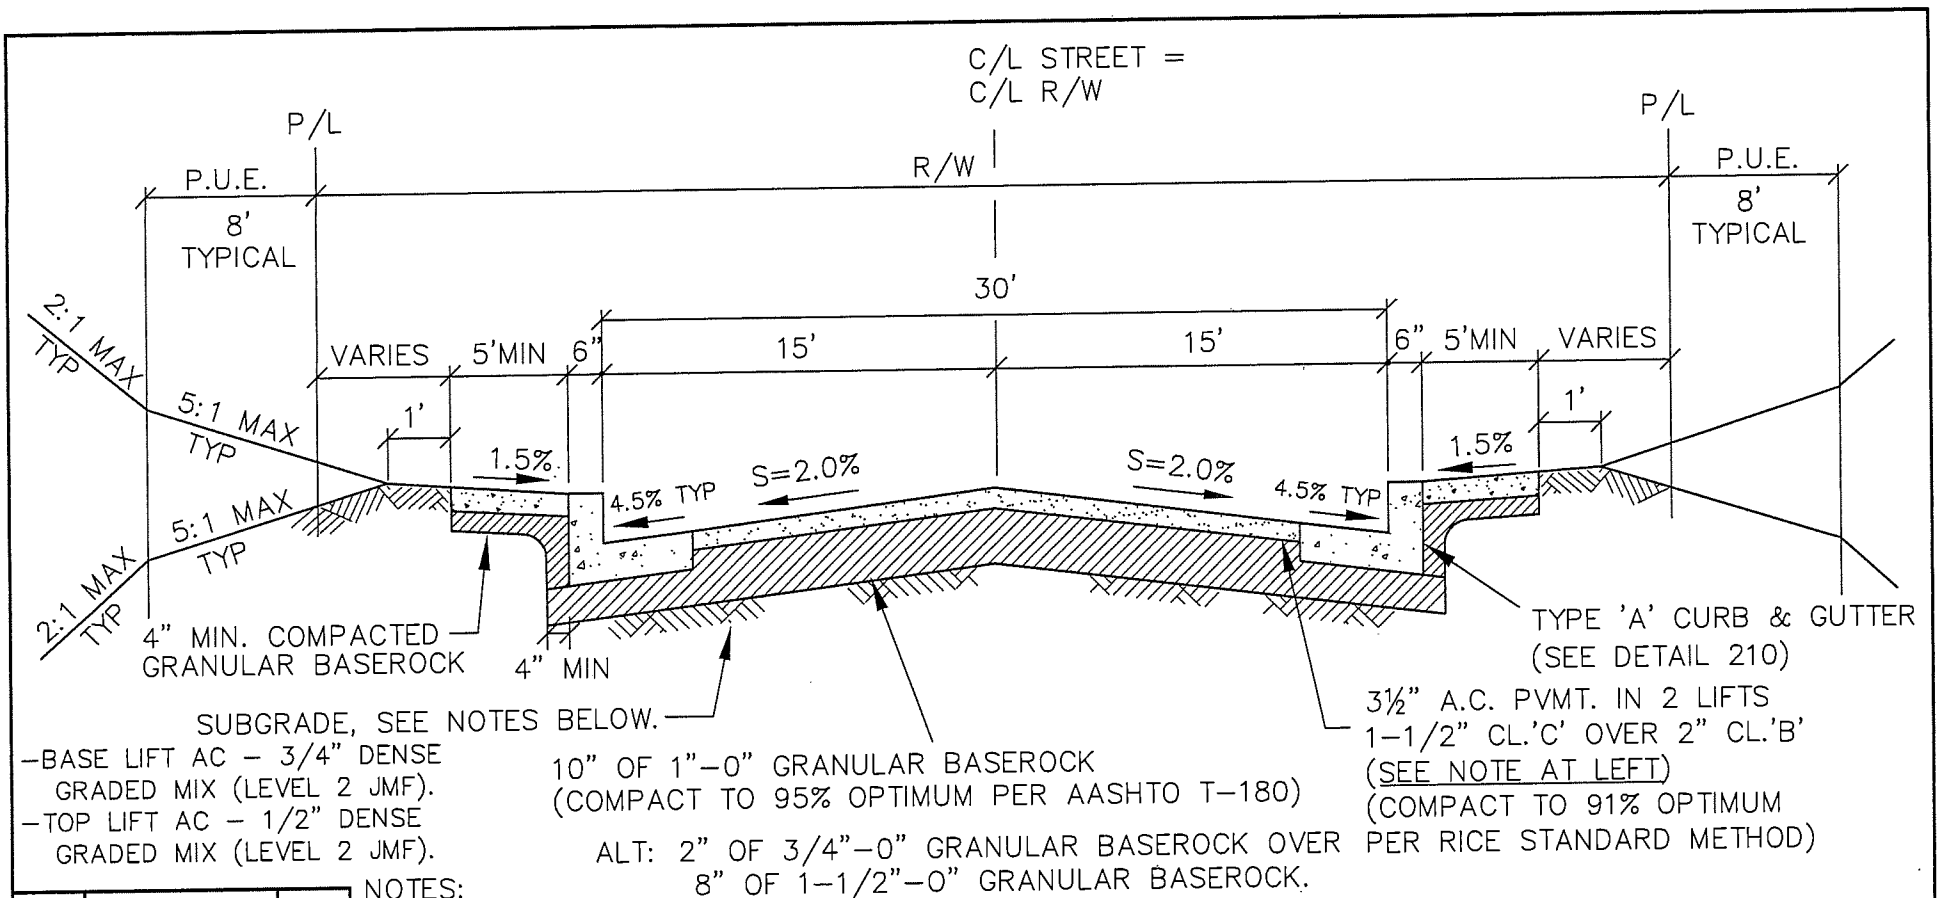

**NOTES:**

1. ALL DESIGN SUBGRADES SHALL BE COMPACTED AND PROOF-ROLLED PRIOR TO PLACEMENT OF BASEROCK. COMPACTION TESTING OF SUBGRADE MAY BE WAIVED AS OUTLINED UNDER NOTE 3.
2. IF SUBGRADE FAILS THE PROOF-ROLL, SUBGRADE SHALL BE OVEREXCAVATED TO UNDISTURBED SOIL AND BACKFILLED WITH BASEROCK OVER GEOTEXTILE REINFORCEMENT FABRIC (AS SPECIFIED) TO ALLOW COMPACTION OF UPPER (DESIGN) BASEROCK SECTION AND TO MAINTAIN STRUCTURAL INTEGRITY OF NATIVE SUBGRADE SOILS. TYPICAL MIN. OVEREXCAVATION REQUIRED IS 12-INCHES. NO RUBBER Tired EQUIPMENT ALLOWED ON SUBGRADE FOLLOWING OVEREXCAVATION.
3. IF SUBGRADE PASSES PROOF-ROLL BUT CANNOT BE COMPACTED TO 95% OPTIMUM DENSITY PER AASHTO T-180 (OR IF CONTRACTOR CHOOSES NOT TO TEST), GEOTEXTILE SEPARATION FABRIC (AS SPECIFIED) SHALL BE PLACED ON THE SUBGRADE PRIOR TO PLACEMENT OF THE BASEROCK.
4. REINFORCEMENT FABRIC (FOR USE W/OVEREXCAVATION): NON-WOVEN (MIRAFI 1000N, GEOTEX 1001, LINQ 250EX OR EQUAL), WOVEN (MIRAFI 550X, GEOTEX 250ST, LINQ GTF250 OR EQUAL).  
SEPARATION FABRIC: NON-WOVEN (MIRAFI 160N, GEOTEX 601, LINQ 150EX OR EQUAL), WOVEN (MIRAFI 500X, GEOTEX 200ST, LINQ GTF200 OR EQUAL).

DAYTON, OR	30' RESIDENTIAL STREET (LOCAL 1 CLASS) MINIMUM SECTION (NTS)	LAST REVISION DATE: AUG 2019
		COPYRIGHT 1998 WEBTECH ENGINEERING, INC.
DETAIL NO.		201-1

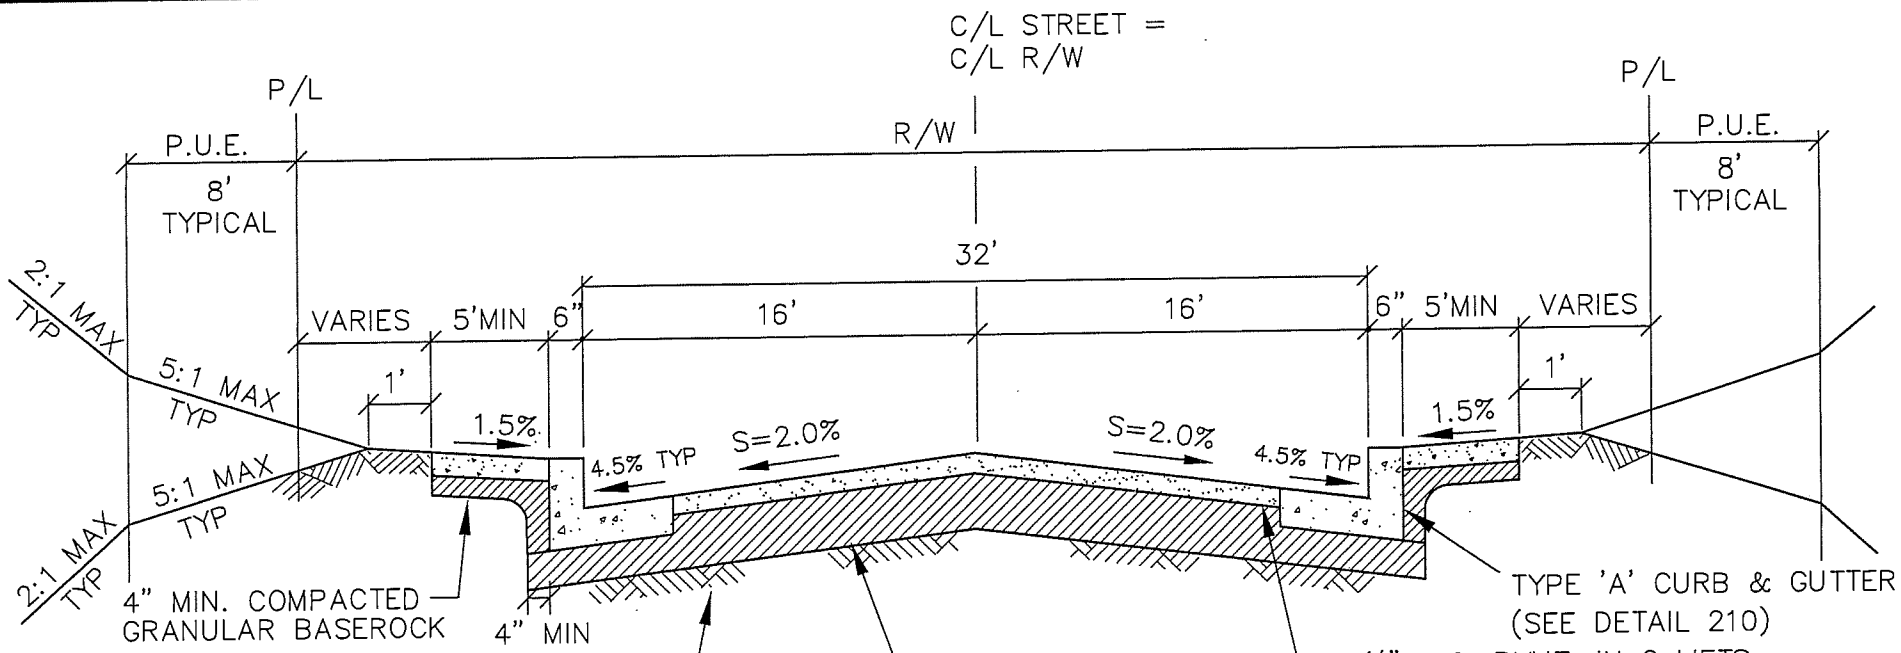


-BASE LIFT AC - 3/4" DENSE GRADED MIX (LEVEL 2 JMF).  
 -TOP LIFT AC - 1/2" DENSE GRADED MIX (LEVEL 2 JMF).  
 10" OF 1"-0" GRANULAR BASEROCK (COMPACT TO 95% OPTIMUM PER AASHTO T-180)  
 ALT: 2" OF 3/4"-0" GRANULAR BASEROCK OVER PER RICE STANDARD METHOD  
 8" OF 1-1/2"-0" GRANULAR BASEROCK.

**NOTES:**

1. ALL DESIGN SUBGRADES SHALL BE COMPACTED AND PROOF-ROLLED PRIOR TO PLACEMENT OF BASEROCK. COMPACTION TESTING OF SUBGRADE MAY BE WAIVED AS OUTLINED UNDER NOTE 3.
2. IF SUBGRADE FAILS THE PROOF-ROLL, SUBGRADE SHALL BE OVEREXCAVATED TO UNDISTURBED SOIL AND BACKFILLED WITH BASEROCK OVER GEOTEXTILE REINFORCEMENT FABRIC (AS SPECIFIED) TO ALLOW COMPACTION OF UPPER (DESIGN) BASEROCK SECTION AND TO MAINTAIN STRUCTURAL INTEGRITY OF NATIVE SUBGRADE SOILS. TYPICAL MIN. OVEREXCAVATION REQUIRED IS 12-INCHES. NO RUBBER Tired EQUIPMENT ALLOWED ON SUBGRADE FOLLOWING OVEREXCAVATION.
3. IF SUBGRADE PASSES PROOF-ROLL BUT CANNOT BE COMPACTED TO 95% OPTIMUM DENSITY PER AASHTO T-180 (OR IF CONTRACTOR CHOOSES NOT TO TEST), GEOTEXTILE SEPARATION FABRIC (AS SPECIFIED) SHALL BE PLACED ON THE SUBGRADE PRIOR TO PLACEMENT OF THE BASEROCK.
4. REINFORCEMENT FABRIC (FOR USE W/OVEREXCAVATION): NON-WOVEN (MIRAFI 1000N, GEOTEX 1001, LINQ 250EX OR EQUAL), WOVEN (MIRAFI 550X, GEOTEX 250ST, LINQ GTF250 OR EQUAL).  
 SEPARATION FABRIC: NON-WOVEN (MIRAFI 160N, GEOTEX 601, LINQ 150EX OR EQUAL), WOVEN (MIRAFI 500X, GEOTEX 200ST, LINQ GTF200 OR EQUAL).


DAYTON, OR	32' RESIDENTIAL STREET (LOCAL II CLASS) MINIMUM SECTION (NTS)	LAST REVISION DATE: AUG 2019
		COPYRIGHT 1996 WESTECH ENGINEERING, INC.
DETAIL NO.		201-2

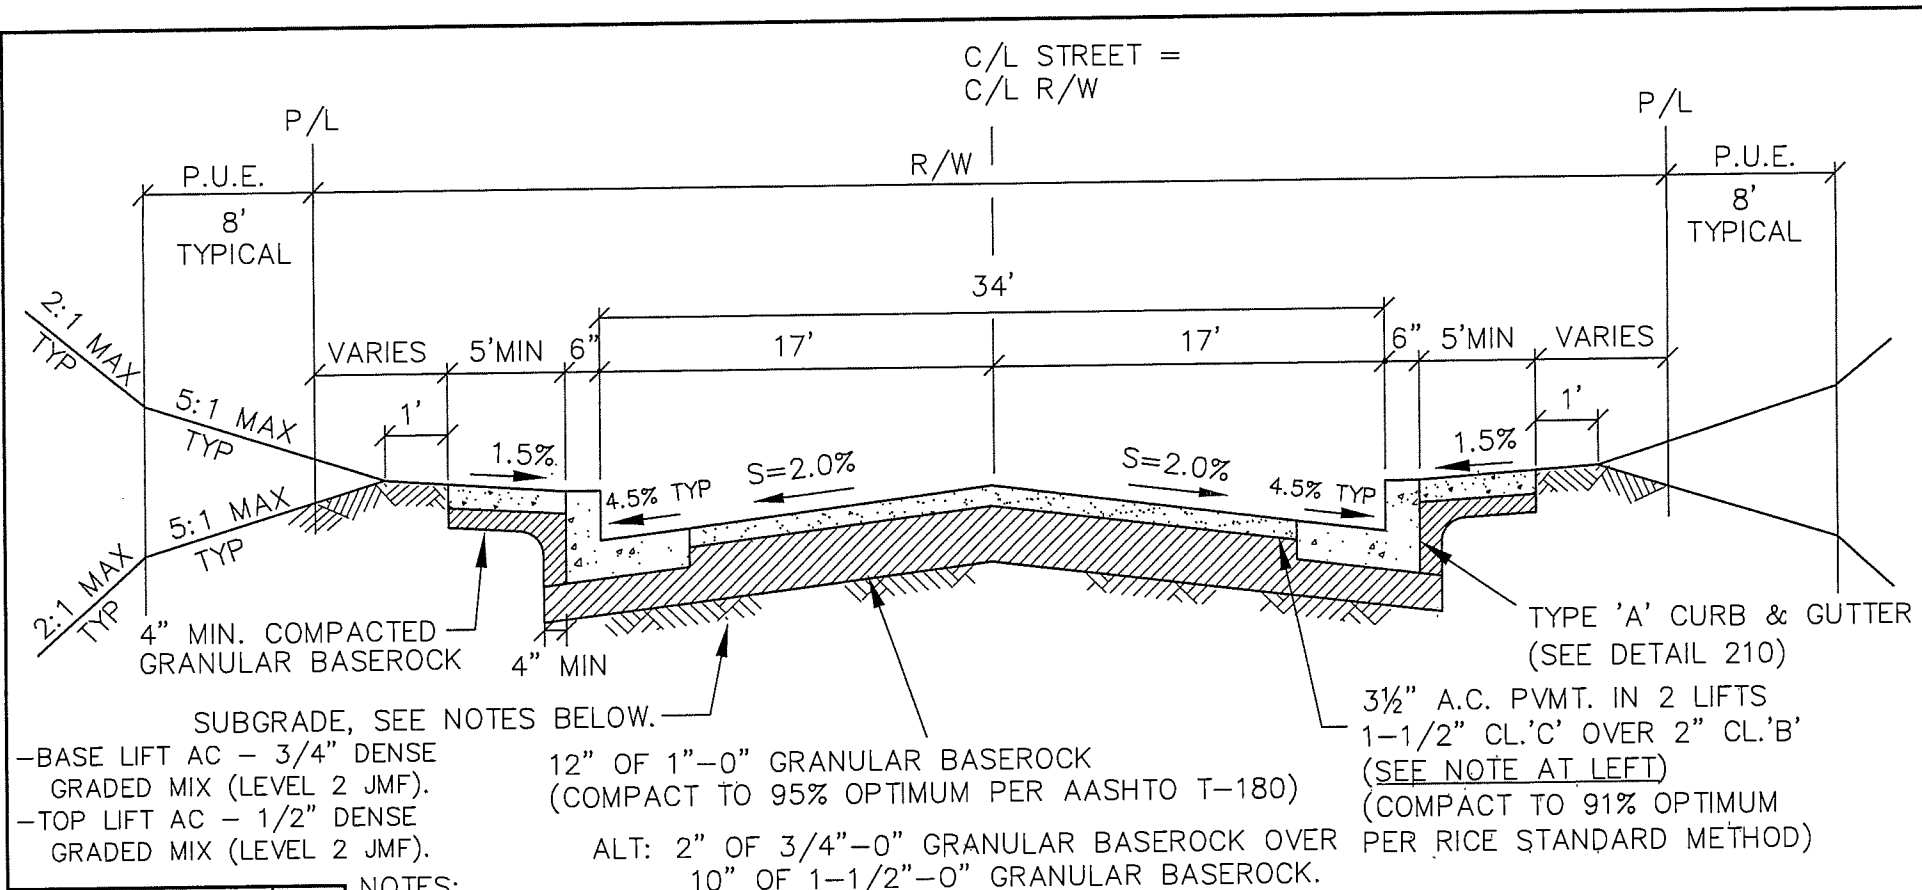

**NOTES:**

1. ALL DESIGN SUBGRADES SHALL BE COMPACTED AND PROOF-ROLLED PRIOR TO PLACEMENT OF BASEROCK. COMPACTION TESTING OF SUBGRADE MAY BE WAIVED AS OUTLINED UNDER NOTE 3.
2. IF SUBGRADE FAILS THE PROOF-ROLL, SUBGRADE SHALL BE OVEREXCAVATED TO UNDISTURBED SOIL AND BACKFILLED WITH BASEROCK OVER GEOTEXTILE REINFORCEMENT FABRIC (AS SPECIFIED) TO ALLOW COMPACTION OF UPPER (DESIGN) BASEROCK SECTION AND TO MAINTAIN STRUCTURAL INTEGRITY OF NATIVE SUBGRADE SOILS. TYPICAL MIN. OVEREXCAVATION REQUIRED IS 12-INCHES. NO RUBBER TIRED EQUIPMENT ALLOWED ON SUBGRADE FOLLOWING OVEREXCAVATION.
3. IF SUBGRADE PASSES PROOF-ROLL BUT CANNOT BE COMPACTED TO 95% OPTIMUM DENSITY PER AASHTO T-180 (OR IF CONTRACTOR CHOOSES NOT TO TEST), GEOTEXTILE SEPARATION FABRIC (AS SPECIFIED) SHALL BE PLACED ON THE SUBGRADE PRIOR TO PLACEMENT OF THE BASEROCK.
4. REINFORCEMENT FABRIC (FOR USE W/OVEREXCAVATION): NON-WOVEN (MIRAFI 1000N, GEOTEX 1001, LINQ 250EX OR EQUAL), WOVEN (MIRAFI 550X, GEOTEX 250ST, LINQ GTF250 OR EQUAL).  
SEPARATION FABRIC: NON-WOVEN (MIRAFI 160N, GEOTEX 601, LINQ 150EX OR EQUAL), WOVEN (MIRAFI 500X, GEOTEX 200ST, LINQ GTF200 OR EQUAL).

DAYTON, OR	(NTS)	LAST REVISION DATE:	COPYRIGHT 1998 WEBBACH ENGINEERING, INC.
		AUG 2019	
34' RESIDENTIAL STREET (LOCAL III CLASS) MINIMUM SECTION			
DETAIL NO.			
201-3			

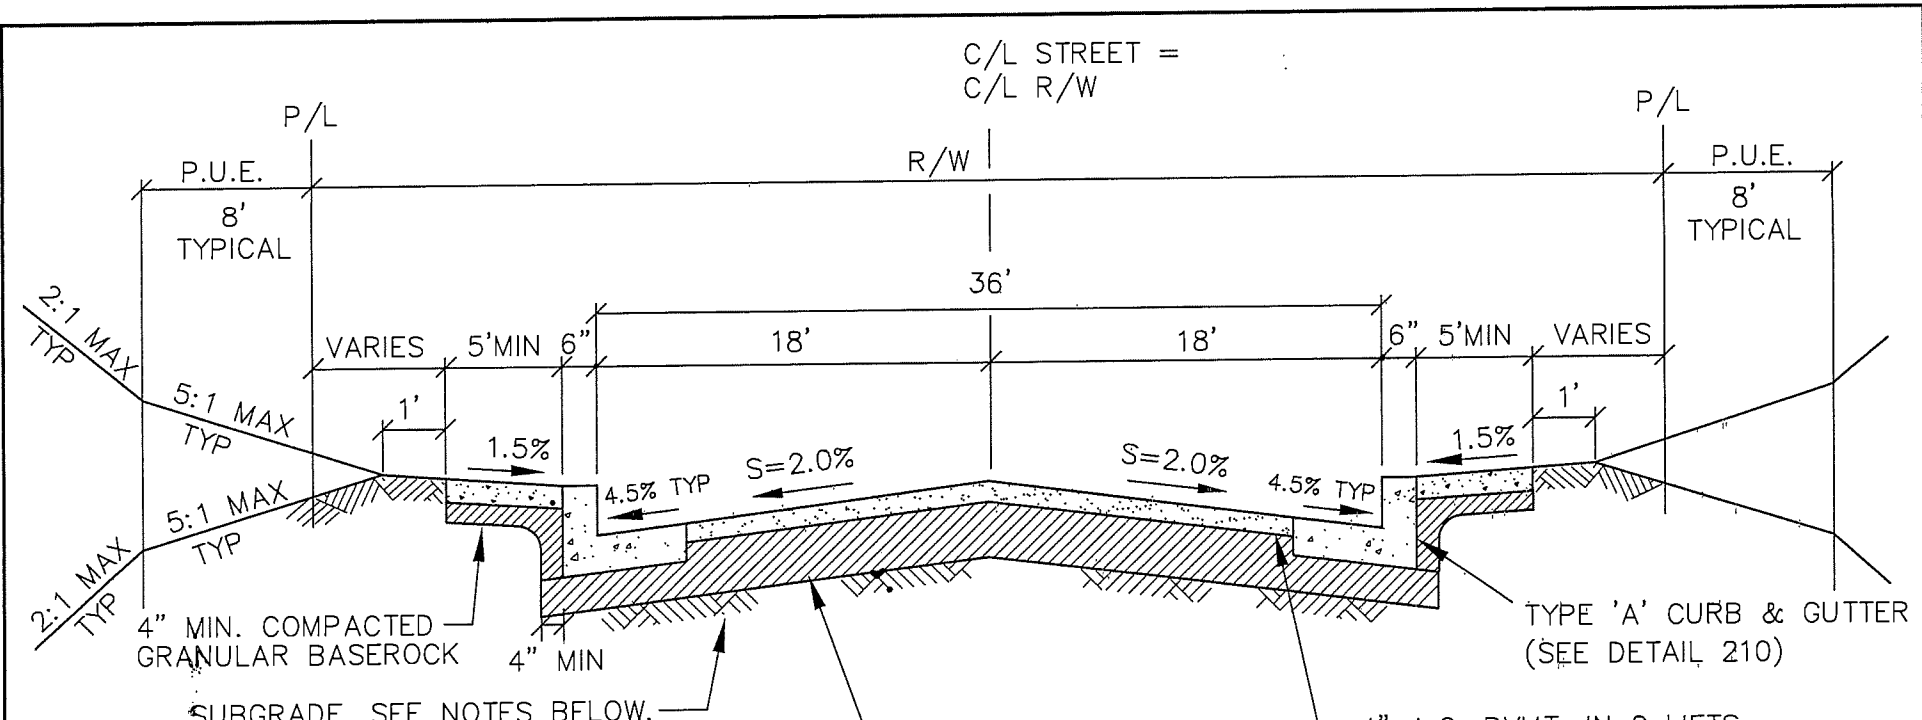


-BASE LIFT AC - 3/4" DENSE GRADED MIX (LEVEL 3 JMF).  
 -TOP LIFT AC - 1/2" DENSE GRADED MIX (LEVEL 3 JMF).  
 ALT: 2" OF 3/4"-0" GRANULAR BASEROCK OVER 10" OF 1-1/2"-0" GRANULAR BASEROCK.

- NOTES:**
1. ALL DESIGN SUBGRADES SHALL BE COMPACTED AND PROOF-ROLLED PRIOR TO PLACEMENT OF BASEROCK. COMPACTION TESTING OF SUBGRADE MAY BE WAIVED AS OUTLINED UNDER NOTE 3.
  2. IF SUBGRADE FAILS THE PROOF-ROLL, SUBGRADE SHALL BE OVEREXCAVATED TO UNDISTURBED SOIL AND BACKFILLED WITH BASEROCK OVER GEOTEXTILE REINFORCEMENT FABRIC (AS SPECIFIED) TO ALLOW COMPACTION OF UPPER (DESIGN) BASEROCK SECTION AND TO MAINTAIN STRUCTURAL INTEGRITY OF NATIVE SUBGRADE SOILS. TYPICAL MIN. OVEREXCAVATION REQUIRED IS 12-INCHES. NO RUBBER TIRED EQUIPMENT ALLOWED ON SUBGRADE FOLLOWING OVEREXCAVATION.
  3. IF SUBGRADE PASSES PROOF-ROLL BUT CANNOT BE COMPACTED TO 95% OPTIMUM DENSITY PER AASHTO T-180 (OR IF CONTRACTOR CHOOSES NOT TO TEST), GEOTEXTILE SEPARATION FABRIC (AS SPECIFIED) SHALL BE PLACED ON THE SUBGRADE PRIOR TO PLACEMENT OF THE BASEROCK.
  4. REINFORCEMENT FABRIC (FOR USE W/OVEREXCAVATION): NON-WOVEN (MIRAFI 1000N, GEOTEX 1001, LINQ 250EX OR EQUAL), WOVEN (MIRAFI 550X, GEOTEX 250ST, LINQ GTF250 OR EQUAL).  
SEPARATION FABRIC: NON-WOVEN (MIRAFI 160N, GEOTEX 601, LINQ 150EX OR EQUAL), WOVEN (MIRAFI 500X, GEOTEX 200ST, LINQ GTF200 OR EQUAL).

DAYTON, OR	36' COLLECTOR STREET 36' COMMERCIAL STREET MINIMUM SECTION (NTS)	LAST REVISION DATE: AUG 2019
		COPYRIGHT 1986 WESTECH ENGINEERING, INC.
DETAIL NO.		202

C/L STREET = TC RIGHT - --- = TC LEFT  
 C/L R/W = TC RIGHT - --- = CROWN

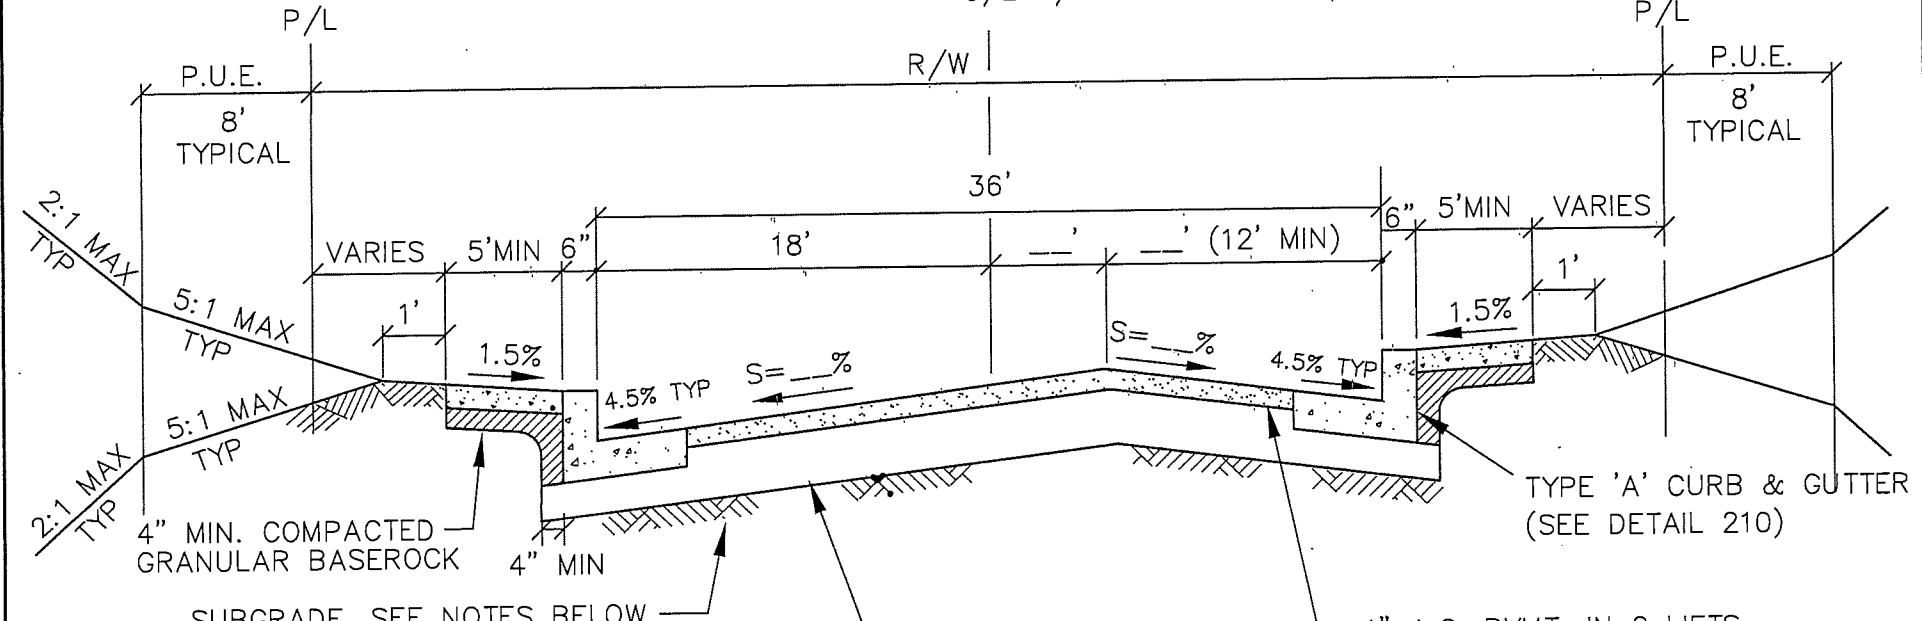

SUBGRADE, SEE NOTES BELOW.

-BASE LIFT AC - 3/4" DENSE GRADED MIX (LEVEL 3 JMF).  
 -TOP LIFT AC - 1/2" DENSE GRADED MIX (LEVEL 3 JMF).


12" OF 1"-0" GRANULAR BASEROCK (COMPACT TO 95% OPTIMUM PER AASHTO T-180)

ALT: 2" OF 3/4"-0" GRANULAR BASEROCK OVER 10" OF 1-1/2"-0" GRANULAR BASEROCK.

4" A.C. PVMT. IN 2 LIFTS  
 2" CL.'C' OVER 2" CL.'B'  
 (SEE NOTE AT LEFT)  
 (COMPACT TO 91% OPTIMUM PER RICE STANDARD METHOD)

- NOTES:
1. ALL DESIGN SUBGRADES SHALL BE COMPACTED AND PROOF-ROLLED PRIOR TO PLACEMENT OF BASEROCK. COMPACTION TESTING OF SUBGRADE MAY BE WAIVED AS OUTLINED UNDER NOTE 3.
  2. IF SUBGRADE FAILS THE PROOF-ROLL, SUBGRADE SHALL BE OVEREXCAVATED TO UNDISTURBED SOIL AND BACKFILLED WITH BASEROCK OVER GEOTEXTILE REINFORCEMENT FABRIC (AS SPECIFIED) TO ALLOW COMPACTION OF UPPER (DESIGN) BASEROCK SECTION AND TO MAINTAIN STRUCTURAL INTEGRITY OF NATIVE SUBGRADE SOILS. TYPICAL MIN. OVEREXCAVATION REQUIRED IS 12-INCHES. NO RUBBER TIRED EQUIPMENT ALLOWED ON SUBGRADE FOLLOWING OVEREXCAVATION.
  3. IF SUBGRADE PASSES PROOF-ROLL BUT CANNOT BE COMPACTED TO 95% OPTIMUM DENSITY PER AASHTO T-180 (OR IF CONTRACTOR CHOOSES NOT TO TEST), GEOTEXTILE SEPARATION FABRIC (AS SPECIFIED) SHALL BE PLACED ON THE SUBGRADE PRIOR TO PLACEMENT OF THE BASEROCK.
  4. REINFORCEMENT FABRIC (FOR USE W/OVEREXCAVATION): NON-WOVEN (MIRAFI 1000N, GEOTEX 1001, LINQ 250EX OR EQUAL), WOVEN (MIRAFI 550X, GEOTEX 250ST, LINQ GTF250 OR EQUAL).  
 SEPARATION FABRIC: NON-WOVEN (MIRAFI 160N, GEOTEX 601, LINQ 150EX OR EQUAL), WOVEN (MIRAFI 500X, GEOTEX 200ST, LINQ GTF200 OR EQUAL).

DAYTON, OR	36' COLLECTOR STREET OFFSET CROWN MINIMUM SECTION (NTS)	LAST REVISION DATE: AUG 2019	COPYRIGHT 1998 WESTECH ENGINEERING, INC.
		DETAIL NO. 202-1	

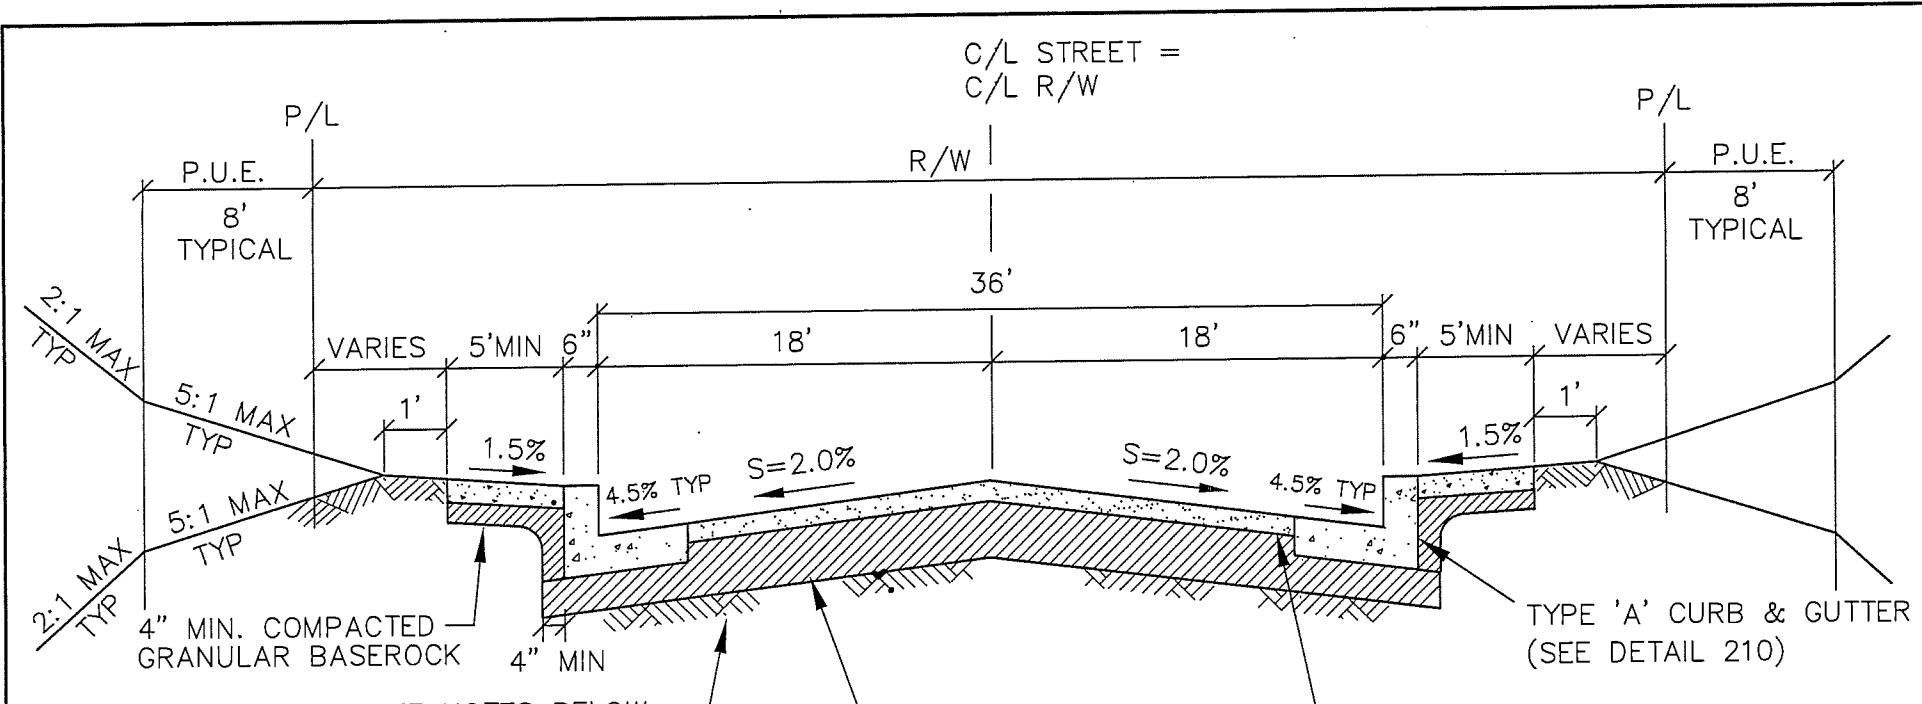

4" MIN. COMPACTED GRANULAR BASEROCK

SUBGRADE, SEE NOTES BELOW.


4" A.C. PVMT. IN 2 LIFTS  
2" CL.'C' OVER 2" CL.'B'  
(SEE NOTE AT LEFT)  
(COMPACT TO 91% OPTIMUM PER RICE STANDARD METHOD)

TYPE 'A' CURB & GUTTER (SEE DETAIL 210)

NOTE: ALT: 2" OF 3/4"-0" GRANULAR BASEROCK OVER 13" OF 1-1/2"-0" GRANULAR BASEROCK.

DAYTON, OR	MINIMUM SECTION (NTS)	36' INDUSTRIAL STREET	LAST REVISION DATE: AUG 2019
			COPYRIGHT 1998 WESTECH ENGINEERING, INC.
DETAIL NO.			
203			

- NOTES:
1. ALL DESIGN SUBGRADES SHALL BE COMPACTED AND PROOF-ROLLED PRIOR TO PLACEMENT OF BASEROCK. COMPACTION TESTING OF SUBGRADE MAY BE WAIVED AS OUTLINED UNDER NOTE 3.
  2. IF SUBGRADE FAILS THE PROOF-ROLL, SUBGRADE SHALL BE OVEREXCAVATED TO UNDISTURBED SOIL AND BACKFILLED WITH BASEROCK OVER GEOTEXTILE REINFORCEMENT FABRIC (AS SPECIFIED) TO ALLOW COMPACTION OF UPPER (DESIGN) BASEROCK SECTION AND TO MAINTAIN STRUCTURAL INTEGRITY OF NATIVE SUBGRADE SOILS. TYPICAL MIN. OVEREXCAVATION REQUIRED IS 12-INCHES. NO RUBBER TIRED EQUIPMENT ALLOWED ON SUBGRADE FOLLOWING OVEREXCAVATION.
  3. IF SUBGRADE PASSES PROOF-ROLL BUT CANNOT BE COMPACTED TO 95% OPTIMUM DENSITY PER AASHTO T-180 (OR IF CONTRACTOR CHOOSES NOT TO TEST), GEOTEXTILE SEPARATION FABRIC (AS SPECIFIED) SHALL BE PLACED ON THE SUBGRADE PRIOR TO PLACEMENT OF THE BASEROCK.
  4. REINFORCEMENT FABRIC (FOR USE W/OVEREXCAVATION): NON-WOVEN (MIRAFI 1000N, GEOTEX 1001, LINQ 250EX OR EQUAL), WOVEN (MIRAFI 550X, GEOTEX 250ST, LINQ GTF250 OR EQUAL).  
SEPARATION FABRIC: NON-WOVEN (MIRAFI 160N, GEOTEX 601, LINQ 150EX OR EQUAL), WOVEN (MIRAFI 500X, GEOTEX 200ST, LINQ GTF200 OR EQUAL).

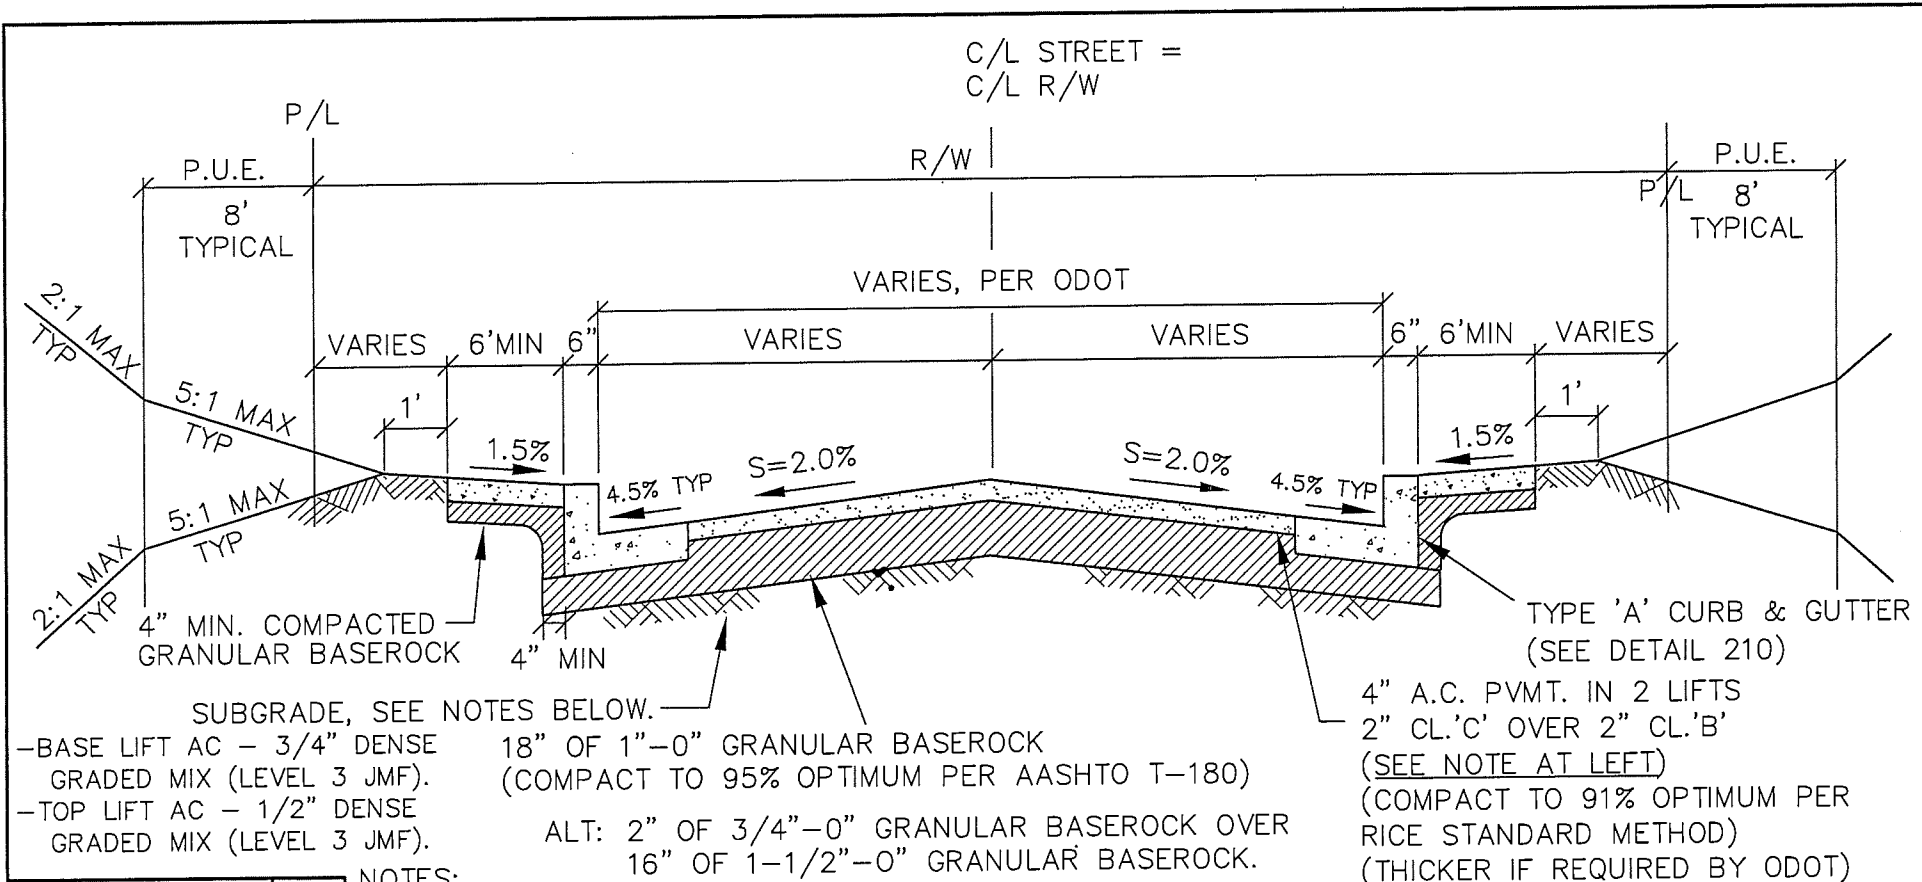


**NOTES:**

1. ALL DESIGN SUBGRADES SHALL BE COMPACTED AND PROOF-ROLLED PRIOR TO PLACEMENT OF BASEROCK. COMPACTION TESTING OF SUBGRADE MAY BE WAIVED AS OUTLINED UNDER NOTE 3.
2. IF SUBGRADE FAILS THE PROOF-ROLL, SUBGRADE SHALL BE OVEREXCAVATED TO UNDISTURBED SOIL AND BACKFILLED WITH BASEROCK OVER GEOTEXTILE REINFORCEMENT FABRIC (AS SPECIFIED) TO ALLOW COMPACTION OF UPPER (DESIGN) BASEROCK SECTION AND TO MAINTAIN STRUCTURAL INTEGRITY OF NATIVE SUBGRADE SOILS. TYPICAL MIN. OVEREXCAVATION REQUIRED IS 12-INCHES. NO RUBBER TIRED EQUIPMENT ALLOWED ON SUBGRADE FOLLOWING OVEREXCAVATION.
3. IF SUBGRADE PASSES PROOF-ROLL BUT CANNOT BE COMPACTED TO 95% OPTIMUM DENSITY PER AASHTO T-180 (OR IF CONTRACTOR CHOOSES NOT TO TEST), GEOTEXTILE SEPARATION FABRIC (AS SPECIFIED) SHALL BE PLACED ON THE SUBGRADE PRIOR TO PLACEMENT OF THE BASEROCK.
4. REINFORCEMENT FABRIC (FOR USE W/OVEREXCAVATION): NON-WOVEN (MIRAFI 1000N, GEOTEX 1001, LINQ 250EX OR EQUAL), WOVEN (MIRAFI 550X, GEOTEX 250ST, LINQ GTF250 OR EQUAL).  
SEPARATION FABRIC: NON-WOVEN (MIRAFI 160N, GEOTEX 601, LINQ 150EX OR EQUAL), WOVEN (MIRAFI 500X, GEOTEX 200ST, LINQ GTF200 OR EQUAL).

DAYTON, OR	(NTS)	ARTERIAL STREET MINIMUM SECTION	LAST REVISION DATE: JAN 2024	COPYRIGHT 1998 WESTCOAST ENGINEERING, INC.
DETAIL NO.	204			



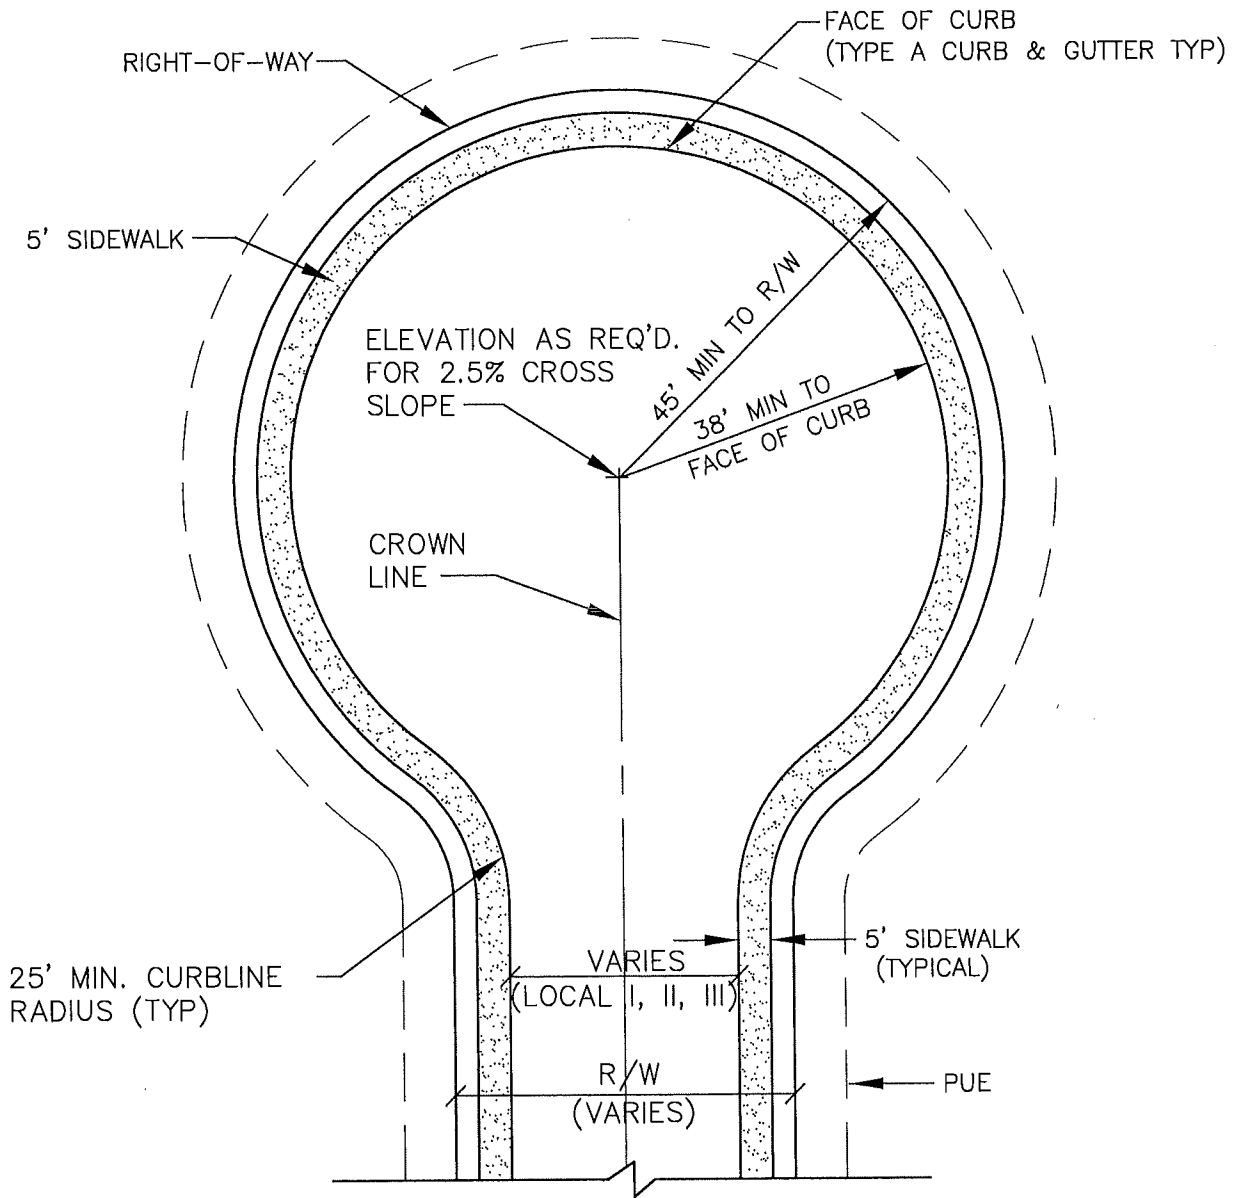

**NOTES:**

1. 2.5% MIN. CROSS SLOPE REQUIRED FROM CENTER OF BULB TO GUTTER.
2. MAINTAIN CROWN LINE TO CENTER OF CUL-DE-SAC BULB.

LAST REVISION DATE: DEC 2015	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>STANDARD CUL-DE-SAC (RESIDENTIAL)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 205

ELEVATION AS REQ'D.  
FOR 2.5% CROSS SLOPE

FACE OF CURB  
(TYPE A CURB & GUTTER TYP)

FACE OF CURB

SEE NOTE 3

38' MIN TO  
FACE OF CURB

45' MIN TO R/W

CROWN  
LINE

5' SIDEWALK  
(TYP)

25' MIN. CURBLINE  
RADIUS (TYP)

PUE

VARIES  
(LOCAL I, II, III)

R/W  
(VARIES)

**NOTES:**

1. 2.5% MIN. CROSS SLOPE REQUIRED FROM CENTER OF BULB TO GUTTER.
2. MAINTAIN CROWN LINE TO CENTER OF CUL-DE-SAC BULB.
3. OFFSET FROM ROADWAY CENTERLINE TO CENTER OF BULB = CURB RADIUS MINUS ONE-HALF STREET WIDTH.

LAST REVISION DATE: DEC 2015	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>OFFSET CUL-DE-SAC (RESIDENTIAL)</b> (NTS)	
DAYTON, OR	DETAIL NO. 206

CURB ELEVATIONS AS REQ'D.  
FOR 2% MIN CROSS SLOPE  
FROM CROWN LINE TO GUTTER  
PAN.

FACE OF CURB  
(TYPE A CURB & GUTTER TYP)

RIGHT-OF-WAY

25' MIN  
CURBLINE  
RADIUS  
(TYP)

45' MIN TO R/W  
36' MIN TO  
FACE OF CURB

CROWN LINE

25' TYP  
CURBLINE  
RADIUS

5' SIDEWALK (TYP)

VARIES


PUE

R/W VARIES


**NOTES:**

1. MAINTAIN CROWN LINE AROUND RADIUS OF CORNER AS SHOWN.
2. PROVIDE 2% MIN. CROSS SLOPE AS REQUIRED FROM CROWN LINE TO GUTTER.
3. PROVIDE CATCH BASIN IN EYEBROW CUL-DE-SAC IF REQUIRED FOR DRAINAGE COLLECTION.

LAST REVISION DATE: JAN 2024	JO #
<b>EYEBROW CUL-DE-SAC (RESIDENTIAL)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 207

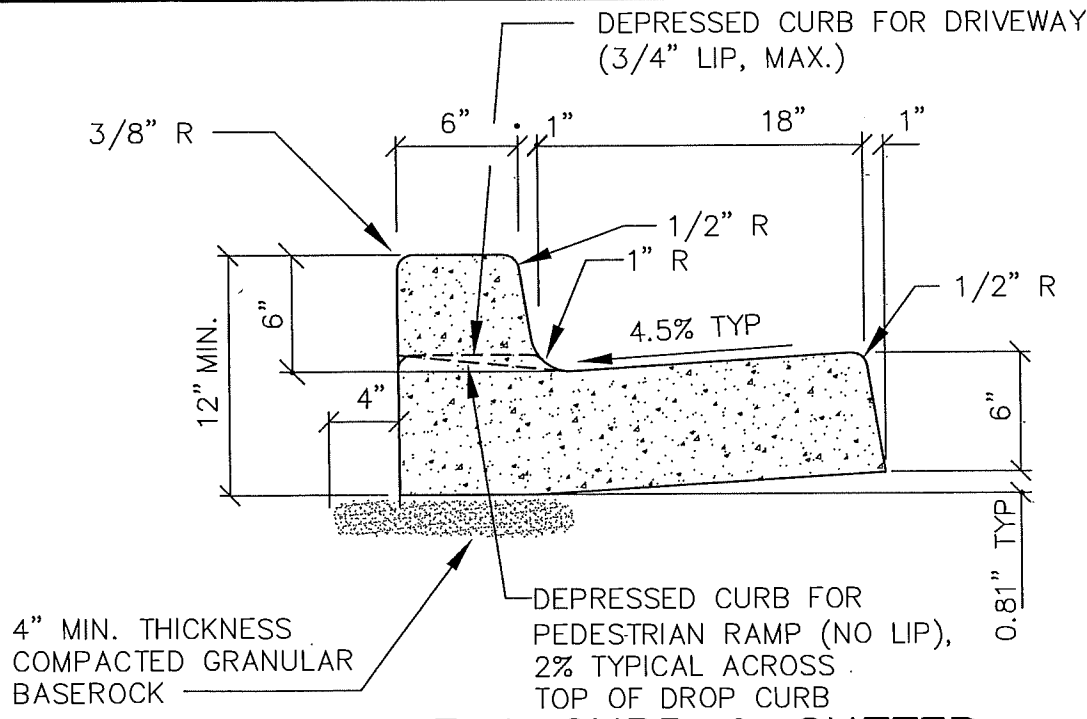

**TYPE A CURB & GUTTER**

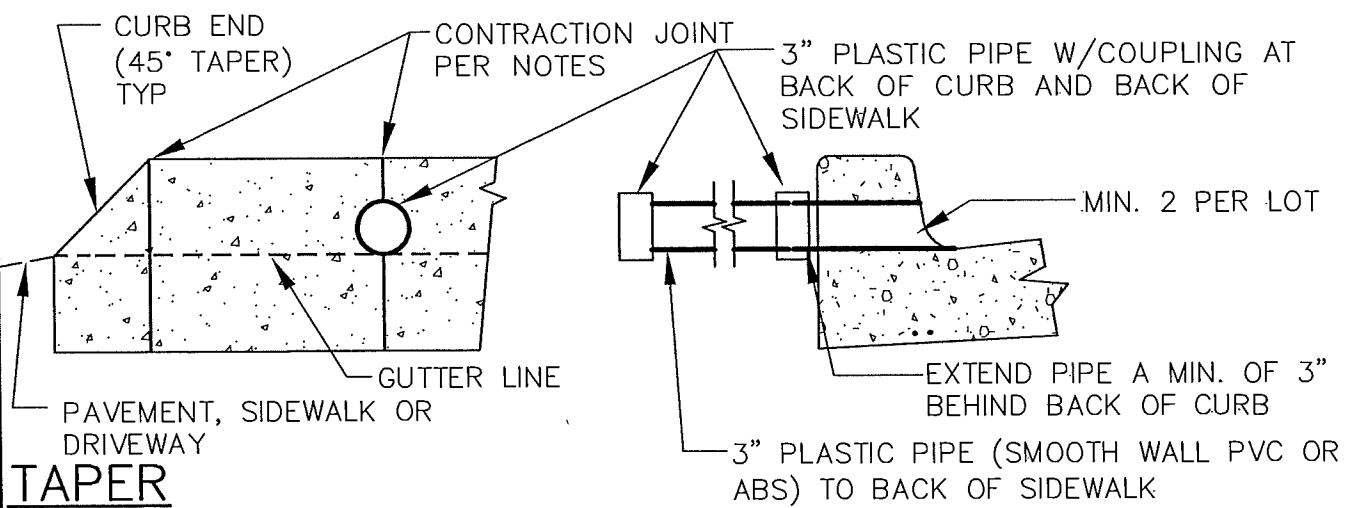


**WEEP HOLE THROUGH CURB**


**NOTES:**

1. CONTRACTION JOINTS SHALL BE PLACED AT 15' MAX INTERVALS, WITH AGGREGATE SEPARATION TO EXTEND AT LEAST 50% THROUGH THE CURB AND GUTTER.
2. A CONTRACTION JOINT SHALL BE PLACED ACROSS SIDEWALK OVER WEEP HOLE PIPE.
3. ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).
4. WHERE SIDEWALKS ARE TO BE CONSTRUCTED, EXTEND 3" PIPE TO BACK OF SIDEWALK LOCATION & INSTALL COUPLING AT END OF PIPE.
5. INSTALL AT LEAST 2 WEEP HOLES ON ALL LOTS. IN ADDITION TO WEEPHOLES AT DRIVEWAY WINGS, INSTALL ONE WEEPHOLE AT LOW POINT OF LOT, 5' MAX FROM P/L. ANY WEEPHOLES IN EXTG CURBS SHALL BE CORE DRILLED.
6. MONOLITHIC CURB & PUBLIC SIDEWALK OR DRIVEWAY APRON PLACEMENT IS NOT PERMITTED EXCEPT PED RAMPS (IE. CURB CONCRETE & SIDEWALK OR DRIVEWAY CONCRETE SHALL BE PLACED SEPARATELY).

LAST REVISION DATE: JAN 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>TYPE 'A' CURB AND GUTTER AND WEEP HOLE (NTS)</b>	
DAYTON, OR	DETAIL NO. 210

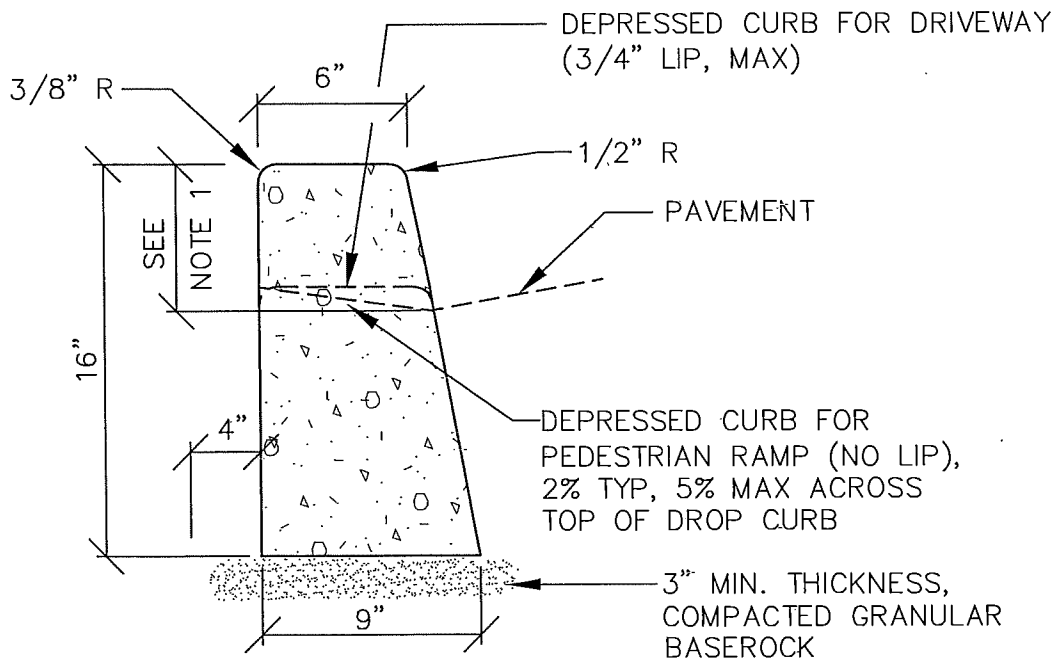

## TYPE 'C' (FULL HEIGHT) CURB

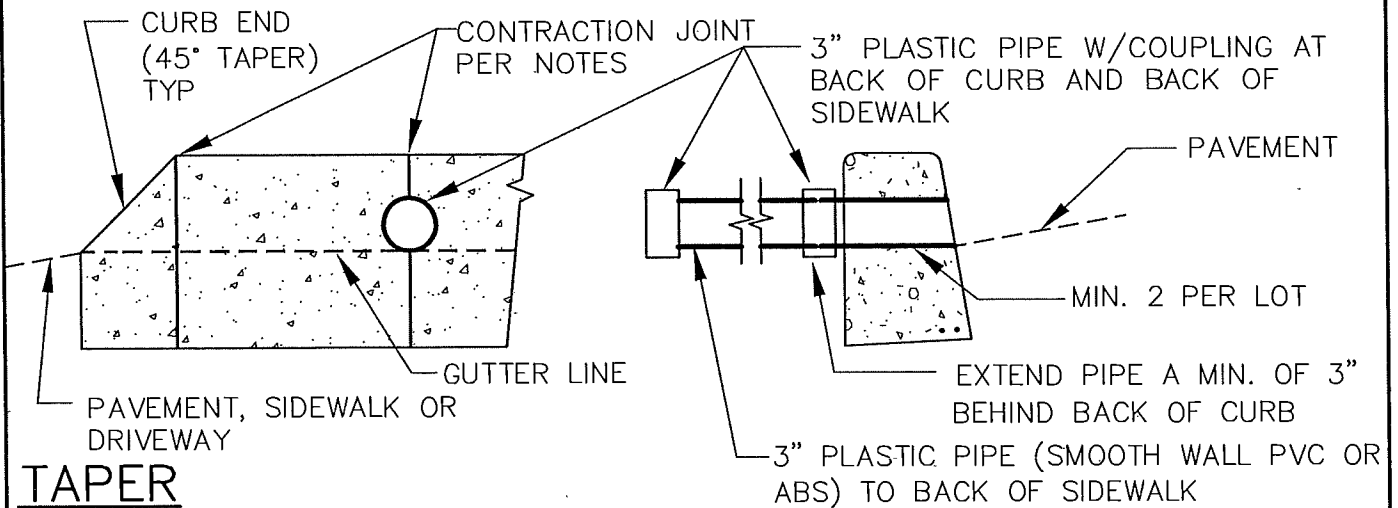

## TAPER

## WEEP HOLE THROUGH CURB

### NOTES

- 7" CURB EXPOSURE FOR ARTERIAL & COLLECTOR STREETS TYP WHERE TYPE C CURB IS ALLOWED. 6" EXPOSURE OTHER PUBLIC STREETS, PRIVATE STREETS & PARKING LOTS.
- CONTRACTION JOINTS SHALL BE PLACED AT 15' MAX INTERVALS, WITH AGGREGATE SEPARATION TO EXTEND AT LEAST 50% THROUGH THE CURB.
- A CONTRACTION JOINT SHALL BE PLACED ACROSS SIDEWALK OVER WEEP HOLE PIPE.
- ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR ( $\pm 1.5\%$ ).
- WHERE SIDEWALKS ARE TO BE CONSTRUCTED, EXTEND 3" PIPE TO BACK OF SIDEWALK LOCATION & INSTALL COUPLING AT END OF PIPE.
- INSTALL AT LEAST 2 WEEP HOLES ON ALL LOTS. IN ADDITION TO WEEPHOLES AT DRIVEWAY WINGS, INSTALL ONE WEEPHOLE AT LOW POINT OF LOT, 5' MAX FROM P/L. ANY WEEPHOLES IN EXTG CURBS SHALL BE CORE DRILLED.
- MONOLITHIC CURB & PUBLIC SIDEWALK OR DRIVEWAY APRON PLACEMENT IS NOT PERMITTED EXCEPT PED RAMPS (IE. CURB CONCRETE & SIDEWALK OR DRIVEWAY CONCRETE SHALL BE PLACED SEPARATELY).**

LAST REVISION DATE:

JAN 2024

COPYRIGHT 1996  
WESTECH ENGINEERING, INC.

## TYPE 'C' CURB AND WEEP HOLE

(NTS)


DETAIL NO.

DAYTON, OR

211


TOOLED CONTRACTION JOINTS TYP AT 5' SPACING (UNLESS NOTED OTHERWISE).

**(BROOM FINISH, NO SLICKS)**

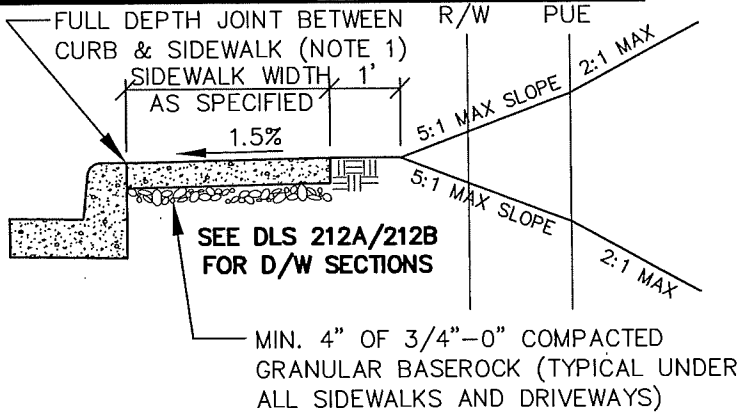


**TYP. S/W CROSS SECTION**

UTILITY POLE OR FIRE HYDRANT WHERE PRE-APPROVED BY CITY.

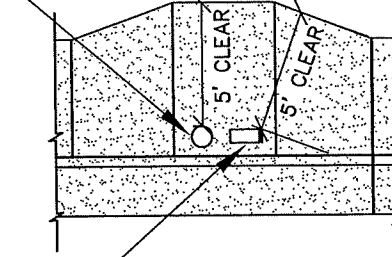

NON-CBU MAILBOXES (PRE-EXISTING MAILBOXES ONLY W/POST OFFICE APPROVAL, ON GALV. POSTS)




MULTI-BOX



SINGLE-BOX

**S/W AT OBSTRUCTION**

2' MIN. APRON OFFSET FROM PROPERTY CORNER

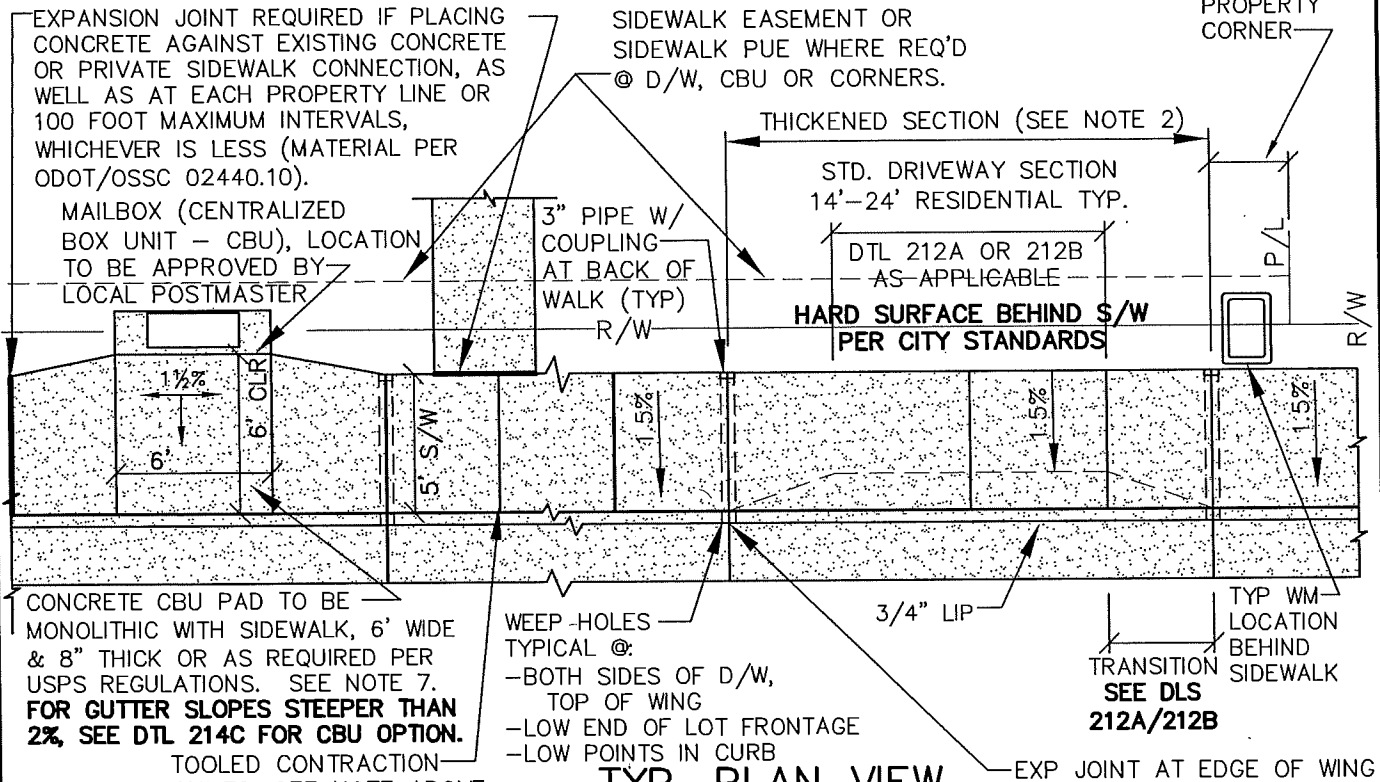

**TYP. PLAN VIEW**


**NOTES:**

1. MONOLITHIC PLACEMENT OF CONCRETE FOR STREET CURB & PARALLEL PUBLIC SIDEWALK IS PROHIBITED.
2. CONCRETE THICKNESS. 4" MIN. CONCRETE THICKNESS FOR STANDARD SIDEWALKS. 6" MIN CONCRETE THICKNESS THROUGH RESIDENTIAL DRIVEWAYS (INCLUDING WINGS). 8" MIN CONCRETE THICKNESS THROUGH COMMERCIAL/INDUSTRIAL/MULTI-FAMILY DRIVEWAYS & ALLEY APPROACHES.
3. SIDEWALKS ≥8' SHALL HAVE A LONGITUDINAL CONTRACTION JOINT AT MIDPOINT (OR 5 MAX OC IF WIDER)
4. CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).
5. PCC APRONS JOINTED TO MATCH SIDEWALK PATTERN.
6. SIDEWALKS SHALL BE LOCATED ENTIRELY WITHIN PUBLIC R/W OR PUBLIC EASEMENTS, INCLUDING AT DRIVEWAYS & INTERSECTIONS.
7. ADA ACCESS TO CBU MAILBOXES SHALL CONFORM WITH SECTION 1111 OF OSSC (OREGON STRUCTURAL SPECIALTY CODE), INCLUDING AN ADA PEDESTRIAN CURB RAMP LOCATED WITHIN 50 FEET OF THE CBU. PROWAG REQUIRED 6'x6' TURNING SPACE IN FRONT OF CBU SHALL NOT EXCEED 2% IN ANY DIRECTION. **CBU LAYOUT SHOWN ABOVE ASSUMES STREET & CURB GRADE DOES NOT EXCEED 2%.**

LAST REVISION DATE: MAR 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>CURBLINE SIDEWALKS AND RESIDENTIAL DRIVEWAY APRONS</b> (NTS)	
DAYTON, OR	DETAIL NO. 212

SEE DETAIL 212 FOR STANDARD MAILBOX LOCATION, MOUNTING DETAILS & INFORMATION.

TOOLED CONTRACTION JOINTS TYPICAL AT 5' INTERVALS, UNLESS NOTED OTHERWISE.  
**(BROOM FINISH, NO SLICKS)**

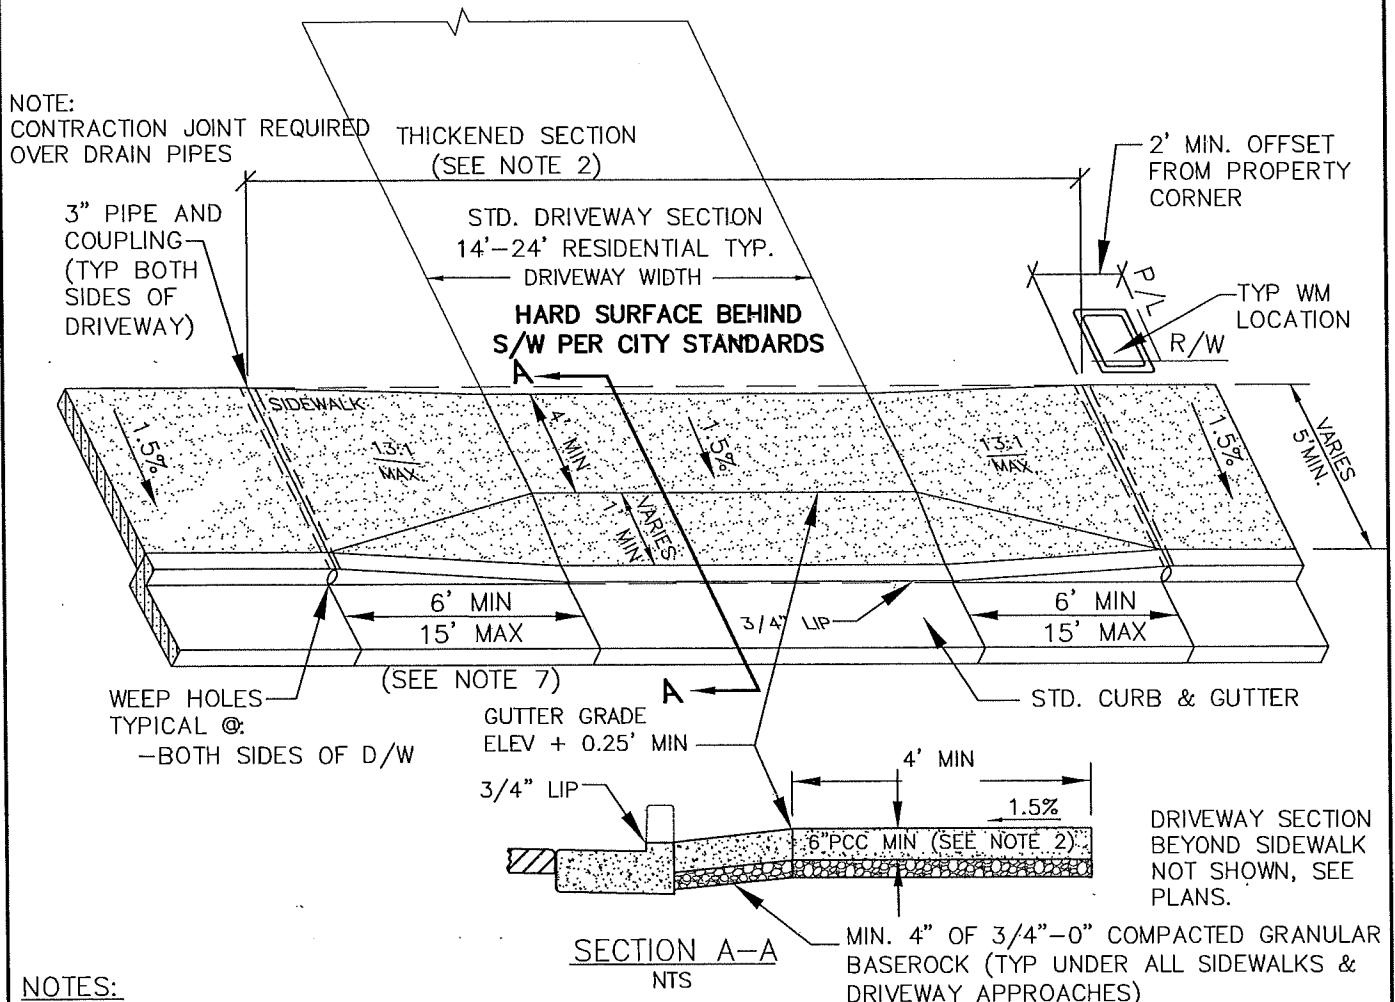

**NOTES:**

1. SEE DETAIL 212 & 212A FOR STANDARD APRON & SIDEWALK DETAILS. **USE OF THIS DETAIL IS REQUIRED FOR ANY DRIVEWAY WHICH DROPS BELOW CURB ELEVATION (ADVERSE GRADE) UNLESS OTHERWISE SHOWN ON THE APPROVED DRAWINGS.**
2. **CONCRETE THICKNESS.** 4" MIN. CONCRETE THICKNESS FOR STANDARD SIDEWALKS. 6" MIN CONCRETE THICKNESS THROUGH RESIDENTIAL DRIVEWAYS (INCLUDING WINGS). 8" MIN CONCRETE THICKNESS THROUGH COMMERCIAL/INDUSTRIAL/MULTI-FAMILY DRIVEWAYS & ALLEY APPROACHES.
3. MONOLITHIC PLACEMENT OF CONCRETE FOR STREET CURB & PARALLEL PUBLIC SIDEWALK BEYOND DRIVEWAY APPROACH IS PROHIBITED.
4. PCC APRONS SHALL HAVE CONTRACTION JOINTS TO MATCH SIDEWALK PATTERN & D/W EDGE.
5. SIDEWALKS SHALL BE LOCATED ENTIRELY WITHIN RIGHT-OF-WAY OR SIDEWALK EASEMENTS, INCLUDING SIDEWALKS AT INTERSECTIONS.
6. CROSS SLOPE IS MEASURED FROM HORIZONTAL.
7. RUNNING SLOPE OF SIDEWALK AT TRANSITION DOWN TO DRIVEWAYS SHALL TYPICALLY NOT EXCEED 1V:13H (7.7%), BUT SHALL NOT REQUIRE THE LENGTH TO EXCEED 15 FEET.
8. CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).

LAST REVISION DATE:	
FEB 2024	
<b>RESIDENTIAL D/W APRON AT ADVERSE GRADE D/W'S CURBLINE SIDEWALK</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>212A</b>

SEE DETAIL 212 FOR STANDARD MAILBOX LOCATION, MOUNTING DETAILS & INFORMATION.

TOOLED CONTRACTION JOINTS TYPICAL AT 5' INTERVALS, UNLESS NOTED OTHERWISE.  
**(BROOM FINISH, NO SLICKS)**

NOTE:  
CONTRACTION JOINT  
REQUIRED OVER DRAIN  
PIPES

3" PIPE AND  
COUPLING  
(TYP BOTH  
SIDES OF  
DRIVEWAY)

THICKENED SECTION  
(SEE NOTE 2)


STD. DRIVEWAY SECTION  
14'-24' RESIDENTIAL TYP.

DRIVEWAY WIDTH

HARD SURFACE BEHIND  
S/W PER CITY STANDARDS

2' MIN. OFFSET  
FROM PROPERTY  
CORNER

TYP WM  
LOCATION

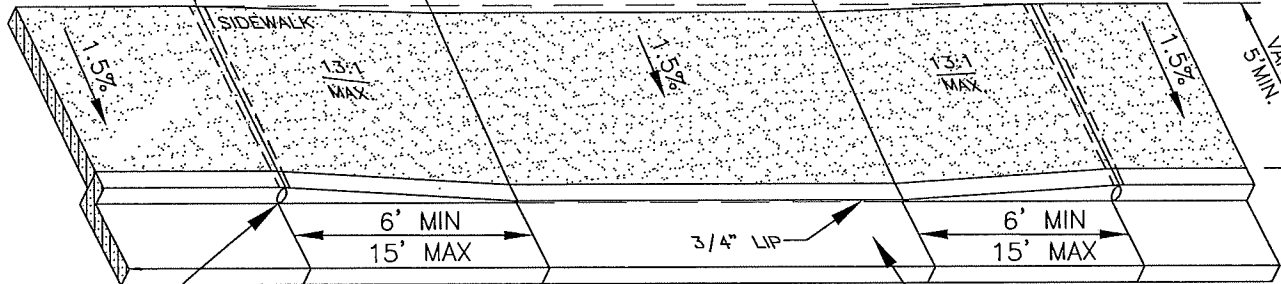

WEEP HOLES  
TYPICAL @:

- BOTH SIDES OF D/W, 1' MIN FROM TOP OF WING EACH SIDE
- LOW POINTS IN CURB/LOT FRONTAGE

**NOTES:**

1. SEE DETAIL 212 STANDARD SIDEWALK DETAIL. **USE OF THIS FULLY DEPRESSED DRIVEWAY DETAIL IS NOT ALLOWED FOR DRIVEWAYS WHICH DROP BELOW CURB ELEVATION (ADVERSE GRADE) UNLESS SPECIFICALLY APPROVED BY THE CITY (TYPICALLY BASED ON CATCH BASIN BEING PROVIDED WITHIN 75 FT UPHILL ALONG CURBLINE AND DRIVEWAY APRON NOT BEING LOCATED AT STREET LOW POINT).**
2. **CONCRETE THICKNESS.** 4" MIN. CONCRETE THICKNESS FOR STANDARD SIDEWALKS. 6" MIN CONCRETE THICKNESS THROUGH RESIDENTIAL DRIVEWAYS (INCLUDING WINGS). 8" MIN CONCRETE THICKNESS THROUGH COMMERCIAL/INDUSTRIAL/MULTI-FAMILY DRIVEWAYS & ALLEY APPROACHES.
3. MONOLITHIC PLACEMENT OF CONCRETE FOR STREET CURB & PARALLEL PUBLIC SIDEWALK BEYOND DRIVEWAY APPROACH IS PROHIBITED.
4. PCC APRONS SHALL HAVE CONTRACTION JOINTS TO MATCH SIDEWALK PATTERN & D/W EDGE.
5. SIDEWALKS SHALL BE LOCATED ENTIRELY WITHIN RIGHT-OF-WAY OR SIDEWALK EASEMENTS, INCLUDING SIDEWALKS AT INTERSECTIONS.
6. CROSS SLOPE IS MEASURED FROM HORIZONTAL.
7. RUNNING SLOPE OF SIDEWALK AT TRANSITION DOWN TO DRIVEWAYS SHALL TYPICALLY NOT EXCEED 1V:13H (7.7%), BUT SHALL NOT REQUIRE THE LENGTH TO EXCEED 15 FEET.
8. CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).

LAST REVISION DATE:

FEB 2024

**FULLY DEPRESSED D/W  
AT ALLEY OR POSITIVE GRADE  
D/W'S, CURBLINE SIDEWALK**

(NTS)

DETAIL NO.


DAYTON, OR

212B




TOOLED CONTRACTION JOINTS TYPICAL AT 5' INTERVALS (UNLESS NOTED OTHERWISE).  
**(BROOM FINISH. NO SLICKS)**

NOTE:  
 CONTRACTION JOINT  
 REQUIRED OVER  
 DRAIN PIPES

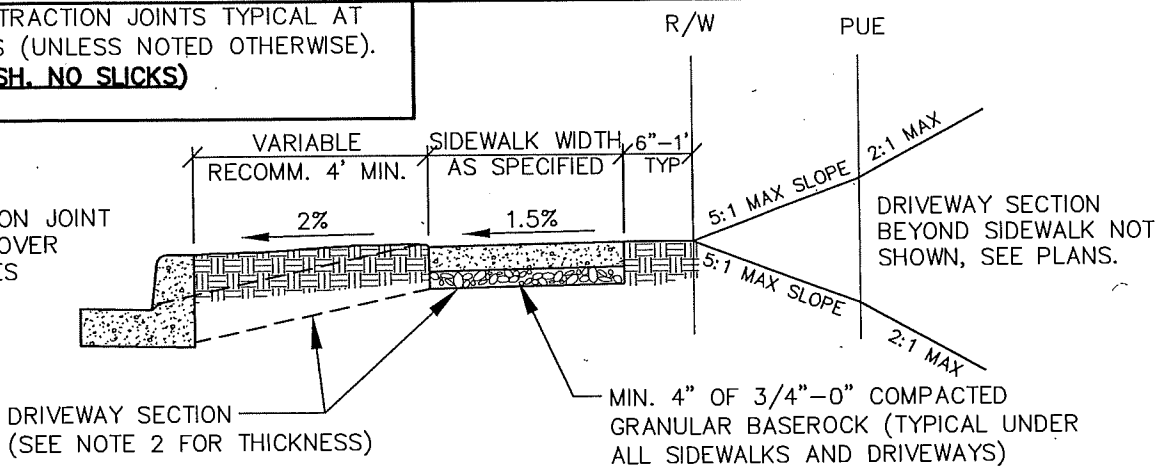

**TYP. CROSS SECTION**

EXPANSION JOINT REQUIRED IF PLACING CONCRETE AGAINST EXISTING CONCRETE OR PRIVATE SIDEWALK CONNECTION, AS WELL AS AT EACH PROPERTY LINE OR 100 FOOT MAXIMUM INTERVALS, WHICHEVER IS LESS (MATERIAL PER ODOT/OSSC 02440.10).

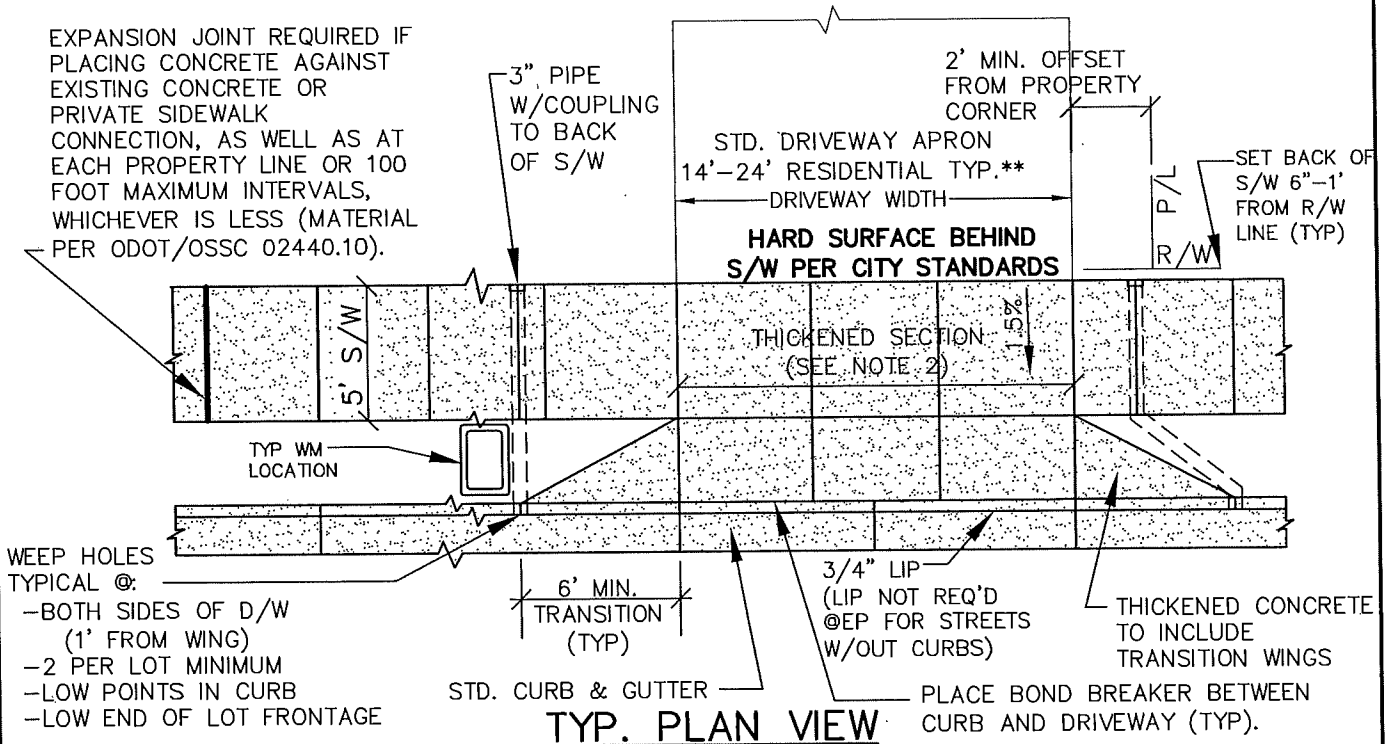


**TYP. PLAN VIEW**

**NOTES:**

1. MONOLITHIC PLACEMENT OF CONCRETE FOR STREET CURB & PARALLEL PUBLIC SIDEWALK IS PROHIBITED.
2. **CONCRETE THICKNESS.** 4" MIN. CONCRETE THICKNESS FOR STANDARD SIDEWALKS. 6" MIN CONCRETE THICKNESS THROUGH RESIDENTIAL DRIVEWAYS (INCLUDING WINGS). 8" MIN CONCRETE THICKNESS THROUGH COMMERCIAL/INDUSTRIAL/MULTI-FAMILY DRIVEWAYS & ALLEY APPROACH.
3. SIDEWALKS 8' & WIDER SHALL HAVE A LONGITUDINAL CONTRACTION JOINT AT MIDPOINT (5' MAX. ON CENTER FOR WIDER SIDEWALKS).
4. PCC APRONS SHALL HAVE CONTRACTION JOINTS TO MATCH SIDEWALK PATTERN & D/W EDGE.
5. **RADIUS AT TURNPIKE STREET CONNECTION.** FOR DRIVEWAYS FROM TURNPIKE STREETS, PROVIDE AC OR CONCRETE RADIUS AT STREET CONNECTION (TYP ≥10' RADIUS).
6. **CBU MAILBOXES** ON PROPERTY LINE SIDEWALKS TO CONFORM WITH DETAIL 213A & PROWAG STANDARDS, INCLUDING TURNING SPACE/LANDING FRONTING CBU (6'x6' MIN, 1½% SLOPE), WITH PEDESTRIAN CURB RAMP LOCATED WITHIN 50 FEET OF THE CBU.
7. CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).


LAST REVISION DATE:	
MAR 2024	
<b>PROPERTY LINE SIDEWALKS AND DRIVEWAY APRONS (OR ALLEY APPROACH)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 213

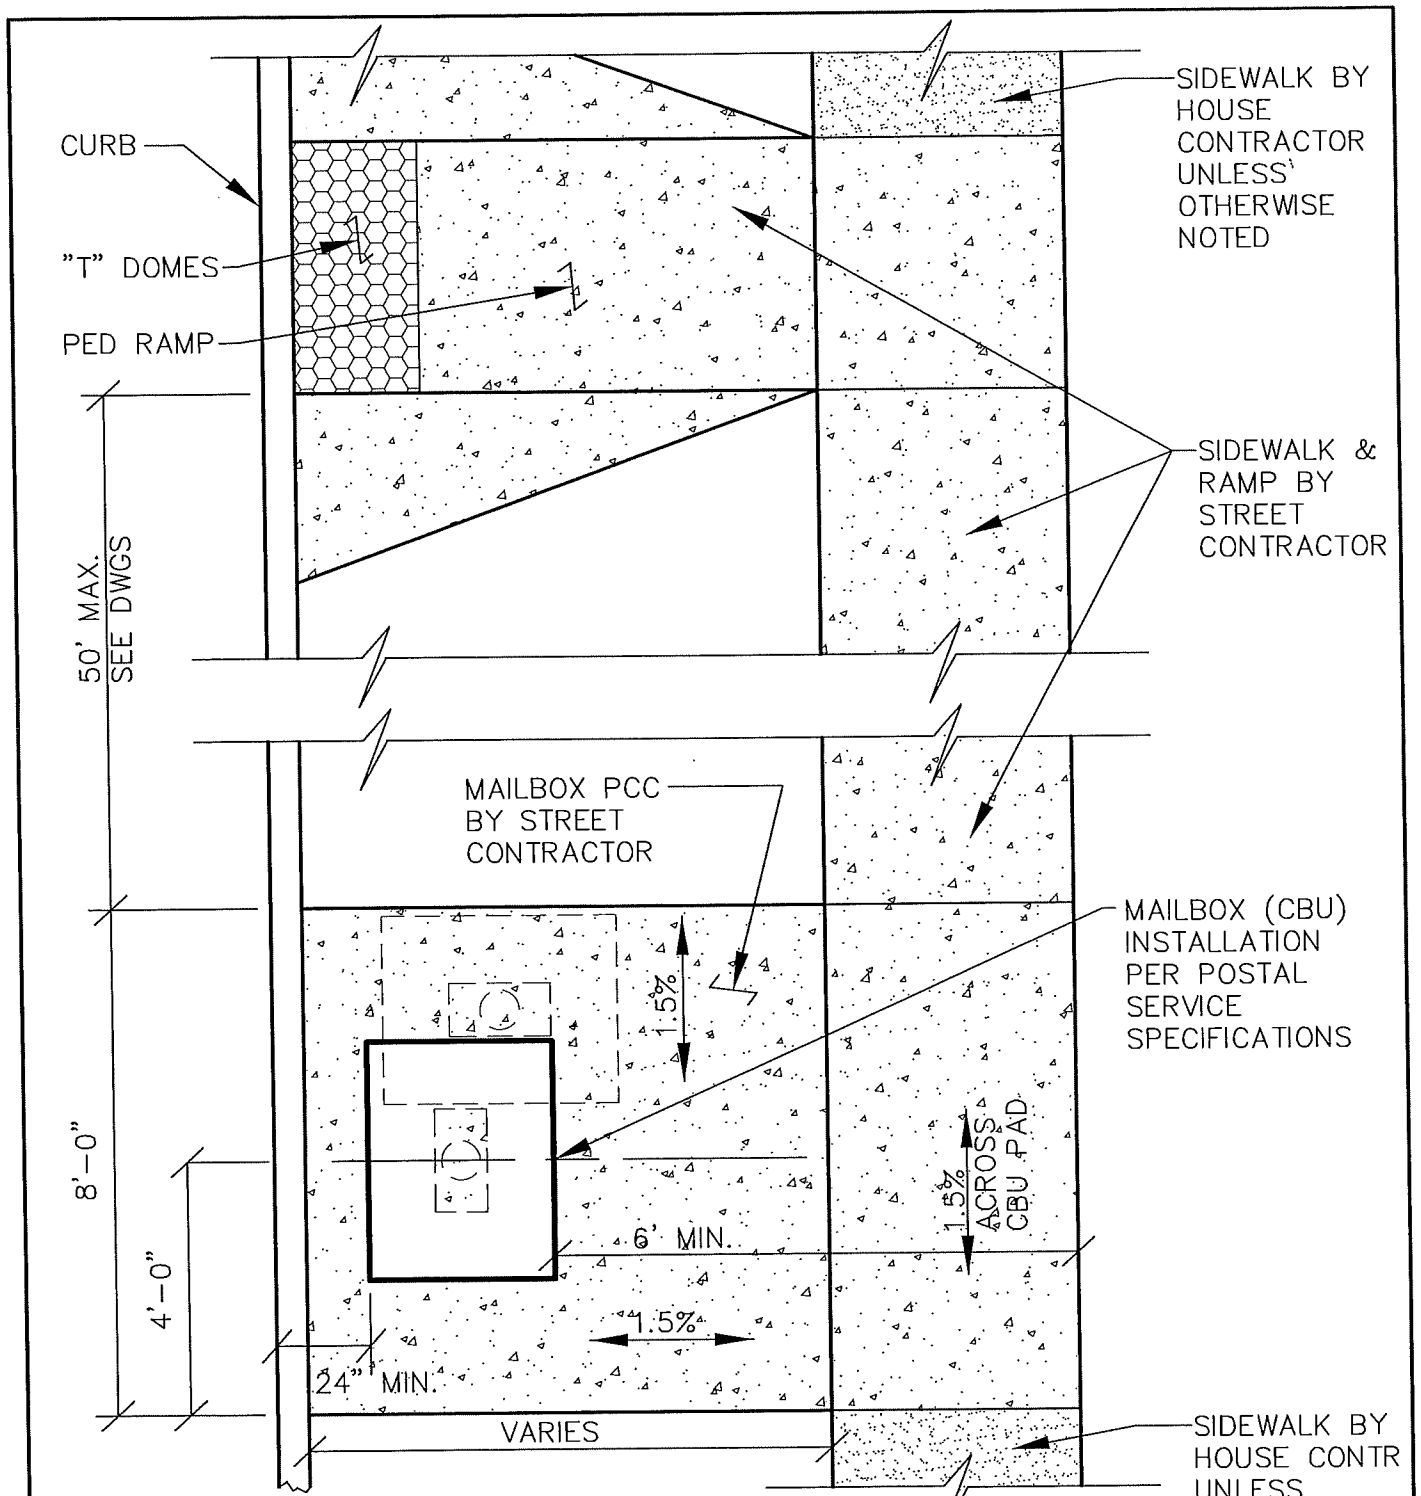


**NOTES:**

1. MAILBOX (CENTRALIZED BOX UNIT-CBU), LOCATION TO BE APPROVED BY LOCAL POSTMASTER
2. SET CBU 24" MIN. CLEAR BEHIND FACE OF CURB.
3. CONCRETE CBU PAD TO BE 8" THICK OR AS REQUIRED PER USPS REGULATIONS.
4. ADA ACCESS TO CBU MAILBOXES SHALL CONFORM WITH SECTION 1111 OF THE OSSC (OREGON STRUCTURAL SPECIALTY CODE), INCLUDING AN ADA PEDESTRIAN CURB RAMP LOCATED WITHIN 50 FEET OF THE CBU.
5. CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).

LAST REVISION DATE: FEB 2024	JO #
<b>CBU MAILBOX &amp; RAMP W/ PROPERTY LINE SIDEWALK INSTALLATION DETAIL</b> (NTS)	
DAYTON, OR	DETAIL NO. 213A

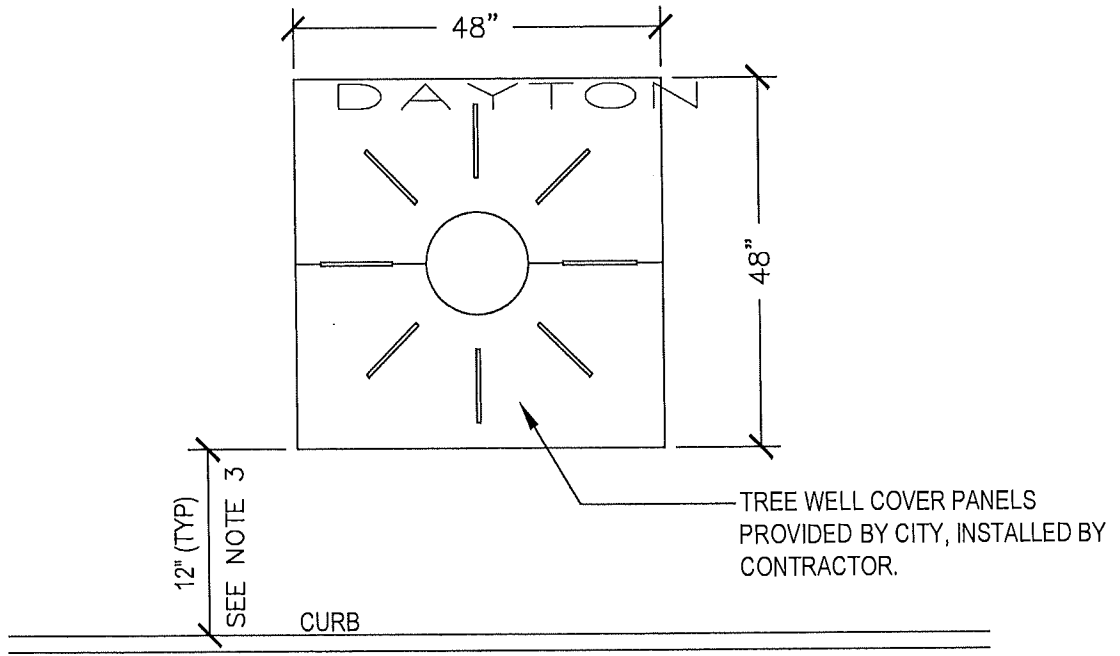


PLAN  
NTS

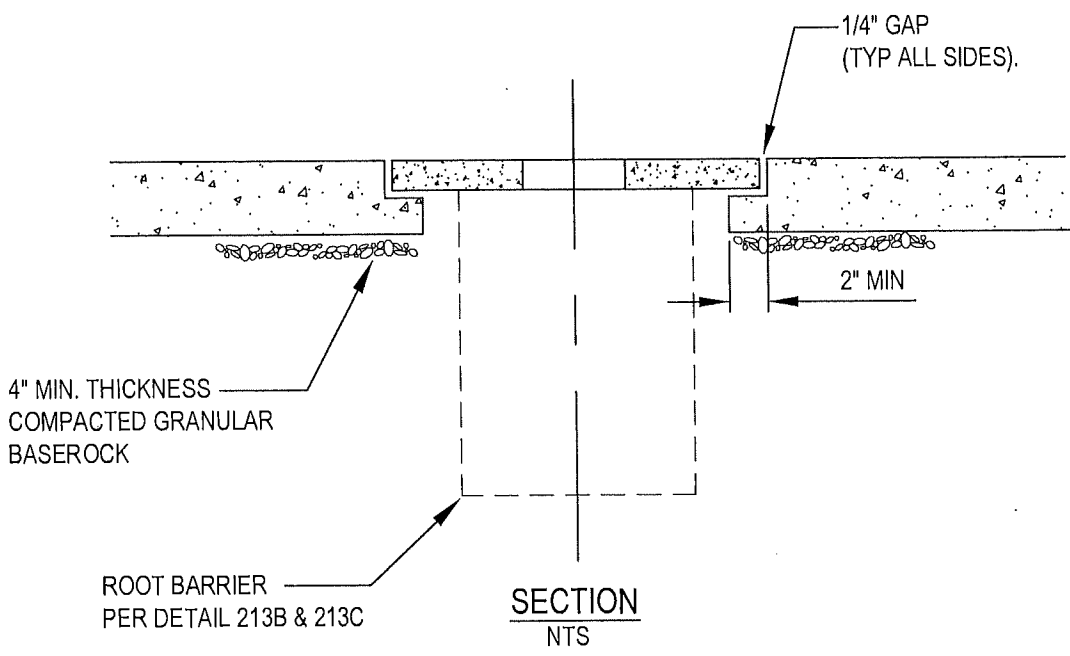


NOTES:

1. CONTRACTOR TO VERIFY INSET PANEL DIMENSIONS AND THICKNESS PRIOR TO FORMING BLOCKOUT AND LIP.
2. DRAWING NOT TO SCALE.
3. SPACING FROM CURB TO TREE WELL MAY VARY FOR SIDEWALKS NARROWER THAN 12 FOOT STANDARD FOR CBO ZONE (SEE DRAWINGS FOR ACTUAL DIMENSION).


LAST REVISION DATE: JUNE 2019	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>48" SQUARE TREE WELL COVER PANELS</b> (NTS)	
DAYTON, OR	DETAIL NO. 213B1

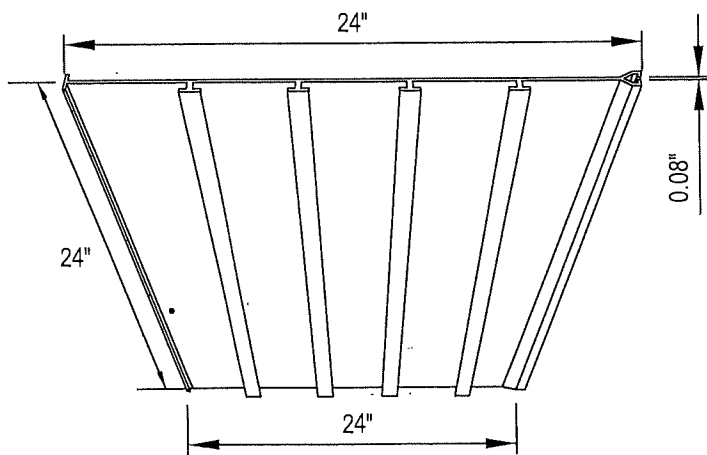

**BARRIER PANEL**  
NTS (oblique view)

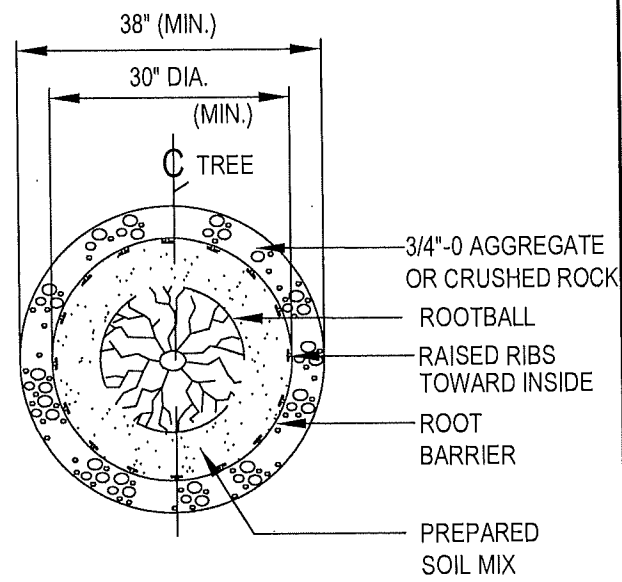

**TYPE 1 (4 PANELS)**  
NTS

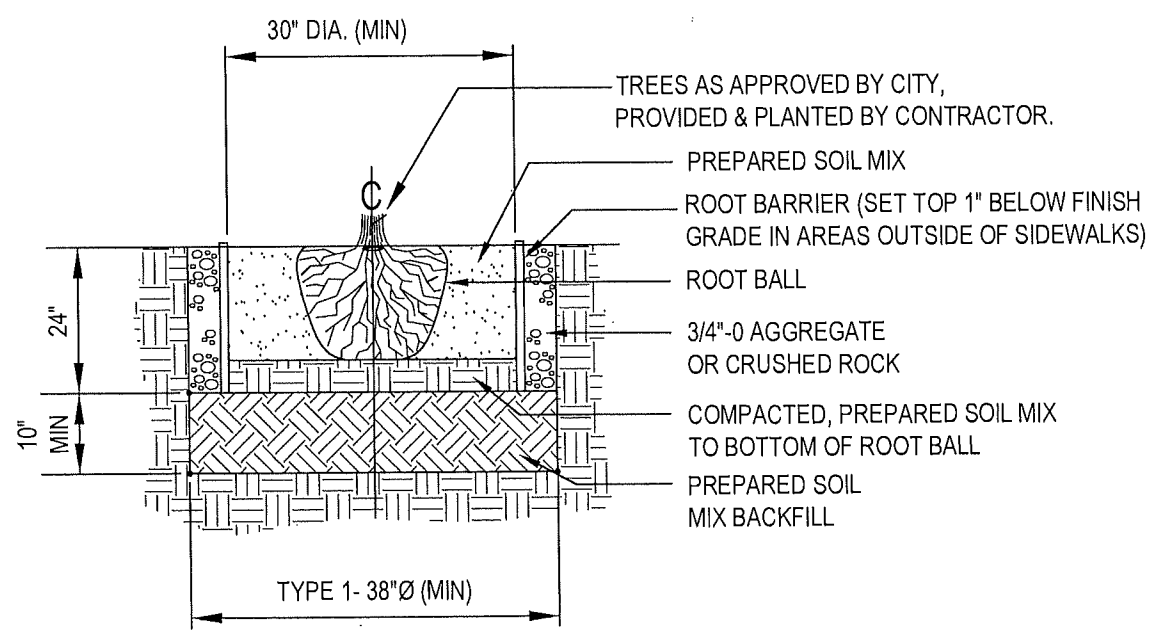


**SECTION**  
NTS


**NOTES:**

1. BARRIER PANEL ASSEMBLY & INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS & DRAWING/DETAIL NOTES, WHICHEVER IS MORE STRINGENT.
2. DO NOT SCALE DRAWINGS.
3. BARRIER PANELS TO BE NDS RP SERIES OR EQUAL.


LAST REVISION DATE: FEB 2019	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>24" DEEP, 30" Ø</b> <b>4 PANEL ROOT BARRIER</b> <b>TREE WELLS</b> (NTS)	
DAYTON, OR	DETAIL NO. 213B2

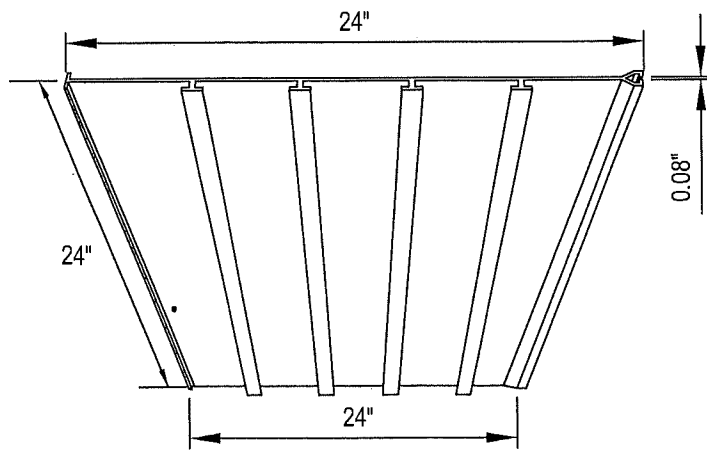

**BARRIER PANEL**  
NTS (oblique view)

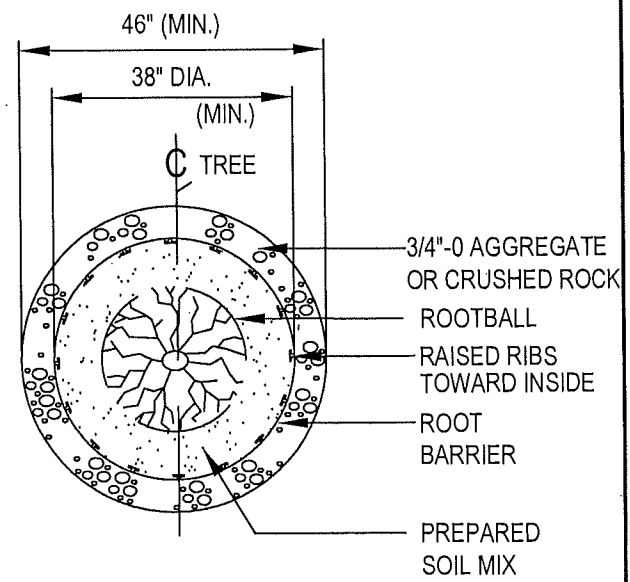

**TYPE 2 (5 PANELS)**  
NTS

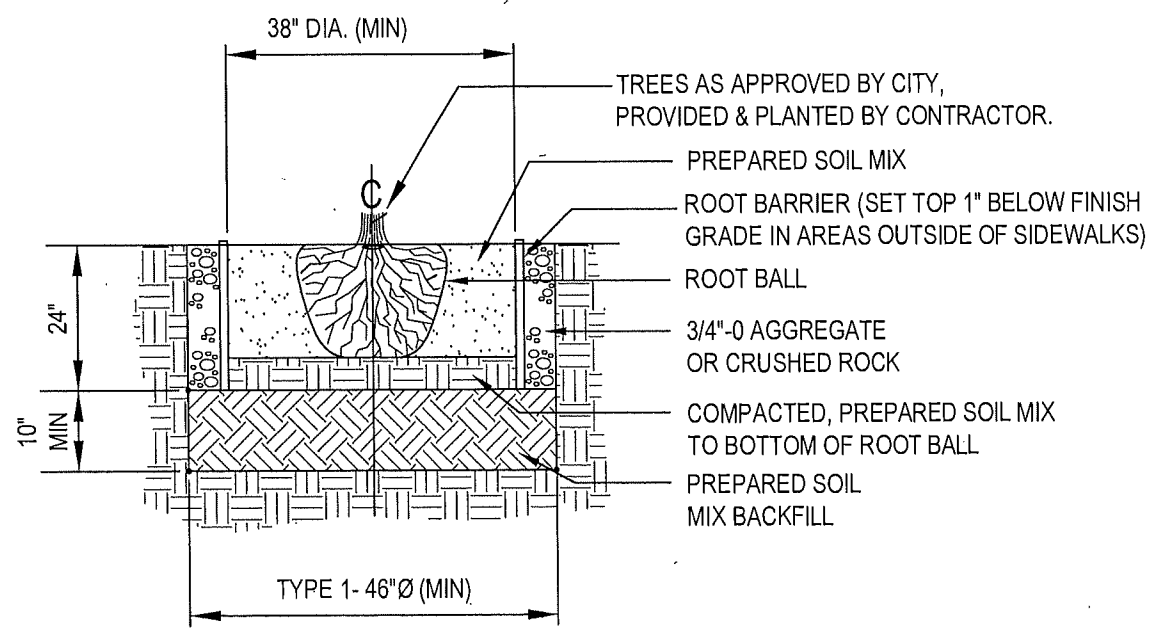

**SECTION**  
NTS

- NOTES:**
1. BARRIER PANEL ASSEMBLY & INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS & DRAWING/DETAIL NOTES, WHICHEVER IS MORE STRINGENT.
  2. DO NOT SCALE DRAWINGS.
  3. BARRIER PANELS TO BE NDS RP SERIES OR EQUAL.

LAST REVISION DATE: FEB 2019	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>24" DEEP, 38" Ø</b> <b>5 PANEL ROOT BARRIER</b> <b>TREE WELLS</b> (NTS)	
DAYTON, OR	DETAIL NO. <b>213C</b>

**DOMES SHALL BE WET-SET REPLACEABLE PANELS  
(ADA SOLUTIONS (CAST-IN-PLACE, BRICK RED) OR EQUAL)**

INSTALL TRUNCATED DOME DETECTABLE WARNING SURFACE AS SHOWN & SPECIFIED, **FULL WIDTH OF RAMP THROAT.**

SPACING: D=1.6" MIN. TO 2.40" MAX  
0.65" MIN CLEAR BETWEEN DOME BASES


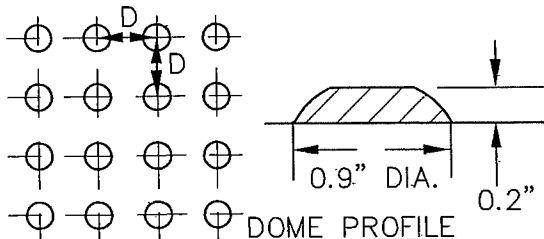


FIGURE A: TRUNCATED DOME DETAIL


5' WIDE TURNING SPACE REQUIRED WHERE LANDSCAPE CURB PROVIDED.

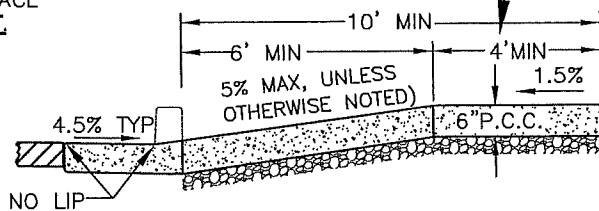

**SECTION A**

TOOLED CONTRACTION JOINTS TYPICAL AT 5' INTERVALS


6" LANDSCAPE CURB EXPOSURE WHERE REQUIRED, SEE NOTE 9

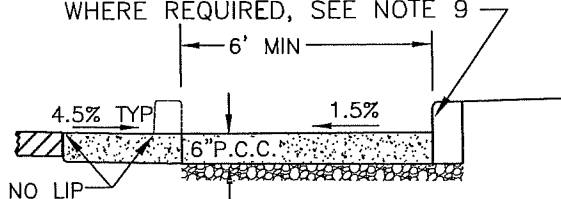


**SECTION B**

10% MAX SLOPE ON WINGS (TYP)

MONOLITHIC CURB/RAMP CONCRETE PLACEMENT ALLOWED WHERE APPROVED, TO AVOID FUTURE SETTLEMENT LIP, OR USE PINS PER DETAIL 217.

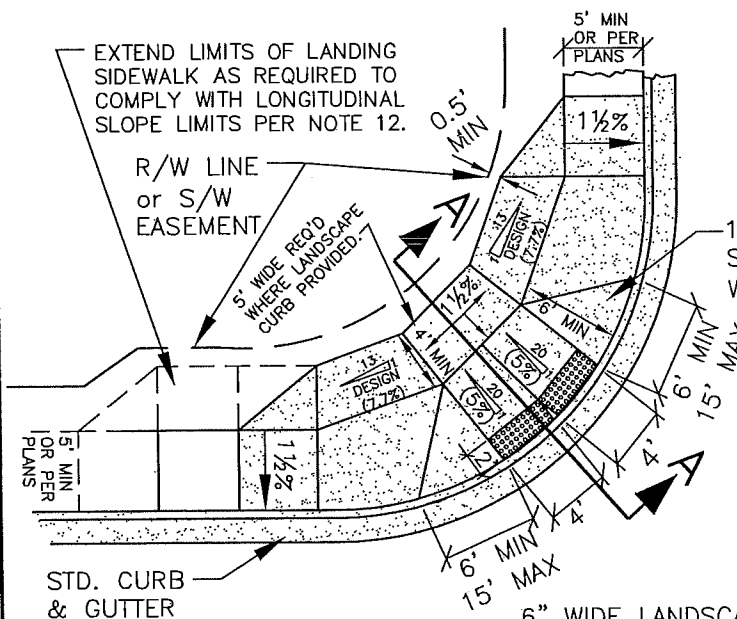

**GUTTER SLOPE 2% MAX AT CURB RAMP**  
(SEE SECTION A)

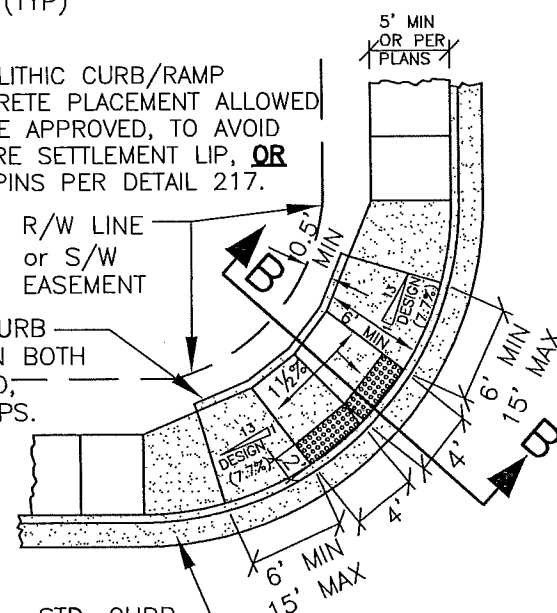

**GUTTER SLOPE AROUND RADIUS 2% MAX**  
(SEE SECTION B)

**GENERAL NOTES:**

- SEE NOTE & DETAIL (TOP LEFT) FOR REQUIRED REPLACEABLE DOME STYLE & COLOR (PANEL OR RADIUS STYLE ALLOWED).
- SEE TYPICAL STREET SECTIONS FOR SIDEWALK WIDTH.
- ALL RAMPS AND TRANSITIONS SHALL BE ADA & PROWAG COMPLIANT.
- LANDINGS & TURNING AREAS SHALL HAVE A MIN. WIDTH & DEPTH OF 4 FEET.
- CROSS SLOPES SHOWN ARE MEASURED FROM HORIZONTAL.
- SHADED SIDEWALK & RAMP AREAS TO BE CONSTRUCTED W/STREET IMPROVEMENTS, AND SHALL BE 6" THICK CONCRETE.**
- DROP CURBS FOR HANDICAP RAMPS SHALL BE CONSTRUCTED WITH NO LIP AT THE GUTTER LINE OR EDGE OF PAVEMENT.
- TYPICALLY PROVIDE CATCH BASIN UPHILL OF PEDESTRIAN RAMP.
- PROVIDE 6-INCH WIDE CONCRETE LANDSCAPE CURB AT BACK OF RAMP IF REQUIRED TO RETAIN LANDSCAPING, OR TO CONTAIN GUTTER DRAINAGE (IE. FOR DOWNHILL SLOPES BEHIND RAMP).
- PROVIDE 4" MIN. COMPACTED BASEROCK UNDER ALL S/W.
- WHERE GRADE LIMITS SHOWN CANNOT BE SATISFIED (IE. FOR APPROACH, LANDING OR WINGS), CONSTRUCT RAMP SHOWN ON DETAIL 214B & TRANSITION TO CURBLINE SIDEWALK.**
- DESIGN RUNNING SLOPE OF SIDEWALK APPROACH TO LANDINGS SHALL TYPICALLY NOT EXCEED 1V:13H (7.7%), BUT SHALL NOT REQUIRE THE LENGTH TO EXCEED 15 FEET.


**ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).**

LAST REVISION DATE: FEB 2024	
<b>INTERSECTION CURB RAMPS CURB LINE SIDEWALKS LOCAL STREETS</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 214A

**DOMES SHALL BE WET-SET REPLACEABLE PANELS  
(ADA SOLUTIONS (CAST-IN-PLACE, BRICK RED) OR EQUAL)**


INSTALL TRUNCATED DOME DETECTABLE WARNING SURFACE AS SHOWN & SPECIFIED, **FULL WIDTH OF RAMP THROAT.**

SPACING: D=1.6" MIN. TO 2.40" MAX  
0.65" MIN CLEAR BETWEEN DOME BASES

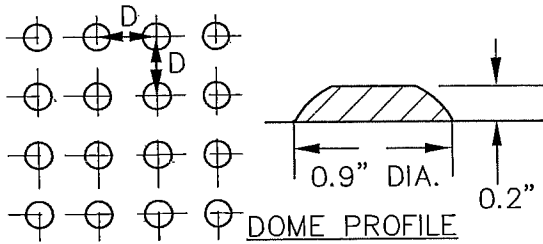

**FIGURE A: TRUNCATED DOME DETAIL**


5' WIDE TURNING SPACE REQUIRED WHERE LANDSCAPE CURB PROVIDED.

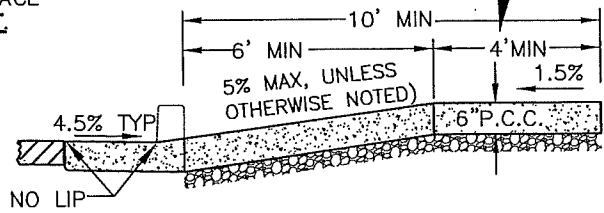

**SECTION A**

TOOLED CONTRACTION JOINTS TYPICAL AT 5' INTERVALS

6" LANDSCAPE CURB EXPOSURE WHERE REQUIRED, SEE NOTE 9

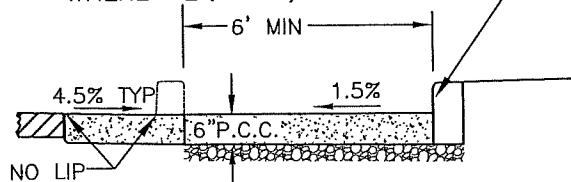


**SECTION B**

EXTEND LIMITS OF LANDING SIDEWALK AS REQUIRED TO COMPLY WITH LONGITUDINAL SLOPE LIMITS PER NOTE 12.


R/W LINE or S/W EASEMENT

5' WIDE REQ'D WHERE LANDSCAPE CURB PROVIDED.

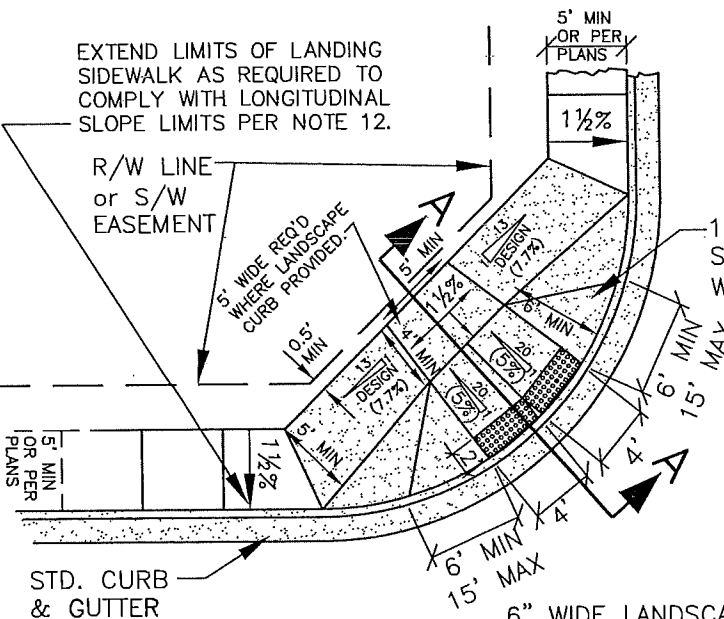

10% MAX SLOPE ON WINGS (TYP)

MONOLITHIC CURB/RAMP CONCRETE PLACEMENT ALLOWED WHERE APPROVED, TO AVOID FUTURE SETTLEMENT LIP, OR USE PINS PER DETAIL 217.

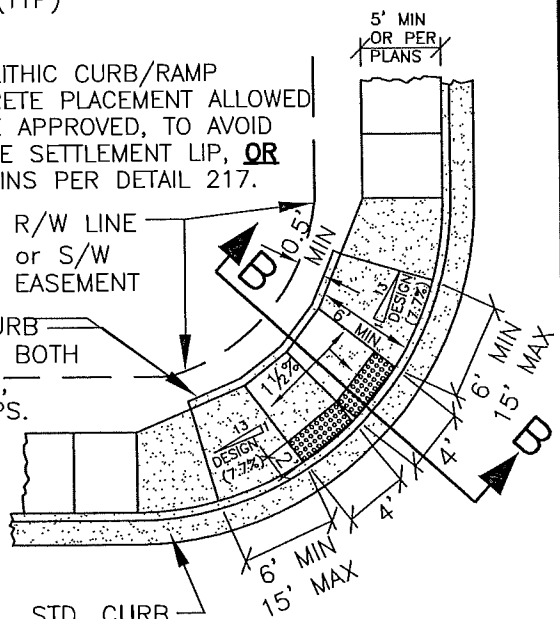

STD. CURB & GUTTER

**GUTTER SLOPE 2% MAX AT CURB RAMP**  
(SEE SECTION A)

6" WIDE LANDSCAPE CURB TO END OF TRANSITION BOTH WAYS WHERE REQUIRED, SEE NOTE 9, ALL RAMPS.

STD. CURB & GUTTER

**GUTTER SLOPE AROUND RADIUS 2% MAX**  
(SEE SECTION B)

**GENERAL NOTES:**

1. SEE NOTE & DETAIL (TOP LEFT) FOR REQUIRED REPLACEABLE DOME STYLE & COLOR (PANEL OR RADIUS STYLE ALLOWED).
2. SEE TYPICAL STREET SECTIONS FOR SIDEWALK WIDTH.
3. ALL RAMPS AND TRANSITIONS SHALL BE ADA & PROWAG COMPLIANT.
4. LANDINGS & TURNING AREAS SHALL HAVE A MIN. WIDTH & DEPTH OF 4 FEET.
5. CROSS SLOPES SHOWN ARE MEASURED FROM HORIZONTAL.
6. **SHADED SIDEWALK & RAMP AREAS TO BE CONSTRUCTED W/STREET IMPROVEMENTS, AND SHALL BE 6" THICK CONCRETE.**
7. DROP CURBS FOR HANDICAP RAMPS SHALL BE CONSTRUCTED WITH NO LIP AT THE GUTTER LINE OR EDGE OF PAVEMENT.
8. TYPICALLY PROVIDE CATCH BASIN UPHILL OF PEDESTRIAN RAMP.
9. PROVIDE 6-INCH WIDE CONCRETE LANDSCAPE CURB AT BACK OF RAMP IF REQUIRED TO RETAIN LANDSCAPING, OR TO CONTAIN GUTTER DRAINAGE (IE. FOR DOWNHILL SLOPES BEHIND RAMP).
10. PROVIDE 4" MIN. COMPACTED BASEROCK UNDER ALL S/W.
11. **WHERE GRADE LIMITS SHOWN CANNOT BE SATISFIED (IE. FOR APPROACH, LANDING OR WINGS), CONSTRUCT RAMP SHOWN ON DETAIL 214B & TRANSITION TO CURBLINE SIDEWALK.**
12. DESIGN RUNNING SLOPE OF SIDEWALK APPROACH TO LANDINGS SHALL TYPICALLY NOT EXCEED 1V:13H (7.7%), BUT SHALL NOT REQUIRE THE LENGTH TO EXCEED 15 FEET.

**ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).**

LAST REVISION DATE:

FEB 2024

**INTERSECTION CURB RAMPS  
CURB LINE SIDEWALKS  
LOCAL STREETS (ALT LAYOUT)**

(NTS)

DAYTON, OR


DETAIL NO.

214A1


**DOMES SHALL BE WET-SET REPLACEABLE PANELS  
(ADA SOLUTIONS (CAST-IN-PLACE, BRICK RED) OR EQUAL)**

INSTALL TRUNCATED DOME DETECTABLE WARNING SURFACE AS SHOWN & SPECIFIED, **FULL WIDTH OF RAMP THROAT.**

SPACING: D=1.6" MIN. TO 2.40" MAX  
0.65" MIN CLEAR BETWEEN DOME BASES

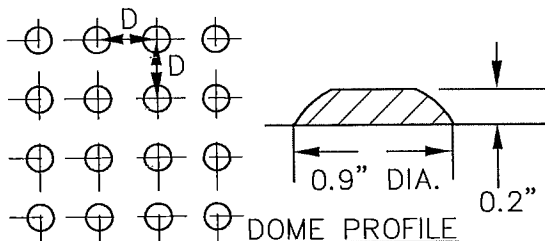


**FIGURE A: TRUNCATED DOME DETAIL**

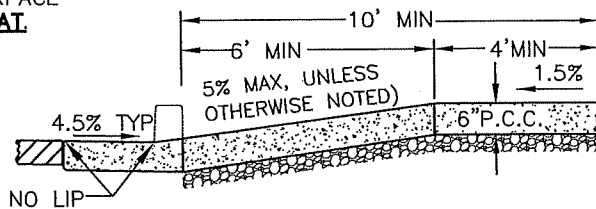

**SECTION**

TOOLED CONTRACTION JOINTS TYPICAL AT 5' INTERVALS


MONOLITHIC CURB/RAMP CONCRETE PLACEMENT ALLOWED WHERE APPROVED, TO AVOID FUTURE SETTLEMENT LIP, **OR** USE PINS PER DETAIL 217.

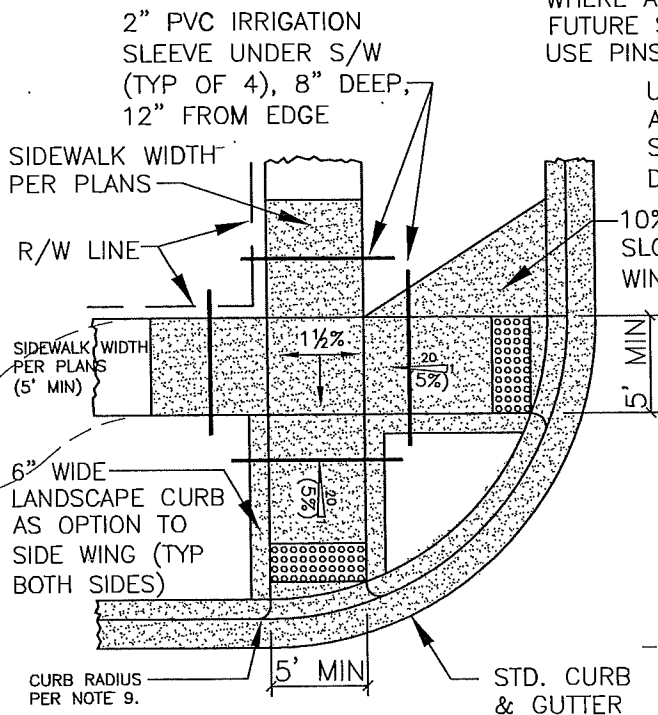

**SEPARATE RAMP FOR PROPERTY LINE SIDEWALKS**

USE SMOOTH CURVES FOR ANY TRANSITION TO CURBLINE SIDEWALK SHOWN ON DRAWINGS (TYP)

10% MAX SLOPE ON WINGS (TYP)  
R/W LINE or S/W EASEMENT, 6" MIN FROM BACK OF S/W INCLUDING RADIUS

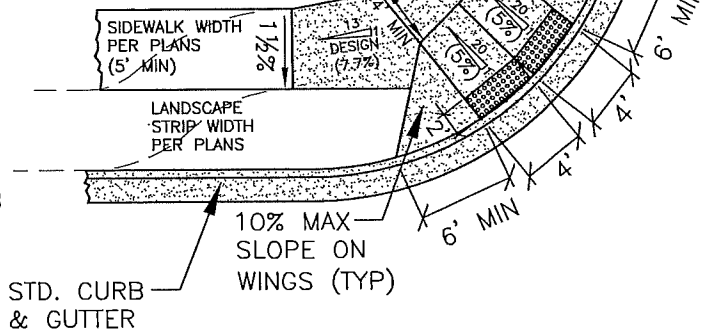

**DOUBLE RAMPS FOR PROPERTY LINE OR CURBLINE SIDEWALKS  
(SEE SECTION A)**

**GENERAL NOTES:**

1. SEE NOTE & DETAIL (TOP LEFT) FOR REQUIRED REPLACEABLE DOME STYLE & COLOR (PANEL OR RADIUS STYLE ALLOWED).
2. SEE TYPICAL STREET SECTIONS FOR SIDEWALK WIDTH.
3. ALL RAMPS AND TRANSITIONS SHALL BE ADA & PROWAG COMPLIANT.
4. LANDINGS & TURNING AREAS SHALL HAVE A MIN. WIDTH & DEPTH OF 4 FEET.
5. CROSS SLOPES SHOWN ARE MEASURED FROM HORIZONTAL.
6. **SHADED SIDEWALK & RAMP AREAS TO BE CONSTRUCTED W/STREET IMPROVEMENTS, AND SHALL BE 6" THICK CONCRETE.**
7. DROP CURBS FOR HANDICAP RAMPS SHALL BE CONSTRUCTED WITH NO LIP AT THE GUTTER LINE OR EDGE OF PAVEMENT.
8. TYPICALLY PROVIDE CATCH BASIN UPHILL OF PEDESTRIAN RAMP.
9. PROVIDE 6-INCH MIN RADIUS ON ALL RETURNED CURBS.
10. PROVIDE 4" MIN. COMPACTED BASEROCK UNDER ALL S/W.
11. DESIGN RUNNING SLOPE OF SIDEWALK APPROACH TO LANDINGS SHALL TYPICALLY NOT EXCEED 1V:13H (7.7%), BUT SHALL NOT REQUIRE THE LENGTH TO EXCEED 15 FEET.

**ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).**

LAST REVISION DATE: FEB 2024	
<b>INTERSECTION CURB RAMPS PROPERTY LINE SIDEWALKS LOCAL STREETS</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 214B



**DOMES SHALL BE WET-SET REPLACEABLE PANELS  
(ADA SOLUTIONS (CAST-IN-PLACE, BRICK RED) OR EQUAL)**

INSTALL TRUNCATED DOME DETECTABLE WARNING SURFACE AS SHOWN & SPECIFIED, **FULL WIDTH OF RAMP THROAT.**

SPACING: D=1.6" MIN. TO 2.40" MAX  
0.65" MIN CLEAR BETWEEN DOME BASES



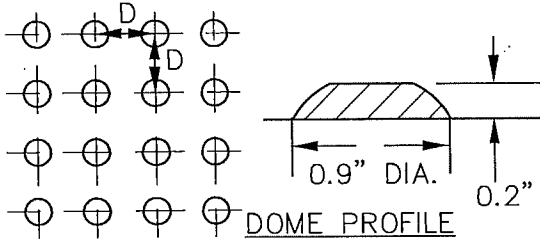


FIGURE A: TRUNCATED DOME DETAIL

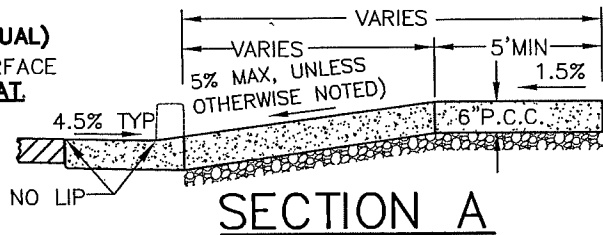


SECTION A


MONOLITHIC CURB/RAMP CONCRETE PLACEMENT ALLOWED WHERE APPROVED, TO AVOID FUTURE SETTLEMENT LIP, OR USE PINS PER DETAIL 2170.




SECTION B

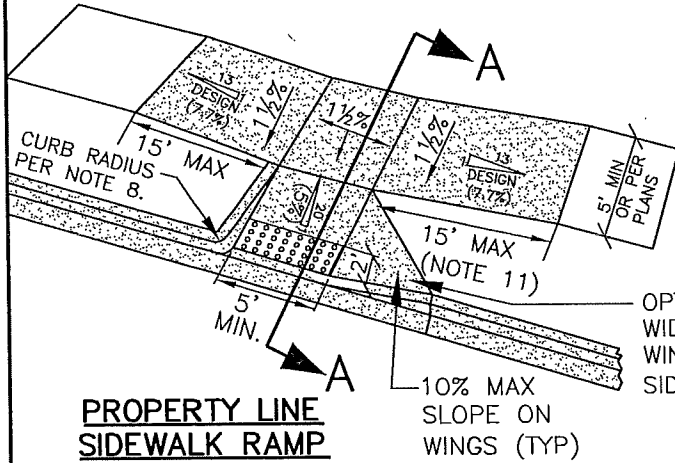

**PROPERTY LINE  
SIDEWALK RAMP**  
(SEE SECTION A)

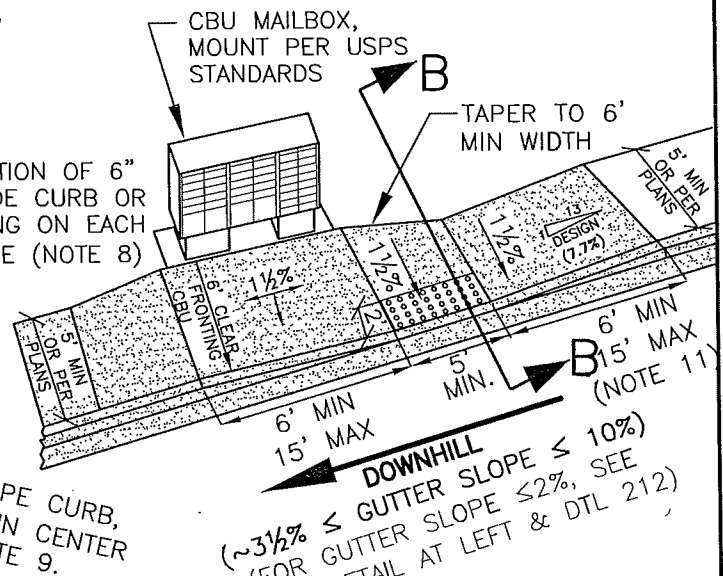

**CURBLINE SIDEWALK RAMP  
W/ADJACENT CBU**  
(GUTTER SLOPE 10% MAX)  
(SEE SECTION B)

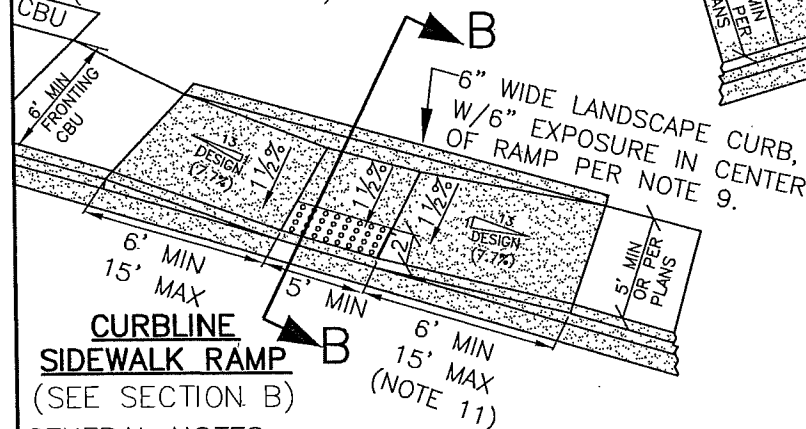

**CURBLINE  
SIDEWALK RAMP**  
(SEE SECTION B)

**GENERAL NOTES:**

- SEE NOTE & DETAIL ABOVE FOR REQUIRED REPLACEABLE DOME STYLE & COLOR (PANEL OR RADIUS STYLE).
- SEE TYPICAL STREET SECTIONS FOR SIDEWALK WIDTH.
- ALL RAMPS AND TRANSITIONS SHALL BE ADA & PROWAG COMPLIANT.
- LANDINGS & TURNING AREAS SHALL HAVE A MIN. WIDTH & DEPTH OF 4 FT.
- CROSS SLOPES SHOWN ARE MEASURED FROM HORIZONTAL.
- SHADED SIDEWALK & RAMP AREAS TO BE CONSTRUCTED W/STREET IMPROVEMENTS, AND SHALL BE 6" THICK CONCRETE.**
- DROP CURBS FOR HANDICAP RAMPS SHALL BE CONSTRUCTED WITH NO LIP AT THE GUTTER LINE OR EDGE OF PAVEMENT.
- PROVIDE 6-INCH MIN RADIUS ON ALL RETURNED CURBS.
- PROVIDE 6-INCH WIDE CONCRETE LANDSCAPE CURB AT BACK OF RAMP IF REQUIRED TO RETAIN LANDSCAPING, OR TO CONTAIN GUTTER DRAINAGE (IE. FOR DOWNHILL SLOPES BEHIND RAMP).
- PROVIDE 4" MIN. COMPACTED BASEROCK UNDER ALL S/Ws.
- DESIGN RUNNING SLOPE OF SIDEWALK APPROACH TO LANDINGS SHALL TYPICALLY NOT EXCEED 1V:13H (7.7%), BUT SHALL NOT REQUIRE THE LENGTH TO EXCEED 15 FEET.

TOOLED CONTRACTION JOINTS TYPICAL AT 5' INTERVALS (UNLESS OTHERWISE NOTED)

**ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).**

LAST REVISION DATE:	
FEB 2024	
<b>CURB RAMPS BETWEEN INTERSECTIONS</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 214C

PED RAMP (TYP)  
W/TRUNCATED  
DOMES SEE STD  
DETAIL 214 SERIES

GUTTER PAN

TYPE A DROP  
CURB & GUTTER

PCC CONCRETE  
APRON.  
8" MIN THICK

CONTRACTION  
JOINTS

PUBLIC STREET

A

B

TYPE C CURB

RIGHT-OF-WAY

SLOPE TYP.  
SEE SITE PLAN  
& NOTE 3


25' MIN. CURBLINE RADIUS (TYP)  
LARGER RADIUS MAY BE REQUIRED FOR  
TRUCK OR BUS TRAFFIC (SEE NOTE 4)

INSTALL STD. SIDEWALK (CURBLINE OR  
PROPERTY LINE PER PLANS)



MIN. 4" OF 3/4"-0" COMPACTED  
GRANULAR BASEROCK. (TYPICAL UNDER  
ALL SIDEWALKS AND CONC. DRIVEWAYS)

SECTION A-A

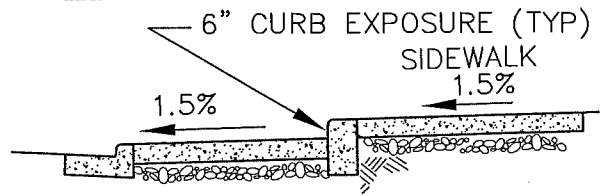

SECTION B-B

VARIABLES  
(24' MIN. FOR  
2-WAY TRAFFIC)

PRIVATE  
DRIVE

PRIVATE TYPE C CURBS  
(TYP)

NOTES:

1. WHERE APPROVED BY THE CITY ENGINEER & PUBLIC WORKS DIRECTOR, A "DUSTPAN" STYLE APRON PER DETAILS 212A OR 213 MAY BE USED FOR COMMERCIAL/INDUSTRIAL DRIVEWAYS (BASED ON CONCRETE THICKNESS/REINFORCING AS NOTED HEREIN).
2. DRIVEWAY APRON SHALL BE 8" MIN THICKNESS CONCRETE.
3. PRIVATE CATCH BASINS ARE REQUIRED BEHIND DRIVEWAY APRON IF THE DRIVEWAY OR THE PARKING LOT BEYOND DRIVEWAY APRON SLOPES & DRAINS TOWARD THE STREET (OR ACROSS A PEDESTRIAN PATH).
4. TURNING RADIUS OF ANTICIPATED LARGEST VEHICLE TO BE VERIFIED DURING DESIGN.
5. **MONOLITHIC CURB & DRIVEWAY APRON PLACEMENT IS NOT PERMITTED (IE. CURB CONCRETE & DRIVEWAY APRON CONCRETE SHALL BE PLACED SEPARATELY).**
6. ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).

LAST REVISION DATE:

FEB 2024


COPYRIGHT  
WESTECH ENGINEERING, INC.

COMMERCIAL/INDUSTRIAL  
DRIVEWAY APPROACH,  
HIGH-VOLUME/TRUCK OPTION  
(NTS)


DAYTON, OR

DETAIL NO.

216

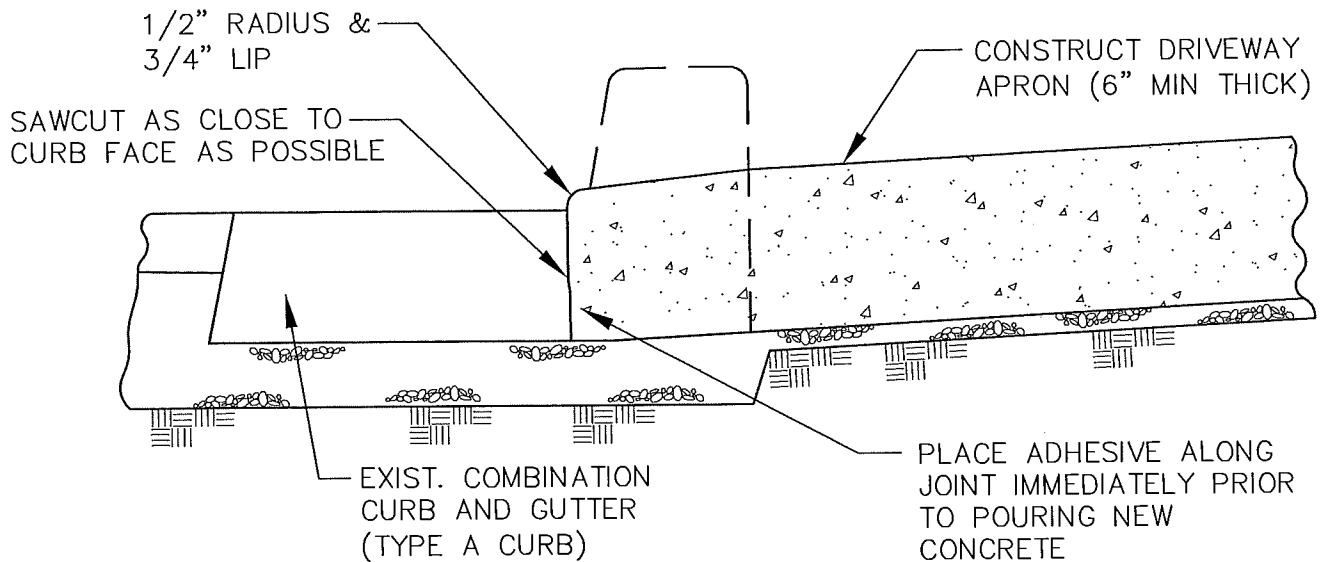

## NEW DRIVEWAY APPROACH (CURB & GUTTER)

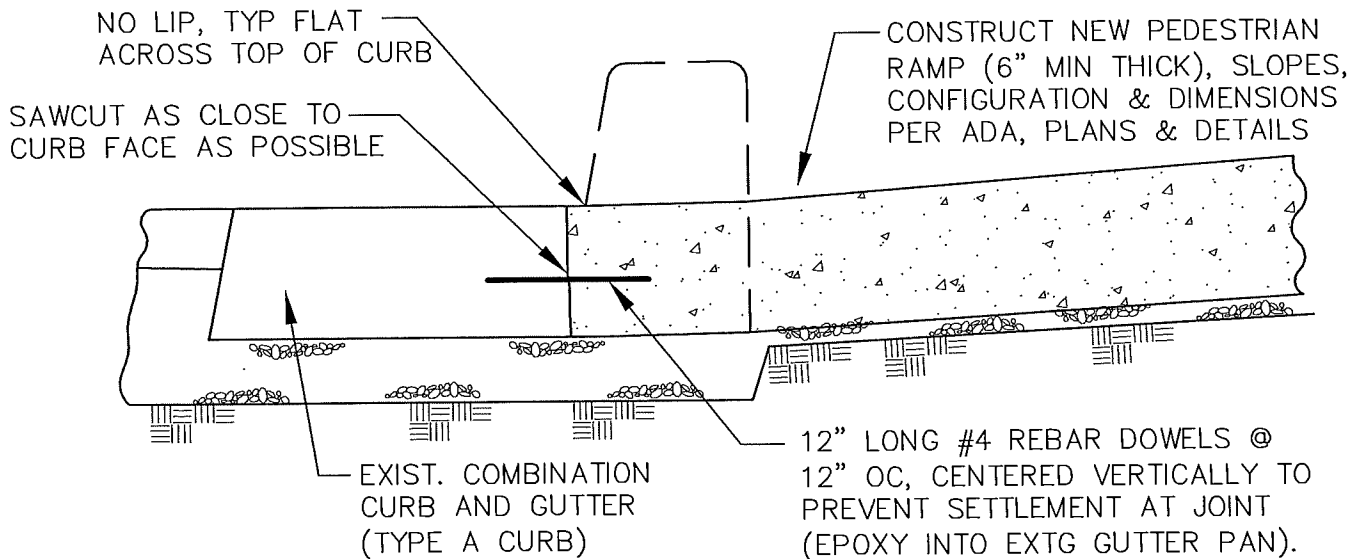


## NEW PEDESTRIAN RAMP (CURB & GUTTER)

### NOTES:

1. ONLY ALLOWED ON EXISTING PAVED STREETS.
2. HORIZONTAL SAWCUTTING OF CURB TO MATCH NEW APPROACH PROFILE IS ALSO ALLOWED (SMOOTH FACED CURB GRINDING IS PROHIBITED).
3. SAWCUT THROUGH GUTTER PAN SHALL BE MADE AS CLOSE TO CURB FACE AS POSSIBLE.
4. COMPLETE CURB AND GUTTER SHALL NOT BE REMOVED UNLESS APPROVED IN WRITING BY THE CITY ENGINEER PRIOR TO START OF CONSTRUCTION.
5. REPAVING IN FRONT OF FULL DEPTH CURB WHEN REMOVED. WHEN TYPE 'C' FULL DEPTH CURBS ARE REMOVED, A MIN OF 2 FEET OF PAVEMENT (MEASURED FROM THE FACE OF CURB) SHALL BE REMOVED AND REPLACED, UNLESS OTHERWISE APPROVED IN WRITING BY THE CITY ENGINEER.
6. BENCH GRINDING. ANY AC SAWCUTS WILL REQUIRE A BENCH GRIND (PER DETAILS 219 & 302A) IN CONJUNCTION WITH REPAVING.
7. ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR ( $\pm 1.5\%$ ).


LAST REVISION DATE:	
FEB 2024	
<b>CURB CUT FOR NEW DRIVEWAYS OR PEDESTRIAN RAMP ON EXISTING CURB</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 217

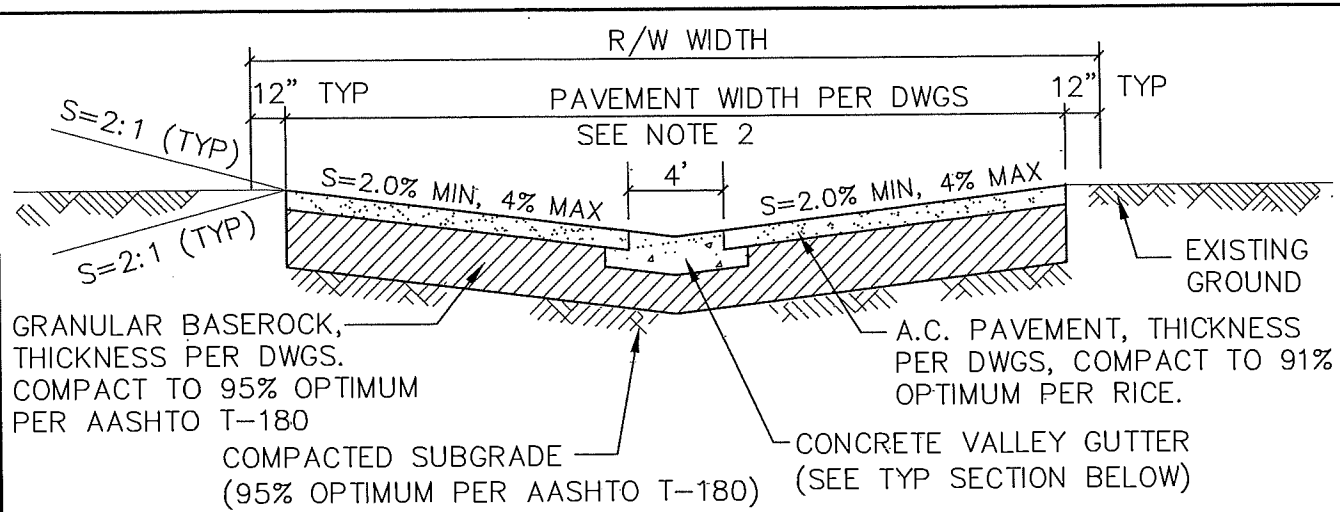

### TYPICAL ALLEY SECTION

**NOTE:**

LONGITUDINAL GUTTER GRADE SHALL NOT BE LESS THAN 0.5%.

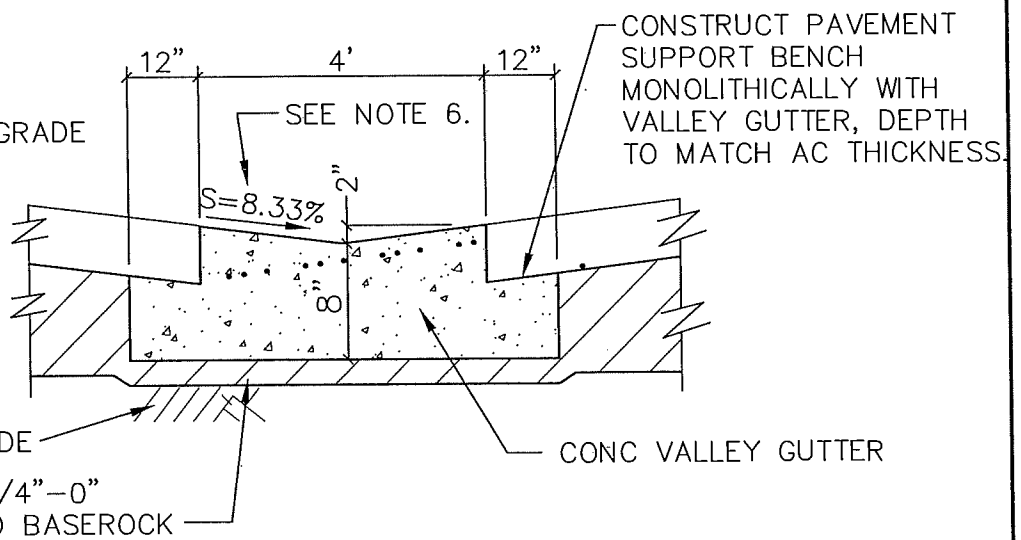


### TYPICAL CONCRETE GUTTER SECTION

**NOTES:**

1. WHEN EXISTING BUILDINGS OR PAVEMENT ABUTS R/W, EXTEND PAVEMENT TO MATCH.
2. DESIGN SUBGRADES SHALL BE COMPACTED AND PROOF-ROLLED PRIOR TO PLACEMENT OF BASEROCK. IF SUBGRADE PASSES PROOF-ROLL BUT FAILS DENSITY TESTING, SEPARATION GEOTEXTILE FABRIC SHALL BE PLACED ON SUBGRADE PRIOR TO PLACEMENT OF BASEROCK. FAILURE OF PROOF-ROLL WILL REQUIRE OVEREXCAVATION.
3. CONTRACTION JOINTS SHALL BE PLACED AT 15' MIN. INTERVALS AND SHALL EXTEND AT LEAST 50% THROUGH THE GUTTER SECTION.
4. VALLEY GUTTER TO CURE A MINIMUM OF 7 DAYS PRIOR TO PLACING FINAL BASEROCK AND PAVING ALLEY.
5. VALLEY GUTTER AT PUBLIC STREET INTERSECTIONS MUST BE APPROVED IN WRITING ON A CASE-BY-CASE BASIS BY THE CITY.
6. VALLEY GUTTERS MUST BE ADA AND PROWAG COMPLIANT WHERE CROSSED BY A PEDESTRIAN ACCESS PATH (MAX GUTTER SLOPE = 4.5% TYP).
7. ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).

LAST REVISION DATE: FEB 2024	JO #
<b>CONCRETE VALLEY GUTTER (TYP FOR USE IN ALLEYS, PARKING LOTS, ETC.)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 218

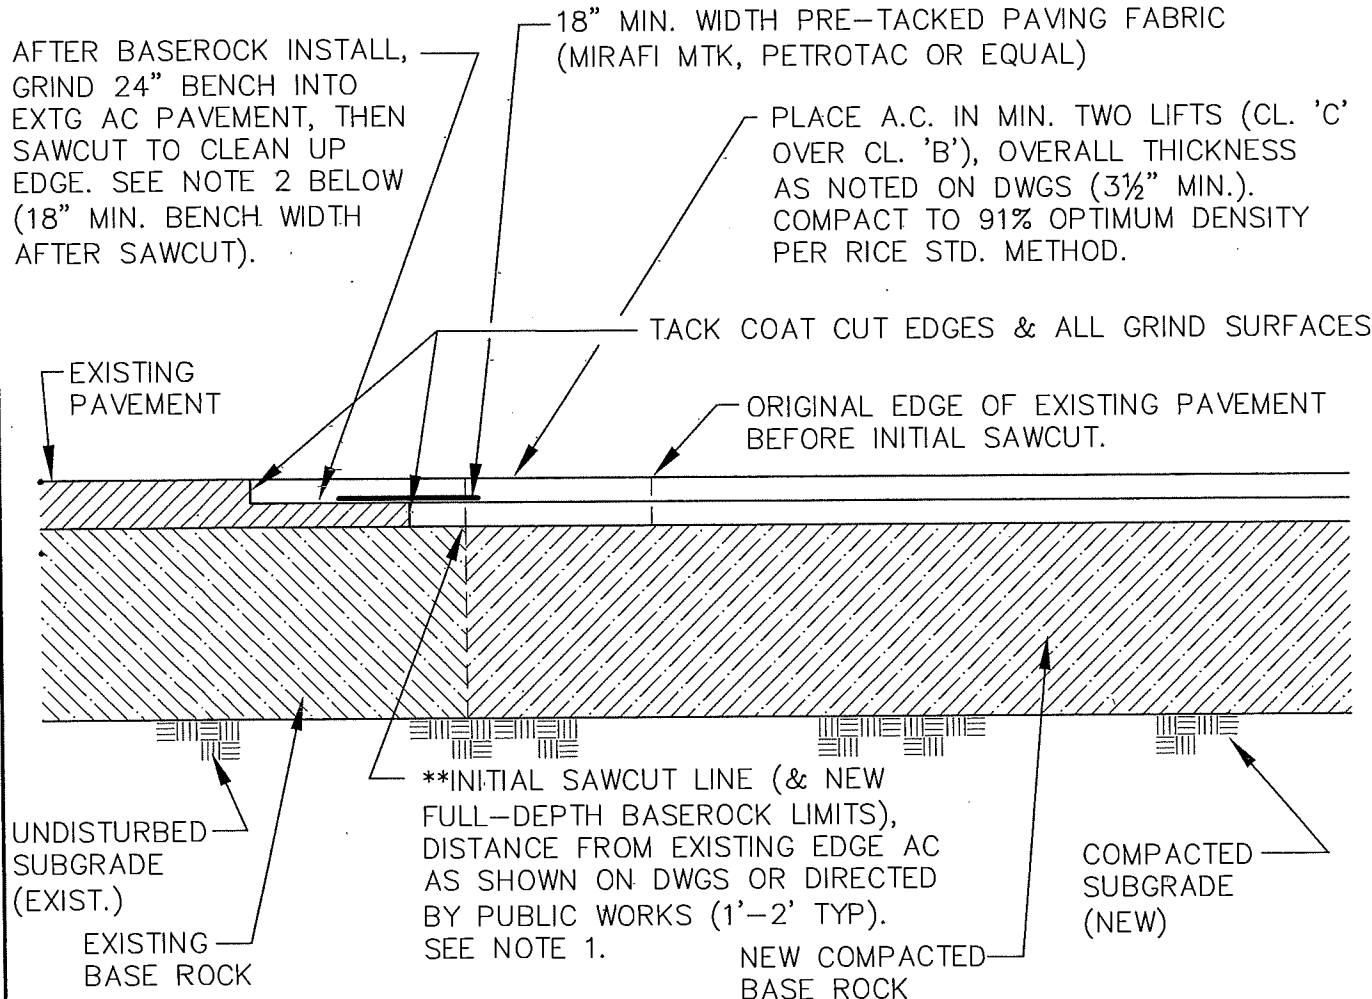

**\*\*BENCH GRIND REQUIREMENT SHOWN DOES NOT REPLACE ANY REQUIREMENT NOTED ON DRAWINGS FOR SAWCUT BACK FROM EDGE OF EXISTING AC & INSTALLATION OF NEW BASEROCK. BENCH GRIND REQUIREMENT APPLIES AFTER ALL EXCAVATION & BASEROCK PLACEMENT (PRIOR TO PAVING), TO AVOID FULL DEPTH AC JOINTS.**

**NOTES:**

1. INITIAL SAWCUT SHOWN ABOVE\*\* TO OCCUR PRIOR TO EXCAVATION FOR NEW BASEROCK. SAWCUT LIMITS (& NEW BASEROCK LIMITS) MAY BE INCREASED BY PUBLIC WORKS BASED ON ACTUAL FIELD CONDITIONS (IE. INADEQUATE BASEROCK AT TRANSITION POINT, ETC.).
2. AFTER INSTALLATION OF NEW BASEROCK (PRIOR TO PAVING), GRIND 24" WIDE BENCH ALONG EDGE OF EXISTING AC (2" DEEP TYP), THEN SAWCUT TO CLEAN UP EDGE AS REQUIRED (FINISHED BENCH GRIND TO EXTEND TO A POINT 18" MINIMUM FROM FINAL SAWCUT LOCATION).
3. TACK COAT CUT EDGES AND INSTALL BASE LIFT OF AC LEVEL WITH BENCH GRIND.
4. INSTALL PAVING FABRIC AT ALL JOINTS, TACK COAT ALL GRIND SURFACES & EDGES, INSTALL TOP LIFT OF AC.
5. SAND SEAL ALL JOINTS (REMOVE EXCESS SAND AFTER CURE).
6. **ALONG WIDENED STREETS, THE CONTRACTOR SHALL VERIFY THAT THE PROPOSED CURB/GUTTER ELEVATIONS MATCH THE EXISTING EDGE OF PAVEMENT, BASED ON THE DESIGN STREET CROSS SLOPES SHOWN ON THE DRAWINGS AND THE SPECIFIED CURB EXPOSURE. ANY DISCREPANCIES SHALL BE REPORTED TO THE ENGINEER PRIOR TO PLACEMENT OF CURB FORMS OR STRINGLINE. CURBS WHICH ARE PLACED TOO HIGH OR TOO LOW SHALL BE REMOVED AND REPLACED AS DIRECTED BY THE CITY.**


LAST REVISION DATE: FEB 2024	
<b>AC STREET CUT FOR PUBLIC STREET CONNECTION, WIDENING OR EXTENSION</b> (NTS)	
DAYTON, OR	DETAIL NO. 219

**FIRE CODE NOTES:**


- A) FIRE LANES, TURNAROUNDS & ASSOCIATED IMPROVEMENTS SHALL COMPLY WITH THE MOST CURRENT VERSION OF THE OREGON FIRE CODE (OFC).
- B) GRADES ALONG FIRE LANES OR ALONG TURNAROUND AREAS SHALL NOT EXCEED 10% WITHOUT PRIOR WRITTEN APPROVAL FROM THE FIRE CODE OFFICIAL (OFC D103.2).
- C) NARROWER FIRE LANE WIDTHS BETWEEN STREET & TURNAROUND MUST BE APPROVED IN WRITING AS AN EXCEPTION BY THE FIRE CODE OFFICIAL (OFC 503.2.2)

**BASEROCK & PAVEMENT:**

- A) MIN FIRE LANE & TURNAROUND BASEROCK & PAVEMENT THICKNESSES ARE SPECIFIED UNDER PWDS 2.31.c (3" AC/9" BASEROCK OR 8" PCC/2" BASEROCK, EITHER OVER COMPACTED SUBGRADE).
- B) OTHER DURABLE HARD SURFACES SHALL PROVIDE EQUIVALENT BEARING STRENGTH (SEE PWDS 2.30.f). PLAIN GRAVEL SURFACES DO NOT MEET CITY STANDARDS.

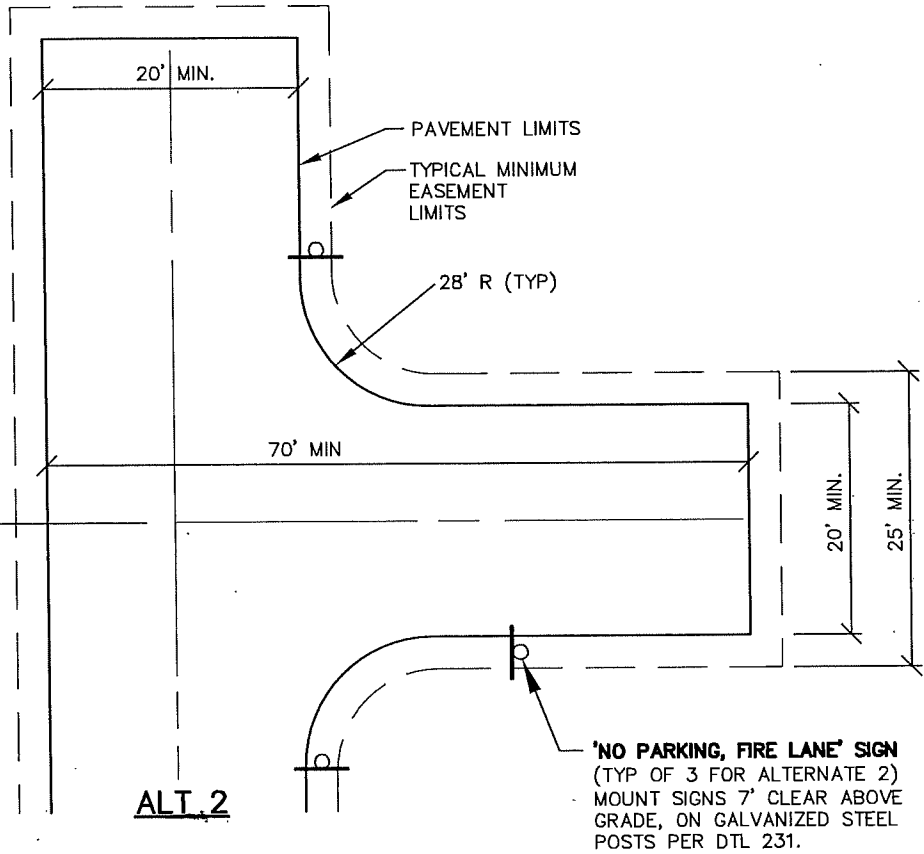

**ALT 2**

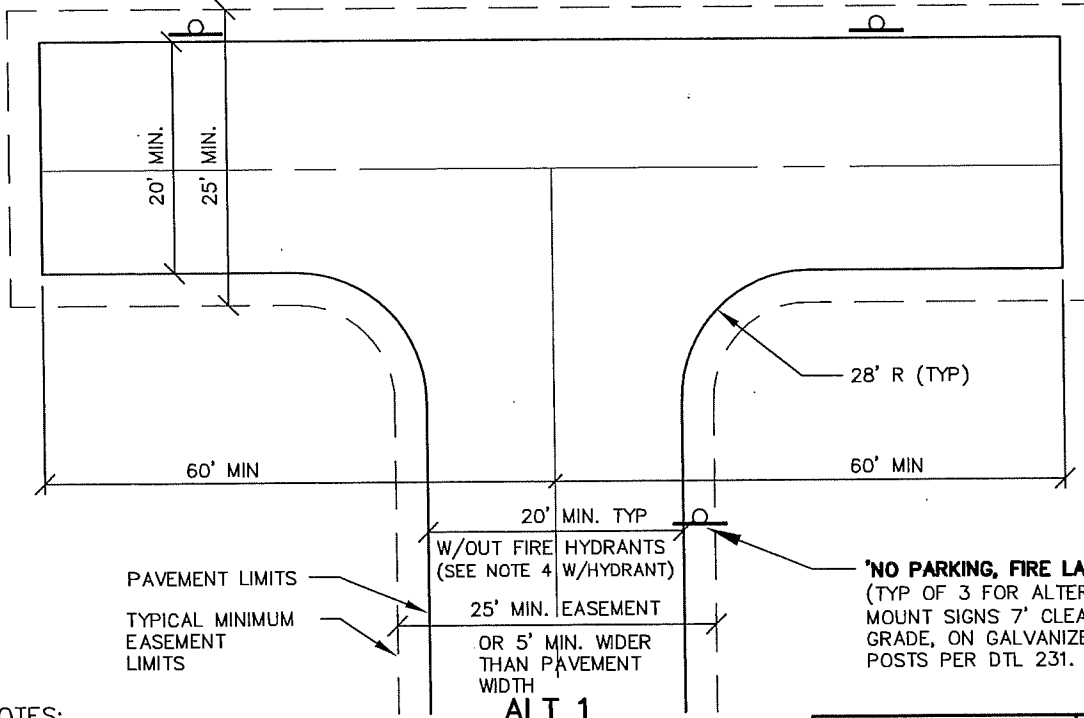


**ALT 1**

**NOTES:**

1. ALUM "NO PARKING/FIRE LANE" SIGNS REQUIRED AT TURN-AROUND AS SHOWN, & AT 50 FT MAXIMUM INTERVALS ALONG LENGTH OF FIRE LANE (SIGN SIZE/WORDING PER OFC D103.6). INSTALL SIGNS ON BOTH SIDES OF STEM (ALTERNATING LOCATIONS) FOR FIRE LANE WIDTHS <= 26 FT. & ALONG ONE SIDE FOR FIRE LANE WIDTHS > 26 FT TO 32 FT.
2. THESE ARE TYPICAL MINIMUM DESIGNS AS REQUIRED BY THE 2022 OFC D103.4 & FIGURE D103.1. ALTERNATE DESIGNS SHALL MEET THE APPROVAL OF THE LOCAL FIRE CODE OFFICIAL.
3. FIRE LANES & TURNAROUNDS MUST BE PAVED OR HARD SURFACED AS NOTED ABOVE. PAVEMENT DIMENSIONS SHOWN REFERS TO TOTAL DRIVABLE WIDTH BETWEEN CURBS (IF CURBS ARE PRESENT).
4. 26' MIN. PAVEMENT WIDTH REQ'D AT FIRE HYDRANTS (OFC D103.1), FOR 20 FEET MINIMUM EACH WAY FROM HYDRANT.

LAST REVISION DATE: FEB 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>FIRE CODE/FIRE LANE HAMMERHEAD TURNAROUND (PRIVATE DRIVES ONLY)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 220

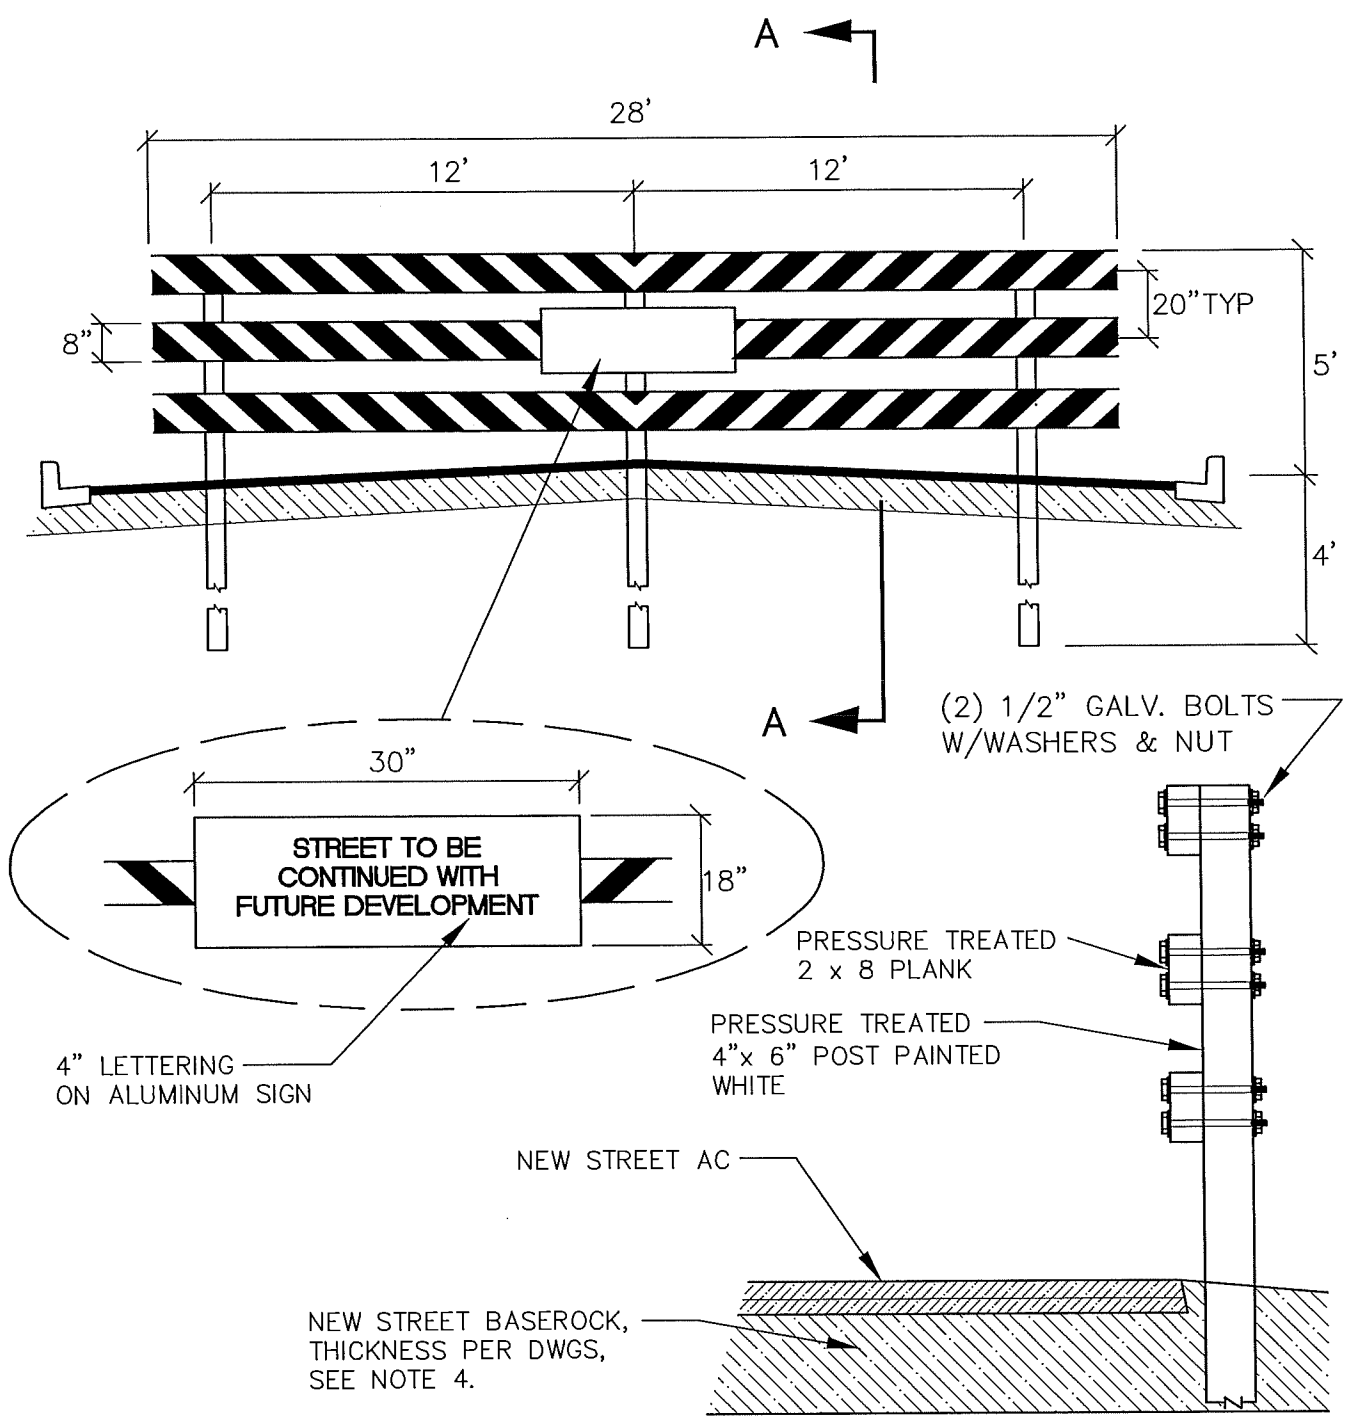


**NOTES:**

1. STRIPING SHALL BE ALTERNATING RED & WHITE STRIPES 6" WIDE & AT A 45° ANGLE.
2. STRIPING SHALL BE EITHER RETRO-REFLECTIVE TAPE ATTACHED WITH STAINLESS PANHEAD SCREWS OR PAINTED WITH A SEALED RETRO-REFLECTIVE SURFACE.
3. BARRICADE SHALL BE LOCATED WITHIN THE RESERVE STRIP OR EASEMENT, IF PRESENT (WITHIN THE RIGHT-OF-WAY OTHERWISE).
4. FULL DEPTH BASEROCK SHALL EXTEND BEYOND BARRICADE POSTS AS SHOWN.

LAST REVISION DATE: FEB 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>STREET BARRICADE (STUB STREETS)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>225</b>

CONTRACTOR SHALL COORDINATE WITH CITY FOR BOLLARD COLOR PRIOR TO ORDERING SLEEVE.

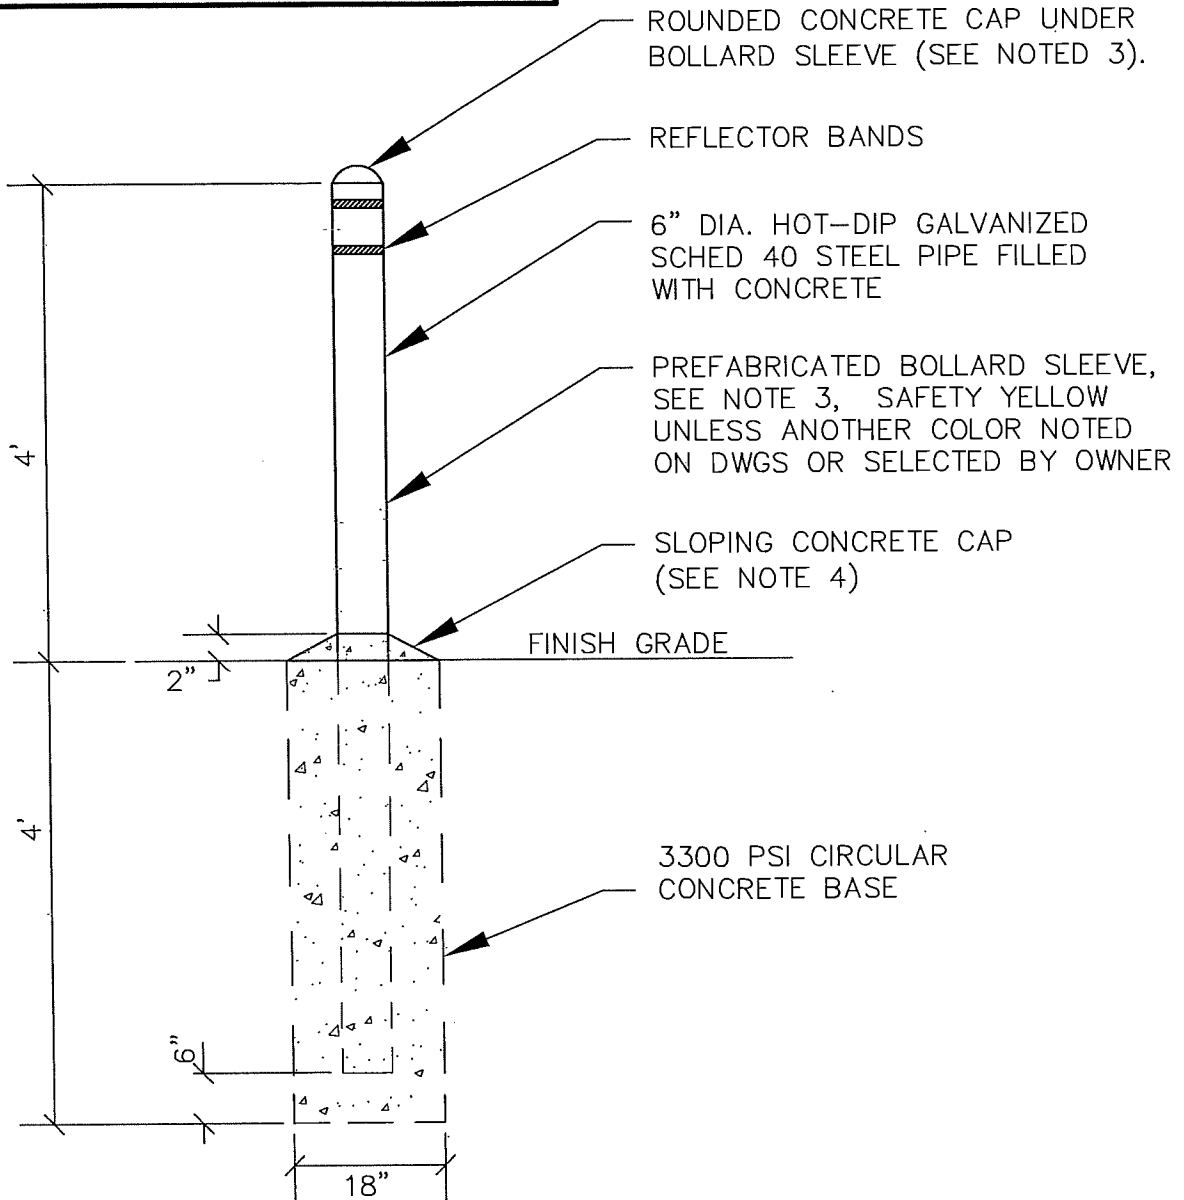


**NOTES:**

1. IF BOLLARDS ARE PLACED IN AC PAVEMENT OR CONCRETE AREAS, HOLES FOR THE CONCRETE ANCHOR BASE SHALL BE CORE DRILLED TO DIMENSIONS SHOWN.
2. CONTRACTOR SHALL COORDINATE WITH PUBLIC WORKS FOR INSPECTION OF BASE HOLES (DIAMETER & DEPTH) PRIOR TO CONCRETE PLACEMENT.
3. PREFABRICATED BOLLARD SLEEVES SHALL BE DOME TOP SLEEVES FABRICATED FROM 1/4-INCH THICK HDPE PLASTIC WITH ULTRAVIOLET INHIBITORS TO RETARD CRACKING AND FADING. SLEEVES SHALL BE SAFETY YELLOW AND PROVIDED WITH TWO RED REFLECTORIZED BANDS FABRICATED INTO THE UPPER END. SLEEVES SHALL BE SIZED TO FIT TIGHTLY OVER THE STEEL POST CORE AND SHALL EXTEND TO COVER THE FULL HEIGHT OF THE CORE POST.
4. CONCRETE FOUNDATION SHALL BE HELD BELOW GRADE IN PAVED AREAS TO PERMIT PAVING UP TO THE POST. INSTALL SLEEVE AFTER PAVING IS COMPLETE TO AVOID DAMAGING SLEEVE.
5. ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).

LAST REVISION DATE: FEB 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>6-INCH BOLLARD (GUARD POST)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 226




CONTRACTOR SHALL COORDINATE WITH CITY FOR BOLLARD COLOR PRIOR TO ORDERING SLEEVE.

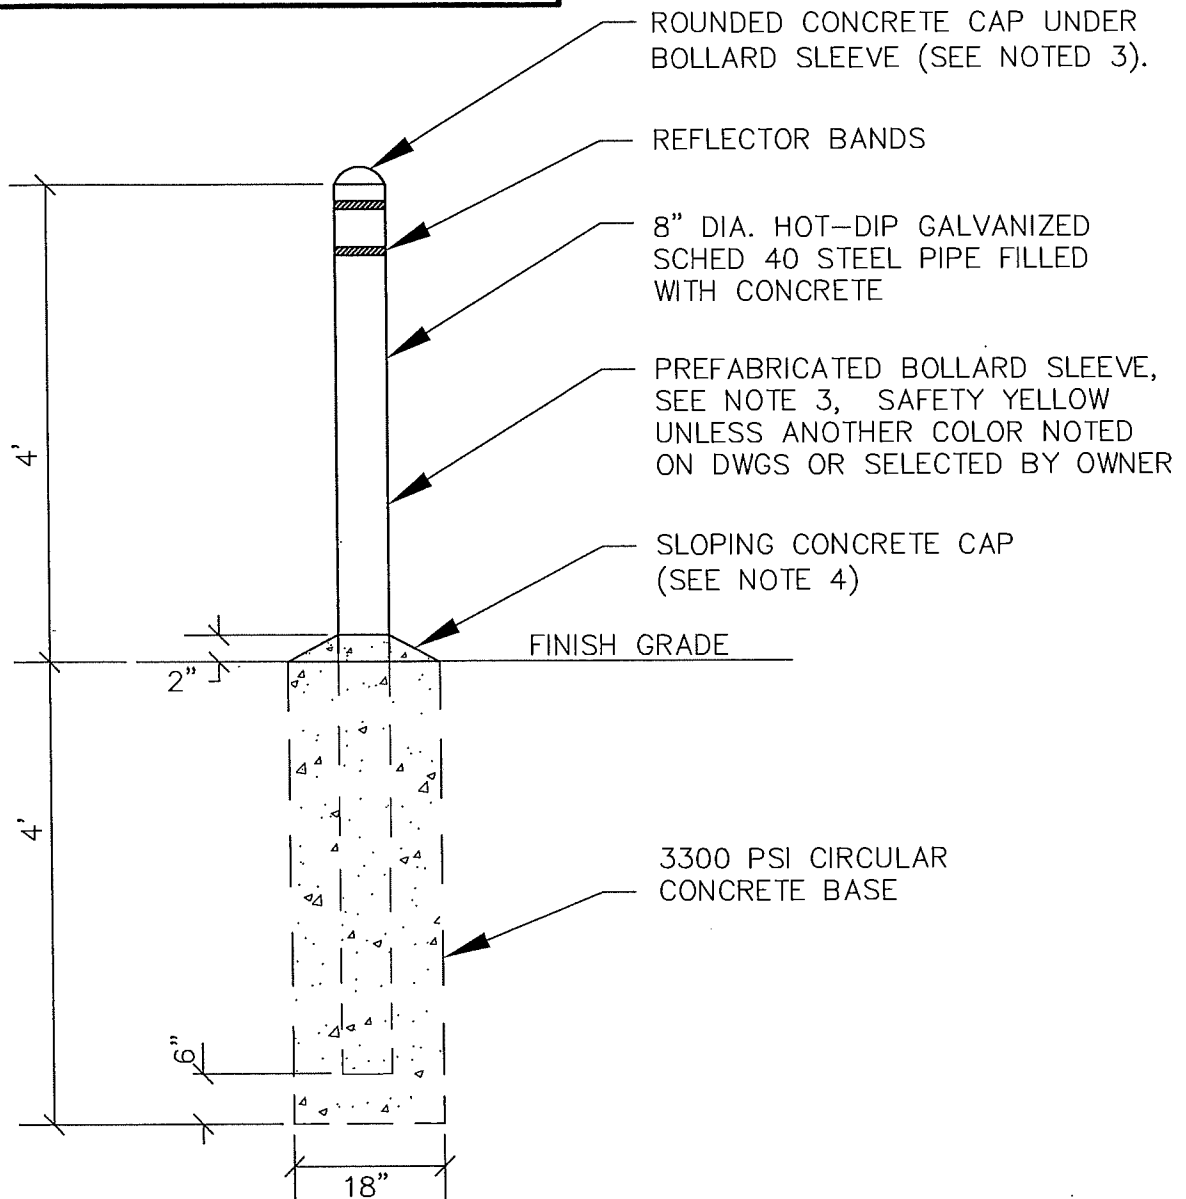

**NOTES:**

1. IF BOLLARDS ARE PLACED IN AC PAVEMENT OR CONCRETE AREAS, HOLES FOR THE CONCRETE ANCHOR BASE SHALL BE CORE DRILLED TO DIMENSIONS SHOWN.
2. CONTRACTOR SHALL COORDINATE WITH PUBLIC WORKS FOR INSPECTION OF BASE HOLES (DIAMETER & DEPTH) PRIOR TO CONCRETE PLACEMENT.
3. PREFABRICATED BOLLARD SLEEVES SHALL BE DOME TOP SLEEVES FABRICATED FROM 1/4-INCH THICK HDPE PLASTIC WITH ULTRAVIOLET INHIBITORS TO RETARD CRACKING AND FADING. SLEEVES SHALL BE SAFETY YELLOW AND PROVIDED WITH TWO RED REFLECTORIZED BANDS FABRICATED INTO THE UPPER END. SLEEVES SHALL BE SIZED TO FIT TIGHTLY OVER THE STEEL POST CORE AND SHALL EXTEND TO COVER THE FULL HEIGHT OF THE CORE POST.
4. CONCRETE FOUNDATION SHALL BE HELD BELOW GRADE IN PAVED AREAS TO PERMIT PAVING UP TO THE POST. INSTALL SLEEVE AFTER PAVING IS COMPLETE TO AVOID DAMAGING SLEEVE.
5. ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).
6. 8" BOLLARD TYPICALLY ONLY REQUIRED FOR LARGE COMMERCIAL/INDUSTRIAL TRUCK TRAFFIC.

LAST REVISION DATE: FEB 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>8-INCH BOLLARD (GUARD POST)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 227

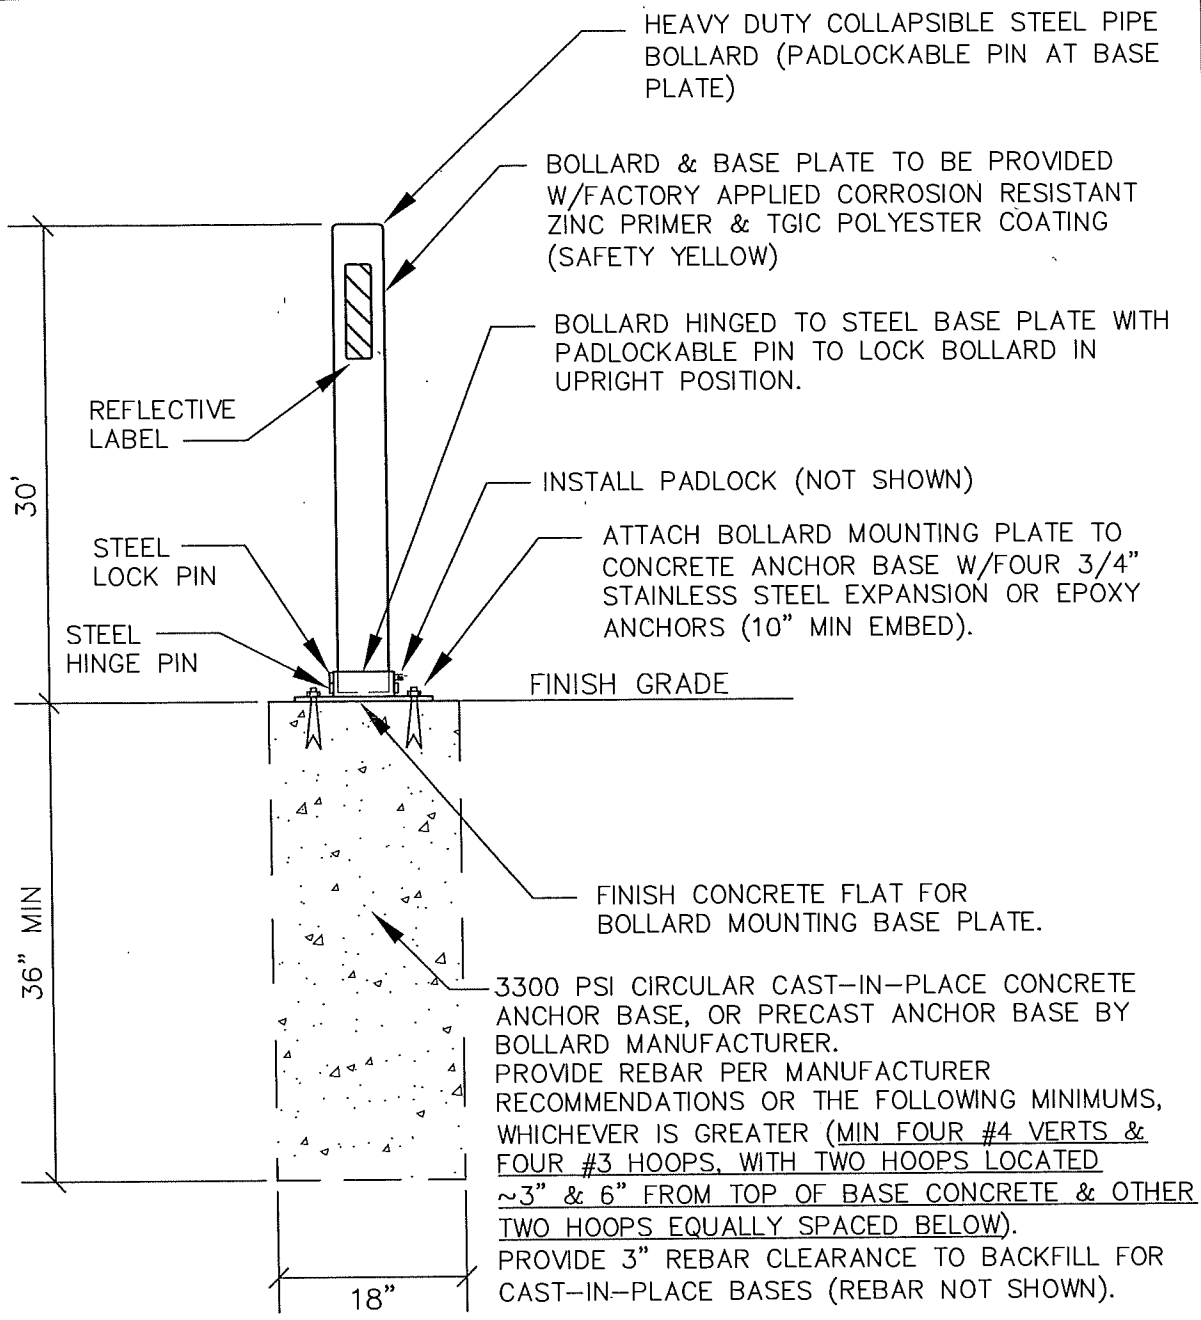

HEAVY DUTY COLLAPSIBLE STEEL PIPE BOLLARD (PADLOCKABLE PIN AT BASE PLATE)

BOLLARD & BASE PLATE TO BE PROVIDED W/FACTORY APPLIED CORROSION RESISTANT ZINC PRIMER & TGIC POLYESTER COATING (SAFETY YELLOW)

BOLLARD HINGED TO STEEL BASE PLATE WITH PADLOCKABLE PIN TO LOCK BOLLARD IN UPRIGHT POSITION.

INSTALL PADLOCK (NOT SHOWN)

ATTACH BOLLARD MOUNTING PLATE TO CONCRETE ANCHOR BASE W/FOUR 3/4" STAINLESS STEEL EXPANSION OR EPOXY ANCHORS (10" MIN EMBED).

FINISH GRADE


FINISH CONCRETE FLAT FOR BOLLARD MOUNTING BASE PLATE.

3300 PSI CIRCULAR CAST-IN-PLACE CONCRETE ANCHOR BASE, OR PRECAST ANCHOR BASE BY BOLLARD MANUFACTURER. PROVIDE REBAR PER MANUFACTURER RECOMMENDATIONS OR THE FOLLOWING MINIMUMS, WHICHEVER IS GREATER (MIN FOUR #4 VERTS & FOUR #3 HOOPS, WITH TWO HOOPS LOCATED ~3" & 6" FROM TOP OF BASE CONCRETE & OTHER TWO HOOPS EQUALLY SPACED BELOW). PROVIDE 3" REBAR CLEARANCE TO BACKFILL FOR CAST-IN-PLACE BASES (REBAR NOT SHOWN).

**NOTES:**

1. BOLLARD BASE MOUNTING PLATE AND BOLLARD SHALL BE 4-INCH MAXIMUM HEIGHT WHEN IN COLLAPSED/DOWN POSITION.
2. UNLESS OTHERWISE SPECIFIED, PROVIDE WEATHER RESISTANT PADLOCK KEYED TO SPECIFIED PATTERN (CONTRACTOR TO COORDINATE WITH FIRE CODE OFFICIAL FOR KNOX AS APPLICABLE).
3. COLLAPSIBLE BOLLARD ASSEMBLY SHALL BE TRAFFIC-GUARD MODEL LPHDHB OR APPROVED EQUAL.
4. CONTRACTOR SHALL VERIFY BOLLARD HINGE LOCATION (IE. COLLAPSE DIRECTION) WITH CITY, OWNER AND/OR FIRE CODE OFFICIAL PRIOR TO INSTALLATION, AS APPLICABLE.
5. IF BOLLARDS ARE PLACED IN AC PAVEMENT OR CONCRETE AREAS, HOLES FOR THE CONCRETE ANCHOR BASE SHALL BE CORE DRILLED TO DIMENSIONS SHOWN.
6. CONTRACTOR SHALL COORDINATE WITH PUBLIC WORKS FOR INSPECTION OF BASE HOLES (DIAMETER & DEPTH) PRIOR TO CONCRETE PLACEMENT.
7. ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).

LAST REVISION DATE:	
FEB 2024	
<b>30" TALL COLLAPSIBLE PADLOCKABLE BOLLARD</b>	
(NTS)	
DAYTON, OR	228

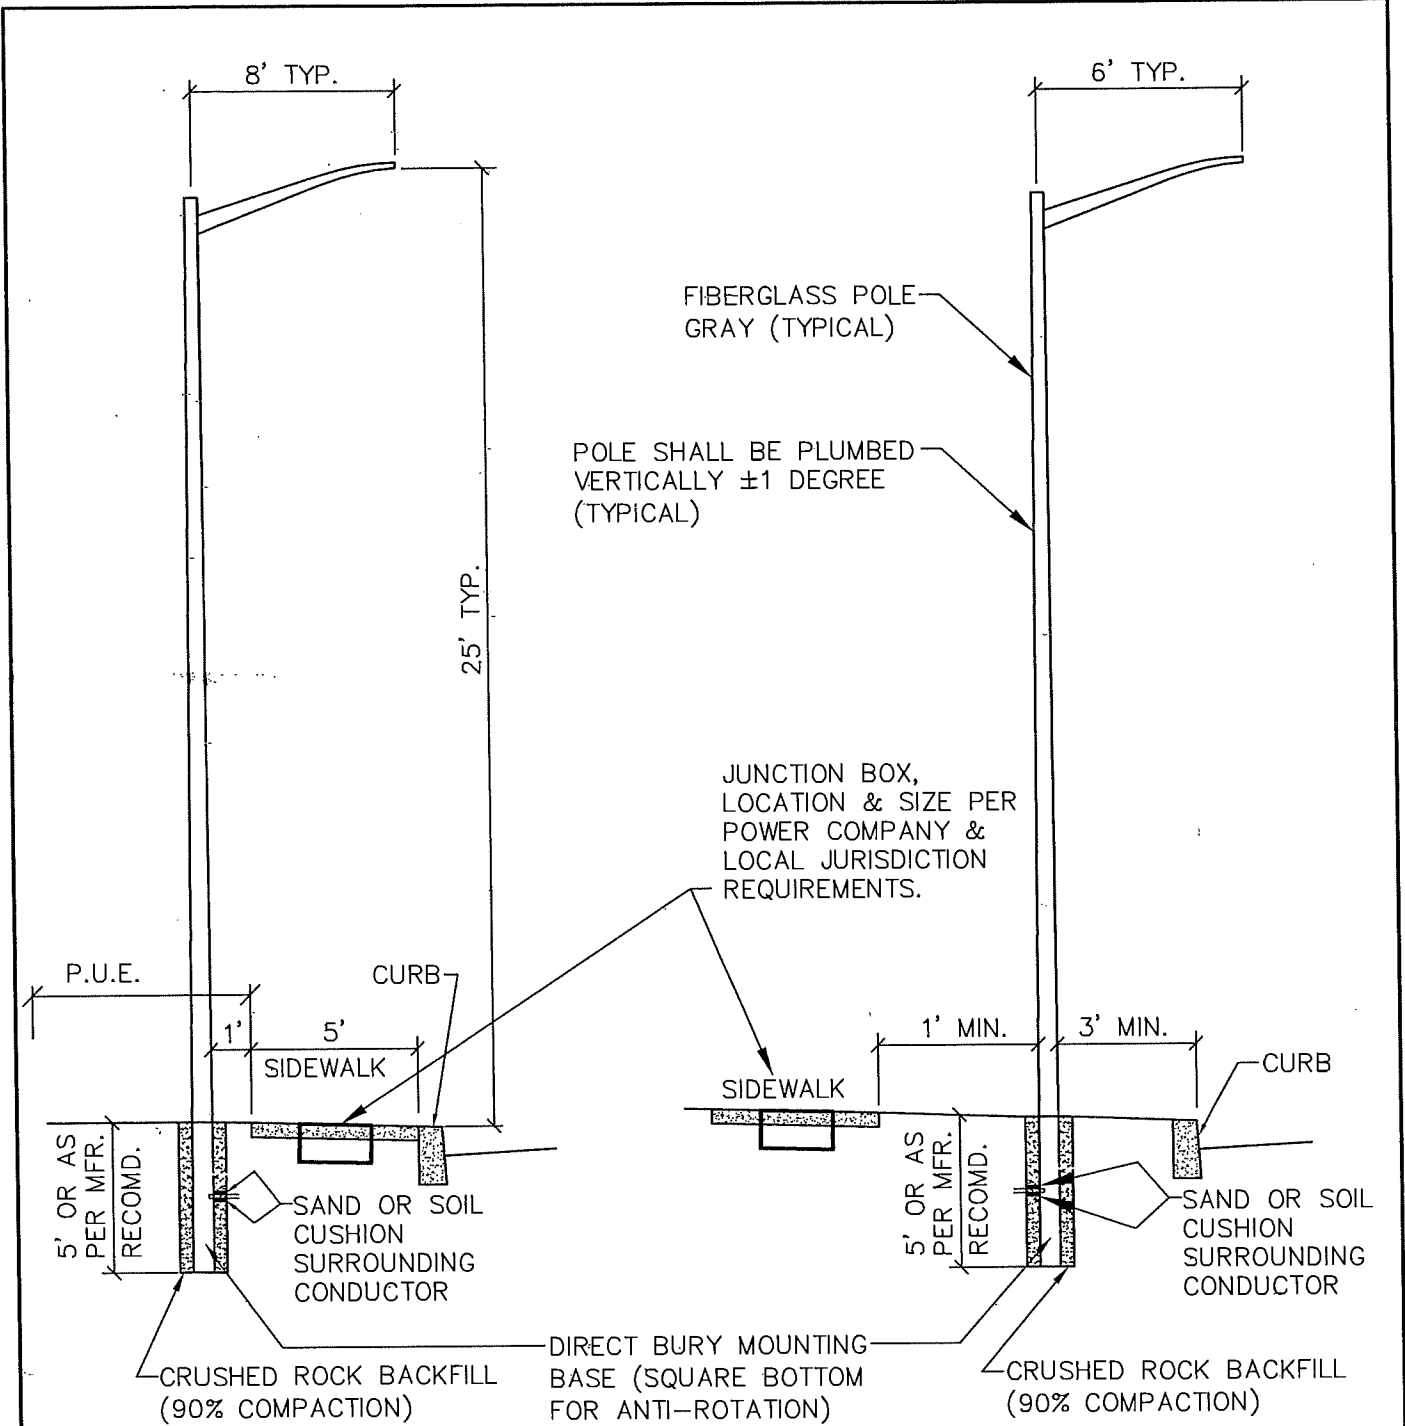

TYPICAL LAMP POST  
CROSS SECTION TYPE ONE

TYPICAL LAMP POST  
CROSS SECTION TYPE TWO


NOTES:

1. CONTRACTOR TO COORDINATE W/LOCAL POWER COMPANY AND AGENCY WITH JURISDICTION FOR MATERIALS AND WORKMANSHIP REQUIREMENTS.
2. UNLESS OTHERWISE SHOWN ON DRAWINGS OR REQUIRED BY CITY, PROVIDE CITY APPROVED COBRAHEAD LED FIXTURE EQUIVALENT TO 100 WATT HPS (45 WATT LED LEOTECH 3K GRAY COBRAHEAD).
3. PUBLIC STREET LIGHTS TO BE INSTALLED UNDER PGE TARIFF OPTION A (OWNED & MAINTAINED BY PGE).
4. PER ORS 92.044(7), STREET LIGHT MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT.

LAST REVISION DATE:	
FEB 2024	
<b>TYPICAL STREET LAMP POST</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 230

**SIGN TEXT STANDARDS:** PROVIDE SIGN TEXT AS FOLLOWS:

- 4" HIGH CHARACTERS FOR UPPER CASE,
- 3" HIGH CHARACTERS FOR LOWER CASE,
- 3" HIGH 1ST LETTER FOR TITLE (Rd/St/Ave/Ln/Ct/Blvd/Pvt etc).

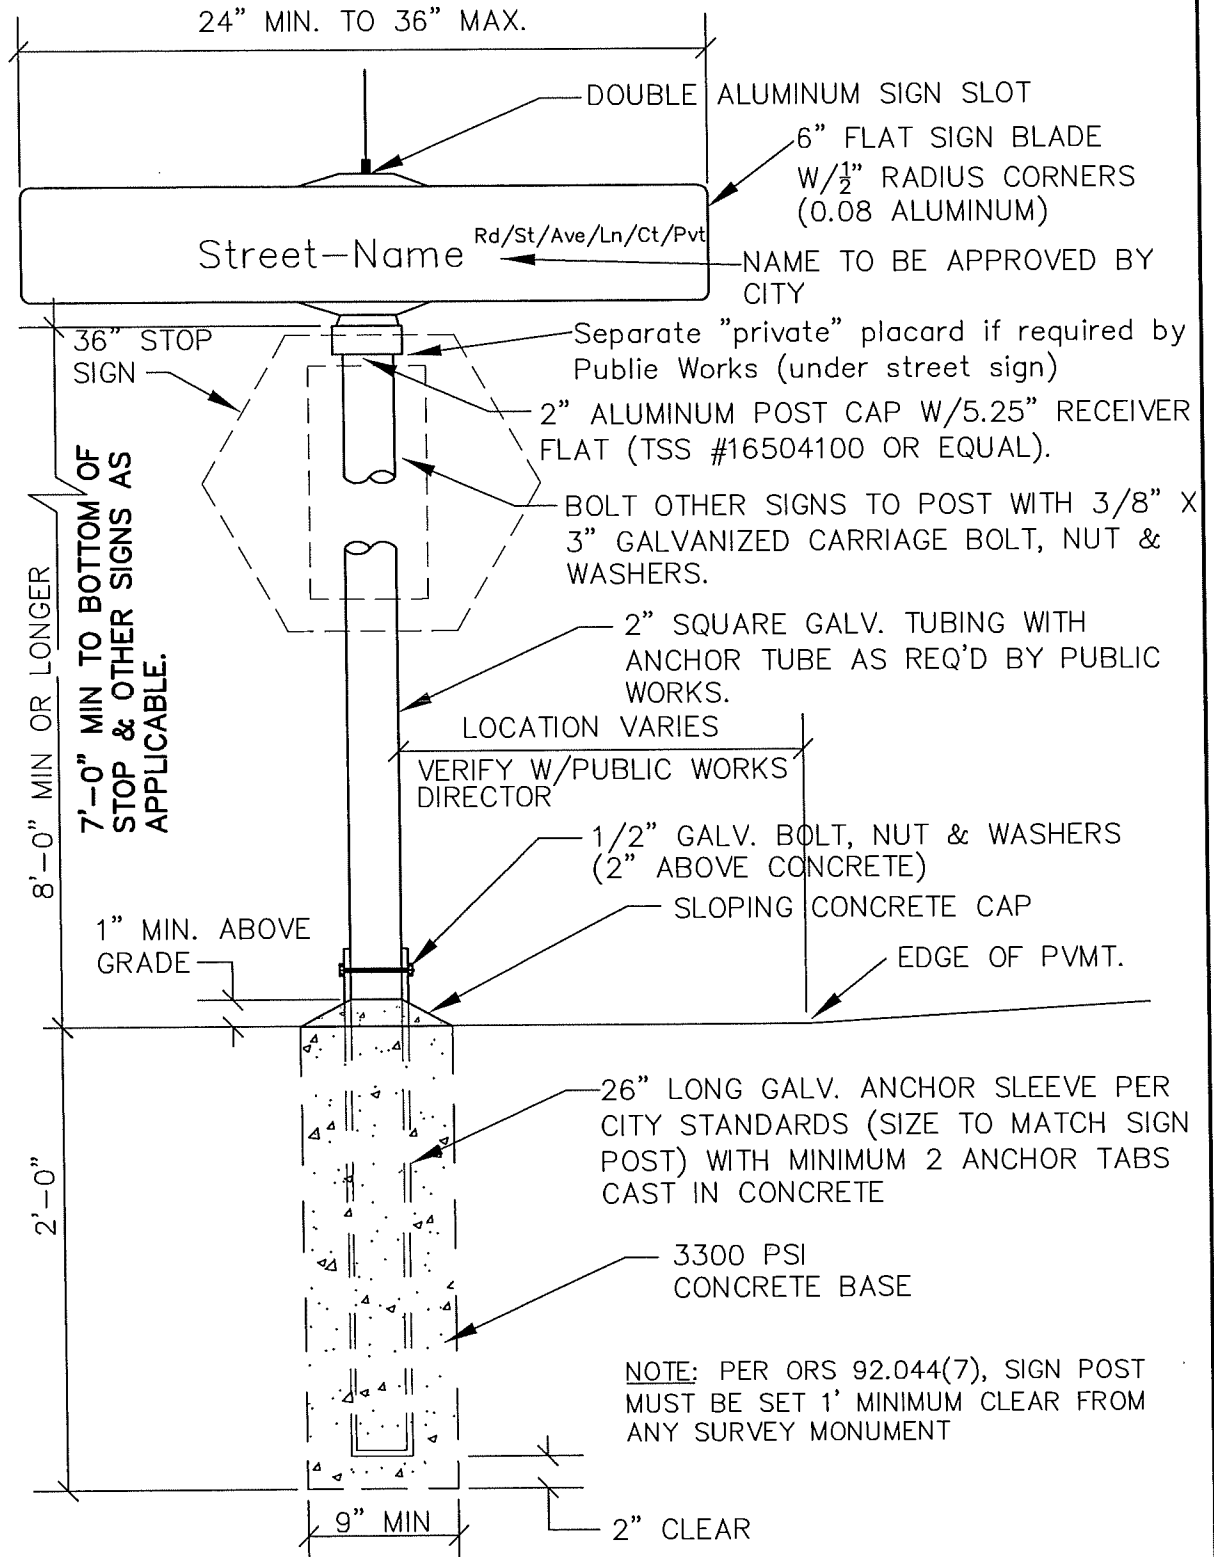


**NOTES:**

1. ALL RECONSTRUCTED & NEWLY PLATTED STREETS TO BE SIGNED IN ACCORDANCE WITH CITY STANDARDS.
2. SIGN PANEL TO BE ALUMINUM PER OSSC 02910, AND ALL SIGNS TO CONFORM WITH OREGON MUTCD.
3. PROVIDE STOP BARS (12' TYP LENGTH EACH VEHICLE LANE) AT ALL STOP SIGNS, BEHIND PEDESTRIAN CROSSING AT LOCATION ACCEPTABLE TO PUBLIC WORKS (SEE STANDARD CITY NOTES FOR TYPE OF MARKING).
4. CONTRACTOR SHALL COORDINATE WITH PUBLIC WORKS FOR INSPECTION OF BASE HOLES (DIAMETER & DEPTH) PRIOR TO CONCRETE PLACEMENT.

LAST REVISION DATE: MAR 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>SIGN POST FOR STREET SIGNS, STOP SIGNS, TRAFFIC CONTROL SIGNS, ETC.</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 231

**SIGN TEXT STANDARDS:** PROVIDE SIGN TEXT AS FOLLOWS:

- 4" HIGH CHARACTERS FOR UPPER CASE,
- 3" HIGH CHARACTERS FOR LOWER CASE,
- 3" HIGH 1ST LETTER FOR TITLE (Rd/St/Ave/Ln/Ct/Blvd/Pvt etc).

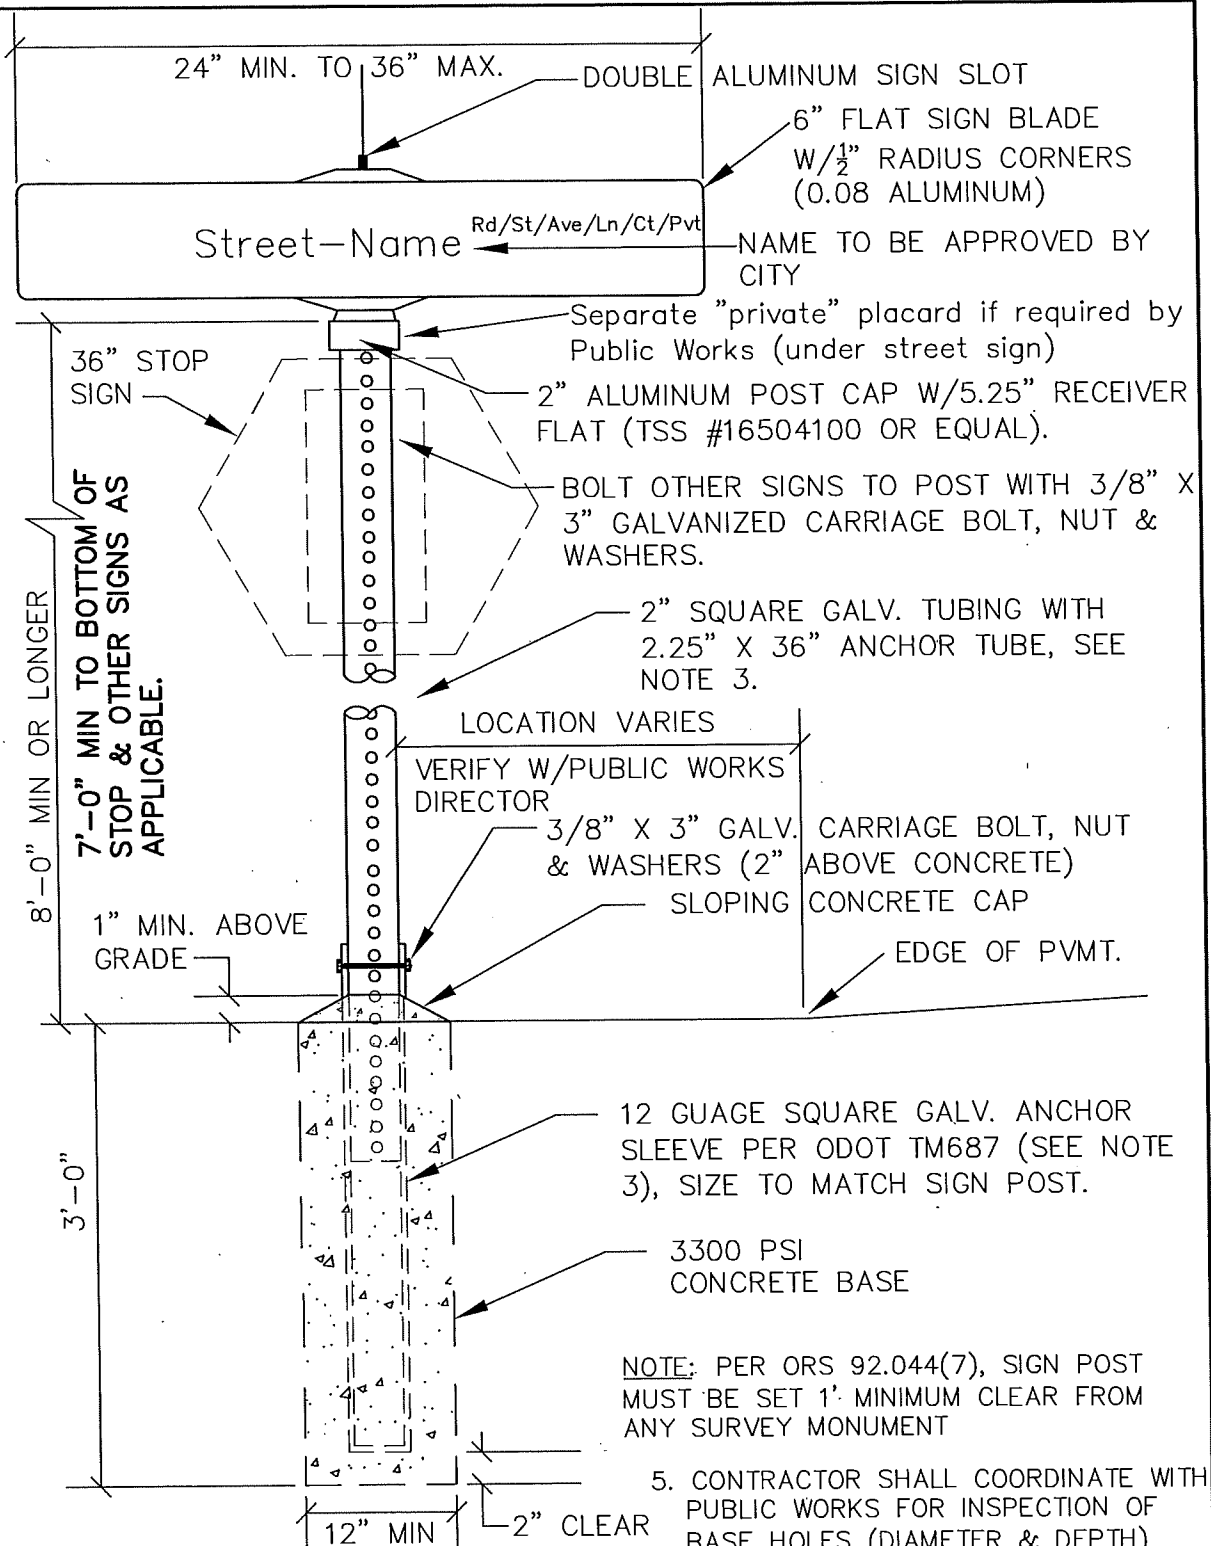

**NOTES:**

1. ALL RECONSTRUCTED & NEWLY PLATTED STREETS TO BE SIGNED IN ACCORDANCE WITH ODOT STANDARDS.
2. SIGN PANEL TO BE ALUMINUM PER OSSC 02910, AND ALL SIGNS SHALL CONFORM TO OREGON MUTCD.
3. SIGN POSTS & SLEEVES TO BE PERFORATED WITH 7/16" DIAMETER HOLES, HOLES TAPED AS REQUIRED DURING CONCRETE PLACEMENT.
4. PROVIDE STOP BARS AT ALL STOP SIGNS (12' TYP LENGTH EACH VEHICLE LANE), BEHIND PEDESTRIAN CROSSING (COORDINATE WITH AGENCY HAVING JURISDICTION FOR LOCATION & TYPE OF MARKING).

5. CONTRACTOR SHALL COORDINATE WITH PUBLIC WORKS FOR INSPECTION OF BASE HOLES (DIAMETER & DEPTH) PRIOR TO CONCRETE PLACEMENT.



NOTE: PER ORS 92.044(7), SIGN POST MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

LAST REVISION DATE:	
MAR 2024	
<b>SIGN POST WITH TELESPAR BASE &amp; ANCHOR (REQUIRED IN ODOT R.O.W)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 232

# OFF-STREET PARKING DIMENSIONS

STALLS WITHIN EACH PARKING LOT/PARKING FACILITY MAY BE DISTRIBUTED AS FOLLOWS: 60% STANDARD SPACES, 40% MAXIMUM COMPACT SPACES.

ALL COMPACT SPACES SHALL BE PERMANENTLY LABELED.

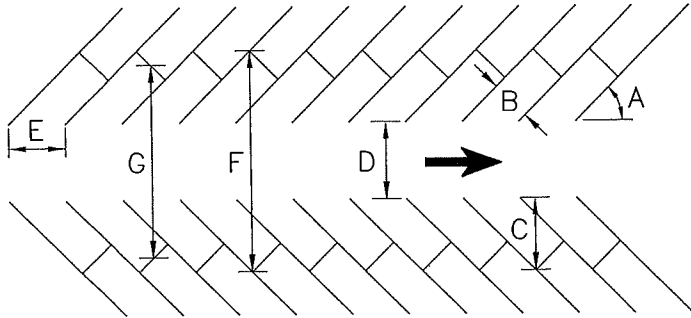

BACKING-POCKET FOR HEAD-IN PARKING WITHOUT DRIVE AISLE EXIT (MIN BACKING-POCKET WIDTH IS SAME AS WIDTH FOR STANDARD PARKING STALL).

- A- PARKING ANGLE
- B- STALL WIDTH
- C- STALL TO CURB DEPTH
- D- DRIVE AISLE WIDTH BETWEEN STALL LINES (SEE NOTE 1&2)
- E- STALL WIDTH PARALLEL TO AISLE
- F- MODULE WIDTH (FRONT OF STALL TO FRONT OF STALL)
- G- MODULE WIDTH (FRONT OF STALL TO FRONT OF STALL AT BUMPER MIDPOINT)

## OFF-STREET PARKING MATRIX

MINIMUM PARKING SPACE AND AISLE DIMENSIONS (FT)  
ONE WAY TRAFFIC FLOW

COMPACT (8.5' x 16')							STANDARD (9' x 19')					
A	B	C	D	E	F	G	B	C	D	E	F	G
0°	8.0	8.0	12.0	19.0	28.0	—	8.0	8.0	12.0	22.0	28.0	—
30°	8.5	15.4	12.0	17.0	41.7	34.4	9.0	17.3	12.0	18.0	45.6	37.8
45°	8.5	17.3	13.0	12.0	47.6	41.6	9.0	19.8	13.0	12.7	52.6	46.2
60°	8.5	18.1	18.0	9.8	54.2	50.0	9.0	21.0	18.0	10.4	60.0	55.7
70°	8.5	17.9	19.0	9.0	54.9	52.0	9.0	21.0	19.0	9.6	61.0	57.8
90°	8.5	16.0	24.0	8.5	56.0	56.0	9.0	19.0	24.0	9.0	62.0	62.0

**NOTES:**


1. WHERE PARKING LOT DRIVE AISLE IS A FIRE LANE, WIDTHS SHALL CONFORM WITH THE OREGON FIRE CODE (OFC) MINIMUMS OF 20 FEET IN ALL CASES (26 FOOT MINIMUM WIDTH, 20 FEET EACH WAY FROM FIRE HYDRANTS), PER OFC 503.2.1 & D103.1.
2. DRIVE AISLE WIDTH "D" IS REQUIRED FOR DRIVING / BACKING / TURNING MOVEMENTS ON BOTH SINGLE LOADED AND DOUBLE LOADED DRIVE AISLES.
3. SEE PWDS 2.28.1 FOR ALLOWABLE STANDARD PARKING SPACE LENGTH REDUCTION WITH SIDEWALKS 6' OR WIDER TO ACCOMODATE BUMPER OVERHANG. LENGTH OF COMPACT SPACES NOT TO BE REDUCED.
4. NUMBER & LOCATION OF ACCESSIBLE PARKING SPACES FOR EACH PARKING LOT/PARKING FACILITY SHALL BE PROVIDED PER OSSC 1106.

LAST REVISION DATE: FEB 2024	<small>COPYRIGHT 1986 WESTECH ENGINEERING, INC.</small>
<b>OFFSTREET PARKING DIMENSIONS ONE WAY TRAFFIC FLOW (NTS)</b>	
DAYTON, OR	DETAIL NO. <b>235</b>

# OFF-STREET PARKING DIMENSIONS

STALLS WITHIN EACH PARKING LOT/PARKING FACILITY MAY BE DISTRIBUTED AS FOLLOWS: 60% STANDARD SPACES, 40% MAXIMUM COMPACT SPACES.

ALL COMPACT SPACES SHALL BE PERMANENTLY LABELED.

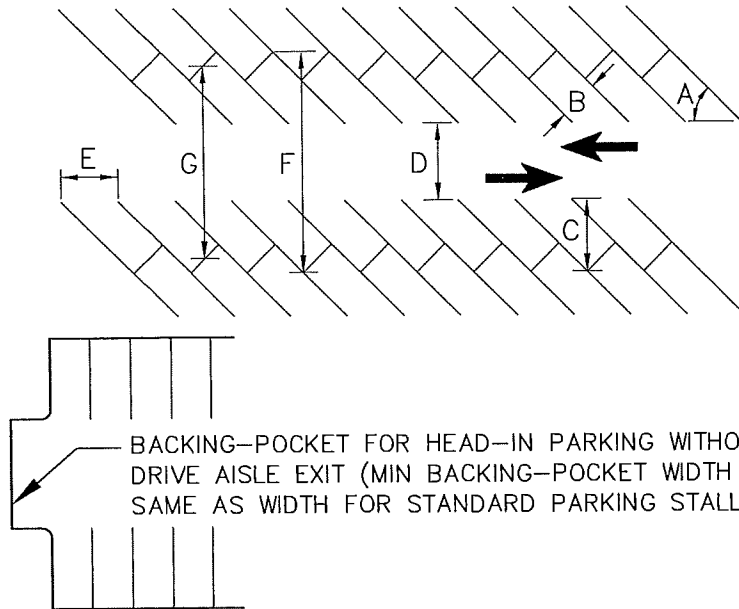

- A- PARKING ANGLE
- B- STALL WIDTH
- C- STALL TO CURB DEPTH
- D- DRIVE AISLE WIDTH BETWEEN STALL LINES (SEE NOTE 1&2)
- E- STALL WIDTH PARALLEL TO AISLE
- F- MODULE WIDTH (FRONT OF STALL TO FRONT OF STALL)
- G- MODULE WIDTH (FRONT OF STALL TO FRONT OF STALL AT BUMPER MIDPOINT)

## OFF-STREET PARKING MATRIX

MINIMUM PARKING SPACE AND AISLE DIMENSIONS (FT)  
ONE WAY TRAFFIC FLOW

COMPACT (8.5' x 16')							STANDARD (9' x 19')					
A	B	C	D	E	F	G	B	C	D	E	F	G
0°	8.0	8.0	24.0	19.0	40.0	-	8.0	8.0	24.0	22.0	40.0	-
30°	8.5	15.4	24.0	17.0	54.8	47.4	9.0	17.3	24.0	18.0	58.6	50.8
45°	8.5	17.3	24.0	12.0	58.6	52.9	9.0	19.8	24.0	12.7	63.6	57.2
60°	8.5	18.1	24.0	9.8	60.2	56.0	9.0	21.0	24.0	10.4	66	61.5
70°	8.5	17.9	24.0	9.0	59.8	56.9	9.0	21.0	24.0	9.6	66	62.9
90°	8.5	16.0	24.0	8.5	56.0	56.0	9.0	19.0	24.0	9.0	62.0	62.0

**NOTES:**

1. WHERE PARKING LOT DRIVE AISLE IS A FIRE LANE, WIDTHS SHALL CONFORM WITH THE OREGON FIRE CODE (OFC) MINIMUMS OF 20 FEET IN ALL CASES (26 FOOT MINIMUM WIDTH, 20 FEET EACH WAY FROM FIRE HYDRANTS), PER OFC 503.2.1 & D103.1.
2. DRIVE AISLE WIDTH "D" IS REQUIRED FOR DRIVING / BACKING / TURNING MOVEMENTS ON BOTH SINGLE LOADED AND DOUBLE LOADED DRIVE AISLES.
3. SEE PWDS 2.28.1 FOR ALLOWABLE STANDARD PARKING SPACE LENGTH REDUCTION WITH SIDEWALKS 6' OR WIDER TO ACCOMODATE BUMPER OVERHANG. LENGTH OF COMPACT SPACES NOT TO BE REDUCED.
4. NUMBER & LOCATION OF ACCESSIBLE PARKING SPACES FOR EACH PARKING LOT/PARKING FACILITY SHALL BE PROVIDED PER OSSC 1106.


LAST REVISION DATE: FEB 2024	<small>COPYRIGHT 1996 NESTECH ENGINEERING, INC.</small>
<b>OFFSTREET PARKING DIMENSIONS TWO WAY TRAFFIC FLOW (NTS)</b>	
DAYTON, OR	DETAIL NO. <b>236</b>

**REFERENCE NOTE:** ACCESSIBLE PARKING SPACES, ACCESS ROUTES, SIGNS, ETC. SHALL FULLY COMPLY WITH REQUIREMENTS OF THE **OREGON TRANSPORTATION COMMISSION – STANDARDS FOR ACCESSIBLE PARKING PLACES (OTC-SAPP), SEPT 2023 VERSION**(SEE PWDS APP F FOR COPY OF OTC-SAPP).



VAN-ACCESSIBLE

SIGNS PER OTC-SAPP FIG 1 & 2 (NOT ALL SIGNS SHOWN)

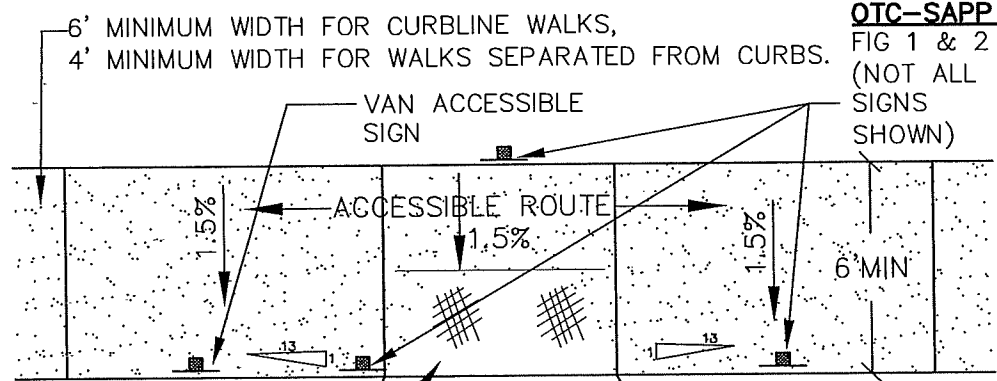


SIGNS PER OTC-SAPP FIG 1 & 2 (NOT ALL SIGNS SHOWN)

19' MIN. FOR ACCESSIBLE PARKING SPACES

CURB RAMP PER STATE STANDARDS (SHALL NOT EXTEND INTO ACCESS AISLE)

WHITE 4" WIDE PAINTED LINES (TYP)




ACCESS AISLE



NO PARKING

2' TYP



9'-0"

9'-0"

8'-0"

VAN-ACCESSIBLE


**DOUBLE ACCESSIBLE PARKING SPACE**

**NOTES:**

- ONE ACCESSIBLE PARKING SPACE MUST BE DESIGNATED "VAN-ACCESSIBLE", THE OTHER SPACE CAN BE EITHER "VAN-ACCESSIBLE" OR STANDARD ACCESSIBLE PARKING SPACE (SEE OTC-SAPP (FIGURES 1 & 2) FOR STATE REQUIRED SIGN LOCATIONS).
- VAN-ACCESSIBLE OR WHEELCHAIR ONLY SPACES SHALL HAVE AN ADDITIONAL SIGN(S) MOUNTED BELOW THE STANDARD ACCESSIBLE PARKING SPACE SIGN (SEE OTC-SAPP FIGURES 1 & 2).
- VAN-ACCESSIBLE SPACE CAN BE USED BY ANY VEHICLE WITH A DMV DISABLED PERMIT.
- MAXIMUM 2% CROSS SLOPE ALLOWED (ALL DIRECTIONS) IN ANY ACCESSIBLE PARKING SPACE OR ACCESS AISLE.
- POST MOUNTED SIGNS SHALL HAVE 7' (±3") CLEARANCE FROM SIGN BOTTOM TO GROUND. BUILDING MOUNTED SIGNS TO HAVE 5' MIN CLEARANCE TO SIGN BOTTOM.
- FOR MORE THAN TWO ADJACENT ACCESSIBLE PARKING SPACES, SEE OTC-SAPP (FIGURE 3) FOR SIGN LOCATIONS & LAYOUT.

LAST REVISION DATE:	FEB 2024
<b>DOUBLE ACCESSIBLE PARKING SPACE</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 237




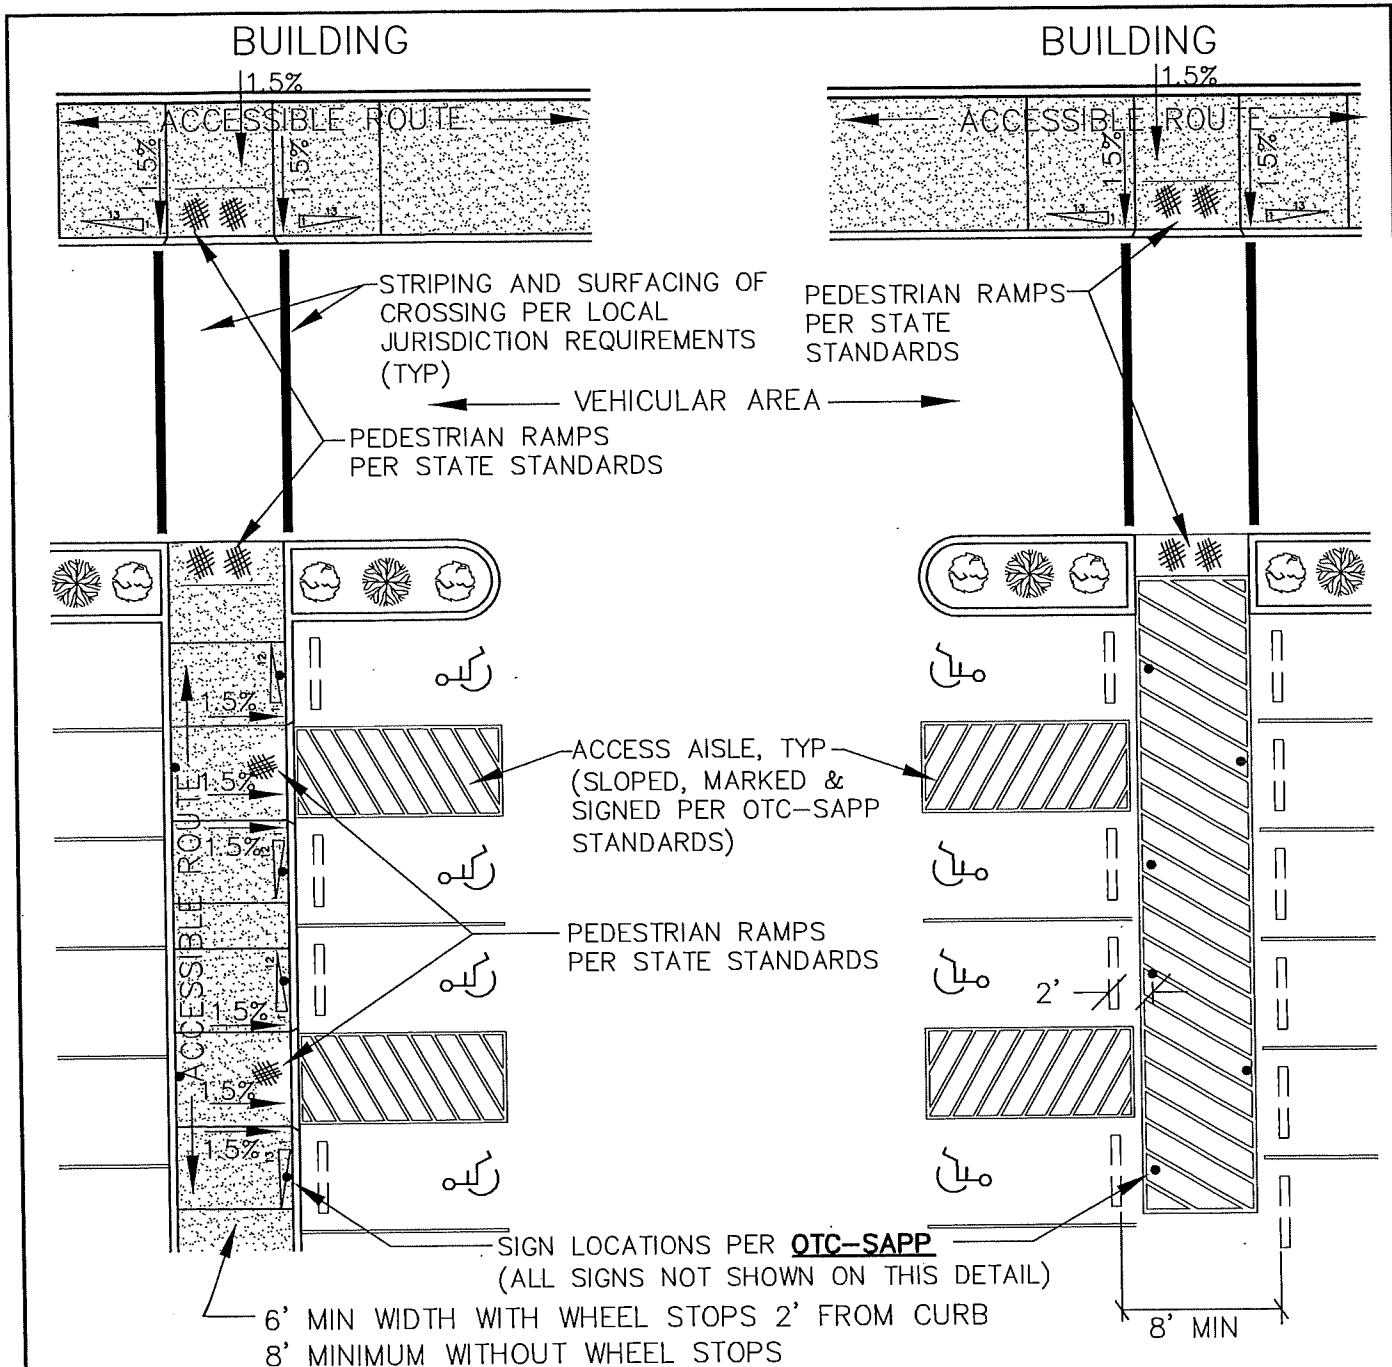

**NOTES:**

1. **REFERENCE NOTE:** ACCESSIBLE PARKING SPACES, ACCESS ROUTES, SIGNS, ETC. SHALL FULLY COMPLY WITH REQUIREMENTS OF THE **OREGON TRANSPORTATION COMMISSION – STANDARDS FOR ACCESSIBLE PARKING PLACES (OTC-SAPP), SEPT 2023** (SEE PWDS APP F FOR OTC-SAPP COPY).
2. SEE DETAIL 237 FOR TYPICAL ACCESSIBLE PARKING SPACE LAYOUT, DIMENSIONS, REFERENCE NOTES, ETC.
3. MAXIMUM 2% CROSS SLOPE ALLOWED (ALL DIRECTIONS) IN ANY ACCESSIBLE PARKING SPACE OR ACCESS AISLE.
4. POST MOUNTED SIGNS SHALL HAVE 7' (±3") CLEARANCE FROM SIGN BOTTOM TO GROUND.
5. SEE OTC-SAPP (FIGURE 3) FOR STATE REQUIRED SIGN LOCATIONS & LAYOUT WITH MULTIPLE ADJACENT ACCESSIBLE PARKING SPACES AS SHOWN.

LAST REVISION DATE: FEB 2024	JO #
<b>ACCESSIBLE ROUTES AND CROSSINGS IN VEHICULAR AREAS</b> (NTS)	
DAYTON, OR	DETAIL NO. 238

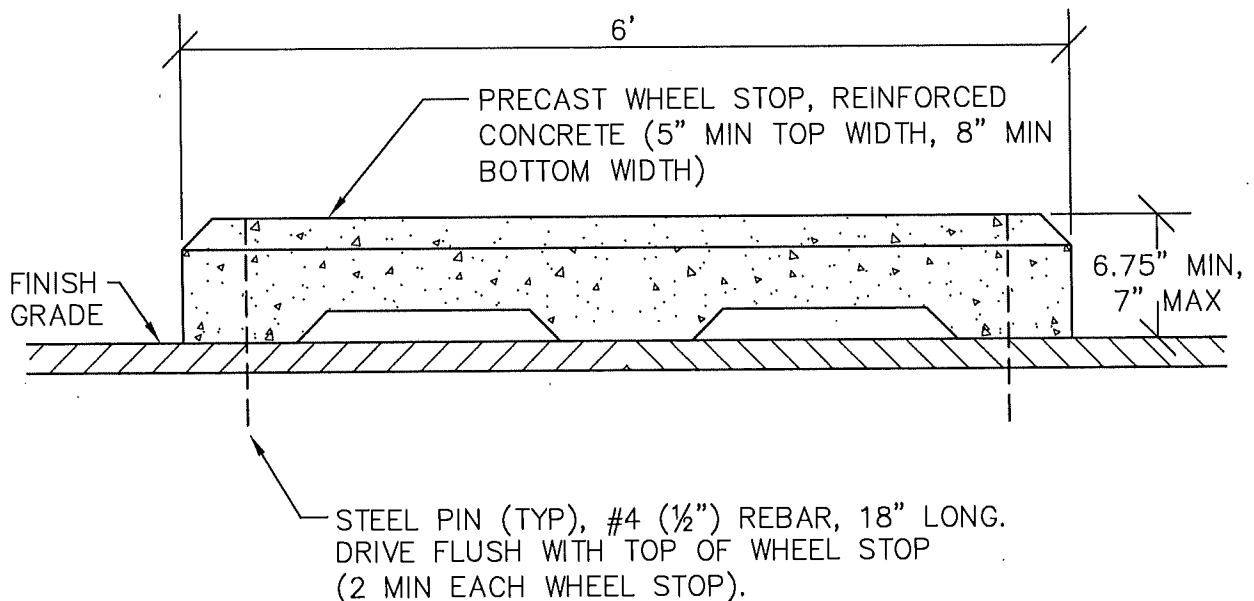


## SECTION

NTS

**NOTES:**

1. SEE DRAWINGS FOR LOCATION & NUMBER OF WHEEL STOPS, INCLUDING DIMENSION FROM CURB, EDGE OF PAVEMENT OR BUILDING AS APPLICABLE.
2. UNLESS OTHERWISE SPECIFIED OR SHOWN ON SITE PLAN, SET WHEEL STOPS 2 FEET FROM FACE OF CURB OR EDGE OF PAVEMENT, MEASURED FROM THE FACE OF THE WHEEL STOP (VEHICLE SIDE) TO FACE OF CURB (OR EDGE OF PAVEMENT). SET BACK FROM PROPERTY LINES PER CITY STANDARDS (3' MIN). MIN SETBACK FROM BUILDINGS AS SHOWN ON DWGS.
3. FOR USE ON HEAD-IN PARKING WITHOUT FULL HEIGHT CURBS, OR WHERE A SIDEWALK ALONG HEAD-IN PARKING IS LESS THAN 6 FEET WIDE.

LAST REVISION DATE: JAN 2013	JO #
<b>PRECAST WHEELSTOP DETAIL</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>239</b>


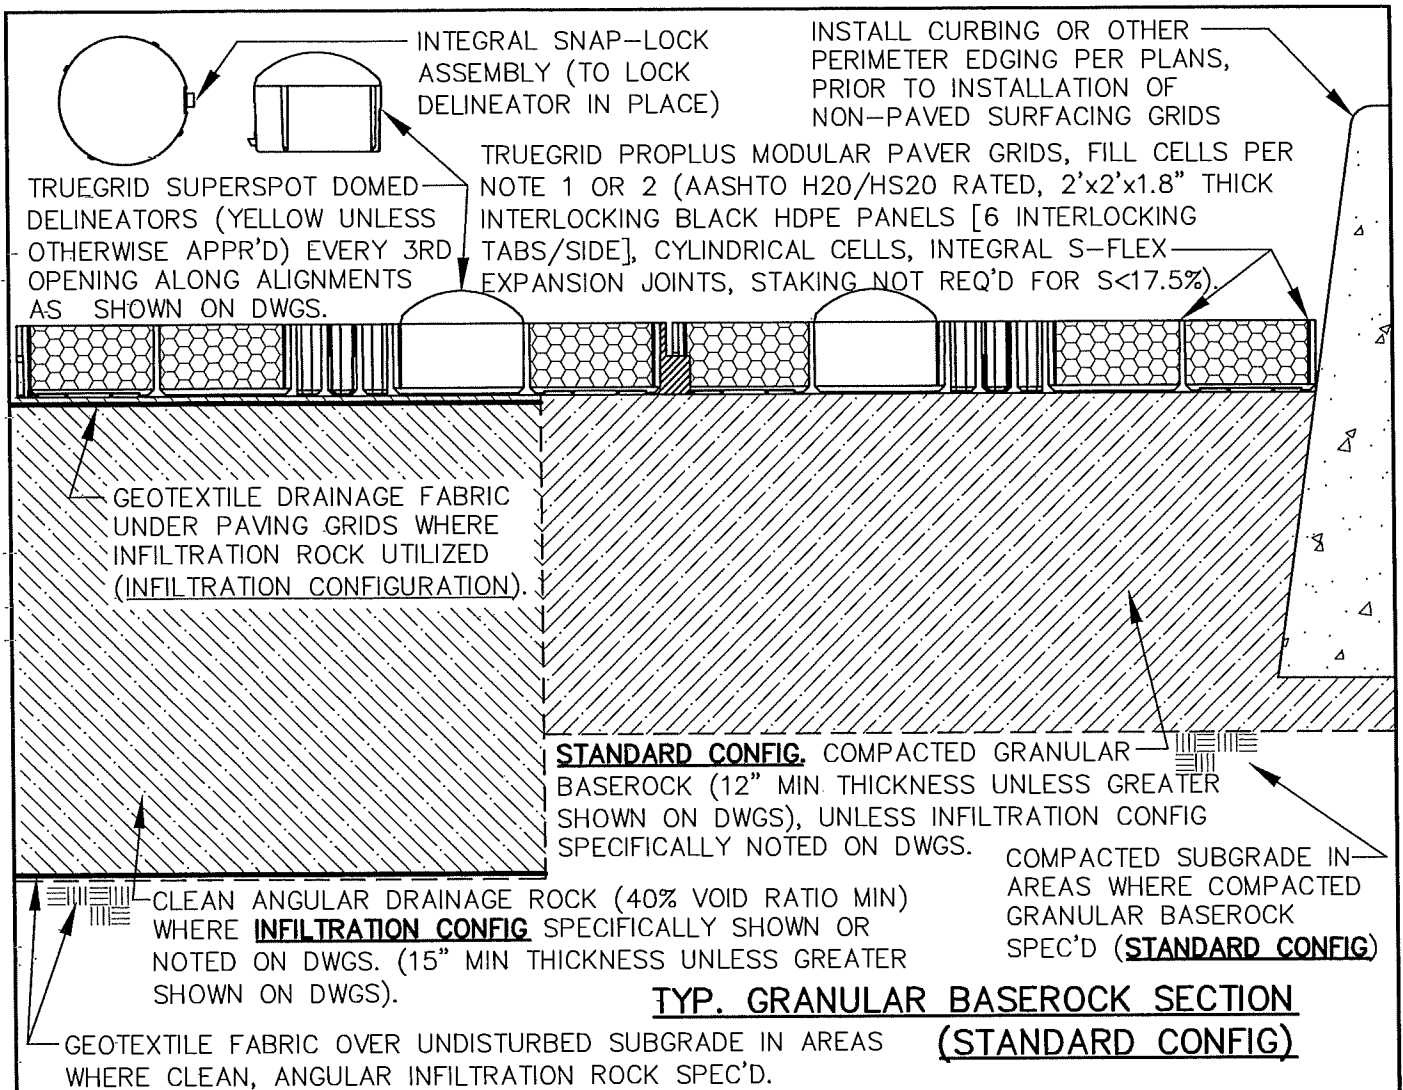


**TYP. DRAINAGE ROCK SECTION (INFILTRATION CONFIG)**

**NOTES: (INFILTRATION CONFIG)**

- STANDARD CONFIG.** UNLESS OTHERWISE SHOWN ON APPROVED DRAWINGS, BASEROCK UNDER PAVING GRIDS SHALL BE 1"-0 GRANULAR BASEROCK (OR 3/4"-0), COMPACTED TO 95% OPTIMUM PER AASHTO T-180. TYPICAL MODULAR GRID CELL FILL SHALL BE 3/4"-0 GRANULAR BASEROCK.
- WHERE **INFILTRATION CONFIG** IS SPECIFICALLY SHOWN OR NOTED ON APPR'D DRAWINGS, DRAINAGE STONE UNDER PAVING GRIDS SHALL BE CLEAN, CRUSHED, ANGULAR QUARRY STONE WITH 3/4"-2" GRADATION SIZE. MODULAR GRID CELL FILL SHALL BE 1/2" CLEAN ANGULAR STONE.
- OVERFLOW.** A PERFORATED PIPE TIED TO A PIPED OVERFLOW SHALL BE PROVIDED FOR ANY INFILTRATION SYSTEM WHICH COULD OTHERWISE OVERFLOW ONTO ADJACENT PRIVATE PROPERTY OR ACROSS SIDEWALKS (PIPE NOT SHOWN IN THIS DETAIL).
- WHEEL STOPS** FOR INFILTRATION CONFIGURATION (WHERE PROVIDED) SHALL BE PINNED IN PLACE WITH #4 REBAR, LENGTH AS REQUIRED TO EXTEND 24" MINIMUM INTO THE SUBGRADE BELOW THE DRAINAGE ROCK.
- CURBS & OTHER ADJACENT HARD SURFACES SHALL BE INSTALLED BEFORE INSTALLATION OF MODULAR SURFACING GRIDS. THE CONTRACTOR SHALL VERIFY THAT THE PROPOSED GRID GRADE ELEVATIONS MATCH OTHER SURFACES, BASED ON THE SLOPES SHOWN ON THE DRAWINGS AND ANY SPECIFIED CURB EXPOSURE.**  
MODULAR GRIDS SHALL BE SET FLUSH W/ADJACENT HARD SURFACES OR SLIGHTLY RECESSED (1/4" MAX). ANY DISCREPANCIES SHALL BE REPORTED TO THE ENGINEER PRIOR TO PLACEMENT OR CONSTRUCTION.

LAST REVISION DATE: FEB 2024	
TRUEGRID PROPLUS INDUSTRIAL GRADE MODULAR NON-PAVED SURFACE SYSTEM (NTS)	
DAYTON, OR	DETAIL NO. 240

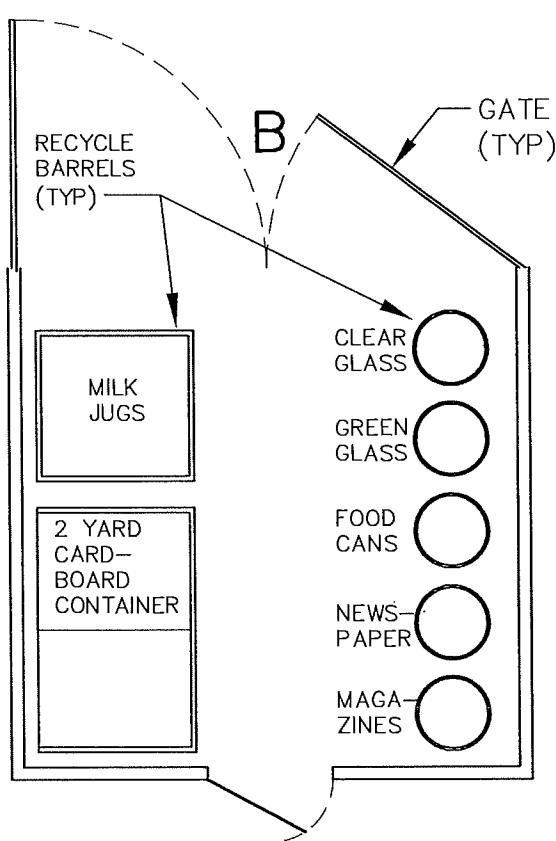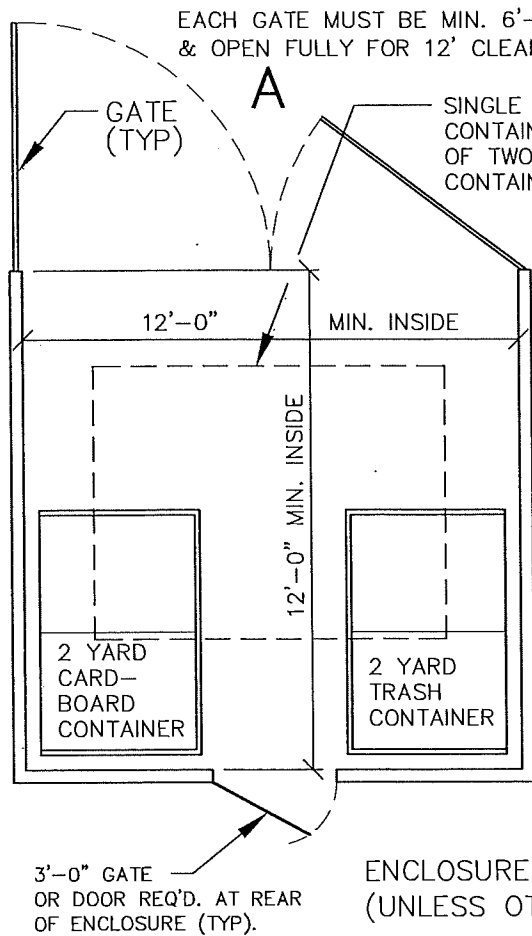

ENCLOSURES SHALL BE LOCATED OUTSIDE OF THE PUBLIC R/W (UNLESS OTHERWISE APPROVED IN WRITING BY THE CITY).

**TRASH ENCLOSURE\*\***


**RECYCLE ENCLOSURE\*\***

\*\*ENCLOSURES SHOWN ARE TYPICAL EXAMPLES UNLESS ALTERNATE CONFIGURATION IS APPROVED BY TRASH/RECYCLING FRANCHISEE AND CITY PLANNER.

**NOTES:**


1. GATES:
  - (a) ALL GATES MUST ATTACH AT THE END OF OF THE WALLS TO PROVIDE A MINIMUM OF 12' CLEAR WORKING SPACE WHEN OPEN.
  - (b) TO SERVICE THE ENCLOSURE, THE GATES MUST BE ABLE TO BE PINNED IN MUST BE ABLE TO BE PINNED IN THE FULL OPEN POSITION.
  - (c) GATES MUST OPEN FROM OUTSIDE THE ENCLOSURE.
2. FOR 5 OR 6 YARD CONTAINERS THE ENCLOSURE DEPTH MUST BE 15'.
3. WHERE REQ'D. (I.E. RESTAURANTS), GREASE BARRELS MUST BE SEPARATE FROM TRASH AND RECYCLING ENCLOSURES.
4. ROOFS OR OVERHANGS SHALL HAVE 15' OF OVERHEAD CLEARANCE.
5. IF RECYCLING IS NOT INCLUDED, AREA (A) CAN PROVIDE SERVICE FOR TRASH AND CARDBOARD FOR CONTAINER SIZES OF 1 TO 2 YARDS. IF A 3 YARD OR LARGER TRASH CONTAINER IS NEEDED, AN ADDITIONAL 12' X 12' SPACE WILL BE NECESSARY FOR CARDBOARD CONTAINER SERVICE.
6. CONCRETE PADS REQUIRED FOR ALL ENCLOSURES. WALLS, GATE & DOOR MATERIALS & HEIGHT PER CITY STANDARDS BASED ON SCREENING REQUIREMENTS.
7. A 1 YD. CONTAINER WILL HOLD APPROXIMATELY THE SAME AS 6 TRASH CANS (32 GAL SIZE). USE 6 TIMES THE CONTAINER SIZE IN YARDS TO ESTIMATE A CONTAINER CAPACITY. FOR EXAMPLE, A 3 YD. CONTAINER WILL HOLD APPROX THE SAME AMOUNT AS 18 TRASH CANS (32 GAL SIZE).

LAST REVISION DATE:	MAY 2014
<b>TYPICAL TRASH AND RECYCLING ENCLOSURE</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 250

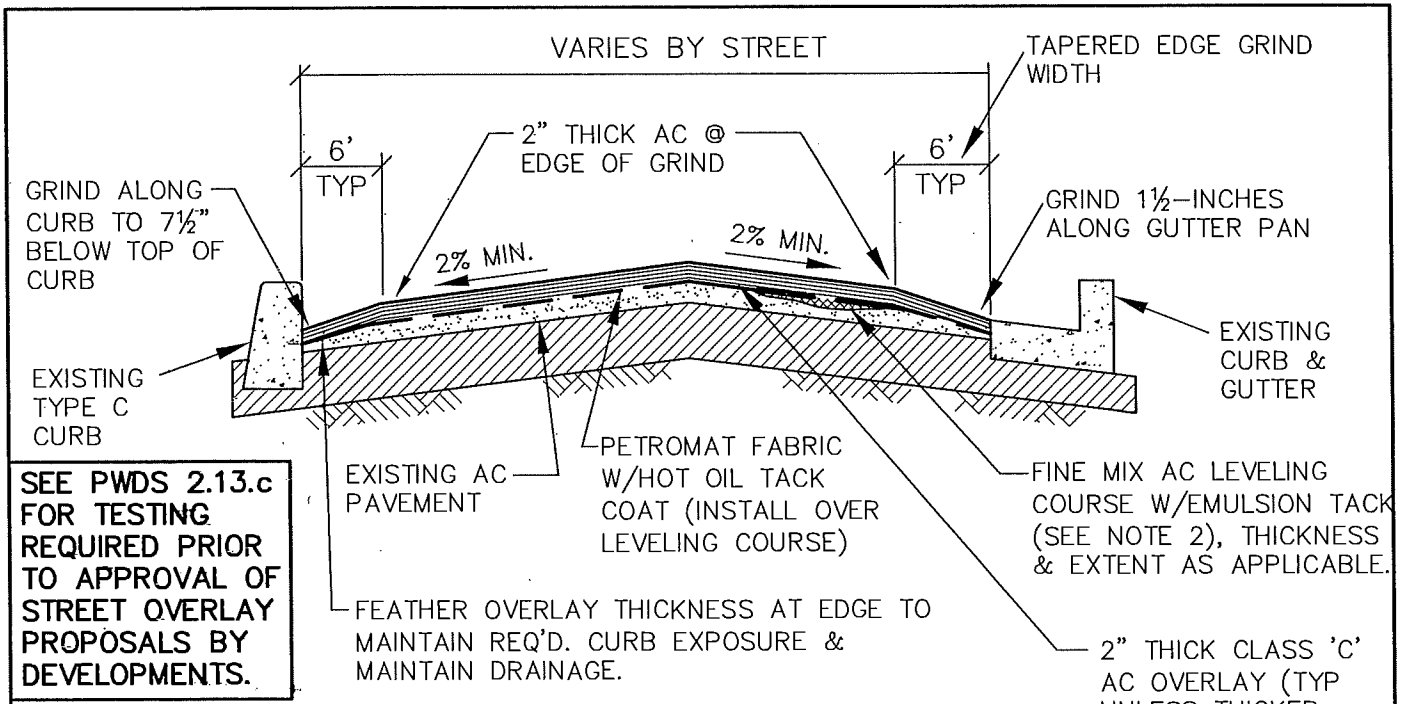

**SEE PWDS 2.13.c FOR TESTING REQUIRED PRIOR TO APPROVAL OF STREET OVERLAY PROPOSALS BY DEVELOPMENTS.**

**TYPICAL A.C. OVERLAY—SECTION**  
NTS

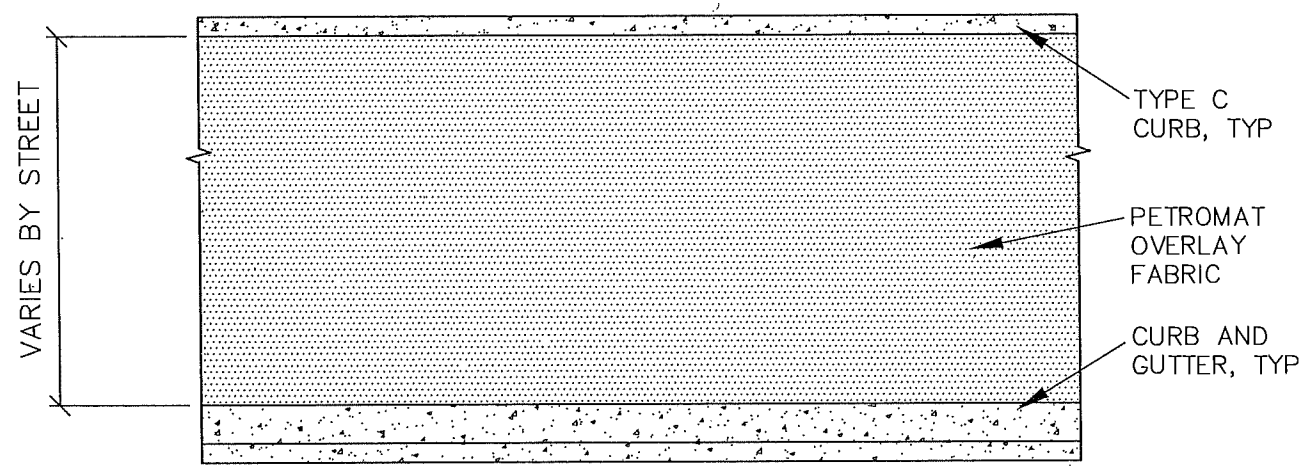


**TYPICAL A.C. OVERLAY—PLAN**  
NTS

**NOTES:**


1. EXISTING PAVEMENT TO BE CLEANED PRIOR TO PLACING LEVELING COURSE OR FABRIC.
2. HOT OIL TACK (PBA-5) REQUIRED UNDER OVERLAY FABRIC & UNDER ENTIRE OVERLAY AREA. EMULSION TACK COAT PROHIBITED FOR USE WITH OVERLAY FABRIC (EMULSION TACK ONLY ALLOWED FOR USE UNDER LEVELING COURSE, AS WELL AS ALONG CURBS & GUTTER PANS, AT MH RIM'S, VALVE BOXES & AROUND OTHER STRUCTURES).
3. UNLESS OTHERWISE SPECIFIED, CLEAN OUT ALL CRACKS 1/2-INCH OR WIDER & FILL DURING PRE-LEVEL, OR FILL WITH ODOT APPROVED HOT POUR CRACK SEALANT (COMPLETE EITHER OPTION PRIOR TO PLACEMENT OF FABRIC OR OVERLAY PAVEMENT).
4. PRIOR TO PAVING, RAISE ALL VALVE BOXES AND SIMILAR STRUCTURES TO GRADE, THEN INSTALL RISER RINGS ON MANHOLES, MONUMENT BOXES AND SIMILAR STRUCTURES.
5. FEATHER OVERLAYS TO MATCH EXISTING PAVEMENT AT ENDS & JOINTS WHERE GRINDING IS NOT SPECIFIED, & ALSO AT OTHER DESIGNATED STRUCTURES THAT CANNOT BE RAISED TO GRADE (AS REQUIRED TO MAINTAIN DRAINAGE).
6. ADJUST & FEATHER OVERLAY AT INTERSECTIONS, ALONG CURBLINES & AT CURB RADII AS REQUIRED TO ENSURE POSITIVE DRAINAGE.

LAST REVISION DATE:	FEB 2024
<b>CURBED SECTION, TYPICAL OVERLAY PLAN &amp; SECTION (WITH EDGE GRINDING)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 260

SEE PWDS 2.13.c  
FOR TESTING  
REQUIRED PRIOR  
TO APPROVAL OF  
STREET OVERLAY  
PROPOSALS BY  
DEVELOPMENTS.

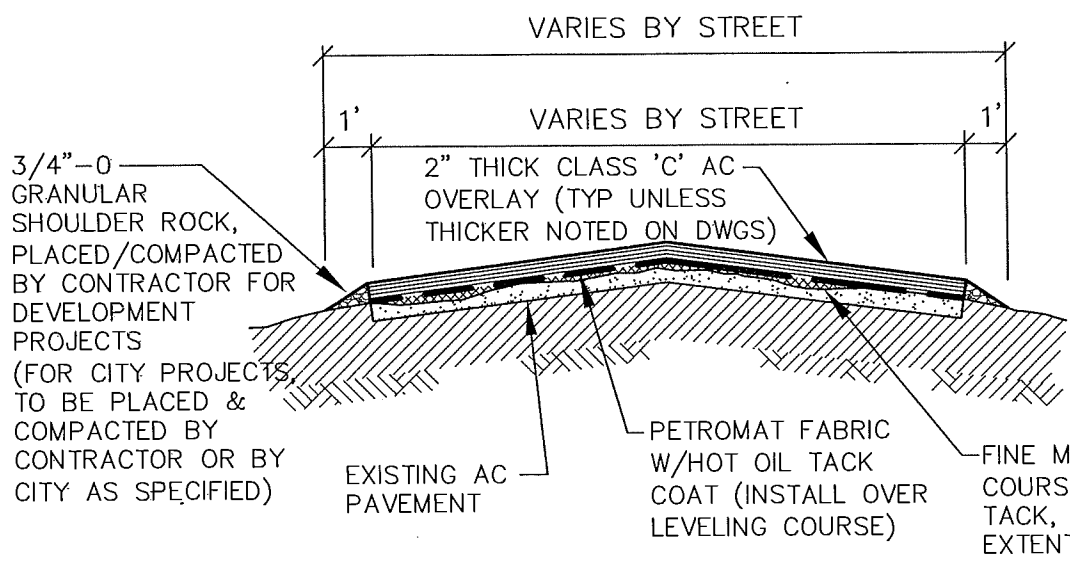

**TYPICAL A.C. OVERLAY—SECTION**  
NTS

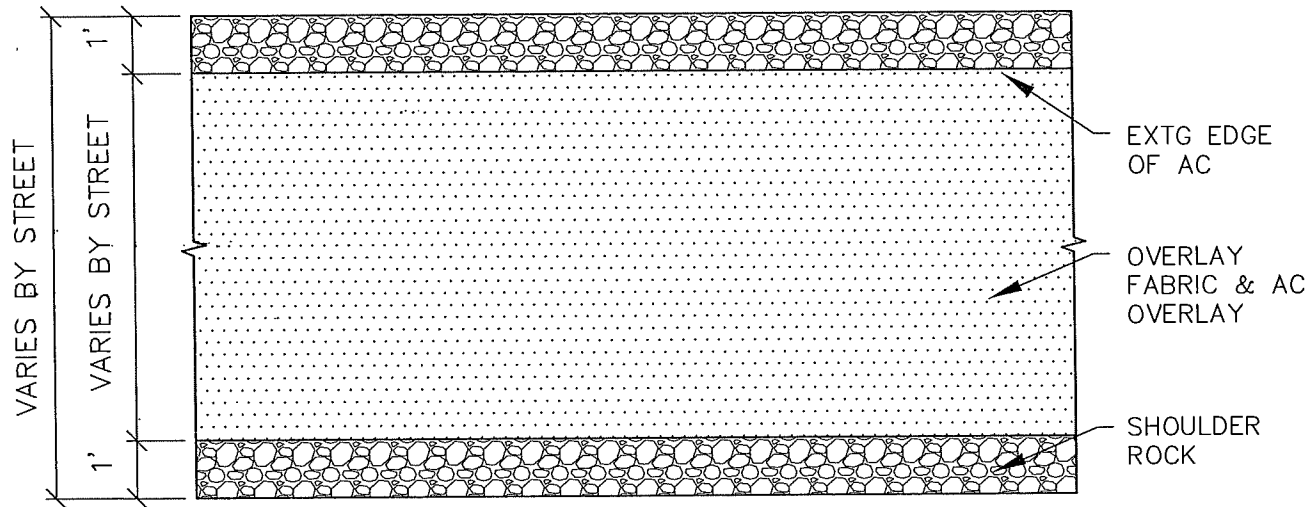

**TYPICAL A.C. OVERLAY—PLAN**  
NTS

**NOTES:**

1. EXISTING PAVEMENT TO BE CLEANED PRIOR TO PLACING LEVELING COURSE OR FABRIC.
2. HOT OIL TACK (PBA-5) REQUIRED UNDER OVERLAY FABRIC & UNDER ENTIRE OVERLAY AREA. EMULSION TACK COAT PROHIBITED FOR USE WITH OVERLAY FABRIC (EMULSION TACK ONLY ALLOWED FOR USE UNDER LEVELING COURSE, AS WELL AS ALONG CURBS & GUTTER PANS, AT MH RIM'S, VALVE BOXES & AROUND OTHER STRUCTURES).
3. UNLESS OTHERWISE SPECIFIED, CLEAN OUT ALL CRACKS 1/2-INCH OR WIDER & FILL DURING PRE-LEVEL, OR FILL WITH ODOT APPROVED HOT POUR CRACK SEALANT (COMPLETE EITHER OPTION PRIOR TO PLACEMENT OF FABRIC OR OVERLAY PAVEMENT).
4. PRIOR TO PAVING, RAISE ALL VALVE BOXES AND SIMILAR STRUCTURES TO GRADE, THEN INSTALL RISER RINGS ON MANHOLES, MONUMENT BOXES AND SIMILAR STRUCTURES.
5. FEATHER OVERLAYS TO MATCH EXISTING PAVEMENT AT ENDS & JOINTS WHERE GRINDING IS NOT SPECIFIED, & ALSO AT OTHER DESIGNATED STRUCTURES THAT CANNOT BE RAISED TO GRADE (AS REQUIRED TO MAINTAIN DRAINAGE).
6. ADJUST & FEATHER OVERLAY AT INTERSECTIONS, ALONG CURBLINES & AT CURB RADII AS REQUIRED TO ENSURE POSITIVE DRAINAGE.

LAST REVISION DATE:	
FEB 2024	
<b>TURNPIKE SECTION, TYPICAL OVERLAY PLAN &amp; SECTION (WITHOUT GRINDING)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 260A

TRENCH COMPACTION: CLASS 1 GRANULAR BACKFILL - 92% OPTIMUM PER AASHTO T-180 (MODIFIED PROCTOR)  
 CLASS 3 NATIVE BACKFILL - 85% OPTIMUM PER AASHTO T-180

**SURFACE RESTORATION CLASS**

(SEE DTLS 302-304 FOR REQ'MTS)

95% COMPACTION REQ'D W/IN STREET BASEROCK THICKNESS (UNDER EXISTING STREETS) PER AASHTO T-180

12" MIN.  
18" MAX.  
TO TAPE

**6-INCH WIDE UNDERGROUND WARNING TAPE**

(COLOR & WORDS AS REQ'D FOR WATER, SEWER, STORM, ETC.)

**CLASS 1 BACKFILL:**  
3/4"-0" GRANULAR BACKFILL  
(92% COMPACTION, SEE ABOVE)

**CLASS 3 BACKFILL:**  
CLEAN NATIVE BACKFILL ABOVE PIPE ZONE  
(85% COMPACTION, SEE ABOVE)


(% TRENCH COMPACTION PER NOTES ABOVE, SEE NOTE 2)

COMPACTED BACKFILL

**TRENCH FOUNDATION STABILIZATION:** IF TRENCHES ARE OVER-EXCAVATED FOR ANY REASON, OVER-EXCAVATION SHALL BE FILLED TO THE DESIGN TRENCH SUBGRADE (IE. TO THE BOTTOM OF THE 6" THICK BEDDING) WITH COMPACTED, WELL-GRADED GRANULAR BACKFILL AS SPECIFIED (IE. THE USE OF OPEN GRADED ROCK IS PROHIBITED UNLESS IT IS COMPLETELY ENCAPSULATED IN GEOTEXTILE FABRIC & APPROVED BY AHJ).

PIPE ZONE  
3/4"-0" COMPACTED GRANULAR BACKFILL TO 12" OVER PIPE (BOTH CLASS 1 & 3 BACKFILL)

PIPE EMBED.  
3/4"-0" GRANULAR BEDDING (ALL TRENCHES)

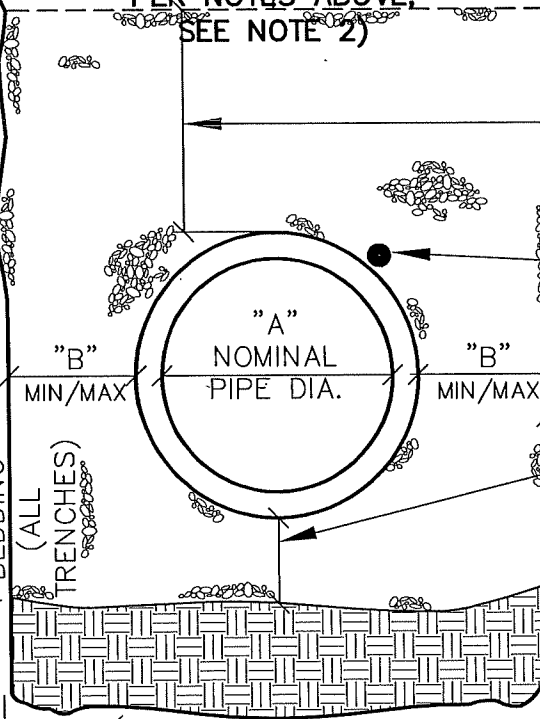

12" MIN. ABOVE OUTSIDE OF PIPE BELL (TYPICAL ALL PIPE TYPES)

TRACER WIRE ALONG ALL PIPE & LATERALS (TAPE TO PIPE BELOW CROWN, AT 5' MAX INTERVALS, 10:30 OR 1:30 POSITION)

6" MIN BEDDING BELOW PIPE (TYPICAL ALL PIPE TYPES, ALL LOCATIONS)

"A" NOM. PIPE DIAMETER	"B" MIN/MAX CLEARANCE
≤10	10"/18"
12"-16"	12"/18"
18"-21"	16"/24"
24"-30"	18"/30"
>30"	24"/36"

(SEE NOTE 5)

↑ STABLE SUBGRADE, OR TRENCH FOUNDATION STABILIZATION AS REQUIRED

24" MIN. (SEE TABLE)

**NOTES:**

- CLASS 1 GRANULAR BACKFILL REQUIRED UNDER ALL EXISTING OR FUTURE IMPROVED AREAS, INCLUDING STREETS, SHOULDERS, PARKING, SIDEWALKS, ETC.
- SUBMIT WRITTEN BACKFILL COMPACTION TEST RESULTS PRIOR TO INSTALLING AC PAVEMENT OR CONCRETE SURFACE RESTORATION.
- WHERE NEW PIPING IS IN SAME ALIGNMENT AS EXISTING PIPING, GRANULAR PIPE EMBEDMENT SHALL EXTEND TO A MIN. OF 6" BELOW THE NEW PIPING OR 6" BELOW EXISTING PIPING, WHICHEVER IS DEEPER.
- SHORING NOTE, PIPE ZONE:** FOR FLEXIBLE PIPE, BOTTOM OF TRENCH SHORING SHALL BE ABOVE PIPE SPRINGLINE PRIOR TO COMPACTING BACKFILL BELOW THE PIPE SPRINGLINE AND UNDER THE PIPE HAUNCHES (TO AVOID LOSS OF PIPE SIDE SUPPORT).
- MINIMUM CLEARANCES SHOWN ("B") ASSUMES STANDARD 6" WALL TRENCH BOXES SET ON TRENCH BOTTOM, AND REPRESENTS WIDTH REQUIRED TO CONSOLIDATE GRANULAR MATERIAL UNDER PIPE HAUNCHES (TO AVOID LOSS OF SIDE SUPPORT WHEN TRENCH BOX IS MOVED OR PULLED FORWARD). TRENCH WIDTH REDUCTION REQUIRES PRIOR APPROVAL BASED ON ACTUAL TRENCH SHORING PROPOSED.

LAST REVISION DATE:

MAR 2024

**TRENCH BACKFILL,  
BEDDING,  
AND PIPE ZONE**

(NTS)

DAYTON, OR

DETAIL NO.

301

PLACE 4" MIN. THICKNESS, CL.'C' A.C. IN TWO EQUAL LIFTS, OR THICKNESS OF REMOVED PAVEMENT, WHICHEVER IS GREATER, TO 91% OPT. DENSITY PER RICE STD. METHOD.

SEAL SURFACE OVER JOINT WITH TACK MATERIAL AND SAND (AC PATCH ONLY)

MIN. TRENCH PATCH WIDTH  
ROLLER WIDTH PLUS 2"


EXISTING PAVEMENT

6" MIN.

TACK COAT CUT EDGES

6" MIN.

EXISTING PAVEMENT

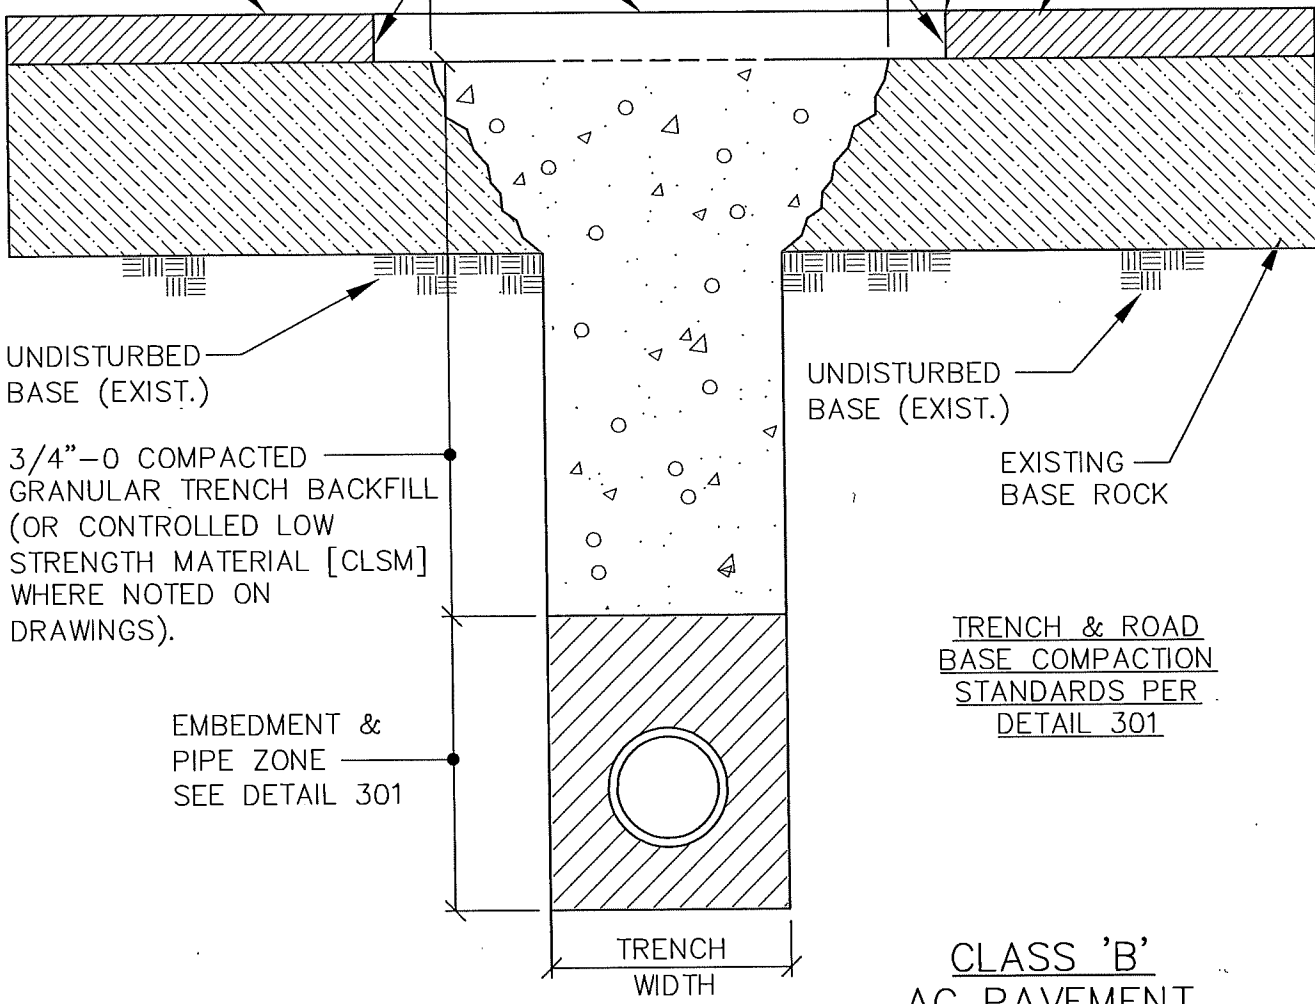

UNDISTURBED BASE (EXIST.)

3/4"-0 COMPACTED GRANULAR TRENCH BACKFILL (OR CONTROLLED LOW STRENGTH MATERIAL [CLSM] WHERE NOTED ON DRAWINGS).

EMBEDMENT & PIPE ZONE  
SEE DETAIL 301

UNDISTURBED BASE (EXIST.)

EXISTING BASE ROCK

TRENCH & ROAD  
BASE COMPACTION  
STANDARDS PER  
DETAIL 301

TRENCH  
WIDTH

**CLASS 'B'  
AC PAVEMENT  
RESTORATION**

**NOTES:**

1. SUBMIT WRITTEN BACKFILL COMPACTION TEST RESULTS PRIOR TO INSTALLING AC PAVEMENT OR CONCRETE SURFACE RESTORATION.
2. ALL EXISTING AC OR PCC PAVEMENT SHALL BE SAWCUT TO PROVIDE A CLEAN EDGE PRIOR TO REPAVING.
3. PCC CONCRETE PAVEMENT SHALL BE REPLACED TO A MINIMUM THICKNESS OF 6" OR TO THE THICKNESS OF REMOVED CONCRETE, WHICHEVER IS GREATER (CONCRETE SHALL BE 3300 PSI MIN @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).).
4. FOR PAVED DRIVEWAYS (EXCEPT COMMERCIAL OR INDUSTRIAL) WITH LESS THAN 4" EXISTING AC PAVEMENT THICKNESS MAY BE REDUCED TO 3" AC IN 2 LIFTS, AND OVERCUT MAY BE REDUCED TO 3" EACH SIDE.

LAST REVISION DATE: FEB 2024	
<b>MINOR OR PRIVATE STREET AND AC DRIVEWAY CUT SURFACE RESTORATION</b> (NTS)	
DAYTON, OR	DETAIL NO. <b>302</b>



PLACE 4" MIN. THICKNESS, CL. 'C' A.C. IN LIFTS. COMPACT TO 91% OPTIMUM DENSITY PER RICE STD. METHOD. (MATCH EXTG AC THICKNESS)

18" MIN. WIDTH PRE-TACKED PAVING FABRIC (MIRAFI MTK, PETROTAC OR EQUAL), SIDE & END JOINTS.

SEAL SURFACE OVER JOINT WITH TACK MATERIAL AND SAND.

MIN. TRENCH PATCH WIDTH  
ROLLER WIDTH PLUS 2"


GRIND 24" BENCH INTO EXTG AC PAVEMENT. SEE NOTE 2 BELOW (18" MIN. WIDTH AFTER SAWCUT).

6" MIN.

TACK COAT CUT EDGES & GRIND AREAS

6" MIN.

EXISTING PAVEMENT

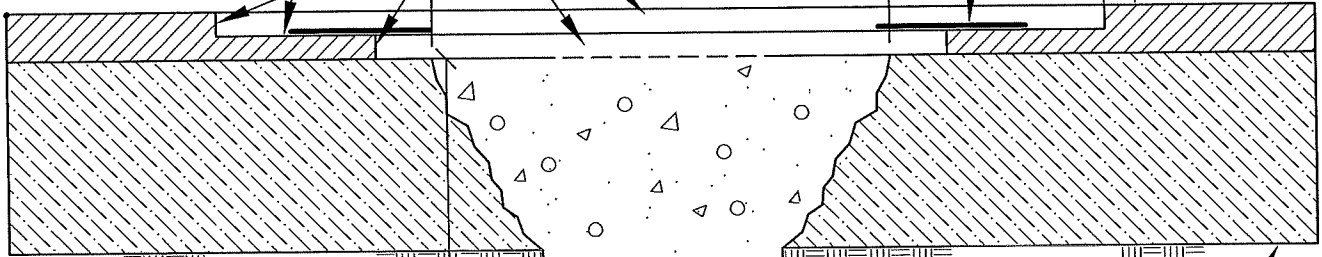

UNDISTURBED BASE (EXIST.)

3/4"-0 GRANULAR BACKFILL (OR 'CONTROLLED LOW STRENGTH MATERIAL [CLSM] WHERE NOTED ON DRAWINGS) FROM 12" OVER PIPE TO BOTTOM OF AC (BACKFILL TYPE AS INDICATED ON DWGS). FOR CSLM, STEEL PLATE FOR 24 HOURS PRIOR TO PLACING COLD MIX OR AC SURFACE RESTORATION.

UNDISTURBED BASE (EXIST.)

EXISTING BASE ROCK

TRENCH & ROAD BASE COMPACTION STANDARDS PER DETAIL 301

EMBEDMENT & PIPE ZONE SEE DETAIL 301

**SURFACE MAINT UNTIL FINAL AC.** TRENCHES IN PAVED AREAS SHALL BE STEEL PLATED OR COLD PATCHED (AND MAINTAINED) AT THE END OF EACH WORKDAY. FINAL HOT PATCH REPAVING TO OCCUR W/IN 14 DAYS OF EXCAVATION UNLESS OTHERWISE APPROVED PER PWDS G.11.b. REMOVE ALL COLD PATCH PRIOR TO FINAL PAVING.

TRENCH WIDTH

**NOTES:**

1. SUBMIT WRITTEN BACKFILL COMPACTION TEST RESULTS PRIOR TO INSTALLING AC PAVEMENT TRENCH RESTORATION.
2. FOLLOWING BACKFILL COMPACTION & TESTING OR CLSM INSTALLATION, GRIND 24" WIDE BENCH IN EXISTING AC ON BOTH SIDES & TRENCH ENDS, 2" DEEP OR HALF THE DEPTH OF EXISTING AC (3" MAX).
3. AFTER GRINDING, SAWCUT ALONG TRENCH SIDES AS REQUIRED TO PROVIDE A CLEAN EDGE PRIOR TO REPAVING, 6" BACK FROM TRENCH EDGE.
4. BASE LIFT(S). TACK COAT EDGES, INSTALL/COMPACT BASE LIFTS (3" MAX LIFT) TO LEVEL OF BENCH GRIND.
5. FINISH LIFT. INSTALL JOINT SEAL FABRIC, TACK COAT GRIND SURFACES & EDGES, & INSTALL TOP LIFT OF AC. SAND SEAL ALL JOINTS (REMOVE EXCESS SAND AFTER CURE).

**CLASS 'A' AC PAVEMENT RESTORATION**

LAST REVISION DATE:

FEB 2024

**AC STREET CUT SURFACE RESTORATION W/BENCH GRIND**

(NTS)

DETAIL NO.

DAYTON, OR

302A

INSTALL TWO 2" LIFTS OF LEVEL 3 1/2-INCH ACP PER ODOT SPECS, **OR MATCH EXISTING PAVEMENT THICKNESS**, WHICHEVER IS GREATER. (3" MAX LIFT THICKNESS).


PLACE (2) 2" LIFTS, LEVEL 3 1/2-INCH ACP PER ODOT SPECS

GRIND THIS AREA 4" DEEP FOR 10 FEET MIN EACH WAY FROM TRENCH EDGE UNLESS OTHERWISE APPROVED OR REQUIRED BY ODOT.

TACK COAT PRIOR TO PAVING & SAND SEAL JOINTS AFTER PAVING.

MIN. TRENCH PATCH WIDTH  
TRENCH WIDTH + 2\*GRIND WIDTH

EXISTING PAVEMENT

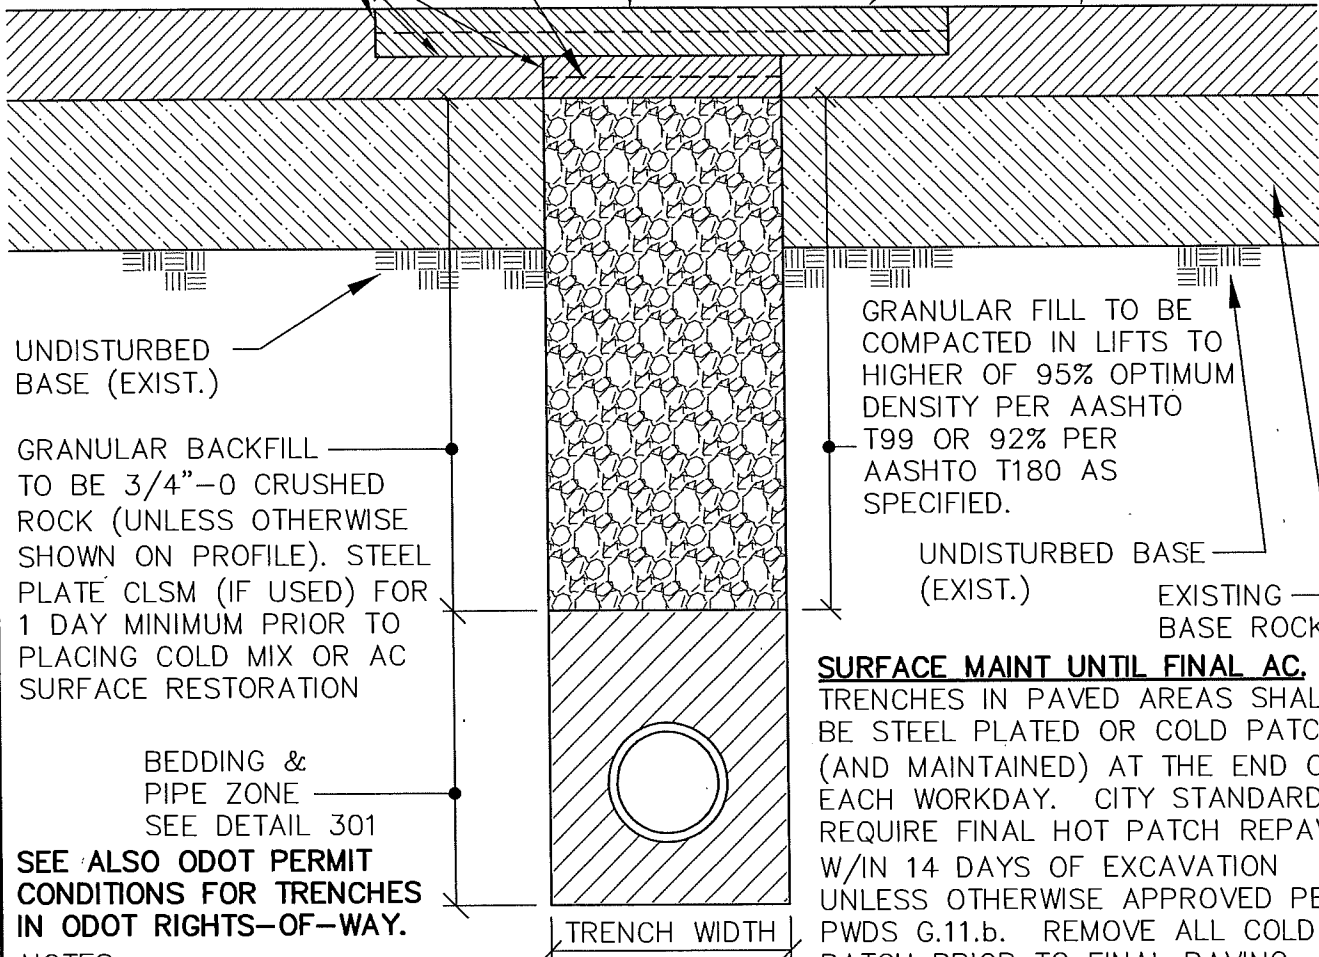

GRANULAR FILL TO BE COMPACTED IN LIFTS TO HIGHER OF 95% OPTIMUM DENSITY PER AASHTO T99 OR 92% PER AASHTO T180 AS SPECIFIED.

UNDISTURBED BASE (EXIST.)  
EXISTING BASE ROCK

**SURFACE MAINT UNTIL FINAL AC.**  
TRENCHES IN PAVED AREAS SHALL BE STEEL PLATED OR COLD PATCHED (AND MAINTAINED) AT THE END OF EACH WORKDAY. CITY STANDARDS REQUIRE FINAL HOT PATCH REPAVING W/IN 14 DAYS OF EXCAVATION UNLESS OTHERWISE APPROVED PER PWDS G.11.b. REMOVE ALL COLD PATCH PRIOR TO FINAL PAVING.

SEE ALSO ODOT PERMIT CONDITIONS FOR TRENCHES IN ODOT RIGHTS-OF-WAY.

NOTES:

- SUBMIT WRITTEN BACKFILL COMPACTION TEST RESULTS PRIOR TO AC PAVEMENT INSTALLATION.
- COMPACT ALL ACP LIFTS TO 91% OPTIMUM DENSITY PER RICE STANDARD METHOD.
- ASPHALT EMULSION TACK COAT SHALL BE USED TO SEAL THE ACP TO THE EDGES OF THE EXISTING AC PAVEMENT. ALL AC PAVEMENT CUTS SHALL BE VERTICAL, CLEAN & ASPHALT SAND SEALED ALONG ALL EDGES AFTER INSTALLATION.
- ALL PAVEMENT CUT AREAS SHALL BE COLD PATCHED OR PLATED AT THE END OF EACH WORK SHIFT, & THE PLATES OR PATCH MAINTAINED UNTIL FULL PAVEMENT RESTORATION IS MADE WITH ACP. COLD PATCH (IF USED) SHALL BE REPLACED WITH HOT MIX ACP WITHIN TIMEFRAME DIRECTED IN WRITING BY THE ODOT DISTRICT MANAGER OR MANAGER'S REPRESENTATIVE.
- ACP SHALL BE A COMMERCIALY PRODUCED PLANT MIXTURE CONFORMING TO ODOT STANDARDS, OSSC 00744 (OLD "B" OR "C" DESIGNATION ON CITY DETAILS REFERS TO AGGREGATE SIZE ONLY).
- 48" MINIMUM COVER IS REQUIRED FOR ALL GAS, ELECTRIC, TELEPHONE, FIBER OPTIC AND OTHER POTENTIALLY DANGEROUS/HIGH IMPACT UTILITY FACILITIES, ALL OTHER FACILITIES REQUIRE 36" MINIMUM COVER DEPTH.



LAST REVISION DATE:  
FEB 2024

**ODOT TRENCH CROSSING,  
TRENCH BACKFILL &  
SURFACE RESTORATION**  
(NTS)

DAYTON, OR

DETAIL NO. .

302D

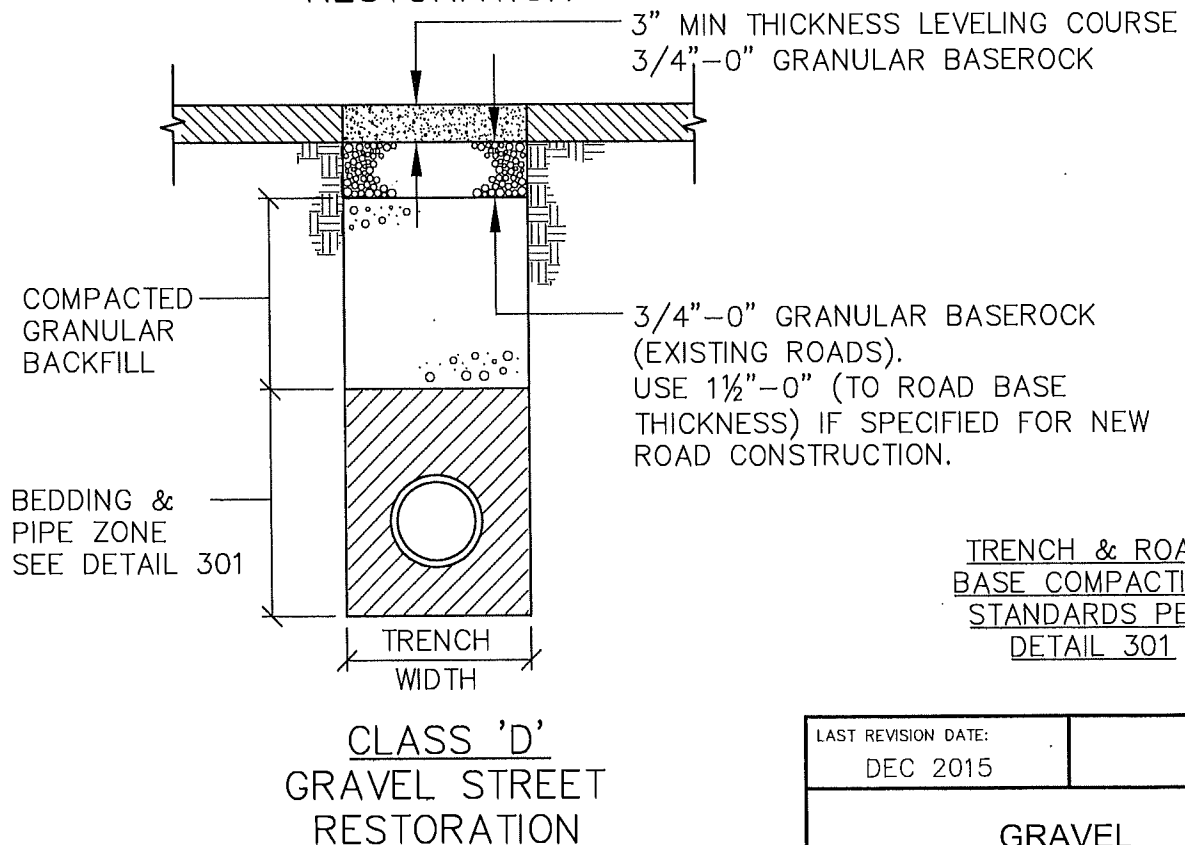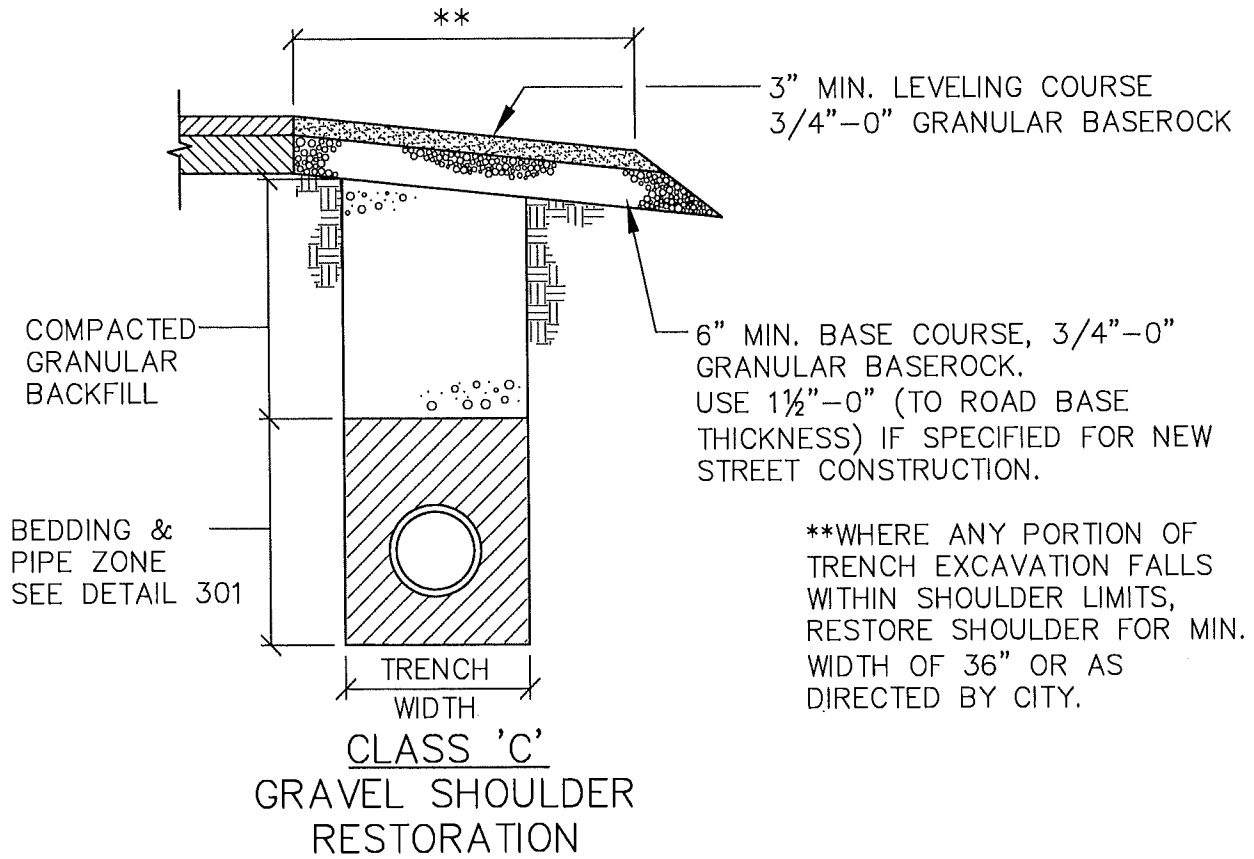


TRENCH & ROAD  
BASE COMPACTION  
STANDARDS PER  
DETAIL 301

NOTES:

1. SHOULDER ROCK TO BE COMPACTED TO ROAD BASEROCK STANDARDS.

LAST REVISION DATE: DEC 2015	
GRAVEL SURFACE RESTORATION	
(NTS)	
DAYTON, OR	DETAIL NO. 303

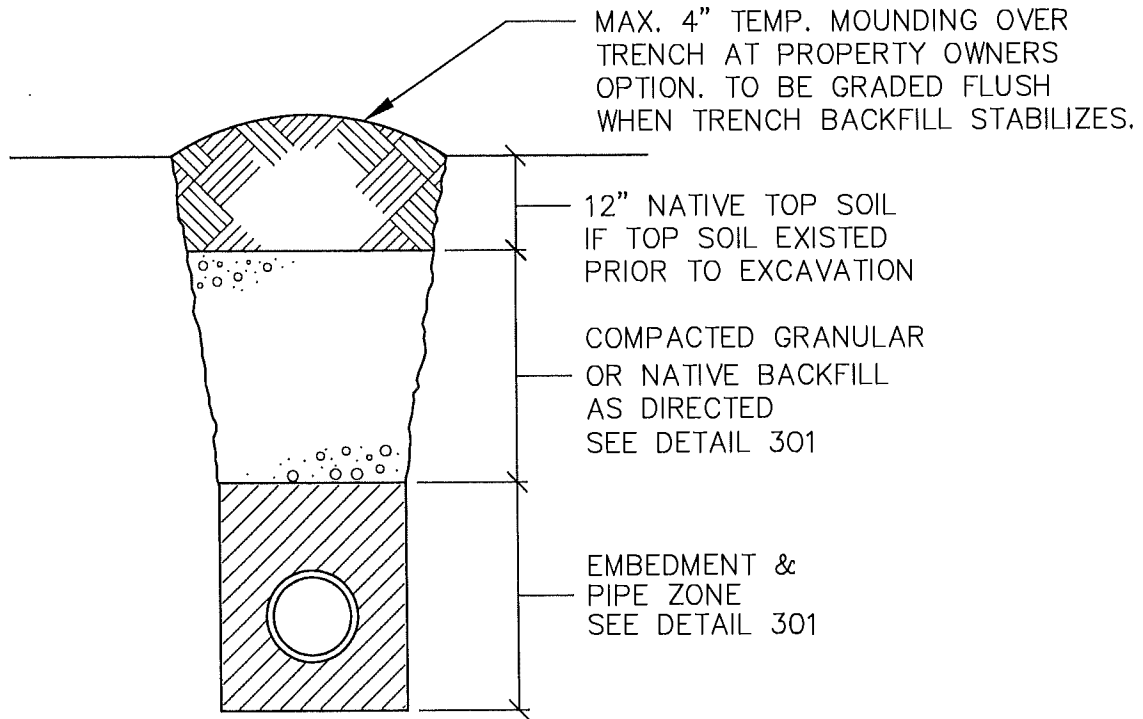


CLASS 'E'  
UNIMPROVED & OPEN AREAS

TRENCH & ROAD  
BASE COMPACTION  
STANDARDS PER  
DETAIL 301

NOTES:

1. ANY TRENCH SETTLEMENT DURING WARRANTY PERIOD SHALL BE CORRECTED AT CONTRACTOR'S EXPENSE, INCLUDING SURFACE RESTORATION.


LAST REVISION DATE: DEC 2015	
NATIVE SURFACE RESTORATION	
(NTS)	
DAYTON, OR	DETAIL NO. 304

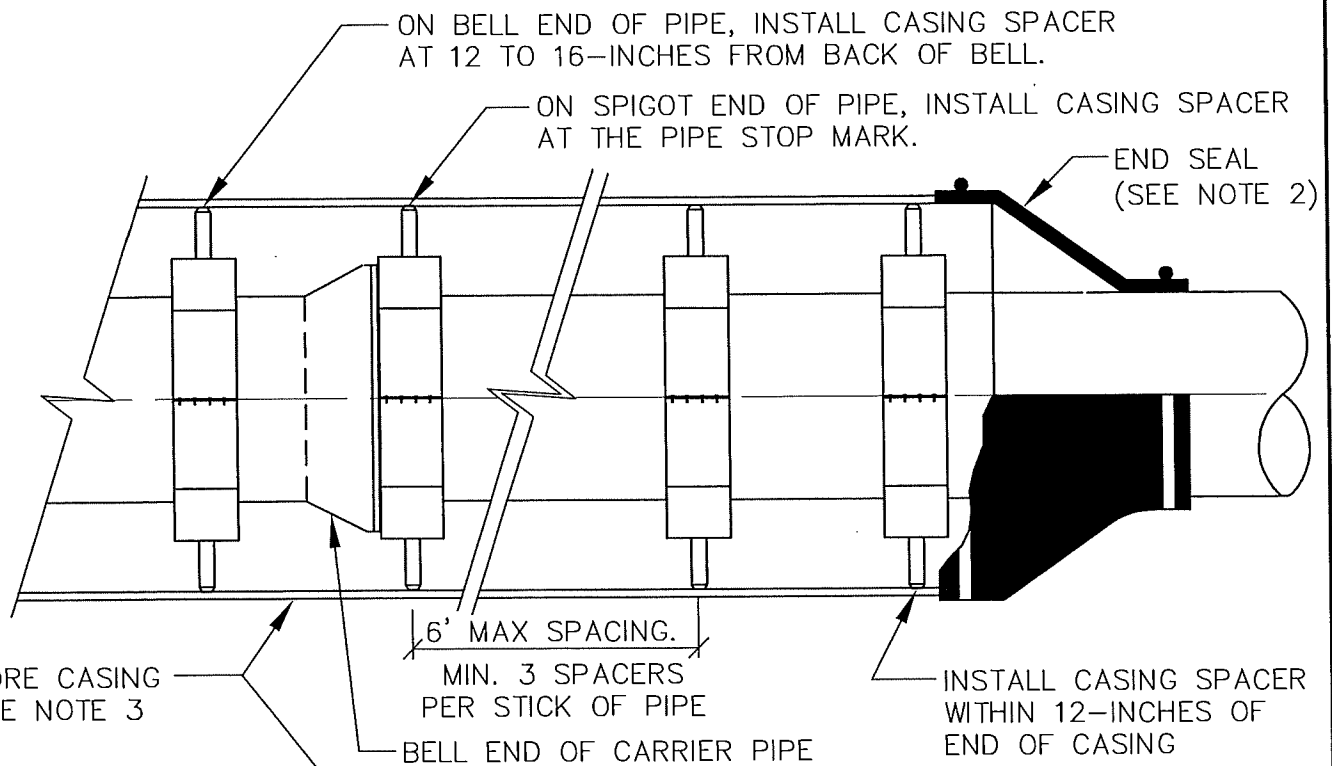

CASING SPACER WITH STAINLESS STEEL BAND & STAINLESS STEEL FASTENERS.

STAINLESS STEEL RISER

UHMW POLYMER PLASTIC RUNNER

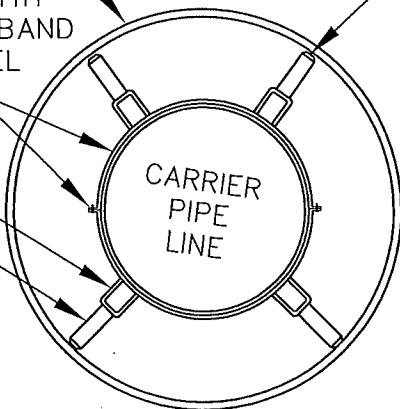

SEE NOTE 5 FOR BORE FILL REQUIREMENTS FOR GRAVITY CARRIER PIPES.

CARRIER PIPE DIAMETER	MIN. DIA. CASING (*1, *2)	MIN CASING WALL THICKNESS (INCH)
6"	12"	0.25 (1/4)
8"	14"	0.25 (1/4)
10"	16"	0.312 (5/16)
12"	18"	0.375 (3/8)

\*1: CASING SIZE LISTED IS FOR PRESSURE PIPE. LARGER DIA CASING REQ'D FOR GRAVITY PIPE.  
 \*2: SEE PWDS 5.8.0 FOR GRAVITY PIPE CASING SIZE REQUIREMENTS OR LARGER CASING SIZES.

**NOTES:**


- CASING SPACERS – APS MODEL SSI, CALPICO M–SS SERIES OR APPROVED EQUAL. FOR 4"–18" CARRIER PIPE, USE 8" WIDE BAND. FOR >18" CARRIER PIPE, USE 12" WIDE BAND.
- SEAL BOTH ENDS OF BORE CASING WITH END SEALS. WITHOUT SAND FILL, USE APS MODEL AZ OR APPROVED EQUIV. FASTEN TO CASING AND CARRIER PIPE WITH ST. STEEL BANDS. WITH SAND FILL, USE GROUT END CAPS (PLUG VENT TUBES AFTER SAND FILL).
- CASING SHALL BE WELDED SMOOTH STEEL PIPE CONFORMING TO ASTM A–53, GRADE B OR APPROVED EQUIVALENT ( $F_y = 35,000$  psi).
- SEE DRAWINGS FOR MINIMUM CARRIER PIPE DIAMETER, THICKNESS & MATERIAL.
- INCREASE CASING DIA AS REQ'D TO ALLOW TRIMMING OF CASING SPACERS ON GRADE CRITICAL BORES
- FOR GRAVITY SEWER OR STORM CARRIER PIPES, THE CASING ANNULAR SPACE SHALL BE COMPLETELY FILLED WITH SAND TO PREVENT FLOATATION OF CARRIER PIPE BY GROUNDWATER.
- CARRIER PIPE SHALL BE COMPLETELY FILLED WITH WATER PRIOR TO INSTALLING OR BLOWING SAND (ANTIFLOATATION).

LAST REVISION DATE: MAR 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>BORE CASING, CARRIER PIPE AND CASING SPACER DETAIL</b> (NTS)	
DAYTON, OR	DETAIL NO. 308


ALL JOINTS & PENETRATIONS SHALL BE GROUTED SMOOTH, SO AS NOT TO RETAIN DEBRIS. BASE TO BE SMOOTH TO FACILITATE CLEANING.

SEE DETAIL 312 FOR FRAME & GRATE

NORMAL SLOPE OF PAVEMENT

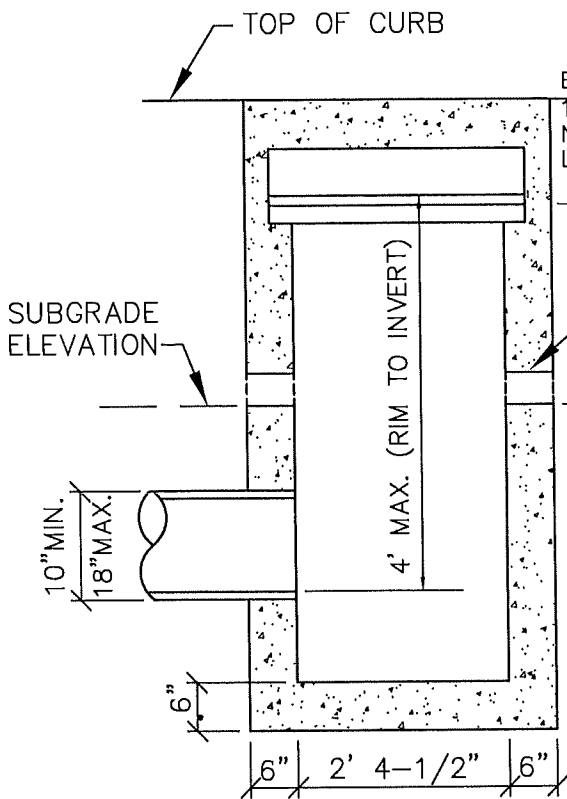

**SECTION A-A**

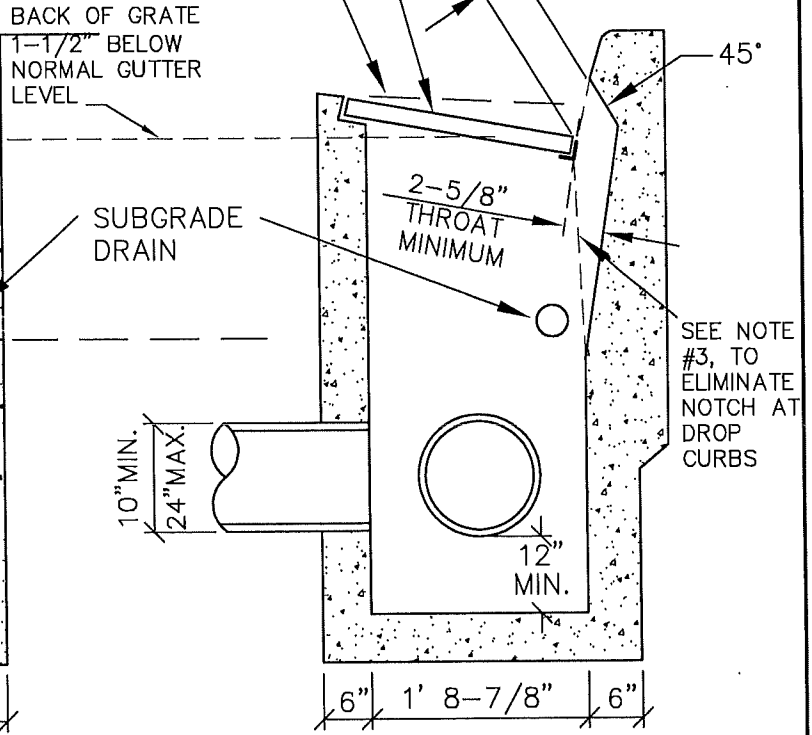


**SECTION B-B**

**NOTES:**

1. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION AND INVERT ELEVATION.
2. MATCH EXISTING CURB UNLESS OTHERWISE NOTED.
3. CURB-INLET NOTCH TO BE ELIMINATED AT DROP CURB LOCATIONS WHERE APPROVED BY THE CITY ENGINEER.

PRECAST CONCRETE TO BE 4000 PSI @ 28 DAYS. CAST-IN-PLACE CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).

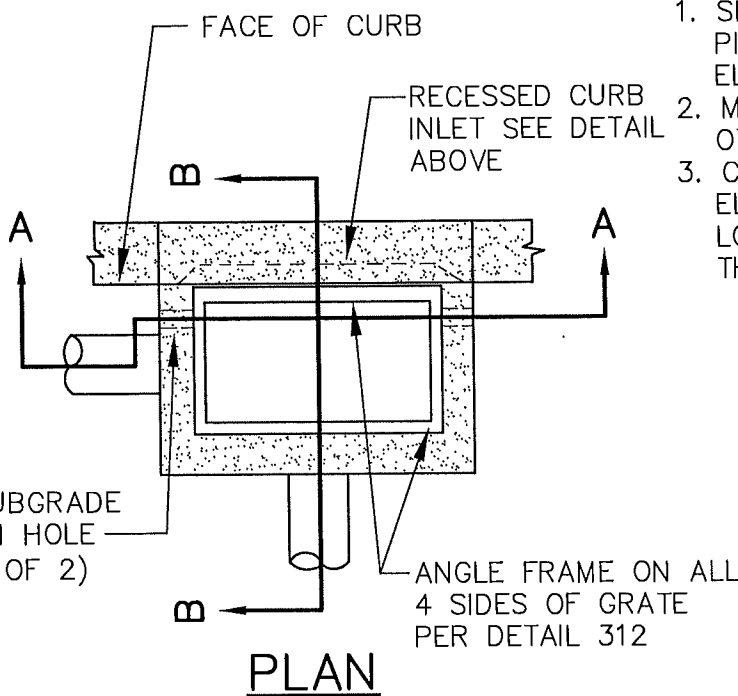


**PLAN**

LAST REVISION DATE: SEPT 2020	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>STANDARD SIDE-INLET GRATED CATCH BASIN</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>310</b>

ALL JOINTS & PENETRATIONS SHALL BE GROUTED SMOOTH, SO AS NOT TO RETAIN DEBRIS. BASE TO BE SMOOTH TO FACILITATE CLEANING.

SEE DETAIL 312 FOR FRAME & GRATE


NORMAL SLOPE OF PAVEMENT

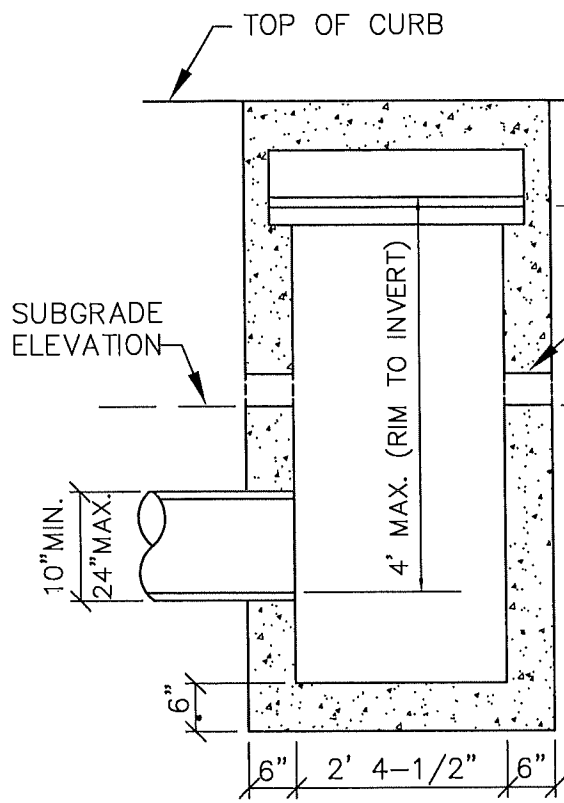


**SECTION A-A**

BACK OF GRATE  
1-1/2" BELOW  
NORMAL GUTTER  
LEVEL

SUBGRADE  
DRAIN

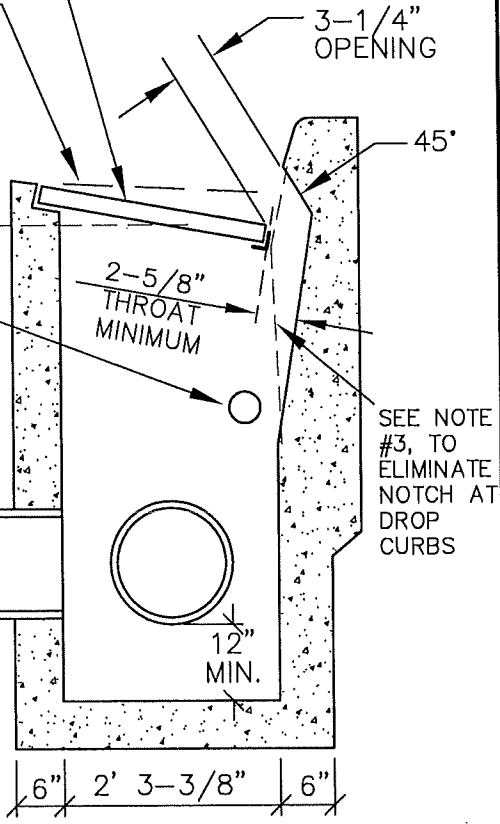

**SECTION B-B**

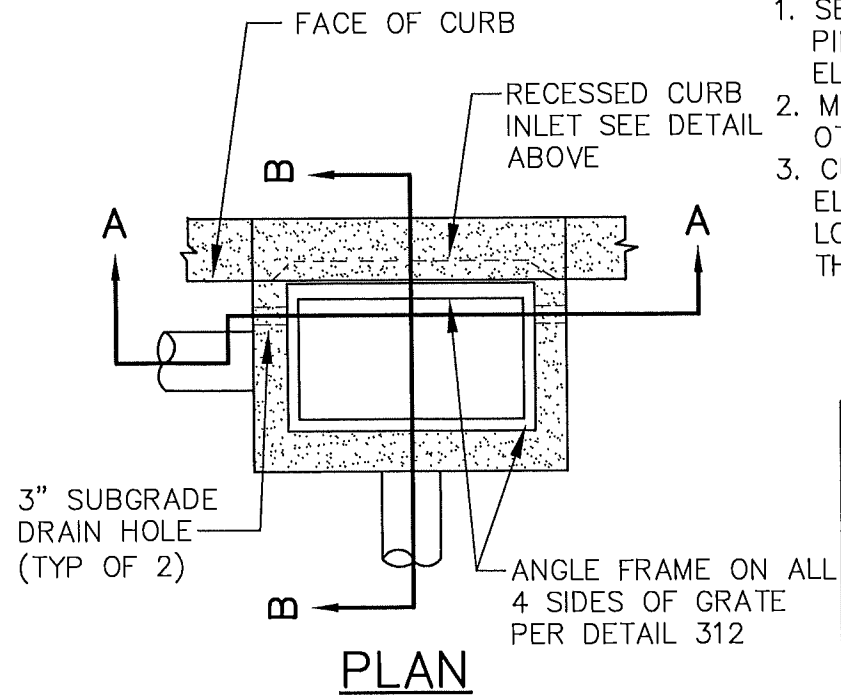


**PLAN**

**NOTES:**

1. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION AND INVERT ELEVATION.
2. MATCH EXISTING CURB UNLESS OTHERWISE NOTED.
3. CURB-INLET NOTCH TO BE ELIMINATED AT DROP CURB LOCATIONS WHERE APPROVED BY THE CITY ENGINEER.

PRECAST CONCRETE TO BE 4000 PSI @ 28 DAYS. CAST-IN-PLACE CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).


LAST REVISION DATE: SEPT 2020	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>OVERSIZE SIDE-INLET GRATED CATCH BASIN</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>311</b>

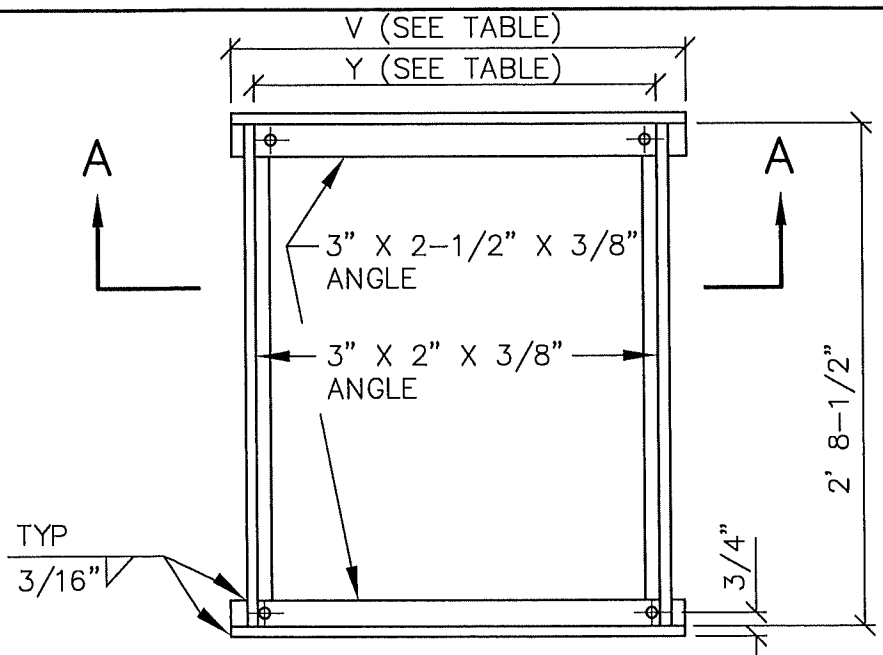


**PLAN**

**NOTE:**

3/8" ROUND OR RECTANGULAR CROSS BARS SHALL BE FILLET WELDED, RESISTANCE WELDED OR ELECTROFORGED TO BEARING BARS.

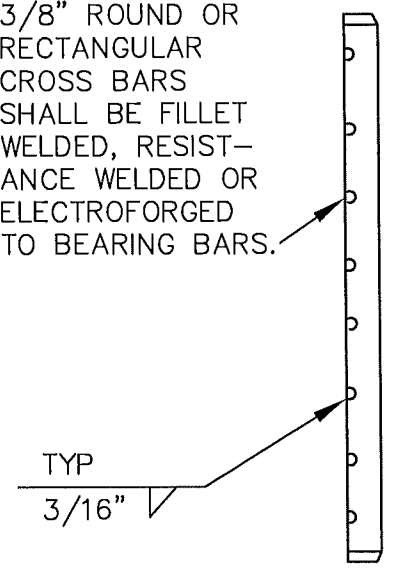


**SECTION B-B**

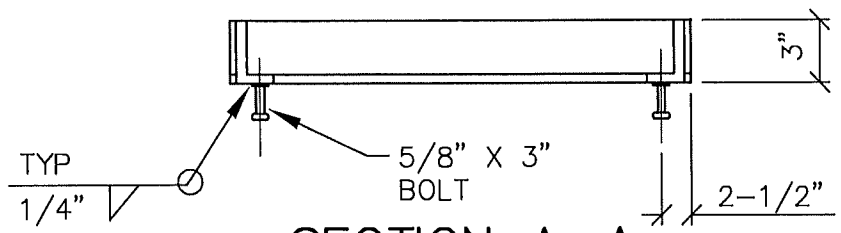

**SECTION A-A**

3/8" X 2" FLAT BAR EA. END

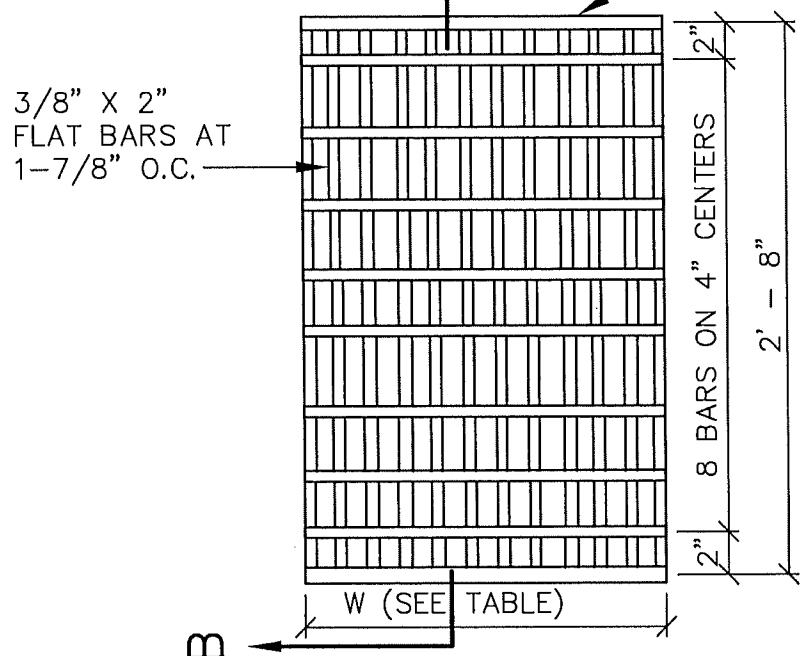

**PLAN**

**NOTE:**


1. USE VERTICAL BEADS IN CORNERS, FILLET WELD JOINT ON BOTTOM OF FRAME. GRATE MUST REST FLAT ON FRAME SURFACE.
2. ALL STEEL SHALL BE ASTM A-36.
3. ANGLE FRAME REQUIRED ON ALL FOUR SIDES OF GRATE OPENING AS SHOWN.

INLET TYPE	FRAME		GRATE		REMARKS
	V	Y	W	NO. OF BARS	
STANDARD	1' 10-3/4"	1' 9-3/8"	1'- 9"	12	1-GRATE
OVERSIZE	2' 4-3/4"	2' 3-3/8"	1' 1-1/2"	8	2-GRATES

LAST REVISION DATE: JUNE 2014	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>CATCH BASIN GRATE DETAILS</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>312</b>




**NOTE:** CONTRACTOR TO VERIFY CB DATA & FINISH GRADE ELEV'S PRIOR TO INSTALLATION TO ENSURE THAT TOP OF CB DOES NOT EXTEND ABOVE SURROUNDING GRADE UNLESS OTHERWISE SPECIFICALLY NOTED ON THE DRAWINGS OR APPROVED BY THE CITY.

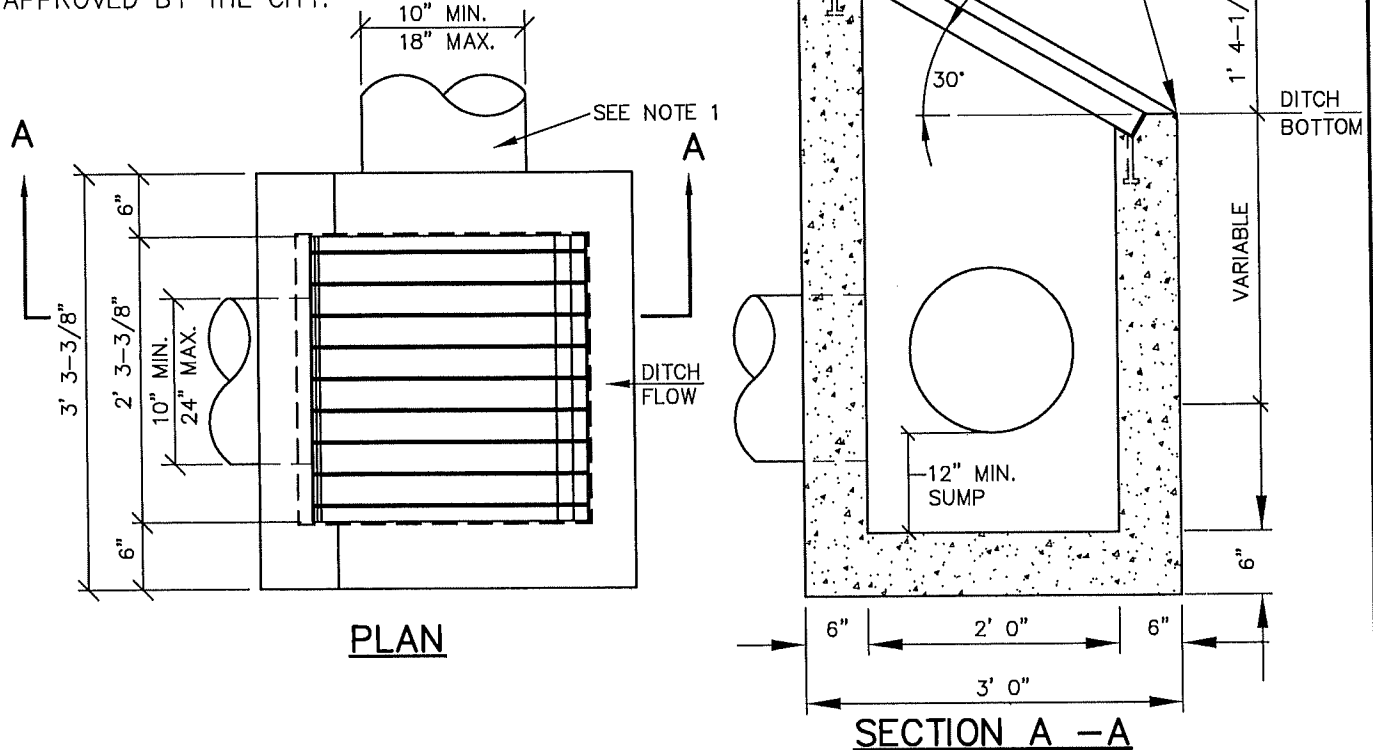

**PLAN**

**SECTION A - A**

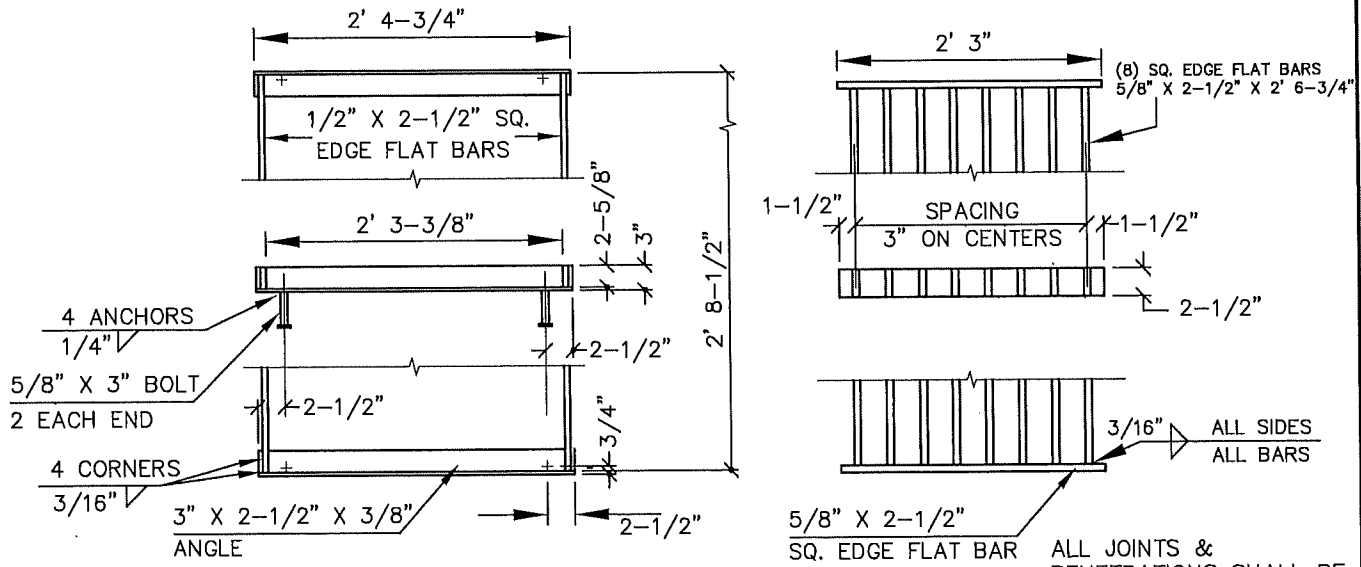


**FRAME & GRATE**

**NOTES:**

1. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION AND INVERT ELEVATION.
2. FRAME & GRATE SHALL BE ASTM A-36 STEEL, HOT-DIPPED GALV. AFTER CONSTRUCTION.
3. ALL CONCRETE TO BE 4000 PSI MIN AT 28 DAYS.
4. PRIOR TO CB INSTALLATION, CONTRACTOR SHALL VERIFY RIM ELEVATIONS LISTED AGAINST DITCH & FINISH GRADE ELEVATIONS, & NOTIFY CITY OF ANY DISCREPANCIES.


LAST REVISION DATE: SEPT 2020	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>TYPE 3 DITCH INLET CATCH BASIN</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>313</b>

**NOTE:** CONTRACTOR TO VERIFY FINISH GRADE ELEV'S PRIOR TO INSTALLATION TO ENSURE THAT TOP OF OUTLET STRUCTURE DOES NOT EXTEND ABOVE SURROUNDING GRADE UNLESS OTHERWISE NOTED ON DWGS OR APPROVED BY CITY. PROVIDE OUTLET PIPE & OUTLET CHANNEL (LENGTH & CONFIGURATION PER NOTE 4) AS NOTED UNLESS OTHERWISE SHOWN ON APPROVED DWGS OR REQUIRED BY CITY.

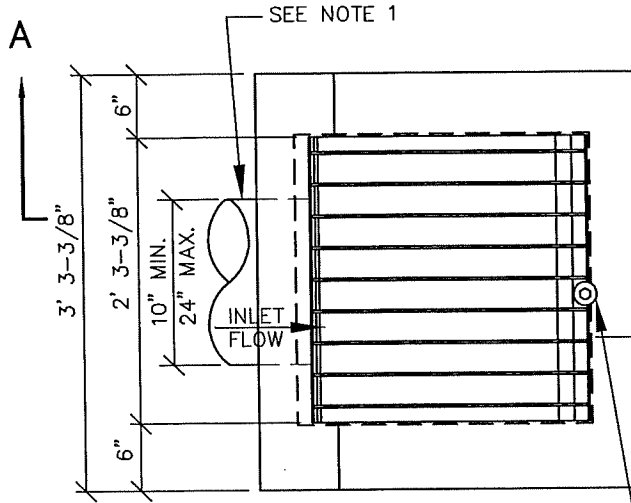


**PLAN**

INSTALL SINGLE 1/2" ST. STEEL EXPANSION ANCHOR BOLT & 2" SS PLATE WASHER UNLESS OTHERWISE APPROVED OR REQUIRED BY CITY

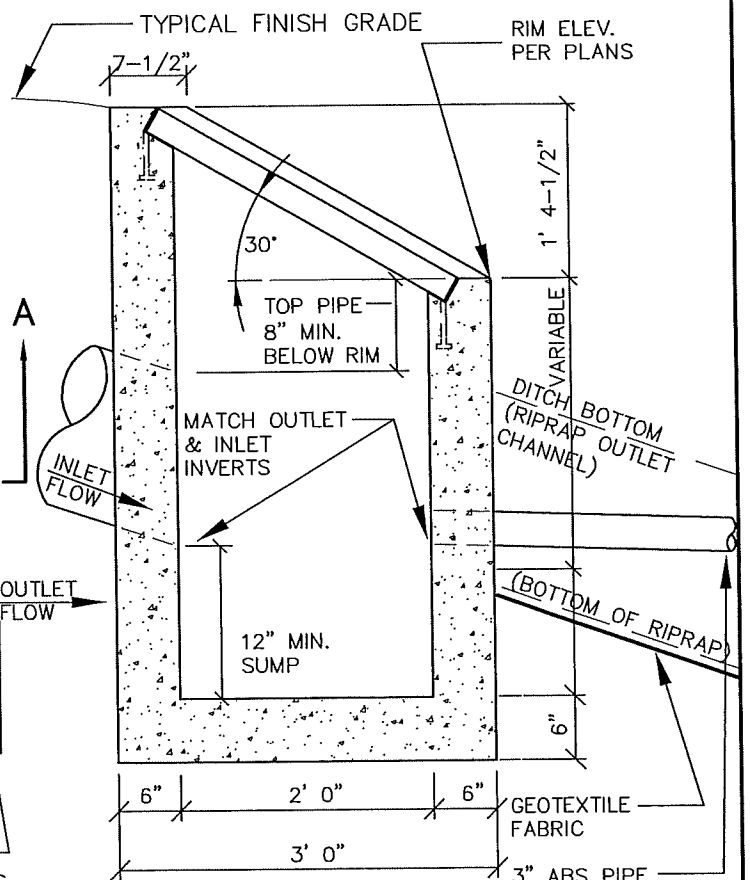


**SECTION A - A**

3" ABS PIPE TYP, EXTEND TO DAYLIGHT, 0.5% MIN SLOPE

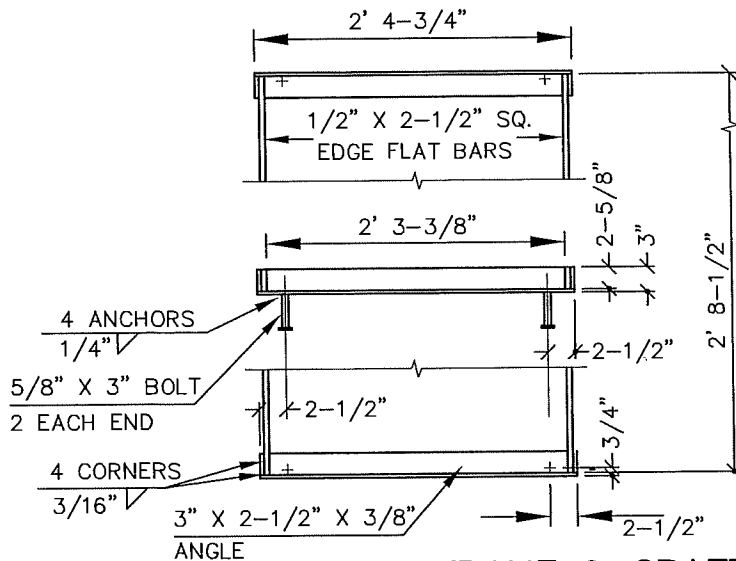

**FRAME & GRATE**

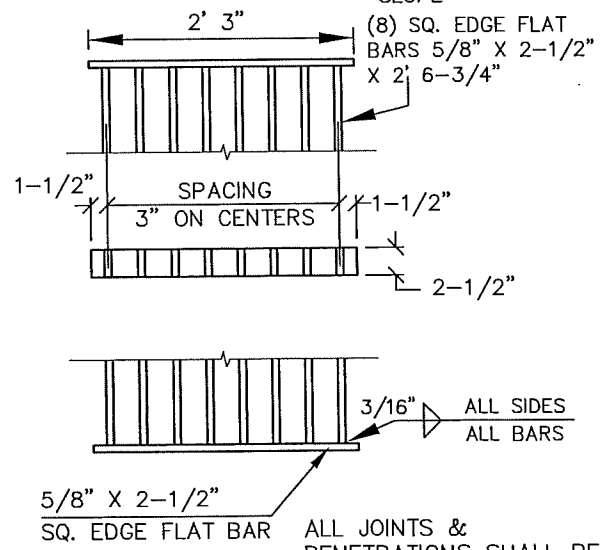

ALL JOINTS & PENETRATIONS SHALL BE GROUTED SMOOTH, SO AS NOT TO RETAIN DEBRIS.

**NOTES:**

1. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION AND INVERT ELEVATION.
2. FRAME & GRATE SHALL BE ASTM A-36 STEEL, HOT-DIP GALV AFTER CONSTRUCTION.
3. ALL CONCRETE TO BE 4000 PSI MIN AT 28 DAYS.
4. PROVIDE RIPRAP OUTLET CHANNEL (TYP 18" MIN THICK) W/2H:1V SIDE SLOPES, 12" MIN CHANNEL DEPTH & LENGTH AS NOTED ON DRAWINGS (10' MIN). PROVIDE GEOTEXTILE UNDER RIPRAP TO TOP OF BANK (NO LAPS). USE 5"-12" GRADED ANGULAR RIPRAP (TYP), FILL VOIDS BETWEEN STONE WITH 3/4"-0 BASEROCK.

LAST REVISION DATE: MAR 2024	COPYRIGHT 1995 WESTECH ENGINEERING, INC.
<b>STORM OUTLET ENERGY DISSIPATOR BASIN</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>313A</b>

FOR USE ONLY WHERE SPECIFICALLY APPROVED OR REQUIRED BY PUBLIC WORKS DIRECTOR AND CITY ENGINEER.

ALL JOINTS & PENETRATIONS SHALL BE GROUTED SMOOTH, SO AS NOT TO RETAIN DEBRIS. BASE TO BE SMOOTH TO FACILITATE CLEANING.

1/2" DIA GALVANIZED DEBRIS RODS, GROUT INTO CURB @ BASE

TOP OF CURB

BOTTOM OF INLET  
1-1/2" BELOW  
NORMAL GUTTER  
LEVEL

SUBGRADE  
ELEVATION

10" MIN.  
18" MAX.

6"

6" 30" 6"

**SECTION A-A**

NORMAL SLOPE  
OF PAVEMENT

SUBGRADE  
DRAIN

10" MIN.  
24" MAX.

6" 23" 6"

**SECTION B-B**

STUD ANCHORS  
3 MIN.

1/4" x 3-1/2" x 1" GALVANIZED  
STEEL CHANNEL W/ANCHORS


1.5%

4' 6" MAX. (RIM TO INVERT)

12" MIN.

INSTALL ONE FULL  
SIDEWALK PANEL WITH  
CATCH BASIN  
CONSTRUCTION

CAST IRON MANHOLE  
FRAME & LID WITH  
ANTI-SLIP DIAMOND  
GROOVE PATTERN

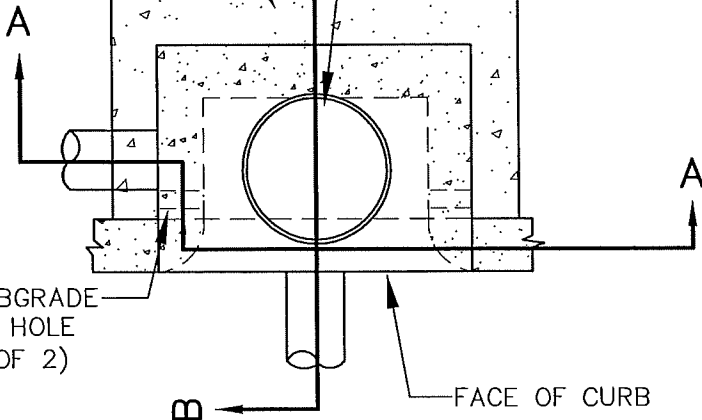

3" SUBGRADE  
DRAIN HOLE  
(TYP OF 2)

FACE OF CURB

**PLAN**

**NOTES:**

1. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION AND INVERT ELEVATION.
2. MATCH EXISTING CURB UNLESS OTHERWISE NOTED.
3. PRECAST CONCRETE TO BE 4000 PSI @ 28 DAYS.
4. CAST-IN-PLACE CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).

LAST REVISION DATE:  
MAR 2024

COPYRIGHT 1995  
WESTECH ENGINEERING, INC.


**CURB-INLET  
CATCH BASIN  
(SPECIAL USE ONLY)**

(NTS)


DAYTON, OR

DETAIL NO.


314

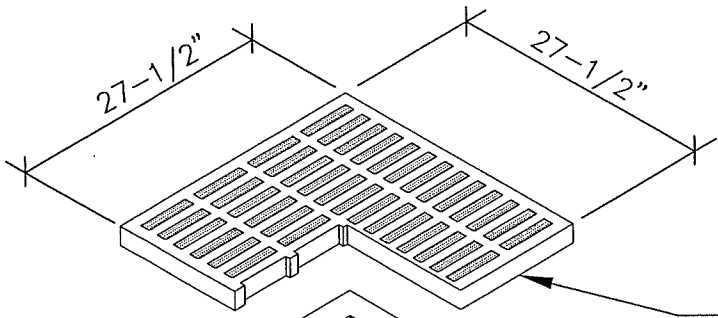

CAST IRON GRATE  
TRAFFIC LOADING

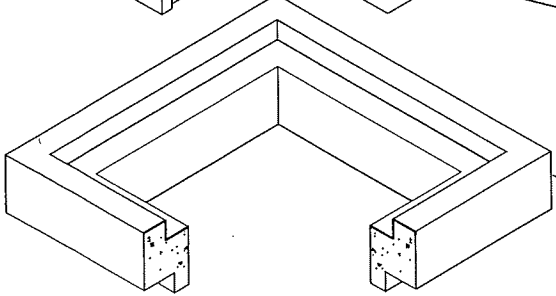


4", 6" AND 12" RISERS  
FOR ADJUSTMENT

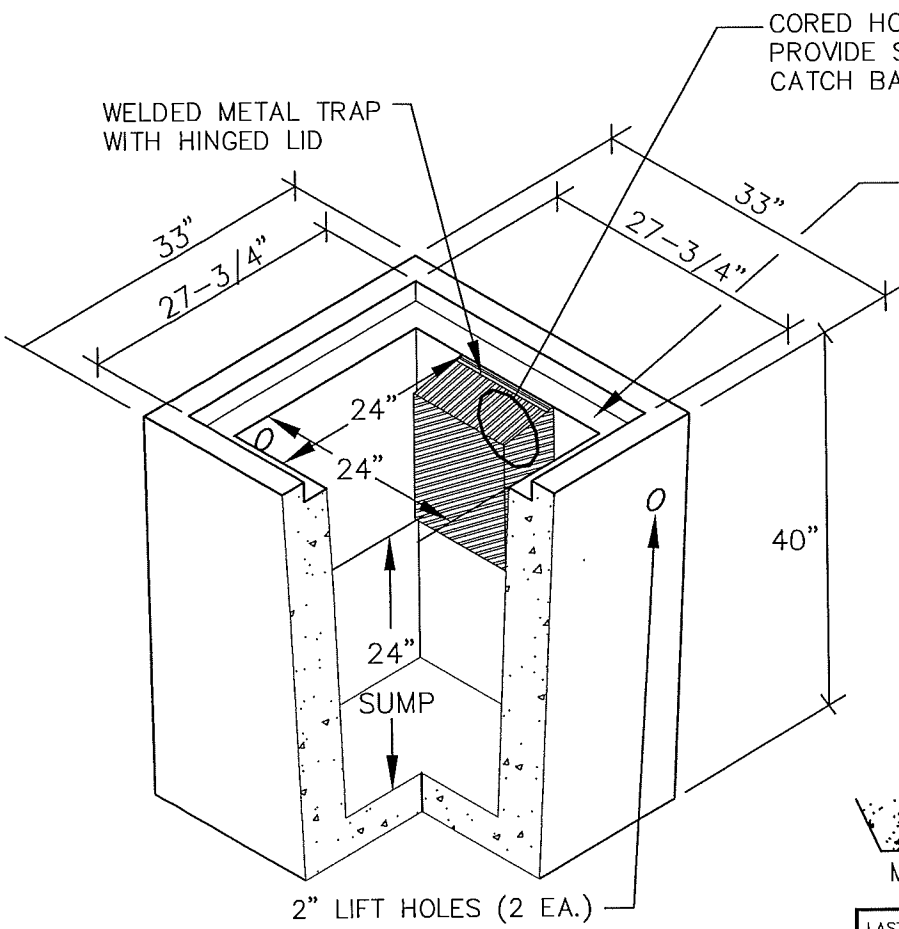

CORED HOLE WITH INSERTALOK BOOT TO  
PROVIDE SEAL BETWEEN PIPE AND  
CATCH BASIN WALL.

WELDED METAL TRAP  
WITH HINGED LID

RECESSED GROOVE FOR  
GRATE TO SET FLUSH WITH  
TOP OF CATCH BASIN

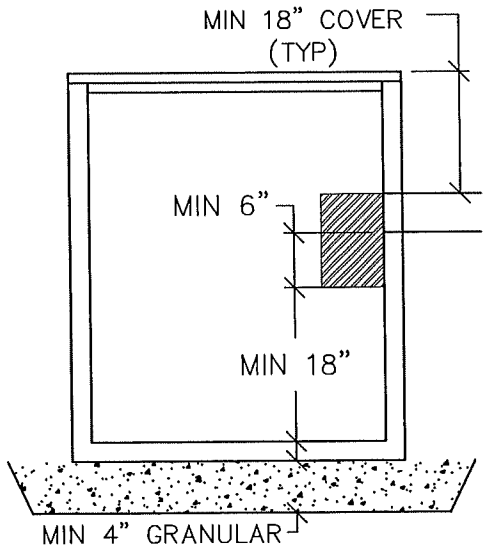

MIN 18" COVER  
(TYP)

MIN 6"

MIN 18"


MIN 4" GRANULAR

**NOTES:**

1. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION AND INVERT ELEVATION.
2. CONCRETE SHALL BE 4000 PSI @ 28 DAYS.
3. SET CB SQUARE WITH BUILDINGS OR WITH EDGE OF PARKING LOT, ALLEY OR DRIVEWAY WHEREIN IT LIES.
4. ADJUST PAVING SO WATER FLOWS TO CB WITH NO PONDING


LAST REVISION DATE: MAR 2024	
<b>PARKING LOT CATCH BASIN or PUBLIC ALLEY CATCH BASIN (PRECAST CONCRETE)</b> (NTS)	
DAYTON, OR	DETAIL NO. <b>315</b>

CAST-IN-PLACE  
REINFORCED CONCRETE  
SUPPORT COLLAR

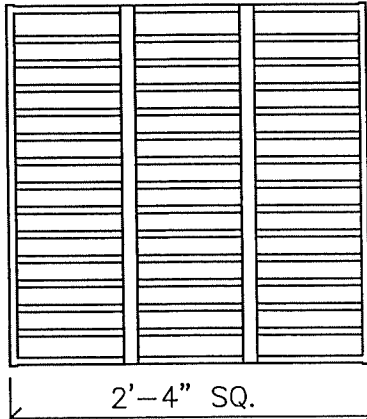


GRATE: WELDED STEEL DROP-IN  
BAR GRATE (ASTM A36).  
END BARS: 1/2" X 2"  
CROSS BARS: 1/2" X 2" @ 2" O.C.  
BIKE STRAPS: 1/8" X 1" (2 REQ'D)  
16,000 LB. UNIFORM LOAD CAPACITY

**GRATE DETAIL**

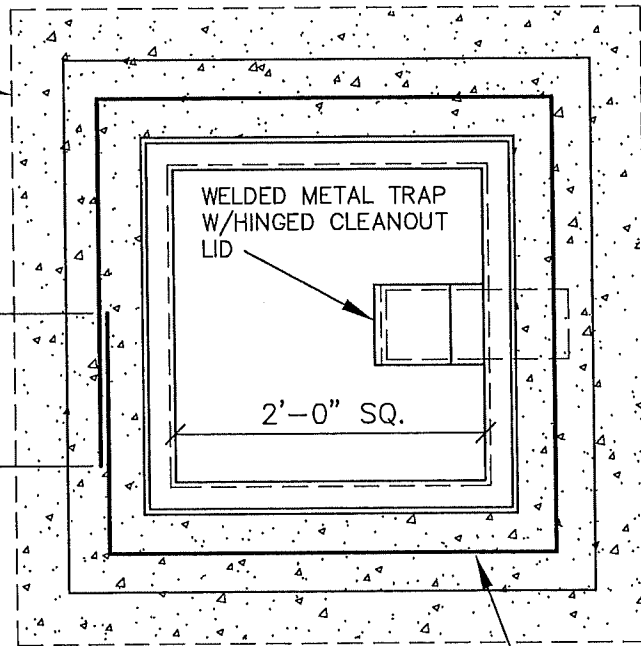


**PLAN VIEW**

#4 REBAR  
CONTINUOUS

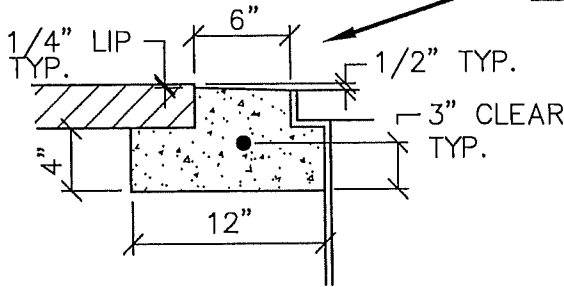

**CONCRETE COLLAR**

CONSTRUCT BASIN OF WELDED  
1/4" STEEL. COAT ALL SURFACES  
WITH ASPHALTIC PAINT.

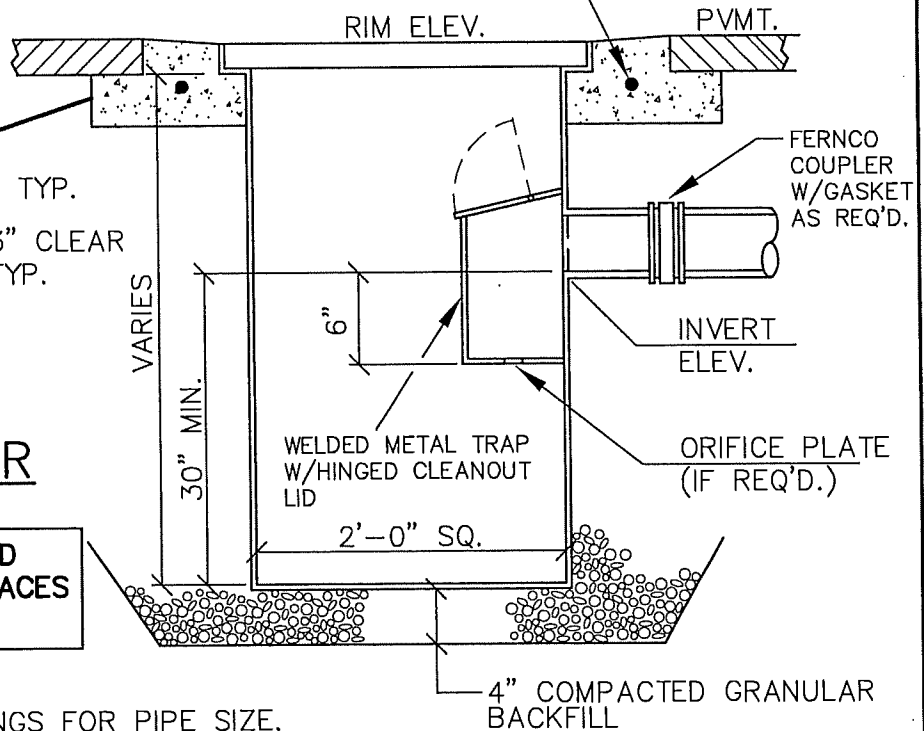


**NOTES:**

1. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION AND INVERT ELEVATION.
2. OUTLET: SIZE AS REQ'D. FOR INDICATED PIPE SIZE.
3. FOR JUNCTION BOX, REPLACE GRATE WITH 3/4" STEEL PLATE. DRILL ONE, 1" LIFTING HOLE, CENTERED IN ONE END OF THE PLATE. WELD SHIMS TO RIM AS REQUIRED TO RAISE PLATE TO RIM ELEVATION.
4. SET CB SQUARE WITH BUILDINGS OR WITH EDGE OF PARKING LOT OR DRIVEWAY WHEREIN IT LIES.
5. ADJUST PAVING SO WATER FLOWS TO CB WITH NO PONDING.

LAST REVISION DATE: JULY 2012	
<b>PARKING LOT CATCH BASIN (LYNCH STYLE)</b> (NTS)	
DAYTON, OR	DETAIL NO. 316



SEE NOTE 5 (RE: INLET)  
 INSERTA-TEE CONNECTION, SEE NOTE 3 & 4. INSERTA-TEE SOCKET TO MATCH PIPE MATERIAL SPECIFIED OR NOTED ON THE DRAWINGS.

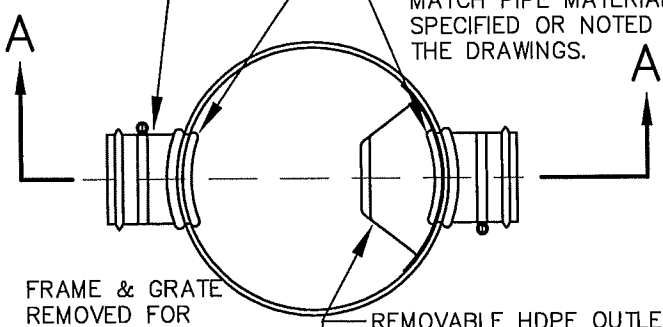

FRAME & GRATE REMOVED FOR CLARITY

**PLAN**


REMOVABLE HDPE OUTLET TRAP REQUIRED ON ALL PRIVATE CATCH BASINS (OMIT FOR FLOW-THRU JUNCTION STRUCTURES). ALL CLIPS & HARDWARE TO BE STAINLESS STEEL.

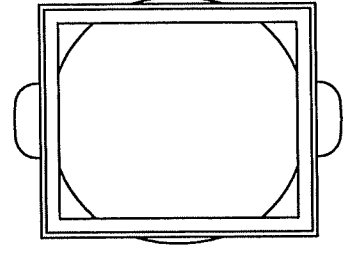

FRAME TO INCLUDE TABS THAT MATCH BASIN OD TO PREVENT DISPLACEMENT. FRAME BODY TO BEAR ON COMPACTED BASEROCK (SEE SECTION A-A)

**FRAME**


44 X SLOT  $\phi$  1.00 THRU

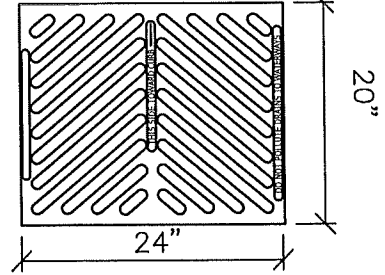

APPROX. DRAIN AREA = 202.48 SQ IN

**GRATE**

PAVED SURFACE

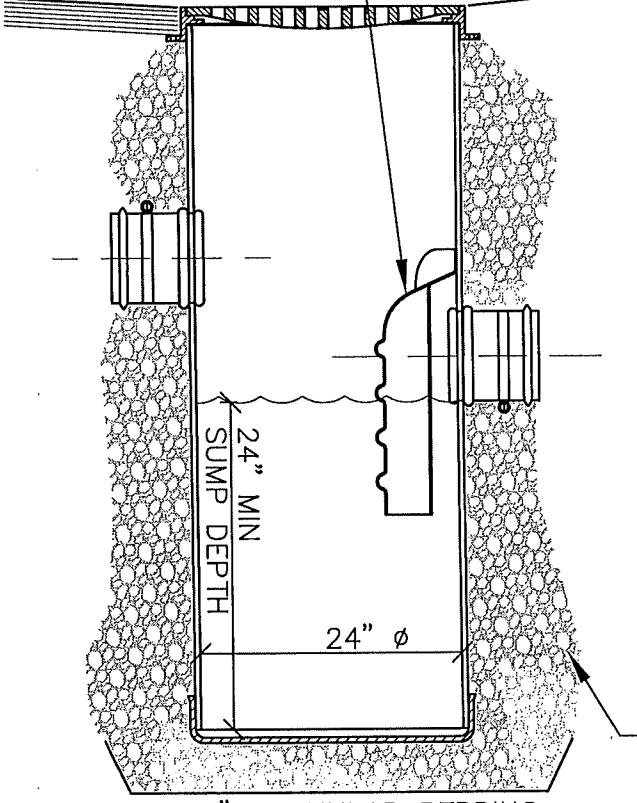

MIN 4" GRANULAR BEDDING

COMPACTED GRANULAR BACKFILL AROUND CATCH BASINS & AREA DRAINS (GRADE AS REQUIRED TO SUPPORT GRATE FRAME).


**SECTION A-A**

**NOTES:**

1. NYLOPLAST TRAFFIC RATED DRAIN BASIN OR APPROVED EQUAL W/NYLOPLAST FRAME & GRATE.
2. HERRING-BONE STYLE GRATE TO BE DUCTILE IRON PER ASTM A536 GRADE 70-50-05.
3. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION, ORIENTATION AND INVERT ELEVATIONS.
4. CONNECTIONS TO PVC CATCH BASIN TO BE INSERTA-TEE STYLE FITTINGS (FACTORY OR FIELD INSTALLED).
5. FLOW-THRU CONFIGURATION SHOWN IS ALLOWED ONLY FOR AREA DRAINS OR JUNCTION BOXES.
6. SET CB GRATE SQUARE WITH BUILDINGS OR WITH EDGE OF PARKING LOT OR DRIVEWAY WHEREIN IT LIES.
7. ADJUST PAVING OR GRADING SO WATER FLOWS TO STRUCTURE INLET WITH NO PONDING.

NOTE: PER ORS 92.044(7), AREA DRAIN MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

LAST REVISION DATE: JAN 2013	JO #
<b>PARKING LOT CATCH BASIN          (TRAFFIC RATED PVC w/TRAP,          DUCTILE IRON FRAME/GRATE)</b> (NTS)	
DAYTON, OR	DETAIL NO. 317

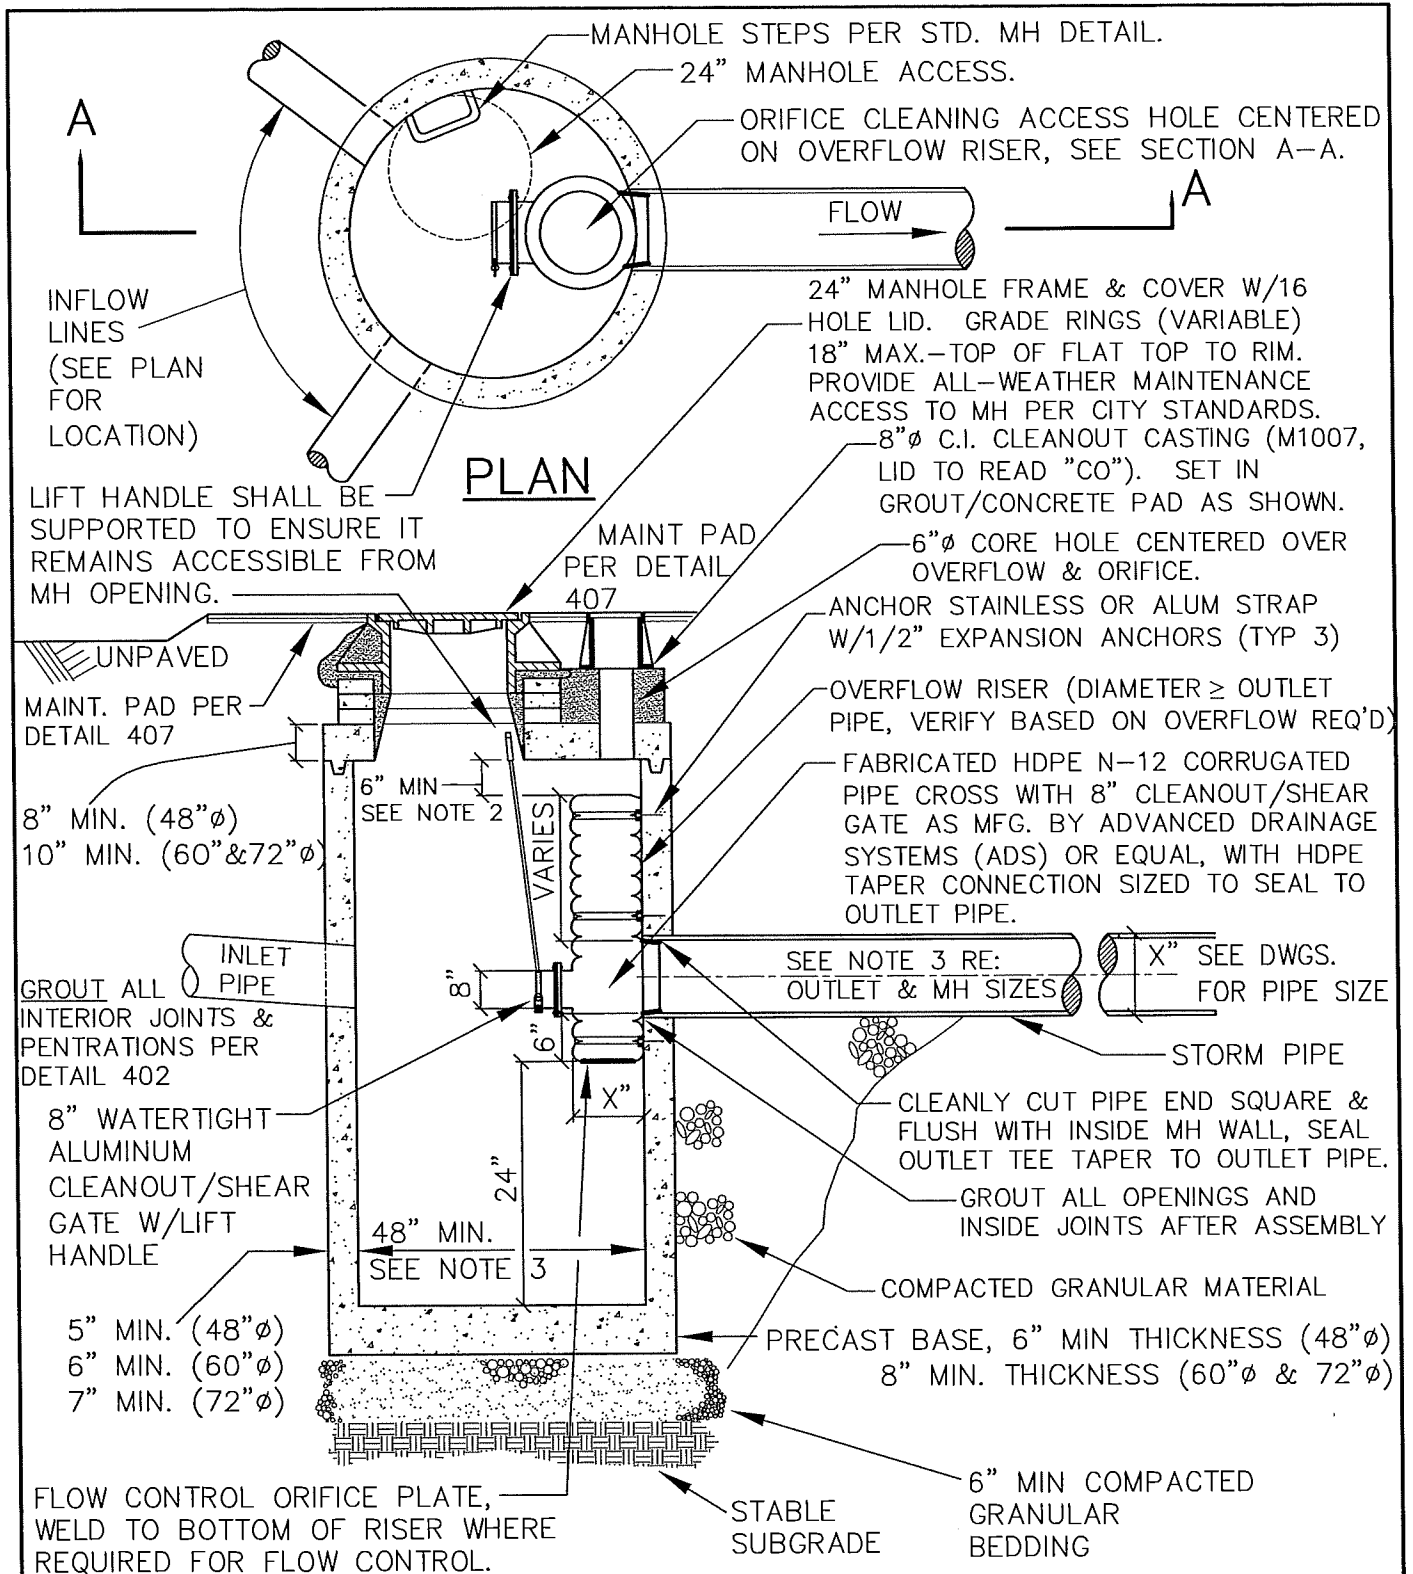


**NOTES:**

1. PRECAST SECTIONS SHALL CONFORM TO ASTM C-478.
2. DISTANCE FROM TOP OF OVERFLOW TO MH RIM SHALL BE BASED ON OVERFLOW CAPACITY CALC'S BY DESIGN ENGINEER (ASSUME ORIFICE CONTROL).
3. 60" MINIMUM DIA. MANHOLE REQUIRED FOR OUTLET PIPE LARGER THAN 15" OR INLET > 21".
4. ORIFICE CLEANING ACCESS TO BE 6" CORE HOLE THROUGH FLAT-TOP (CENTERED ON OVERFLOW) WITH CI CLEANOUT BOX GROUTED TO SLAB.

LAST REVISION DATE: MAR 2024	
<b>POLLUTION/FLOW CONTROL MANHOLE W/OVERFLOW</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 320

GROUT OVERSIZE  
FLOW CHANNEL AS  
SHOWN & TROWEL  
SMOOTH.

CLEARANCE UNDER SANITARY  
SEWER PIPE TO BE A MINIMUM OF  
1.5 TIMES THE DIAMETER OF THE  
STORM PIPE

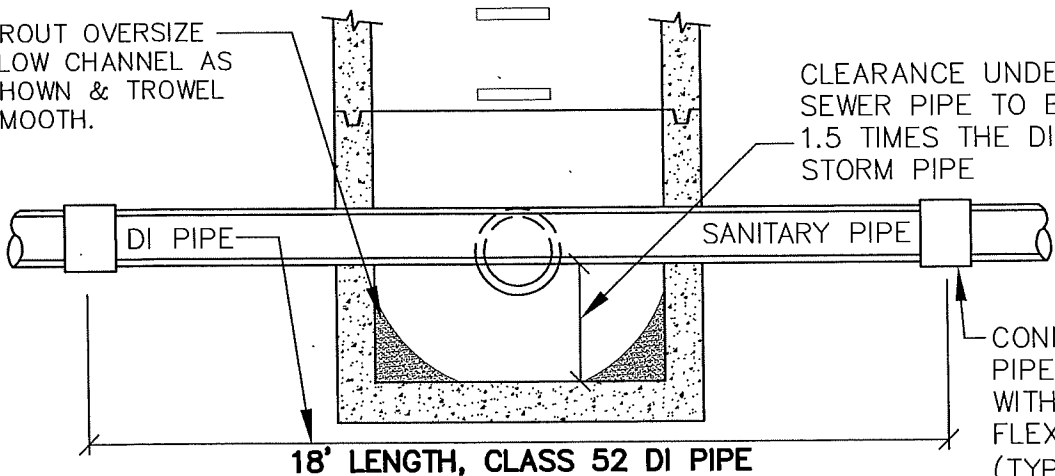


**SECTION THRU SANITARY SEWER**

CONNECT DUCTILE IRON  
PIPE TO SEWER PIPE  
WITH APPROVED  
FLEXIBLE COUPLING.  
(TYP BOTH ENDS)  
MAXADAPTOR COUPLING  
(BY GRIPPER GASKET  
LLC) OR EQUAL.

MANHOLE FRAME & COVER,  
SET PER DTL 407

SET FRAME IN NON-SHRINK GROUT

GROUT ALL  
INTERIOR JOINTS &  
PENETRATIONS PER  
DETAIL 402

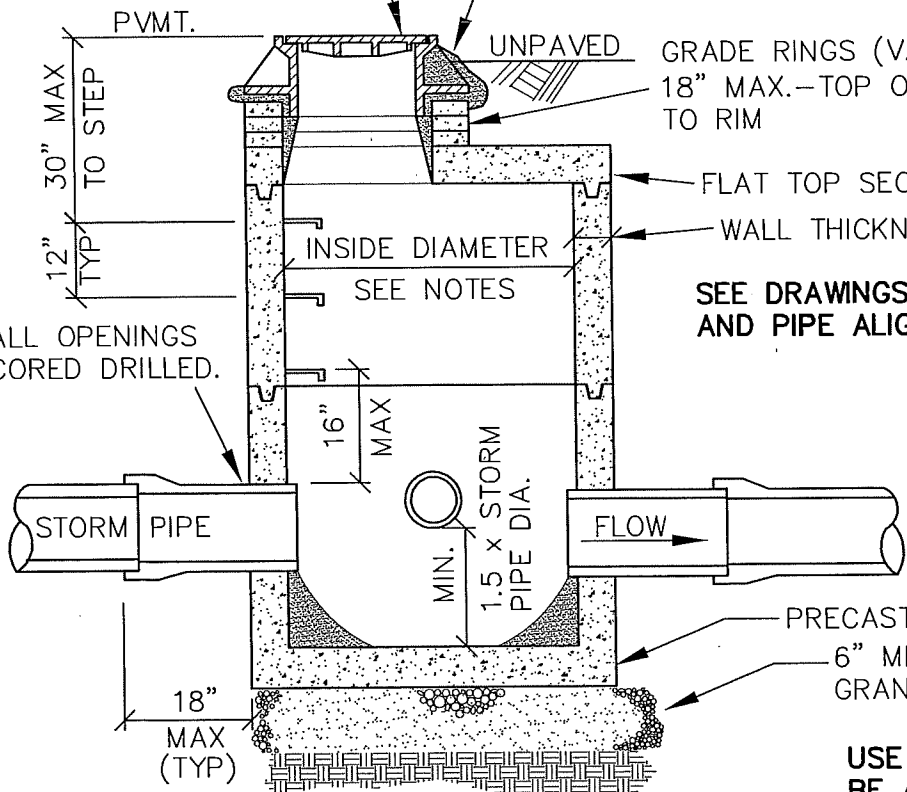

SEE DRAWINGS FOR INVERT ELEVATIONS  
AND PIPE ALIGNMENTS.

**SECTION THRU STORM**


**NOTES:**

1. UNLESS OTHERWISE SHOWN ON DRAWINGS, USE 48" MANHOLE FOR SANITARY SEWER UP TO 12" DIA. & STORM DRAIN UP TO 18" DIAMETER (LARGER DIAMETER MANHOLE OTHERWISE, PER DWGS).
2. PRECAST SECTIONS SHALL MEET OR EXCEED ASTM C-478. WATERTIGHT O-RING OR MASTIC KEYLOCK JOINTS REQUIRED. SEE STANDARD MH DTLS ALSO.
3. STEPS TO BE POLYPROPYLENE PLASTIC WITH GRADE 60 REINFORCING ROD.


**USE OF KUENZI MANHOLES MUST  
BE APPROVED ON A CASE BY  
CASE BASIS BY THE PUBLIC  
WORKS DIRECTOR.**

LAST REVISION DATE: APR 2024	
<b>KUENZI MANHOLE (SEWER PIPE CROSSING)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>330</b>



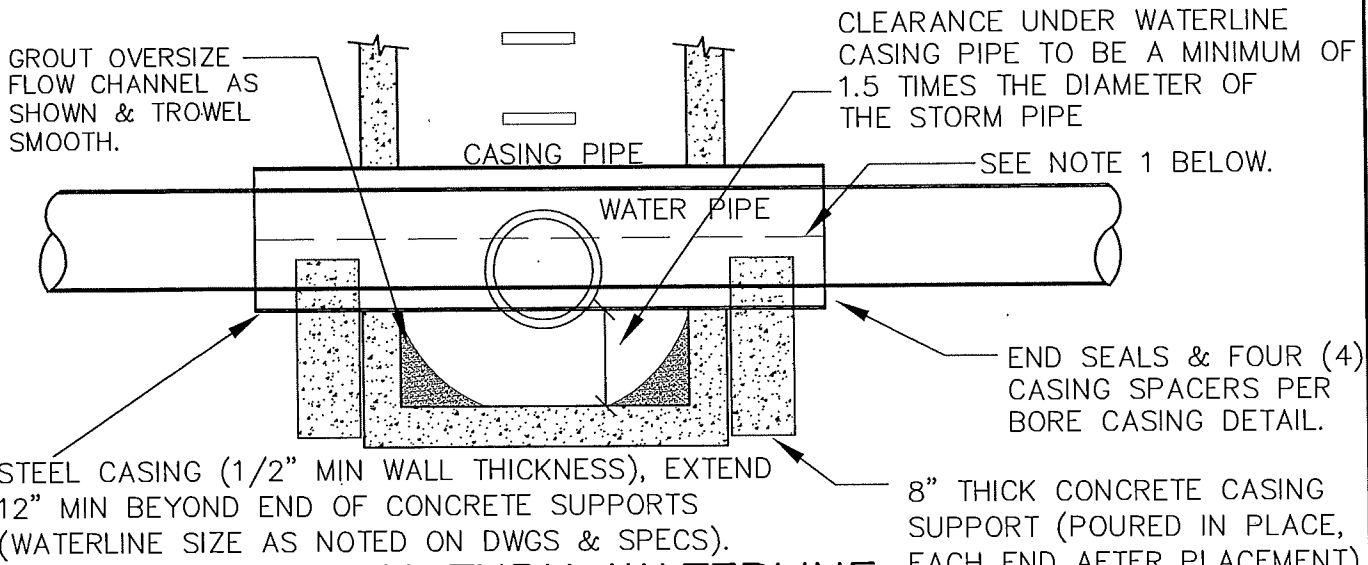

**SECTION THRU WATERLINE**

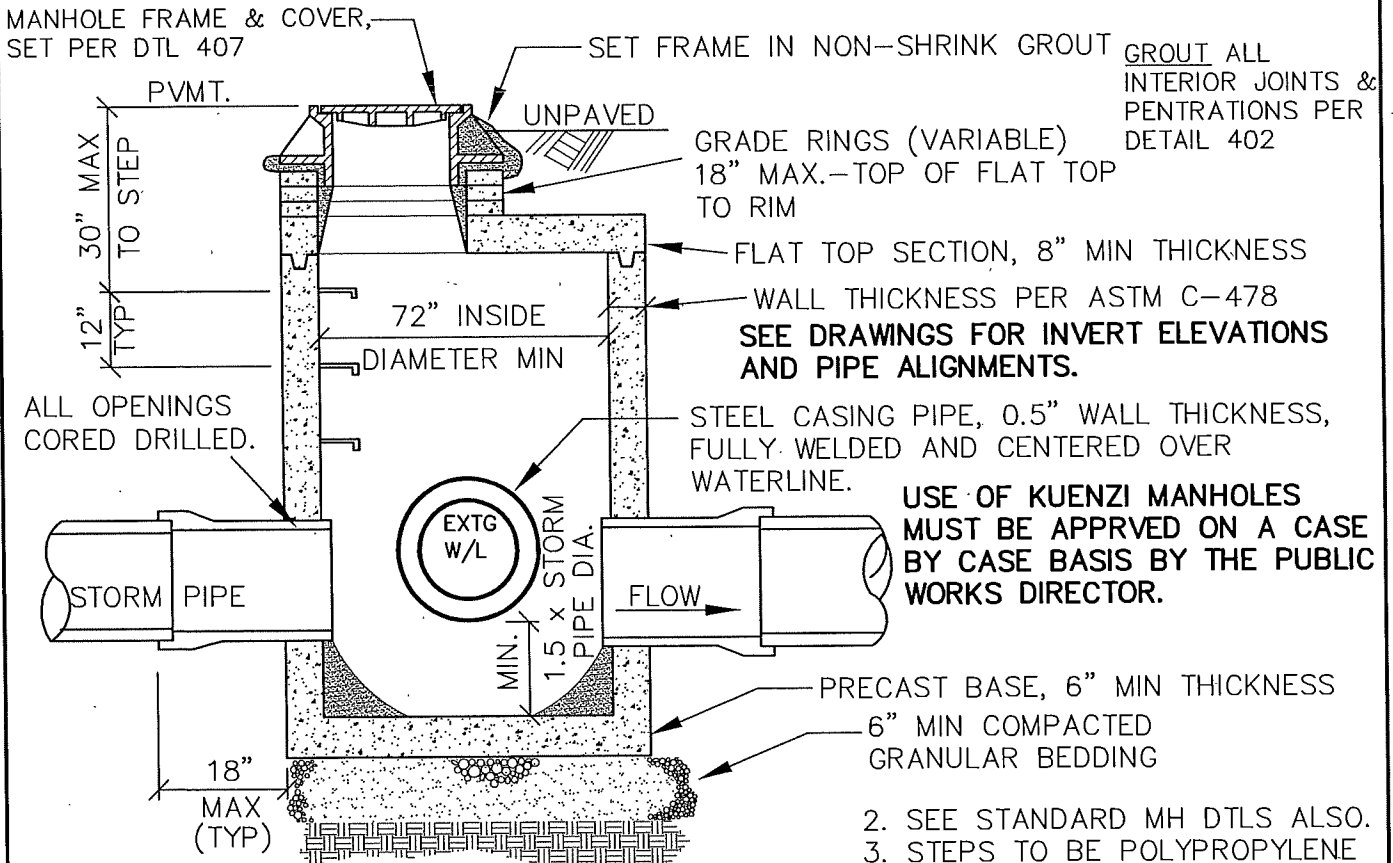


**SECTION THRU STORM**

1. SHOP CUT 30" CASING PIPE IN HALF (LENGTHWISE, ACROSS RADIUS) AND SHOP GRIND BEVELED EDGES FOR FULL PENETRATION WELDS. BLOCK BOTTOM HALF OF CASING PIPE IN PLACE UNDER EXISTING WATERLINE & POUR CONCRETE SUPPORTS. INSTALL CASING SPACERS (DETAIL 308) TO SUPPORT WATERLINE & WELD HALVES OF CASING TOGETHER. USE WATER IN BOTTOM OF CASING DURING WELDING AS REQUIRED TO AVOID OVER-HEATING CASING SPACER SUPPORT LEGS.

LAST REVISION DATE: APR 2024	JO # STANDARD
<b>KUENZI MANHOLE W / WATERLINE CASING (EXISTING WATERLINE)</b> (NTS)	
DAYTON, OR	DETAIL NO. <b>331</b>

2. SEE STANDARD MH DTLs ALSO.
3. STEPS TO BE POLYPROPYLENE PLASTIC WITH GRADE 60 REINFORCING ROD.


**USE OF KUENZI MANHOLES MUST BE APPROVED ON A CASE BY CASE BASIS BY THE PUBLIC WORKS DIRECTOR.**

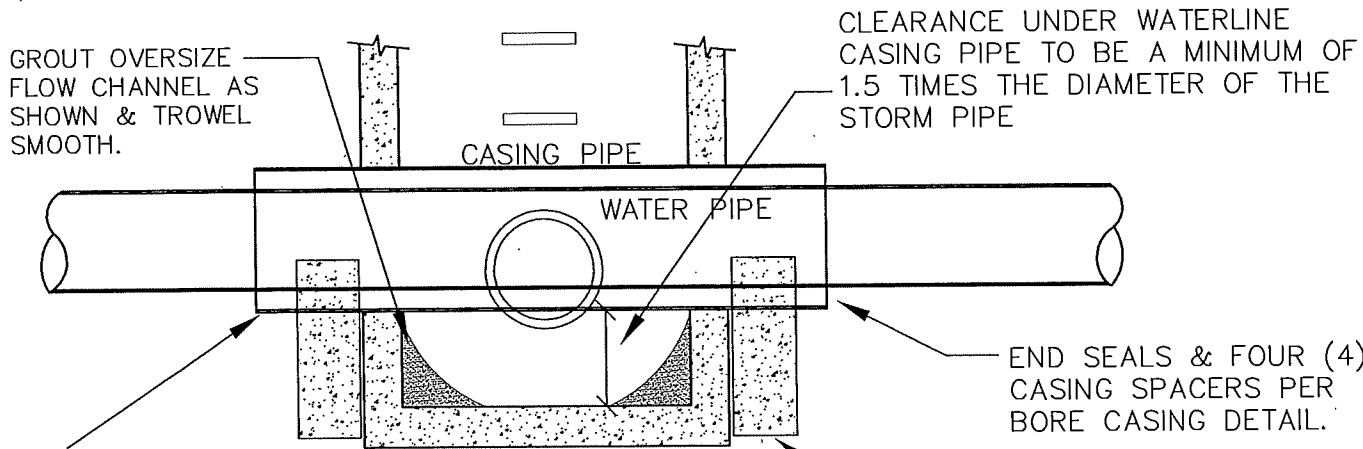

STEEL CASING (1/2" MIN WALL THICKNESS), EXTEND 12" MIN BEYOND END OF CONCRETE SUPPORTS (WATERLINE SIZE AS NOTED ON DWGS & SPECS).

8" THICK CONCRETE CASING SUPPORT (POURED IN PLACE, EACH END AFTER PLACEMENT OF CASING PIPE).

**SECTION THRU WATERLINE**

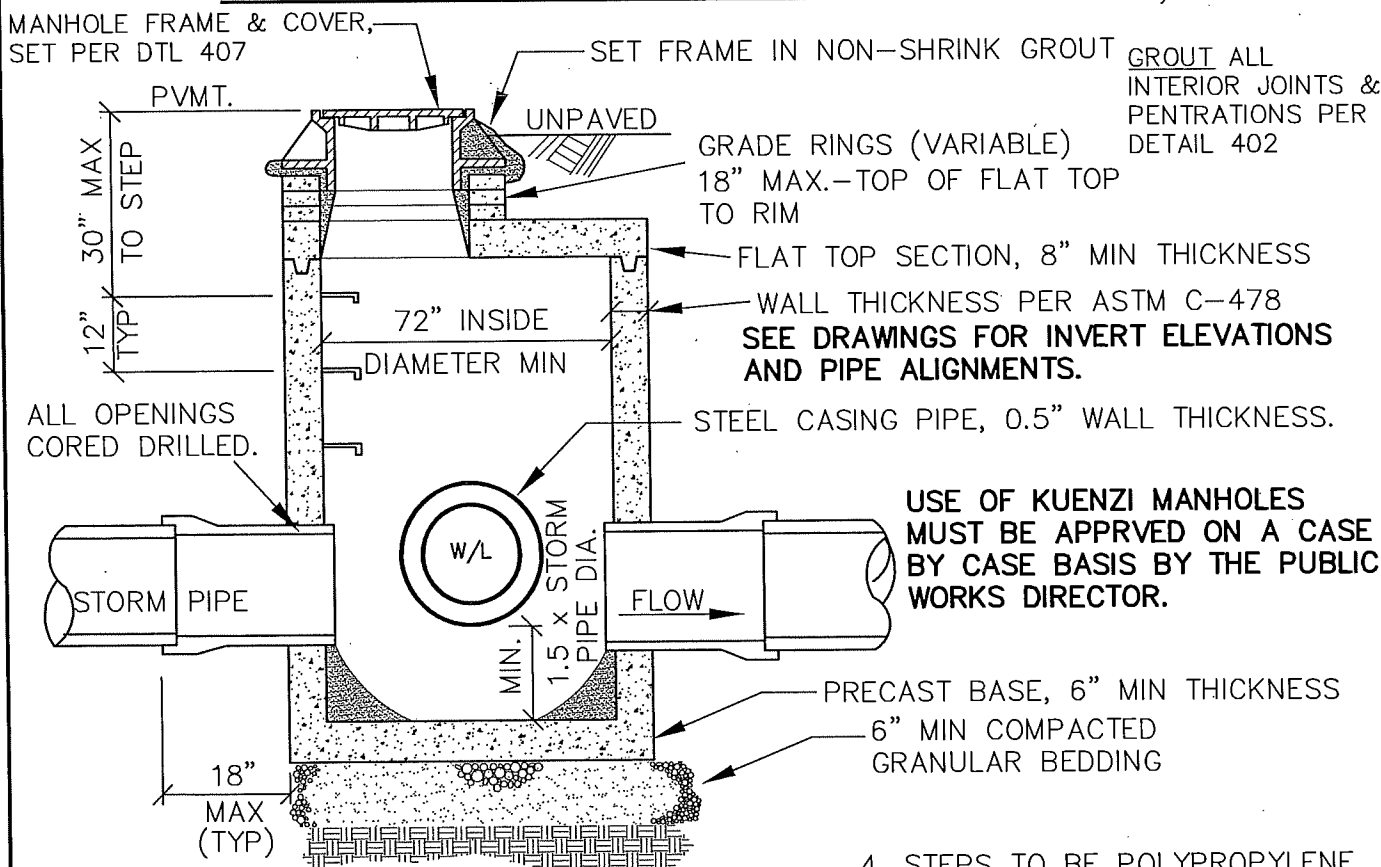

**SECTION THRU STORM**


1. BLOCK CASING PIPE IN PLACE & POUR CONCRETE SUPPORTS. INSTALL CASING SPACERS TO SUPPORT WATERLINE THROUGH CASING (DETAIL 5080). INSTALL END SEALS.
2. SEE PLAN VIEWS FOR WATERLINE & STORM SIZE & CONFIGURATION. USE 72" MANHOLE UNLESS OTHERWISE SHOWN ON DRAWINGS.
3. SEE STANDARD MH DETAILS ALSO.

4. STEPS TO BE POLYPROPYLENE PLASTIC WITH GRADE 60 REINFORCING ROD.

LAST REVISION DATE: APR 2024	JO # STANDARD
<b>KUENZI MANHOLE W / WATERLINE CASING (NEW WATERLINE)</b> (NTS)	
DAYTON, OR	DETAIL NO. <b>332</b>

**TYP DROP THRU MH:**

0.1' MIN STRAIGHT,  
0.2' MIN CORNERS,  
SMALLER INLET PIPES  
TO MATCH LARGER  
OUTLET CROWN

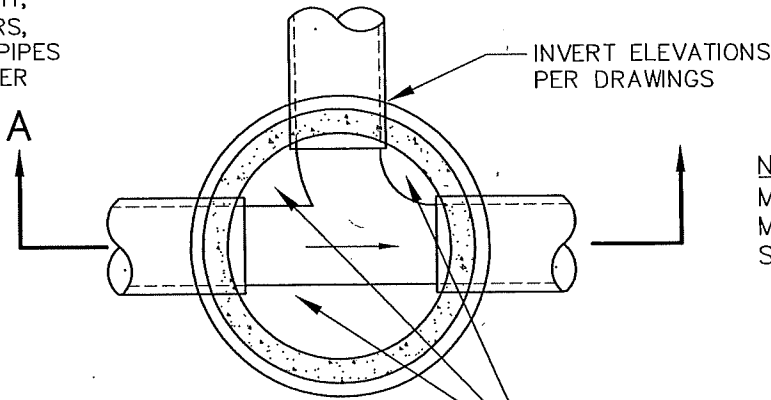

NOTE: PER ORS 92.044(7),  
MANHOLE MUST BE SET 1'  
MINIMUM CLEAR FROM ANY  
SURVEY MONUMENT

CHANNEL & GROUT BASE TO MAKE  
STRUCTURE SELF-CLEANING (SLOPE  
SHELVES TOWARD CHANNEL).

SET FRAME IN  
NON-SHRINK  
GROUT

24" STANDARD MANHOLE FRAME & COVER,  
16-HOLE (OR SLOTTED LID IF NOTED ON DWGS),  
SET PER DTL 407

PVMT.

UNPAVED

4" DRAIN AT  
SUBGRADE

GRADE RINGS (VARIABLE)  
8" MAX.

24" DIA. CONCRETE  
PIPE (C-76, REINF,  
CLASS IV)

PROVIDE ADDITIONAL  
VERTICAL JOINTS IF  
REQUIRED TO FACILITATE  
CAST-IN-PLACE BASE,  
OR IF REQUIRED TO  
ALLOW CHANNELING &  
GROUTING OF MANHOLE  
BASE (AT CONTRACTOR'S  
OPTION).

SAWCUT OR CORE  
DRILL ALL PIPE  
PENETRATIONS

3" MIN.

6" MIN.

5' MAX. (INV TO RIM)

4" MIN.

6" MINIMUM  
COMPACTED  
GRANULAR  
BEDDING

STABLE  
SUBGRADE

GROUT ALL JOINTS  
WATERTIGHT

6" THICK (MIN) CONCRETE BASE  
--PRECAST CONCRETE TO BE 4000 PSI  
@ 28 DAYS.  
--CAST-IN-PLACE CONCRETE SHALL BE  
3300 PSI @ 28 DAYS, MAX 5" SLUMP,  
4.5% AIR (±1.5%).

**SECTION A-A**



**NOTE:**

1. MAXIMUM PIPE NUMBER & DIAMETERS AS FOLLOWS:  
12" DIAMETER OR LESS - 4 MAXIMUM.  
15" DIAMETER - 2 MAXIMUM.  
OTHER PRECAST CONFIGURATIONS TYPICALLY REQUIRE  
STANDARD 48" MIN MANHOLE DIAMETER.
2. CONSTRUCT CAST-IN-PLACE CONCRETE BASE IF REQUIRED  
IN ORDER TO ACCOMMODATE SPECIFIED # & SIZE OR  
ORIENTATION OF PIPES CONNECTED TO MH.

LAST REVISION DATE:	APR 2024
<b>24" DIA. STORM MANHOLE, PRECAST BASE OR CAST-IN-PLACE BASE</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 350

**TYP DROP THRU MH:**  
 0.1' MIN STRAIGHT,  
 0.2' MIN CORNERS,  
 SMALLER INLET PIPES  
 TO MATCH LARGER  
 OUTLET CROWN


INSERTA-TEE CONNECTION,  
 SEE NOTE 3 & 4.  
 INSERTA-TEE SOCKET TO  
 MATCH PIPE MATERIAL  
 SPECIFIED OR NOTED ON  
 THE DRAWINGS.

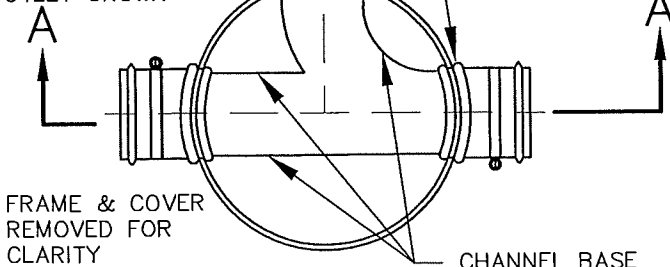

FRAME & COVER  
 REMOVED FOR  
 CLARITY


**PLAN**

CHANNEL BASE  
 W/CONCRETE & SLOPE  
 SHELVES TO DRAIN.

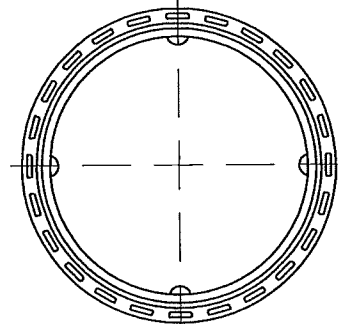

FRAME TO INCLUDE TABS THAT  
 MATCH BASIN OD TO PREVENT  
 DISPLACEMENT. FRAME BODY TO  
 BEAR ON COMPACTED BASEROCK  
 (SEE SECTION A-A)

PAVED  
 SURFACE

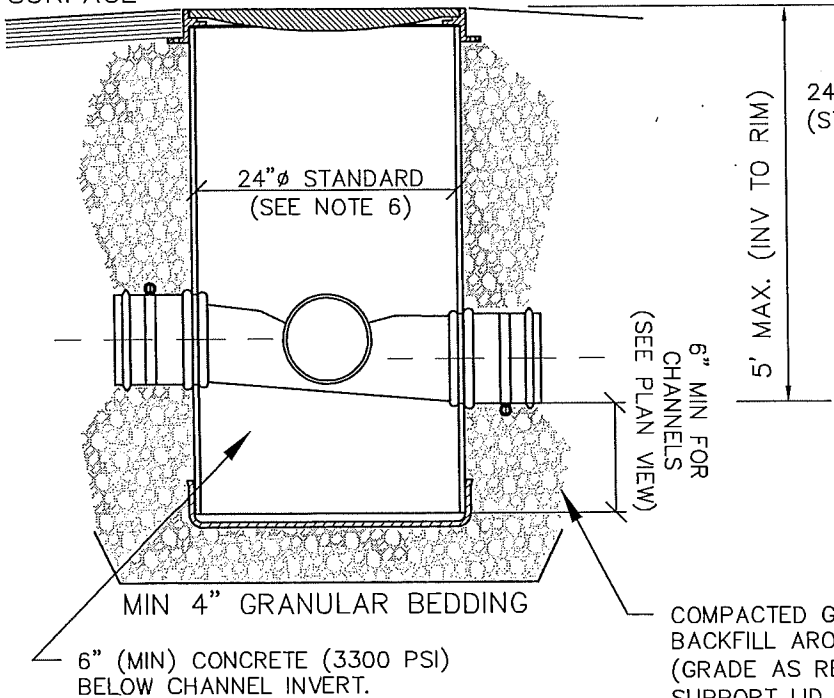

MIN 4" GRANULAR BEDDING


6" (MIN) CONCRETE (3300 PSI)  
 BELOW CHANNEL INVERT.

COMPACTED GRANULAR  
 BACKFILL AROUND MANHOLES  
 (GRADE AS REQUIRED TO  
 SUPPORT LID FRAME).

**SECTION A-A**

**FRAME**

24.75"  $\phi$   
 (STANDARD)



PROVIDE A MINIMUM OF (2) 1"  
 DIAMETER PICK HOLES IN SOLID LID,  
 OR PROVIDE STANDARD 16-HOLE  
 STORM MANHOLE LID.


**SOLID LID**

**NOTES:**

1. NYLOPLAST TRAFFIC RATED DRAIN BASIN OR APPROVED EQUAL WITH NYLOPLAST FRAME & MH LID.
2. MH FRAME & COVER TO BE DUCTILE IRON PER ASTM A536 GRADE 70-50-05.
3. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION, ORIENTATION AND INVERT ELEVATIONS.
4. CONNECTIONS TO PVC MANHOLE TO BE INSERTA-TEE STYLE FITTINGS (FACTORY OR FIELD INSTALLED).
5. FIVE (5) FOOT MAXIMUM ALLOWABLE DEPTH FROM RIM TO OUTLET INVERT (DEEPER APPLICATIONS REQUIRE 48" MANHOLE).
6. MAXIMUM NUMBER & CONFIGURATION OF PIPE CONNECTIONS TO BE BASED ON INSERTA-TEE RECOMMENDATIONS. PROVIDE 30" DIAMETER BASIN & 30" SOLID COVER IF REQUIRED DUE TO NO. OF PIPES, SPACING &/OR ANGLES (30" MH TO MEET ALL DETAIL REQUIREMENTS SHOWN EXCEPT DIAMETER).

**NOTE:** PER ORS 92.044(7),  
 MANHOLE MUST BE SET 1'  
 MINIMUM CLEAR FROM ANY  
 SURVEY MONUMENT



LAST REVISION DATE: AUG 2023	JO #
<b>24" DIA. STORM MANHOLE    (TRAFFIC RATED PVC W/SOLID    DUCTILE IRON FRAME/COVER)</b> (NTS)	
DAYTON, OR	DETAIL NO. 351

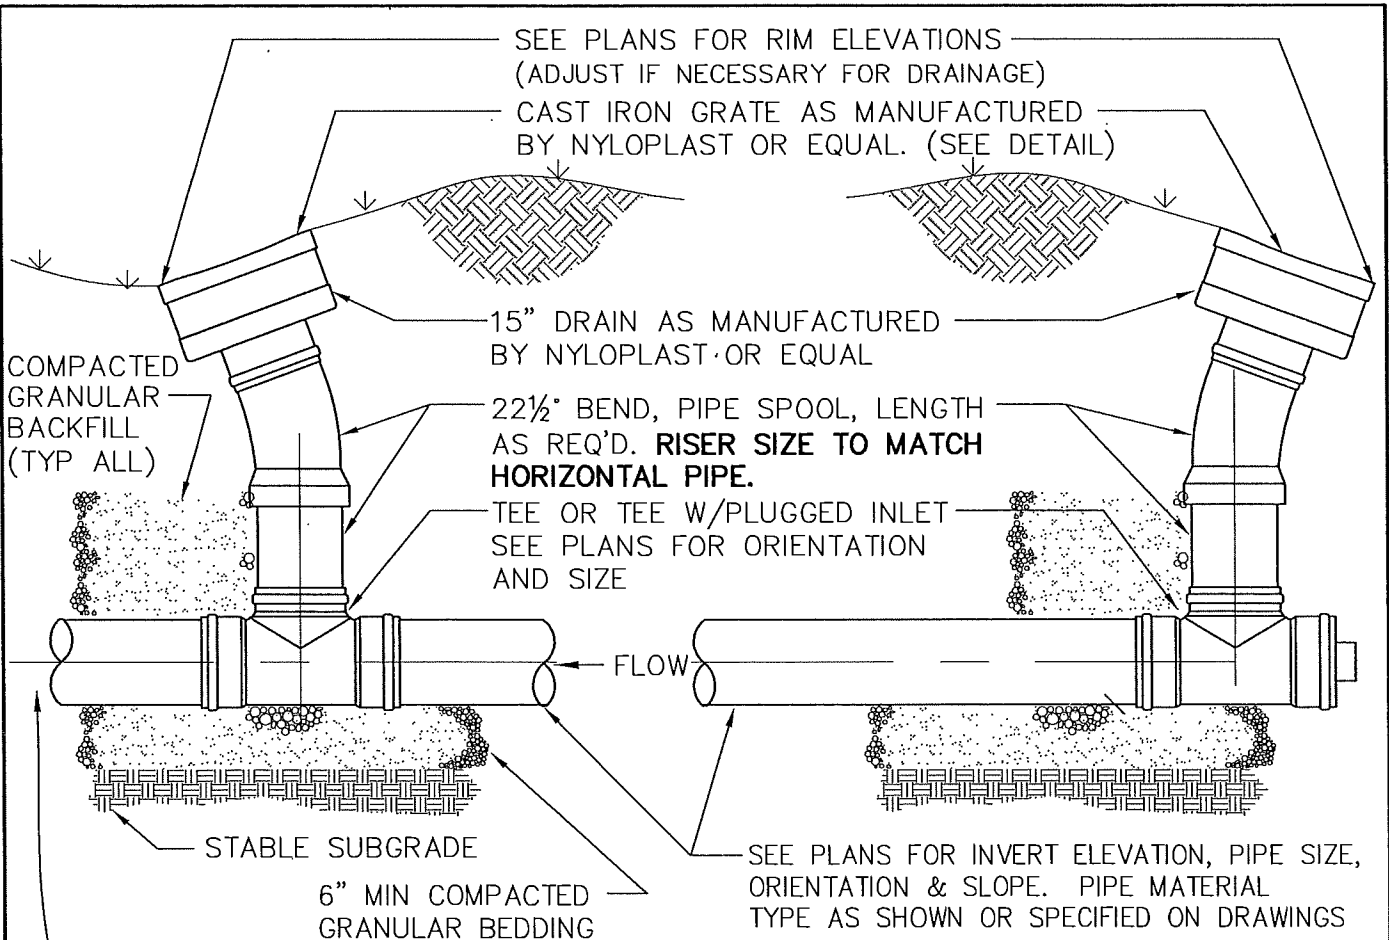

**AREA DRAIN**  
NTS

CONNECT TO MAINLINE OR MANHOLE AS SHOWN ON DRAWINGS

SEE PLANS FOR INVERT ELEVATION, PIPE SIZE, ORIENTATION & SLOPE. PIPE MATERIAL TYPE AS SHOWN OR SPECIFIED ON DRAWINGS

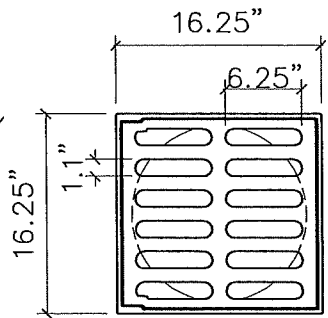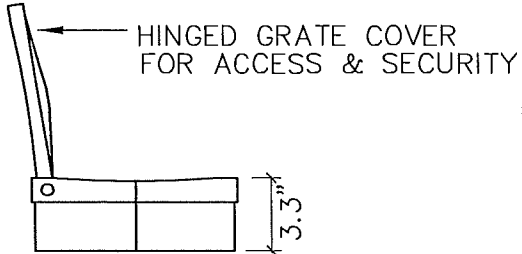



**STANDARD**

**15" CAST IRON GRATE DETAIL**  
NTS

**NOTES:**

1. AREA DRAIN NOT FOR USE IN AREAS SUBJECT TO VEHICLE TRAFFIC.
2. USE WATERTIGHT GASKETED FITTINGS AND ADAPTORS FOR ALL PIPE CONNECTIONS.
3. ALTERNATE PRODUCTS OR CONFIGURATIONS PROPOSED SHALL INCLUDE SLANTED GRATE CONFIGURATION TO MINIMIZE GRATE BLIND-OFF BY LEAVES OR DEBRIS.
4. ANY GRATES SET IN SURFACED PEDESTRIAN AREAS SHALL CONFORM WITH ADA REQUIREMENTS, INCLUDING GRATE OPENING SIZE.

LAST REVISION DATE: JULY 2022	JO # STANDARD
<b>PRIVATE AREA DRAIN, NON-TRAFFIC AREAS</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>355</b>

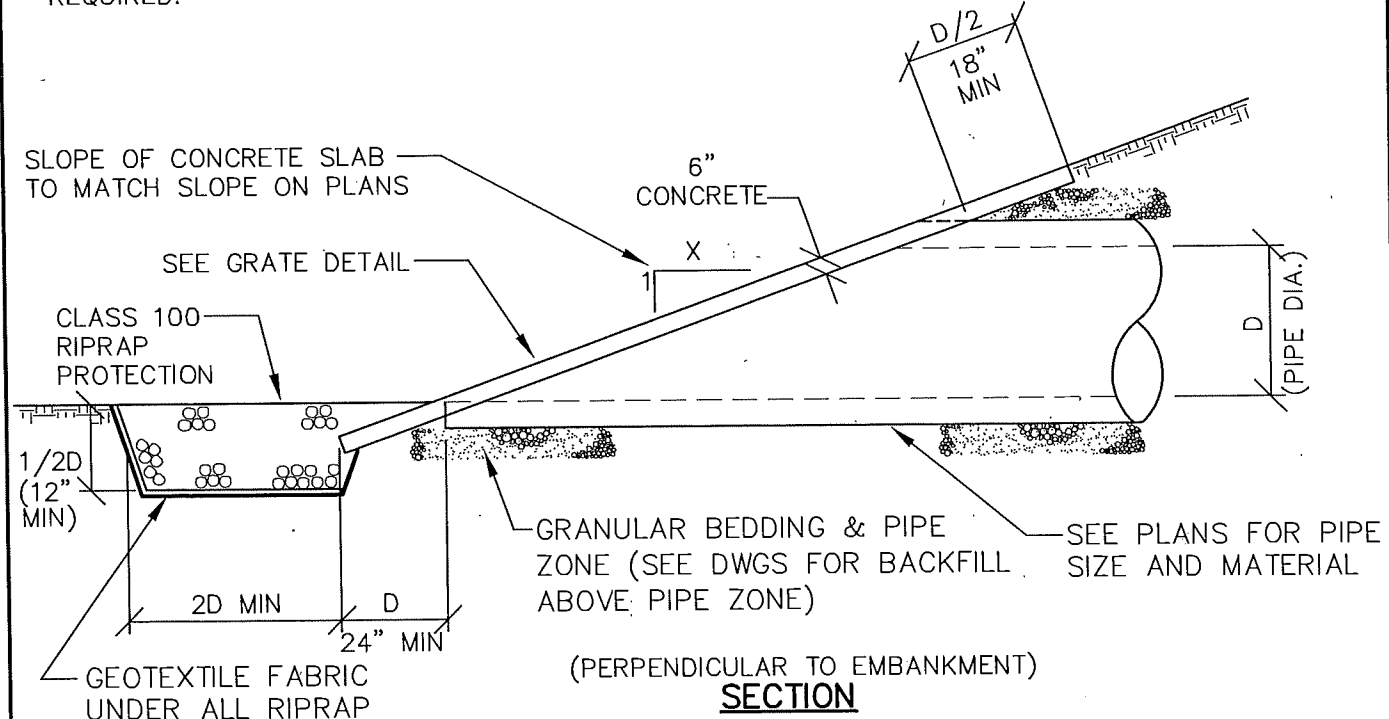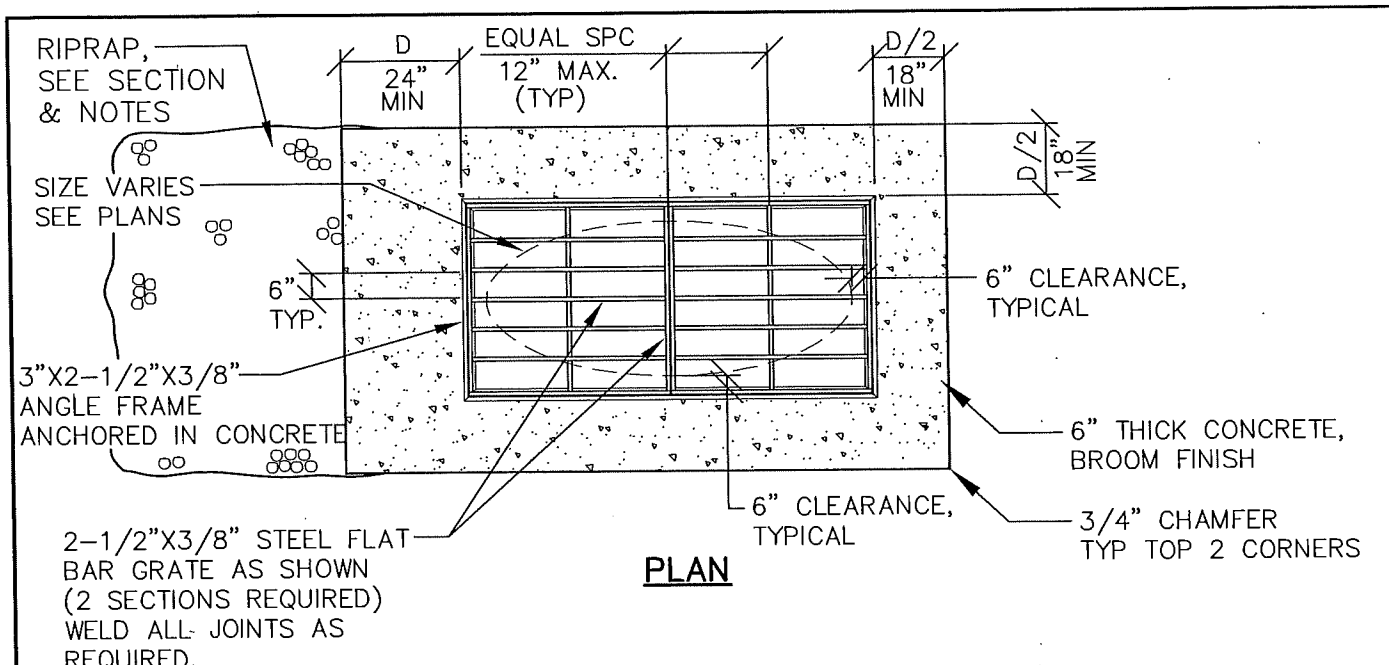


**NOTES:**

1. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION AND INVERT ELEVATION.
2. FRAME & GRATE SHALL BE ASTM A36 STEEL, HOT DIP GALVANIZED AFTER FABRICATION.
3. ALL CONCRETE TO BE 3300 PSI AT 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).
4. GRATED CONFIGURATION SHOWN IS TYPICALLY USED WHERE OUTFALL PIPE DISCHARGES THROUGH EMBANKMENT PERPENDICULAR TO THE DRAINAGE CHANNEL, AND WHERE REQUIRED TO ACCOMMODATE BANK MOWING EQUIP.
5. USE NON-GRATED CONFIGURATION WHERE APPROVED BY PUBLIC WORKS DIRECTOR.
6. ARMORING OF FAR CHANNEL BANK (TO BANK TOP) IS REQUIRED UNLESS NO EROSION POTENTIAL EXISTS (AS DETERMINED BY CITY). ARMOR BOTTOM & BANK 10 FEET MINIMUM IN EACH DIRECTION FROM OUTFALL CENTERLINE, UNLESS FURTHER SHOWN ON DWGS.
7. FILL ALL VOIDS IN RIP-RAP WITH 3/4"-0 GRANULAR BASEROCK.

LAST REVISION DATE:	
APR 2024	
<b>CONCRETE PIPE END CAP WITH GRATE</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 362

FOR USE ONLY WHERE SPECIFICALLY APPROVED BY PUBLIC WORKS DIRECTOR AND CITY ENGINEER, BASED ON SOIL INFILTRATION TESTS PER PWDS 3.20..

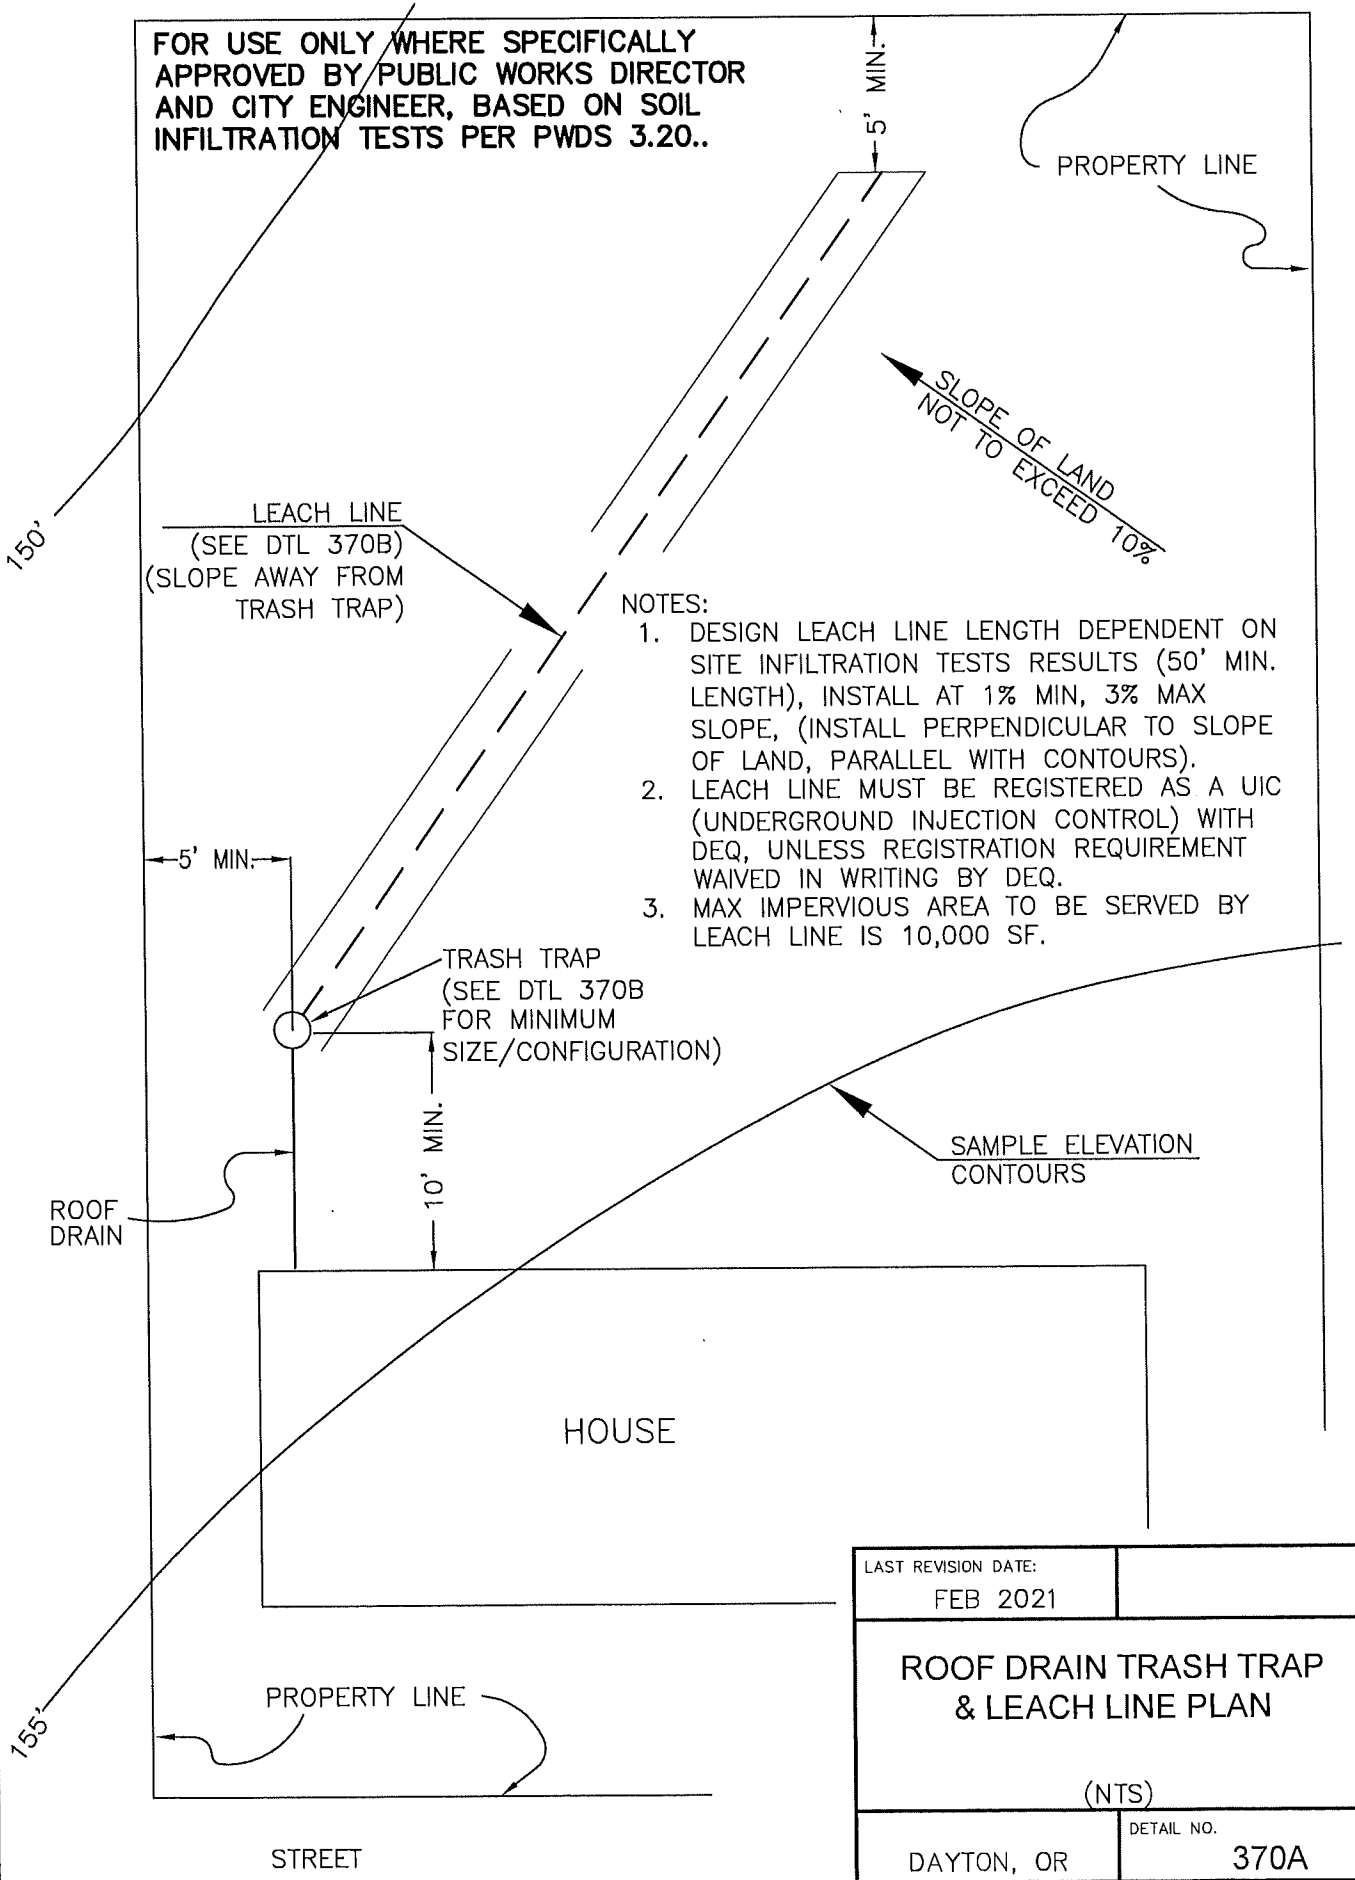

LEACH LINE  
(SEE DTL 370B)  
(SLOPE AWAY FROM TRASH TRAP)

NOTES:

1. DESIGN LEACH LINE LENGTH DEPENDENT ON SITE INFILTRATION TESTS RESULTS (50' MIN. LENGTH), INSTALL AT 1% MIN, 3% MAX SLOPE, (INSTALL PERPENDICULAR TO SLOPE OF LAND, PARALLEL WITH CONTOURS).
2. LEACH LINE MUST BE REGISTERED AS A UIC (UNDERGROUND INJECTION CONTROL) WITH DEQ, UNLESS REGISTRATION REQUIREMENT WAIVED IN WRITING BY DEQ.
3. MAX IMPERVIOUS AREA TO BE SERVED BY LEACH LINE IS 10,000 SF.

TRASH TRAP  
(SEE DTL 370B FOR MINIMUM SIZE/CONFIGURATION)

SAMPLE ELEVATION CONTOURS

ROOF DRAIN

HOUSE

PROPERTY LINE

STREET

LAST REVISION DATE:  
FEB 2021

ROOF DRAIN TRASH TRAP & LEACH LINE PLAN


(NTS)

DAYTON, OR


DETAIL NO.

370A


FOR USE ONLY WHERE SPECIFICALLY APPROVED BY  
PUBLIC WORKS DIRECTOR AND CITY ENGINEER, BASED  
ON SOIL INFILTRATION TESTS PER PWDS 3.20..

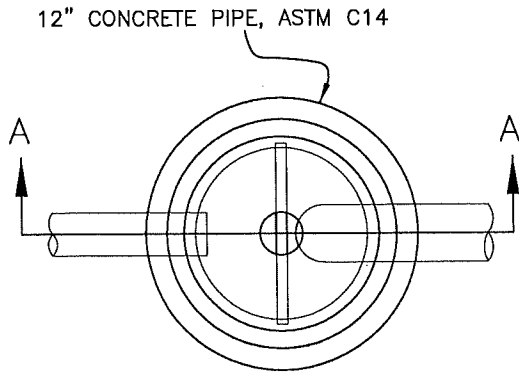


TRASH TRAP

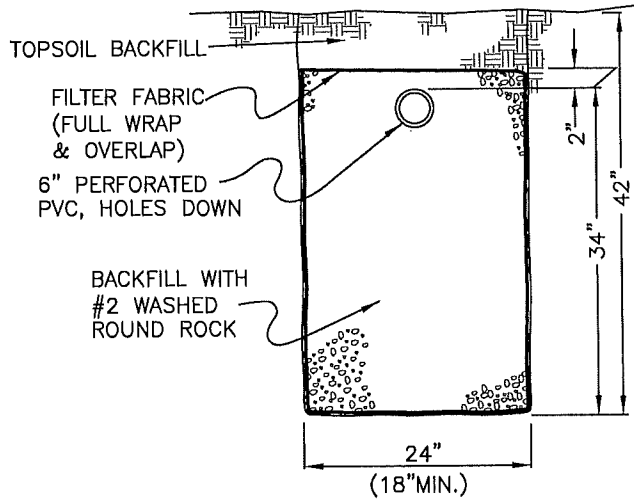

TYPICAL SECTION  
LEACH LINE  
(SEE NOTES FOR  
OPTIONS)

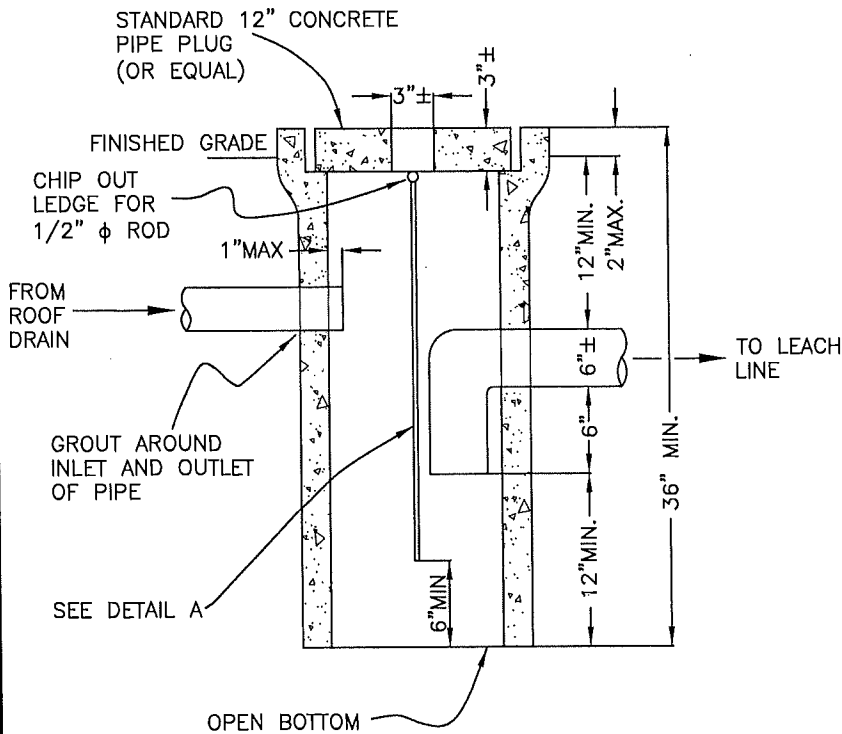

SECTION A-A

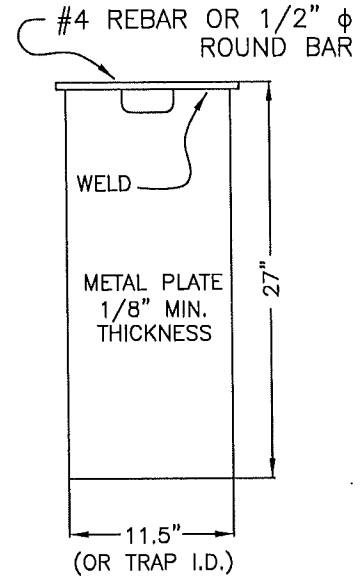

DETAIL A

NOTES:

1. TRASH TRAP SIZE SHOWN IS MINIMUM REQUIRED BY CITY PW STANDARDS. OPSC REQUIREMENTS MAY ALSO APPLY. LARGER TRAPPED BASIN IS RECOMMENDED FOR EASE OF MAINTENANCE & CLEANING.
2. EZflow DRAINAGE SYSTEM by INFILTRATOR (OR EQUAL) IS ALLOWED AS AN OPTION TO WASHED ROCK TRENCH SHOWN (15" MIN BUNDLE W/PIPE).

LAST REVISION DATE:	
FEB 2021	
<b>TRASH TRAP &amp; LEACH LINE DETAILS</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 370B



# STORM SEWER MANDREL TEST REPORT

Project Location: (City)	Project Name:
Inspector: (Print)	Date: (Separate Report Required for Each Test Session)
Mandrel Diameters Verified? Yes / No	

Station (& Manhole #)		Size & Material	Length (ft)	Results	Backfill Compaction Completed?	Date Sewer Flushed & Cleaned	Comments
From	To						
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		

1. Mandrel testing shall be conducted on a manhole to manhole (or cleanout) basis and shall be done after the line has been completely flushed out with water.
2. Mandrel testing shall be conducted after trench backfill and compaction has been completed.
3. The mandrel diameter shall be 95% of the pipe initial inside diameter. The inspector shall verify the diameter of each mandrel used during each test session.

# STORM PIPELINE TV INSPECTION REPORT

Page \_\_\_ of \_\_\_

Date:	Client: City:	Basin No.				
Technician:	Inspector:	Weather:	Cleaned By:	Report No.	Tape No.	
From M.H. #: Street:	Pipe Dia. (in)	Joint Length (ft)	Section Length (ft)	Joint Type:	Pipe Material	To M.H. #: Street:

PIPELINE DATA; Cleanliness: _____ Alignment: _____ Grade: _____ Age: _____ %Est. Leaking Joints: _____ Other: _____ _____	Footage	Problem Code	Comments	I/I (gpm)
	<b>PROBLEM CODE LEGEND:</b> BP = Broken Pipe CC = Circumferential Crack LC = Longitudinal Crack G = Break in Grade L = Leak PJ = Pulled Joint PT = Protruding Tap ST = Service Tap SL = Service Left SR = Service Right RT = Roots U = Unpassable			
<b>PIPE MATERIAL LEGEND:</b> AC = Asbestos Cement CIP = Cast Iron Pipe C(M) = Conc., Mortar Joint C(R) = Conc., Rubr. Gasket Jnt DI = Ductile Iron Pipe PVC = Polyvinylchloride Pipe TC = Terra Cotta VC = Vitrified Clay				
<b>TURNAROUND:</b> Requested (Date/time): _____ Authorized (Date/time): _____				

NOTE: PER ORS 92.044(7), MANHOLE MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT



PROVIDE GASKETED PVC CAP ON ALL STUBS FOR FUTURE CONNECTION SHOWN ON DWGS (EXTEND PIPE 2' MIN BEYOND MH WALL), SLOPE PER DWGS.

**TYP DROP THRU MH:**

0.1' MIN STRAIGHT, 0.2' MIN CORNERS, SMALLER INLET PIPES TO MATCH LARGER OUTLET CROWN

INVERT ELEVATIONS PER DRAWINGS

O-RING or BUTYL RESIN MASTIC AS SPEC'D

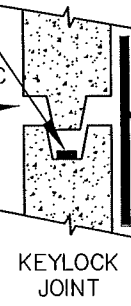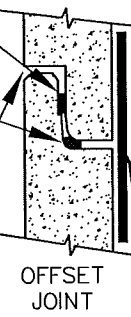

VACUUM TESTING OF EXTG MANHOLES REQUIRED AFTER NEW CONNECTIONS. SEAL MH AS REQUIRED TO PASS.

SLOPE SHELVES 1:12 TO DRAIN

STEPS. VERIFY LOCATION TO AVOID CONFLICTS WITH INSIDE OR OUTSIDE DROPS

MANHOLE FRAME & COVER, SET PER DTL 407

MANPAN MH LID INSERT AS REQ'D (SEE DTL 407)

PAVED SURFACE

**PLAN**

SET FRAME IN NON-SHRINK GROUT

ALL INSIDE JOINTS & WALL PENETRATIONS TO BE GROUTED FOLLOWING MH ASSEMBLY (TYP).

ALL SS MHS. CLEAN & INSTALL 9" WIDE EXTERNAL MASTIC WRAP AT ALL JOINTS & PICKHOLES (TRELLEBORG OR BESTWRAP), SECURE IN PLACE W/ 3 LAYERS OF PLASTIC PALLET WRAP. CONTACT PUBLIC WORKS FOR INSPECTION BEFORE BACKFILLING.

**MANHOLE BARREL JOINT OPTIONS & SEALING**

30" MAX  
8" MIN  
12" TYP

UNPAVED  
GRADE RINGS (VARIABLE) 18" MAX.—TOP OF CONE TO RIM

SLOPE OF PRECAST ECCENTRIC CONE SHALL FACE DOWN GRADE. LOCATE STEPS ON UPSTREAM SIDE OF MANHOLE.

**FLAT TOP MH'S SHALL BE USED FOR ALL MH'S LESS THAN 6' RIM TO INVERT, OR WITH TOP OF PIPE CONNECTIONS WITHIN 5 FEET OF RIM ELEV**

MASTIC WRAP AS NOTED

WALL THICKNESS PER ASTM C-478

48" INSIDE DIA. MIN

ALL PIPE PENETRATIONS ON SANITARY SEWER MANHOLES TO HAVE RUBBER BOOTS.

ALL OPENINGS CORED DRILLED.

CHANNEL DEPTH = 16" MAX 2/3 PIPE DIA. MIN.

ROUTE TONING WIRE UP OUTSIDE OF MH AS SHOWN (TYP ALL PIPES).

18" MAX

PRECAST BASE THICKNESS PER ASTM C-478

6" MIN COMPACTED GRANULAR BEDDING

**SECTION A-A**

STABLE SUBGRADE

**NOTES:**

1. PRECAST SECTIONS SHALL MEET OR EXCEED ASTM C-478. ALL CHANNELS & GROUTING TO BE SMOOTH.
2. WATERTIGHT O-RING OR MASTIC JOINTS REQUIRED, W/EXTERNAL SEAL AT BARREL JOINTS & PICKHOLES.
3. STEPS TO BE POLYPROPYLENE PLASTIC WITH GRADE 60 REINFORCING ROD. ADD STEPS TO EXTG CONNECTION MH IF EXTG STEPS ARE ABSENT.

LAST REVISION DATE:  
APR 2024

COPYRIGHT 1996 WESTECH ENGINEERING, INC.

**STANDARD MANHOLE FOR 21" PIPE AND SMALLER (SEWER & STORM)**

(NTS)

DAYTON, OR

DETAIL NO.


401

NOTE: PER ORS 92.044(7), MANHOLE MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT


PROVIDE GASKETED PVC CAP ON ALL STUBS FOR FUTURE CONNECTION SHOWN ON DWGS (EXTEND PIPE 2' MIN BEYOND MH WALL), SLOPE PER DWGS.

**TYP DROP THRU MH:**


0.1' MIN STRAIGHT, 0.2' MIN CORNERS, SMALLER INLET PIPES TO MATCH LARGER OUTLET CROWN

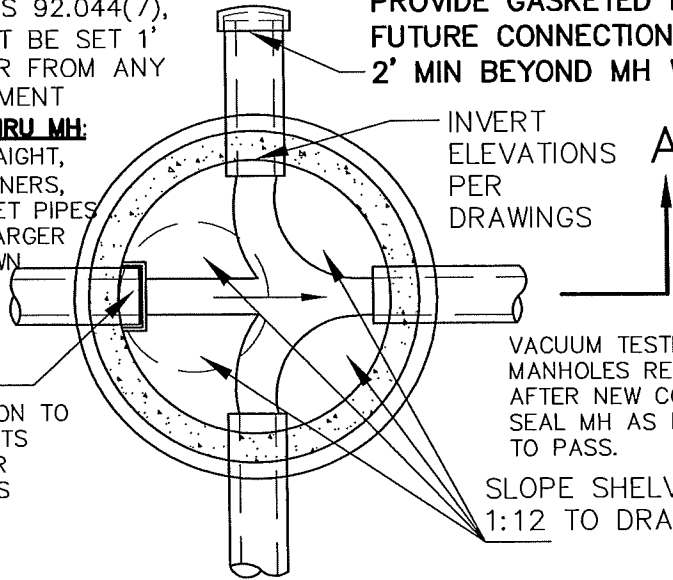

**PLAN**

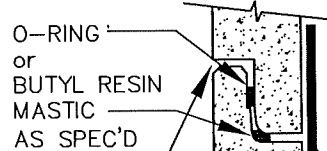

OFFSET JOINT



KEYLOCK JOINT

ALL INSIDE JOINTS & WALL PENETRATIONS TO BE GROUTED FOLLOWING MH ASSEMBLY (TYP).

ALL SS MHS. CLEAN & INSTALL 9" WIDE EXTERNAL MASTIC WRAP AT ALL JOINTS & PICKHOLES (TRELLEBORG OR BESTWRAP), SECURE IN PLACE W/ 3 LAYERS OF PLASTIC PALLET WRAP. CONTACT PUBLIC WORKS FOR INSPECTION BEFORE BACKFILLING.

VACUUM TESTING OF EXTG MANHOLES REQUIRED AFTER NEW CONNECTIONS. SEAL MH AS REQUIRED TO PASS.

SLOPE SHELVES 1:12 TO DRAIN


STEPS. VERIFY LOCATION TO AVOID CONFLICTS WITH INSIDE OR OUTSIDE DROPS

MANHOLE FRAME & COVER, SET PER DTL 407

MANPAN MH LID INSERT AS REQ'D (SEE DTL 407) PAVED SURFACE

SET FRAME IN NON-SHRINK GROUT UNPAVED

**MANHOLE BARREL JOINT OPTIONS & SEALING**

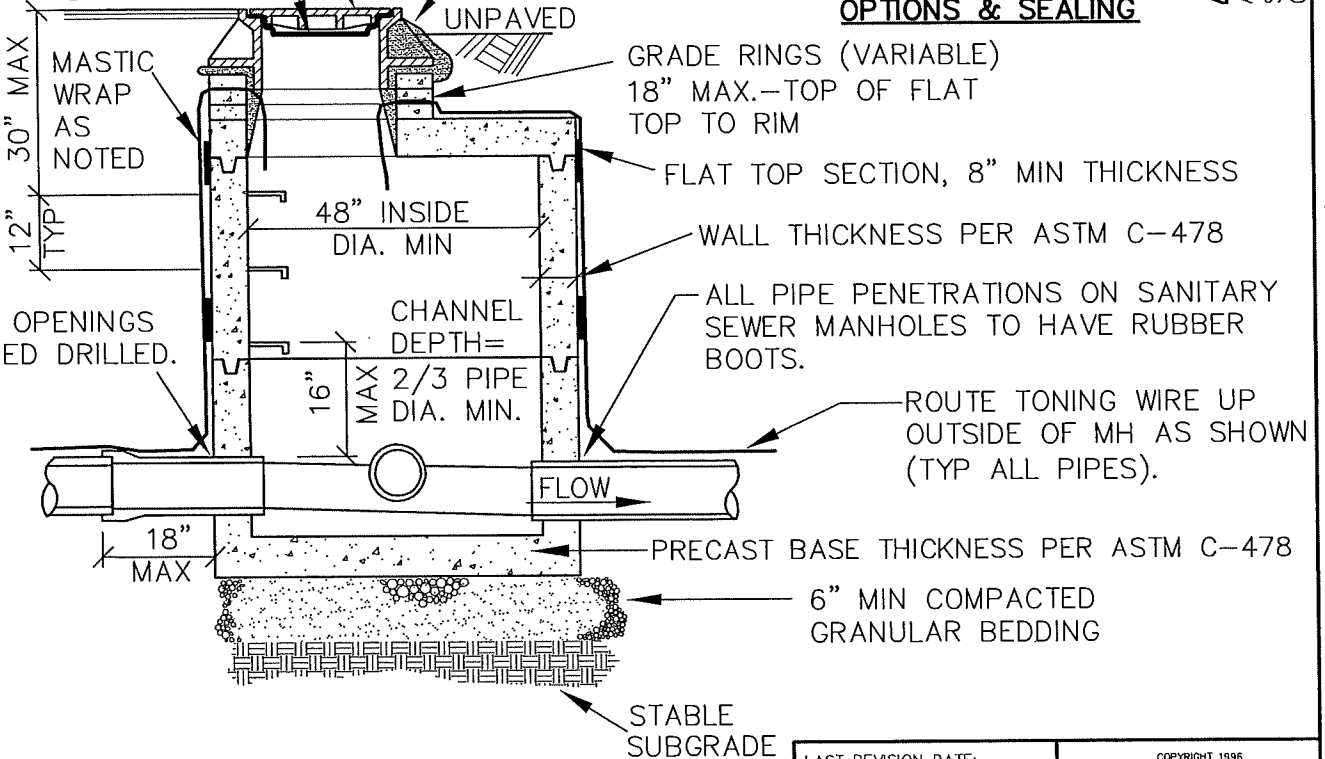

**SECTION A-A**

**NOTES:**


1. PRECAST SECTIONS SHALL MEET OR EXCEED ASTM C-478. ALL CHANNELS & GROUTING TO BE SMOOTH.
2. WATERTIGHT O-RING OR MASTIC JOINTS REQUIRED, W/EXTERNAL SEAL AT BARREL JOINTS & PICKHOLES.
3. STEPS TO BE POLYPROPYLENE PLASTIC WITH GRADE 60 REINFORCING ROD. ADD STEPS TO EXTG CONNECTION MH IF EXTG STEPS ARE ABSENT.

LAST REVISION DATE: APR 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>FLAT TOP MANHOLE FOR 21" PIPE AND SMALLER (SEWER &amp; STORM)</b> (NTS)	
DAYTON, OR	DETAIL NO. 402



NOTE: PER ORS 92.044(7), MANHOLE MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

PROVIDE GASKETED PVC CAP ON ALL STUBS FOR FUTURE CONNECTION SHOWN ON DWGS (EXTEND PIPE 2' MIN BEYOND MH WALL), SLOPE PER DWGS.

**A TYP DROP THRU MH:**  
0.1' MIN STRAIGHT,  
0.2' MIN CORNERS,  
SMALLER INLET PIPES  
TO MATCH LARGER  
OUTLET CROWN

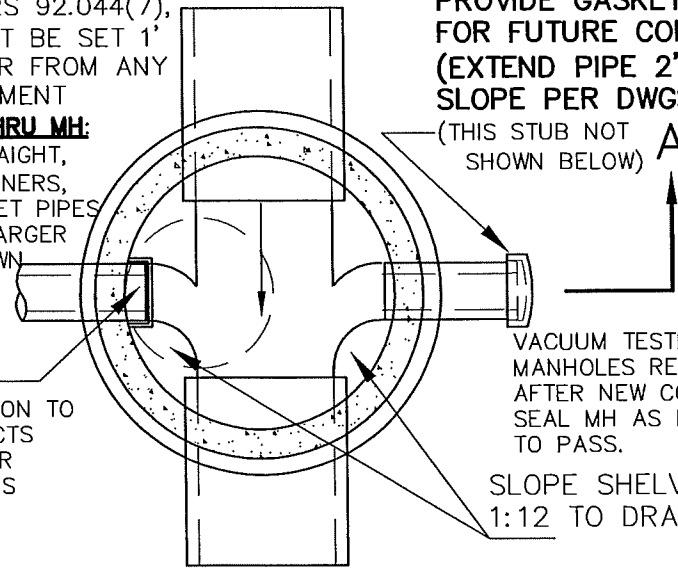

O-RING or BUTYL RESIN MASTIC AS SPEC'D

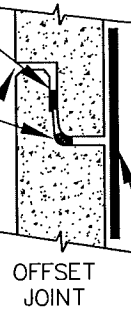

ALL SS MHS. CLEAN & INSTALL 9" WIDE EXTERNAL MASTIC WRAP AT ALL JOINTS & PICKHOLES (TRELLEBORG OR BESTWRAP), SECURE IN PLACE W/ 3 LAYERS OF PLASTIC PALLET WRAP. CONTACT PUBLIC WORKS FOR INSPECTION BEFORE BACKFILLING.


STEPS. VERIFY LOCATION TO AVOID CONFLICTS WITH INSIDE OR OUTSIDE DROPS

**PLAN**

MANHOLE FRAME & COVER, SET PER DTL 407

MANPAN MH LID INSERT AS REQ'D (SEE DTL 407)

SET FRAME IN NON-SHRINK GROUT

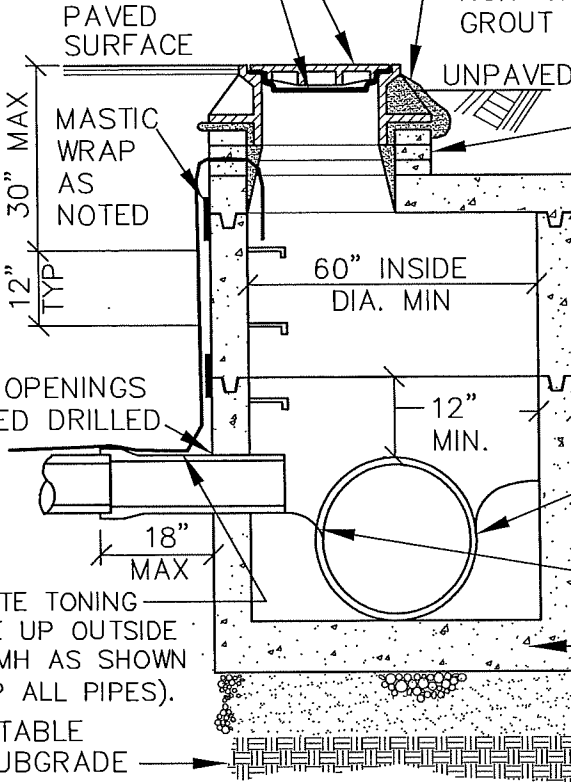

ALL INSIDE JOINTS & WALL PENETRATIONS TO BE GROUTED FOLLOWING MH ASSEMBLY (TYP).

**MANHOLE BARREL JOINT OPTIONS & SEALING**

GRADE RINGS (VARIABLE) 18" MAX.-TOP OF FLAT TOP TO RIM

FLAT TOP SECTION, 8" MIN THICKNESS

**FOR MANHOLES DEEPER THAN 11 FT. RIM TO INVERT, SEE DETAIL 403A**

WALL THICKNESS PER ASTM C-478

ALL PIPE PENETRATIONS ON SANITARY SEWER MANHOLES TO HAVE RUBBER BOOTS.

CHANNEL DEPTH = 2/3 PIPE DIA. MIN.

PRECAST BASE THICKNESS PER ASTM C-478


6" MIN COMPACTED GRANULAR BEDDING

**SECTION A-A**

**NOTES:**

1. PRECAST SECTIONS SHALL MEET OR EXCEED ASTM C-478. ALL CHANNELS & GROUTING TO BE SMOOTH.
2. WATERTIGHT O-RING OR MASTIC JOINTS REQUIRED, W/EXTERNAL SEAL AT BARREL JOINTS & PICKHOLES.
3. STEPS TO BE POLYPROPYLENE PLASTIC WITH GRADE 60 REINFORCING ROD. ADD STEPS TO EXTG CONNECTION MH IF EXTG STEPS ARE ABSENT.

LAST REVISION DATE: APR 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>MANHOLE FOR 24" AND 27" PIPE (SEWER &amp; STORM)</b> (NTS)	
DAYTON, OR	DETAIL NO. <b>403</b>


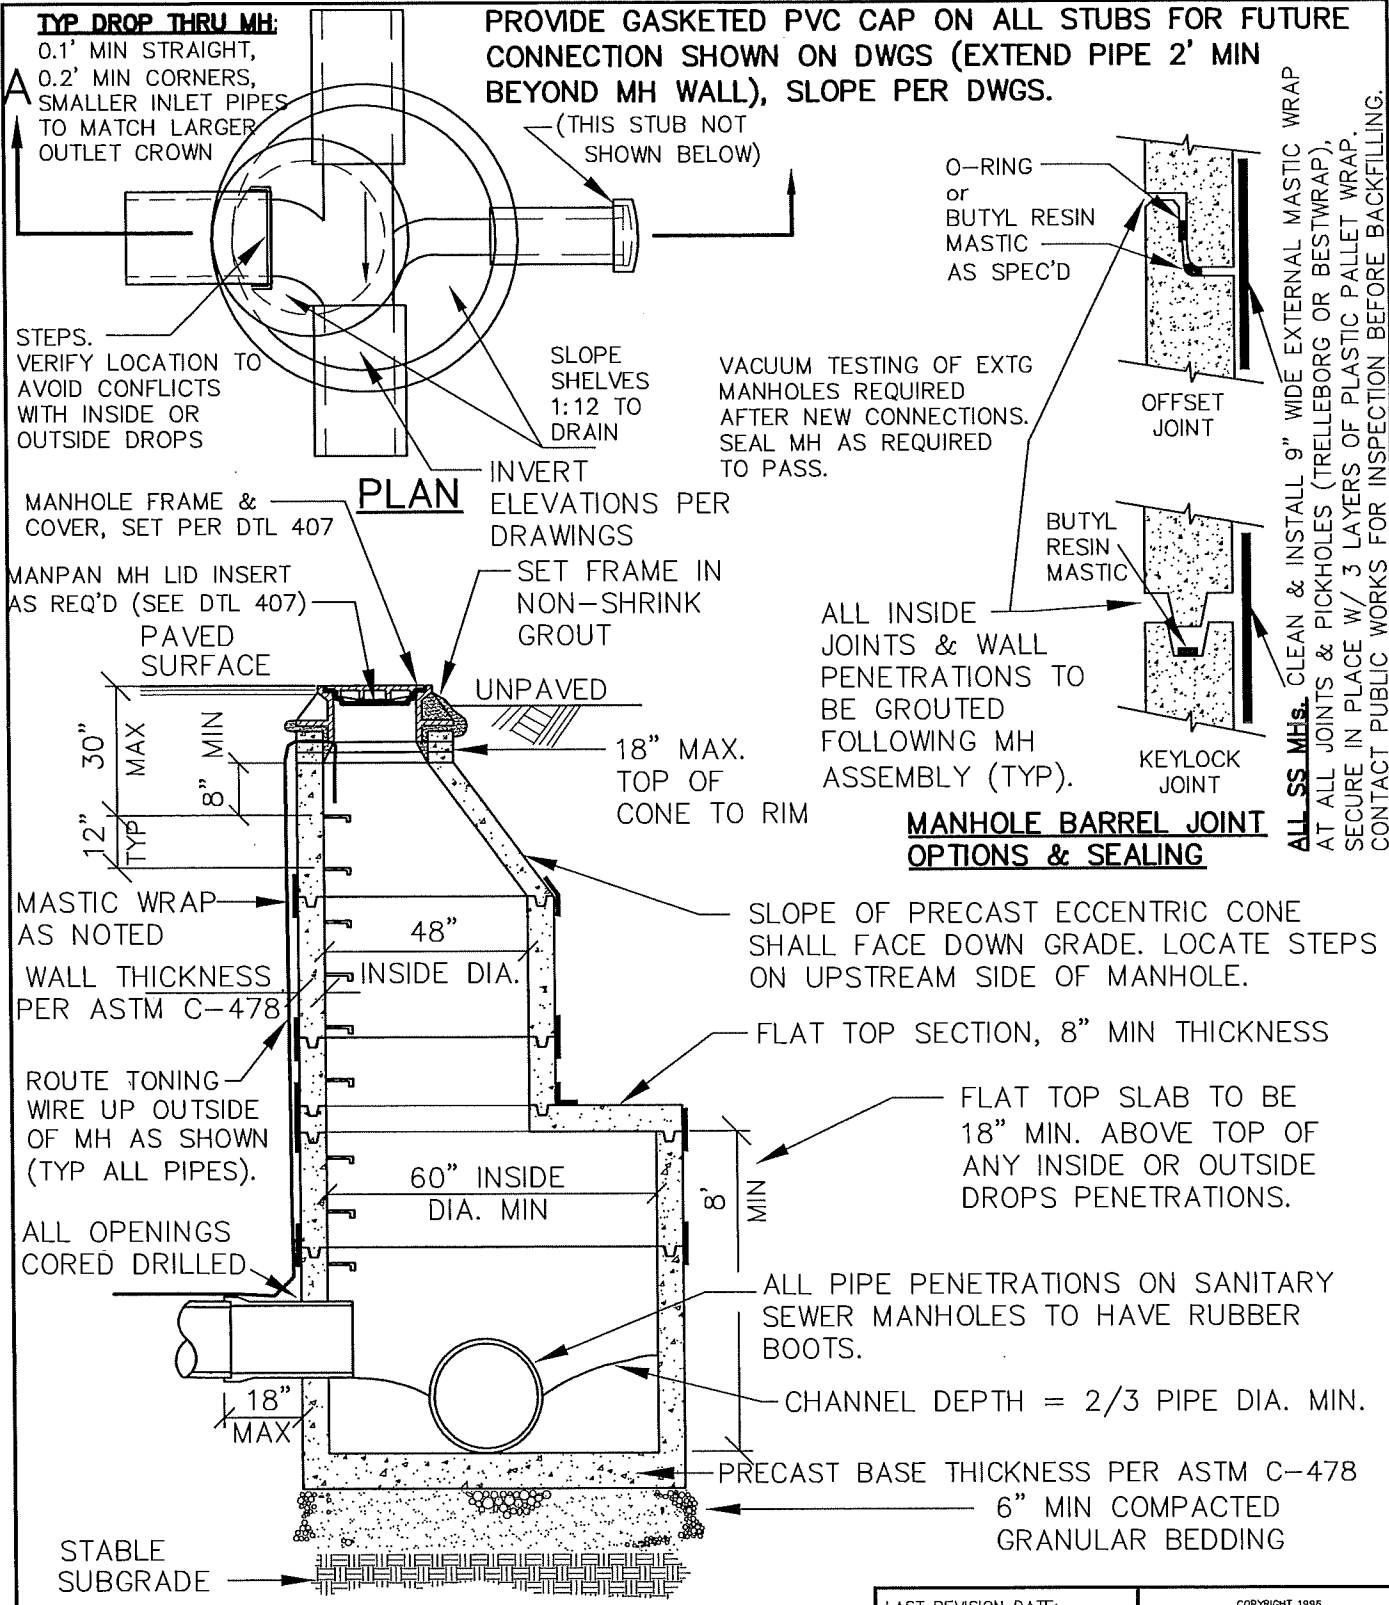


**SECTION A-A**

**NOTES:**

1. PRECAST SECTIONS SHALL MEET OR EXCEED ASTM C-478. ALL CHANNELS & GROUTING TO BE SMOOTH.
2. WATERTIGHT O-RING OR MASTIC JOINTS REQUIRED, W/EXTERNAL SEAL AT BARREL JOINTS & PICKHOLES.
3. STEPS TO BE POLYPROPYLENE PLASTIC WITH GRADE 60 REINFORCING ROD. ADD STEPS TO EXTG CONNECTION MH IF EXTG STEPS ARE ABSENT.

LAST REVISION DATE: APR 2024	COPYRIGHT 1986 WESTECH ENGINEERING, INC.
<b>DEEP MANHOLE FOR 24" AND 27" PIPE (SEWER &amp; STORM)</b> (NTS)	
DAYTON, OR	DETAIL NO. <b>403A</b>

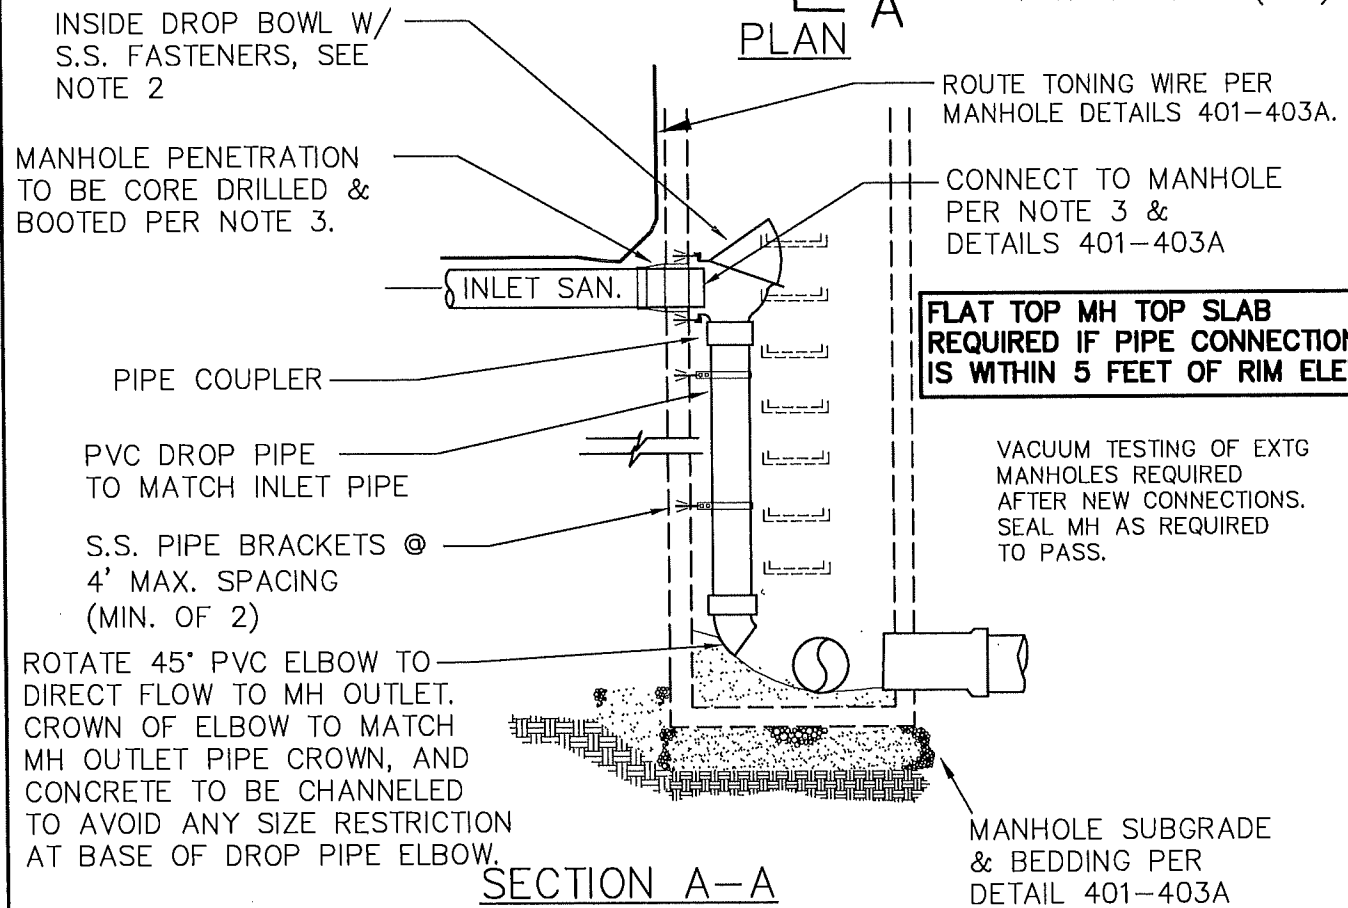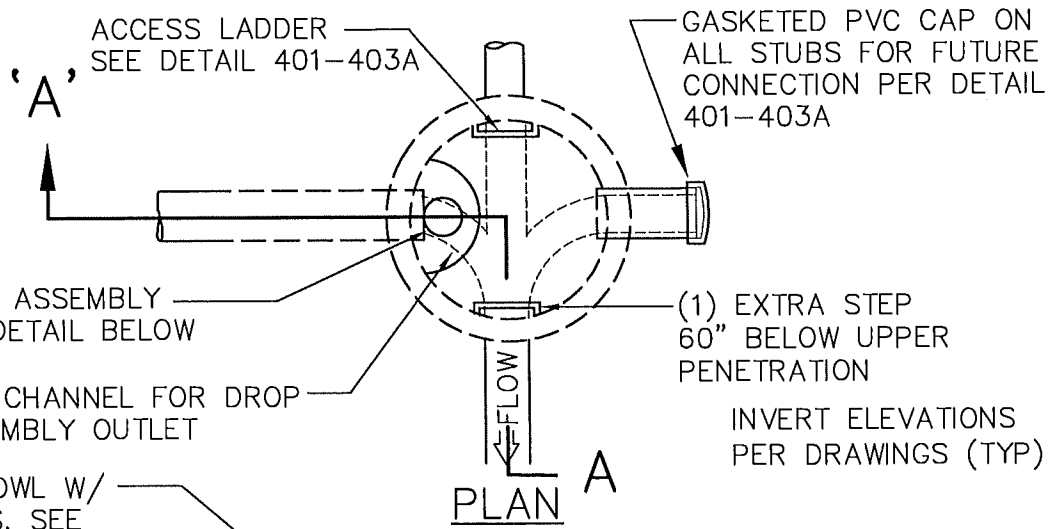


**SECTION A-A**

**NOTES:**


1. ALL INSIDE DROPS MUST BE APPROVED ON A CASE BY CASE BASIS BY THE PUBLIC WORKS DIRECTOR. MINIMUM 60" DIAMETER MANHOLE REQUIRED FOR INSIDE DROPS UNLESS OTHERWISE APPROVED IN WRITING BY THE PUBLIC WORKS DIRECTOR.
2. PROVIDE "RELINER" INSIDE DROP BOWL BY DURAN, INC. OR APPROVED EQUAL. WHERE NOTED ON DRAWINGS, FOR INLET PIPES WITH SLOPES GREATER THAN 5%, OR WHERE REQUIRED BY PUBLIC WORKS, PROVIDE BOWL WITH OPTIONAL HOOD AS SHOWN.
3. ALL PIPE PENETRATIONS SHALL HAVE RUBBER BOOTS. MANHOLE BASE, BARREL & TOP TO CONFORM WITH DETAILS 401-403A.

4. STEPS TO BE POLYPROPYLENE PLASTIC WITH GRADE 60 REINFORCING ROD. ADD STEPS TO EXTG CONNECTION MH IF EXTG STEPS ARE ABSENT.


LAST REVISION DATE: JULY 2021	
<b>INSIDE DROP CONNECTION FOR SANITARY SEWER OR STORM MANHOLE</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 404

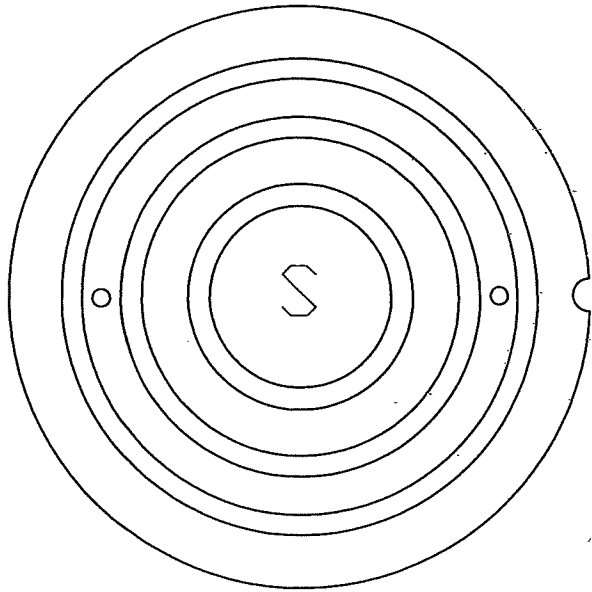

SANITARY

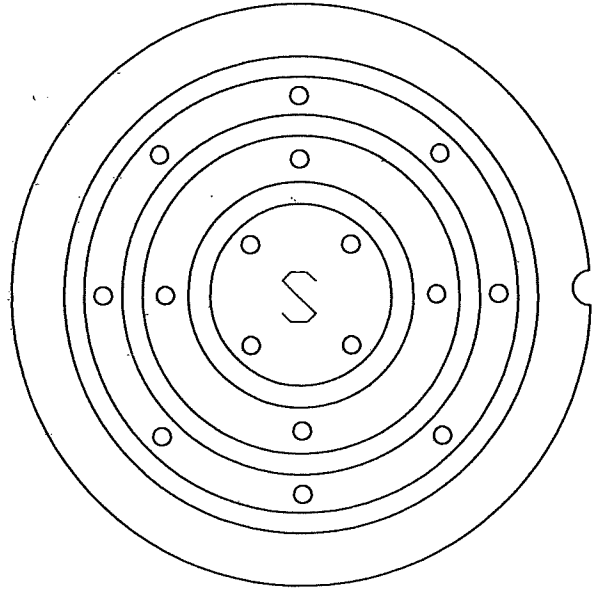


STORM

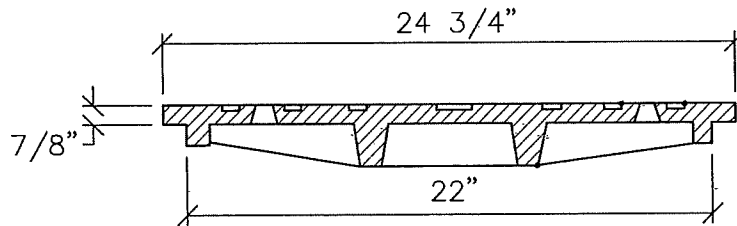

SUBURBAN FRAME  
STANDARD FRAME

8 EA. -1/2" RIBS  
EQUALLY SPACED

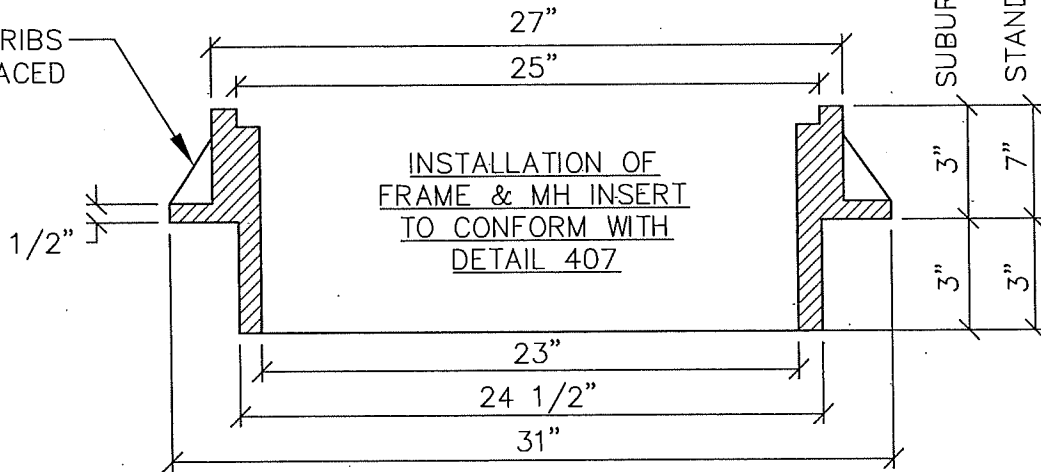

INSTALLATION OF  
FRAME & MH INSERT  
TO CONFORM WITH  
DETAIL 407

NOTES:

1. COVER AND FRAME SHALL BE GRAY CAST IRON  
ASTM A-48, CLASS 30.
2. COVER AND FRAME TO BE MACHINED TO A TRUE  
BEARING ALL AROUND.
3. NOTCH LID FOR LIFTING HOOK.
4. ADJUSTABLE MANHOLE FRAME BY RIM RISER OR  
APPROVED EQUAL MAY BE USED. SEE DTL 405A.

LAST REVISION DATE:

SEPT 2023

**MANHOLE FRAME AND COVER  
(STANDARD AND SUBURBAN)**



(NTS)

DETAIL NO.


DAYTON, OR

**405**



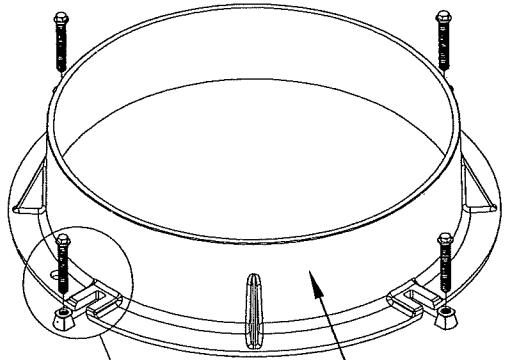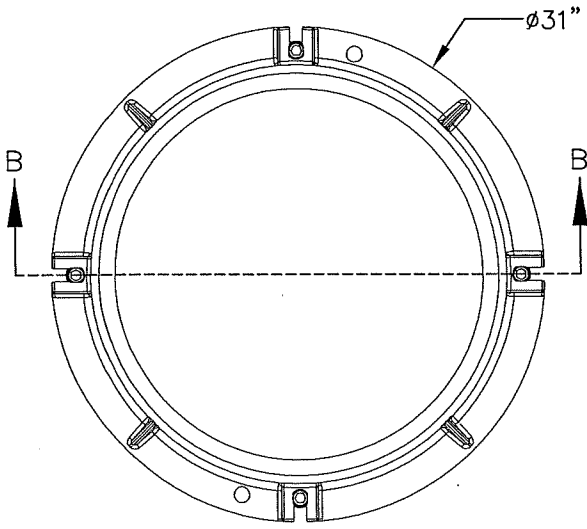


ADJUSTABLE FRAME  
(STANDARD OR SUBURBAN)

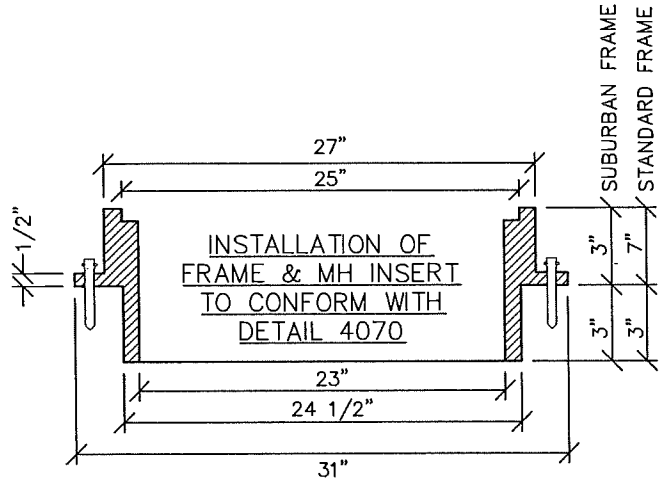

INSTALLATION OF  
FRAME & MH INSERT  
TO CONFORM WITH  
DETAIL 4070

SECTION B-B

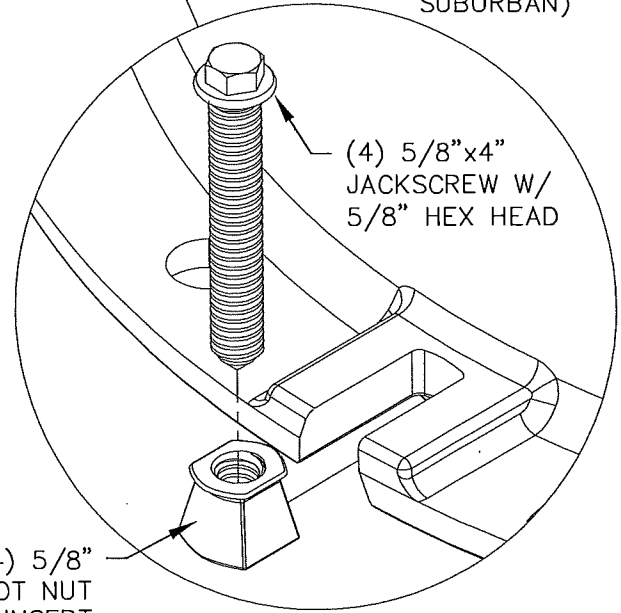

(4) 5/8"x4"  
JACKSCREW W/  
5/8" HEX HEAD

(4) 5/8"  
SLOT NUT  
INSERT


DETAIL A

**NOTES:**



1. ADJUSTABLE MANHOLE FRAMES MUST BE SHOWN ON THE DESIGN DRAWINGS OR AS-BUILT DRAWINGS.
2. NO SHIMS REQUIRED ADJUST SCREWS TO MEET FINISH GRADE.
3. CASTING ASSEMBLY: AASHTO M-306 CERTIFIED, H-20 OR "TRAFFIC-RATED".
4. CASTINGS: GRAY IRON CONFORMS TO ASTM A48 CL35B.
5. SCREWS: ZINC PLATED, MILD STEEL CONFORMS TO ASTM A1018.
6. NUTS: ZINC ALLOY CONFORMS TO ASTM C41A.
7. FILL AND PACK GAP BETWEEN FRAME AND SUPPORTING BASE WITH NON-SHRINK GROUT AND FINISH SMOOTH/FLUSH WITH INTERIOR AND EXTERIOR OF ADJOINING SURFACES PER DETAIL 4070.
8. MANUFACTURER TO BE RIMRISER OR APPROVED EQUAL.
9. USE ONLY PARTS PROVIDED BY THE MANUFACTURER.
10. SEE DETAIL 405 FOR MANHOLE LID (SEWER OR STORM).

LAST REVISION DATE:	
SEPT 2023	
<b>ADJUSTABLE MANHOLE FRAME (RIM-RISER)</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>405A</b>

SLOT FOR SCREWDRIVER


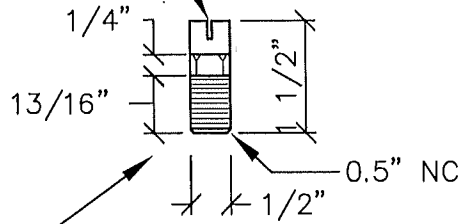


LOCATING STUD,  
DRILL 25/64" HOLE  
& TAP FOR 1/2" STUD  
(ONE PER COVER)

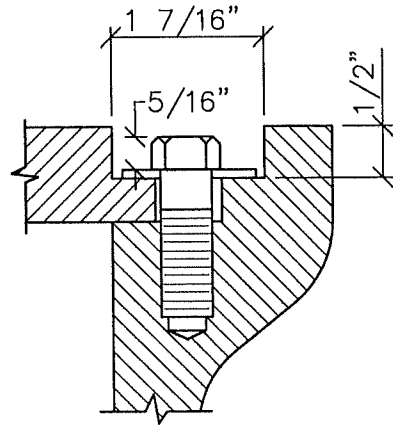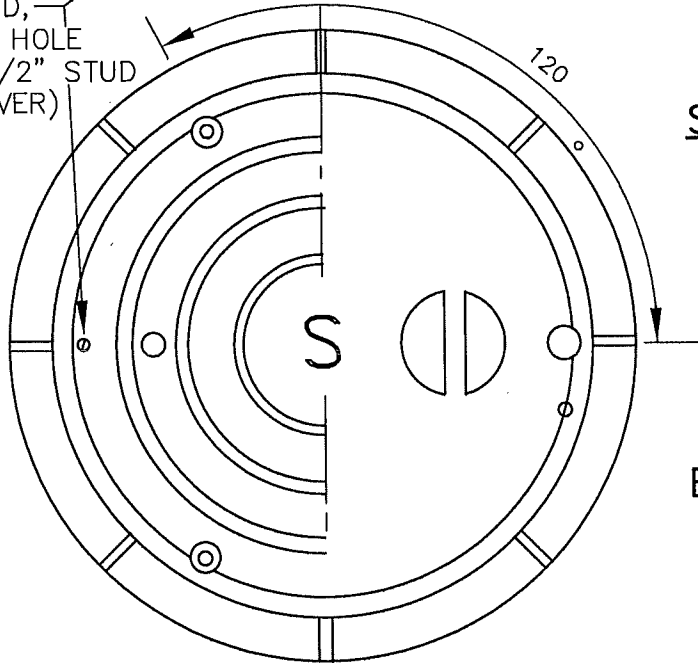

**SECTION B-B**

1/2"-13NCx1"  
STAINLESS STEEL  
HEX HEAD  
CAP SCREW

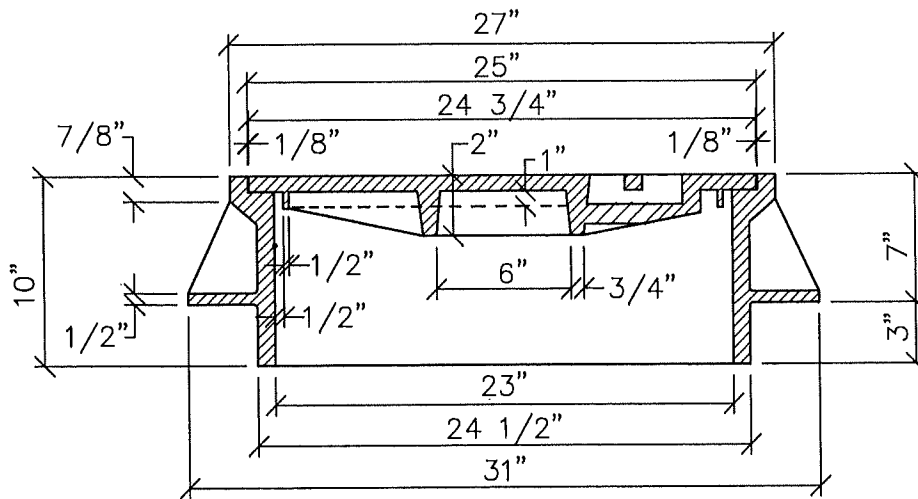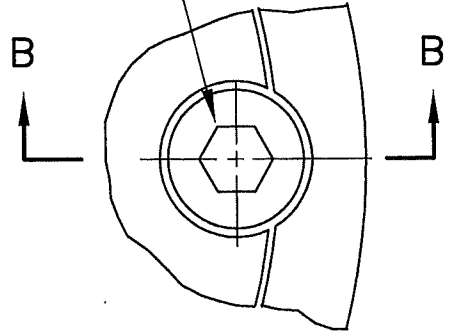


**SECTION A-A**

INSTALLATION OF  
FRAME & MH INSERT  
TO CONFORM WITH  
DETAIL 407



**NOTES:**

1. COVER AND FRAME TO BE MACHINED TO A TRUE BEARING ALL AROUND.
2. MATERIAL SHALL BE OF GRAY CAST IRON, ASTM A-48, CLASS 30.
3. **LOCKDOWN FRAME & COVER SHALL BE USED ONLY WHERE SPECIFICALLY REQUIRED BY PUBLIC WORKS.**

LAST REVISION DATE: DEC 2015	
<b>LOCKDOWN MANHOLE FRAME AND COVER</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 406

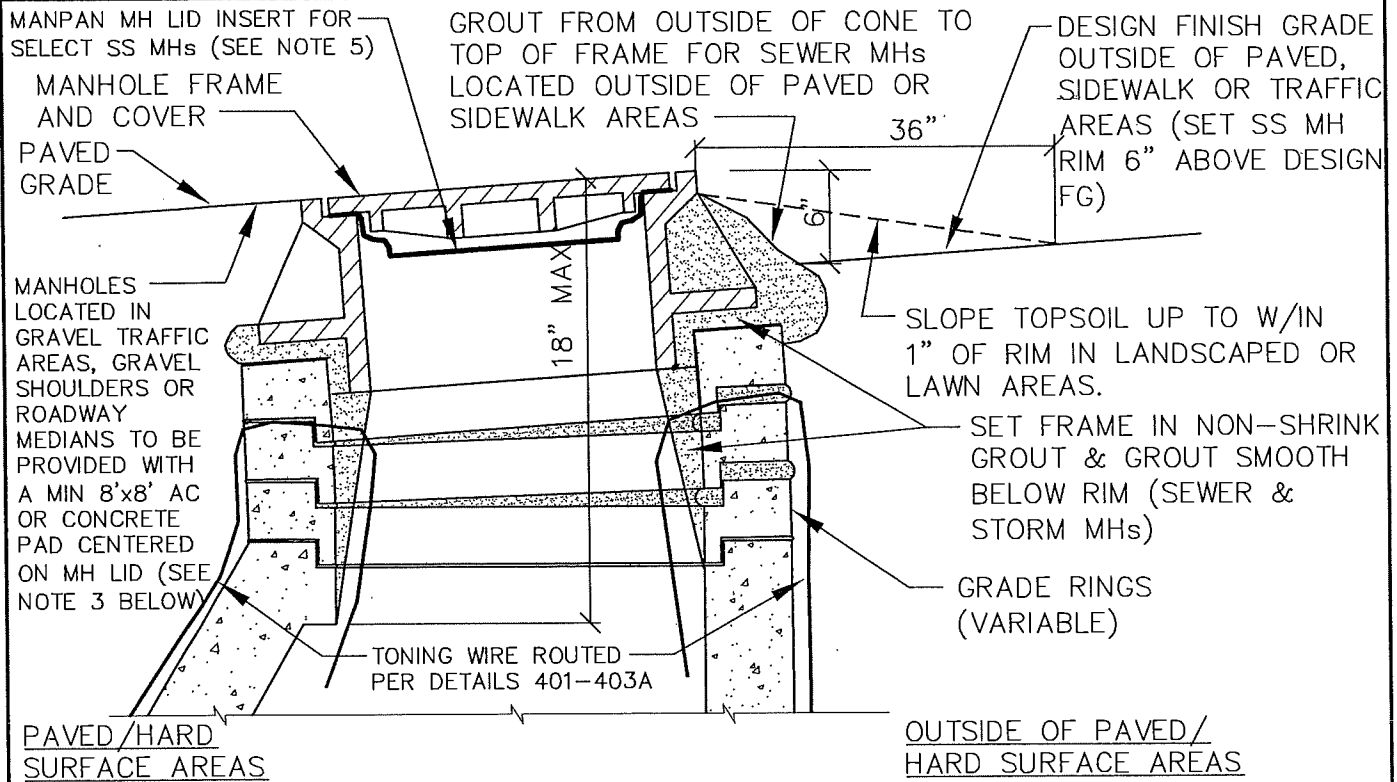

## TYPICAL MANHOLE GRADE ADJUSTMENT

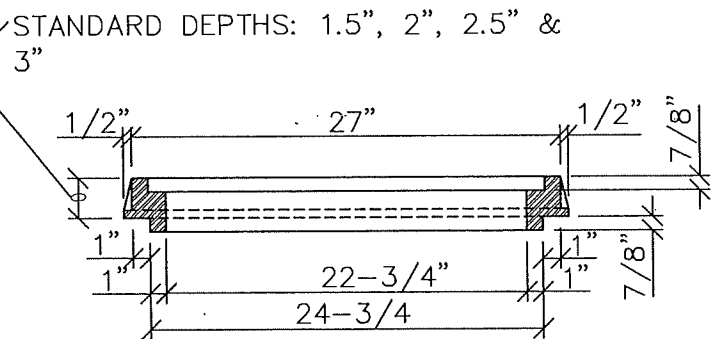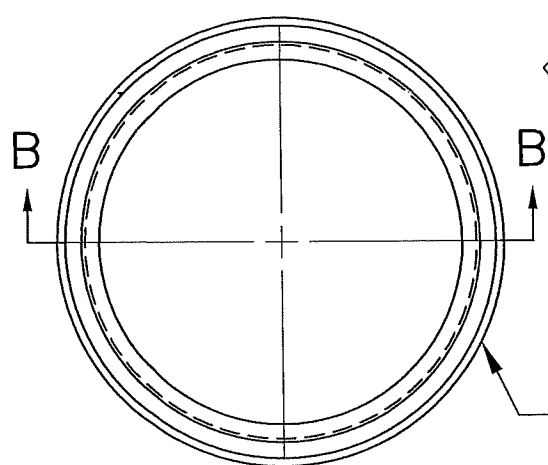

### SECTION B-B

CAST IRON ADJUSTMENT RINGS

## MANHOLE ADJUSTMENT RINGS FOR RESURFACING ONLY

NOTES:





1. CAST IRON ADJUSTMENT RINGS ALLOWED ONLY WITH OVERLAYS AND **NOT ON NEW MANHOLES**. MAXIMUM 1 ADJUSTMENT RING PER MANHOLE.
2. SANITARY SEWER MHs - 2 HOLE LIDS  
STORM DRAIN MHs - 16 HOLE LIDS
3. MH PADS IN UNPAVED TRAFFIC AREAS (OR FLOW CONTROL MH) - 8'x8' MIN SIZE OF (A) 3" MIN. AC OVER 10" COMPACTED BASEROCK (OR PUBLIC ROAD STANDARD THICKNESS IF LOCATED IN R.O.W), OR (B) 8" CONCRETE OVER 2" BACKROCK.
4. MH PADS IN ROAD MEDIAN PLANTER AREAS - 4" CONC (PER DTL 212, 10' MIN SQUARE W/5' SCORING PATTERN).

5. SEWER MHs IN LOW AREAS SUBJECT TO FLOODING OR WATER PONDING, ADJACENT TO CURBLINES OR DITCHES, ETC. SHALL BE PROVIDED WITH INFLOW PROTECTOR LID INSERTS (MAN PAN OR EQUAL). SEE CITY STANDARD CONSTRUCTION NOTES FOR LOCATION CRITERIA.

LAST REVISION DATE: AUG 2022	JO #
<b>MANHOLE RIM ADJUSTMENT DETAILS (SEWER &amp; STORM)</b> (NTS)	
DAYTON, OR	DETAIL NO. <b>407</b>

CLEANOUT COVERS: ALL SEWER CLEANOUT LIDS TO READ "SEWER"  
 ALL STORM CLEANOUT LIDS TO READ "STORM" OR "C/O".

24" SQUARE CONCRETE PAD  
 OR AC PAVEMENT OUTSIDE OF  
 PAVED AREAS. SLOPE AWAY  
 FROM CLEANOUT.

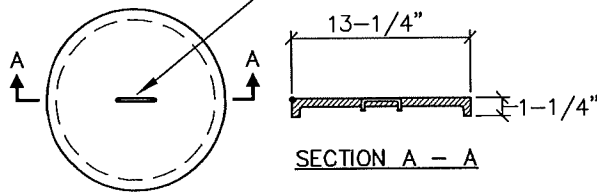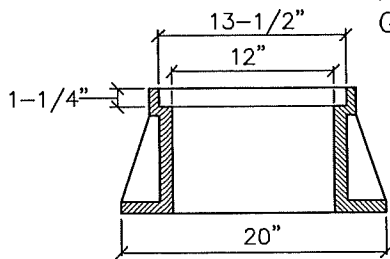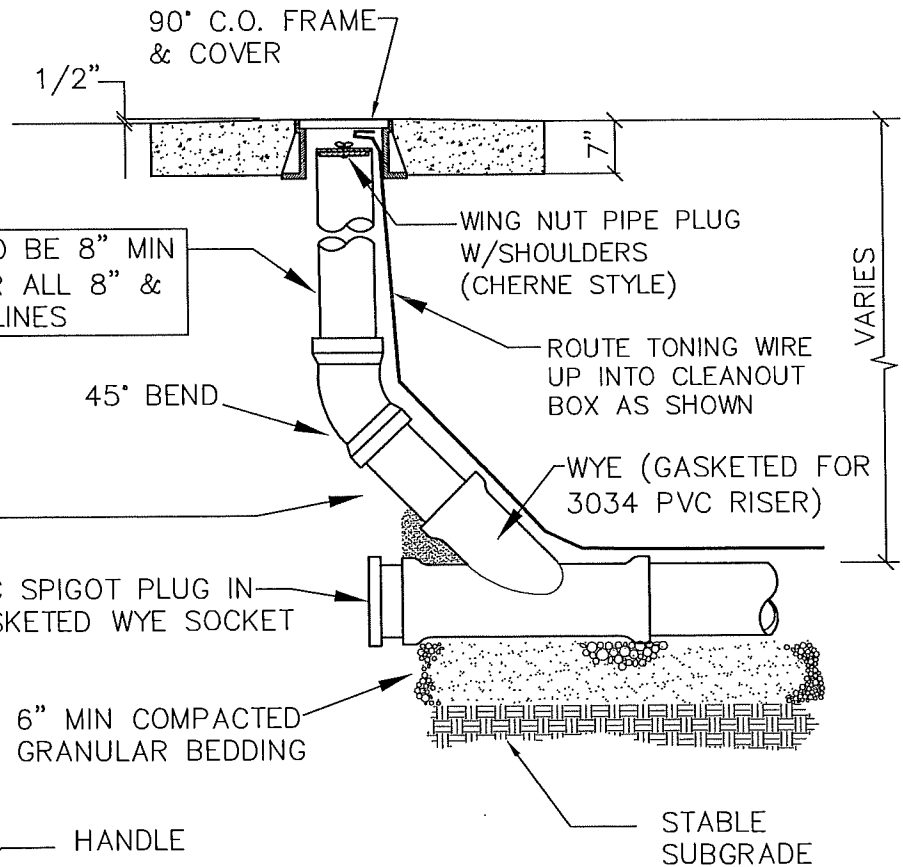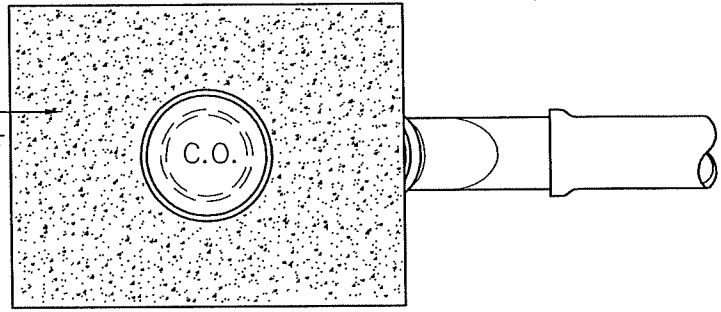

CLEANOUT FRAME & COVER

NOTES:

1. USE INLAND FOUNDRY MODEL 240 FRAME & COVER IN ALL AREAS.
2. COVER AND FRAME SHALL BE GRAY CAST IRON ASTM A-48, CLASS 30.
3. COVER AND FRAME TO BE MACHINED TO A TRUE BEARING ALL AROUND.

ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).

LAST REVISION DATE: MAY 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>MAINLINE CLEANOUT</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>411</b>

**NOTE: NO VERTICAL OR HORIZONTAL BENDS GREATER THAN 22-1/2° WITHIN RIGHT-OF-WAY OR PUBLIC UTILITY EASEMENT (IE. FROM MAINLINE TO CLEANOUT).**

NOTE: PER ORS 92.044(7), SERVICE LINES MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

STAMP 2" TALL "S" OR "D" IN TOP OF CURB & GUTTER PAN AT POINT OF CROSSING.

PRESSURE TREATED 2" X 4" WIRED TO INVERT AND EXTENDING ABOVE FINISH GRADE. STAKE SHALL BE CONTINUOUS AND REMAIN VERTICAL AFTER BACKFILLING. END SHALL BE PAINTED (WHITE FOR SEWER) (GREEN FOR STORM), AND LABELED WITH DEPTH TO PIPE BELOW GROUND SURFACE (2" BLOCK LETTERS). EXTEND TONING WIRE TO SURFACE.

EASEMENT LINE OR P/L

PUE WHERE PROVIDED

PROPERTY LINE CLEANOUT SEE DETAIL 416

CONNECT PIPE FROM BUILDING/SITE TO BASE LEG OF CLEANOUT WYE (CONNECTION TO CLEANOUT RISER IS PROHIBITED).

24" MIN


SEWER: 48" MIN. COVER W/NO WATERLINE

SEWER: 5.75' TYP. COVER WHERE SEWER LATERALS CROSS WATERLINE (SEE NOTE 2)

**NOTES:**

1. MIN. 18" SEPARATION BETWEEN ADJACENT LATERALS.
2. ONE FULL LENGTH OF PVC PIPE (AT CROSSING) REQUIRED FOR ALL SEWER LATERALS WHICH CROSS UNDER WATER LINES WITH LESS THAN 18" MINIMUM VERTICAL CLEARANCE BETWEEN WATER LINE AND SERVICE LATERAL.
3. SERVICE SHALL NOT BE BACKFILLED PRIOR TO INSPECTION BY PUBLIC WORKS.
4. INSTALL A CONTINUOUS 12 GAUGE SOLID CORE GREEN INSULATED TRACER WIRE FROM MAINLINE WIRE TO END OF LATERAL.
5. CHIMNEY DROPS INTO MAINLINES ARE PROHIBITED.
6. **COMMERCIAL** SEWER & STORM SERVICE LATERALS SHALL BE 6-INCH MINIMUM DIAMETER.

**TYPICAL, SHALLOW MAINS**

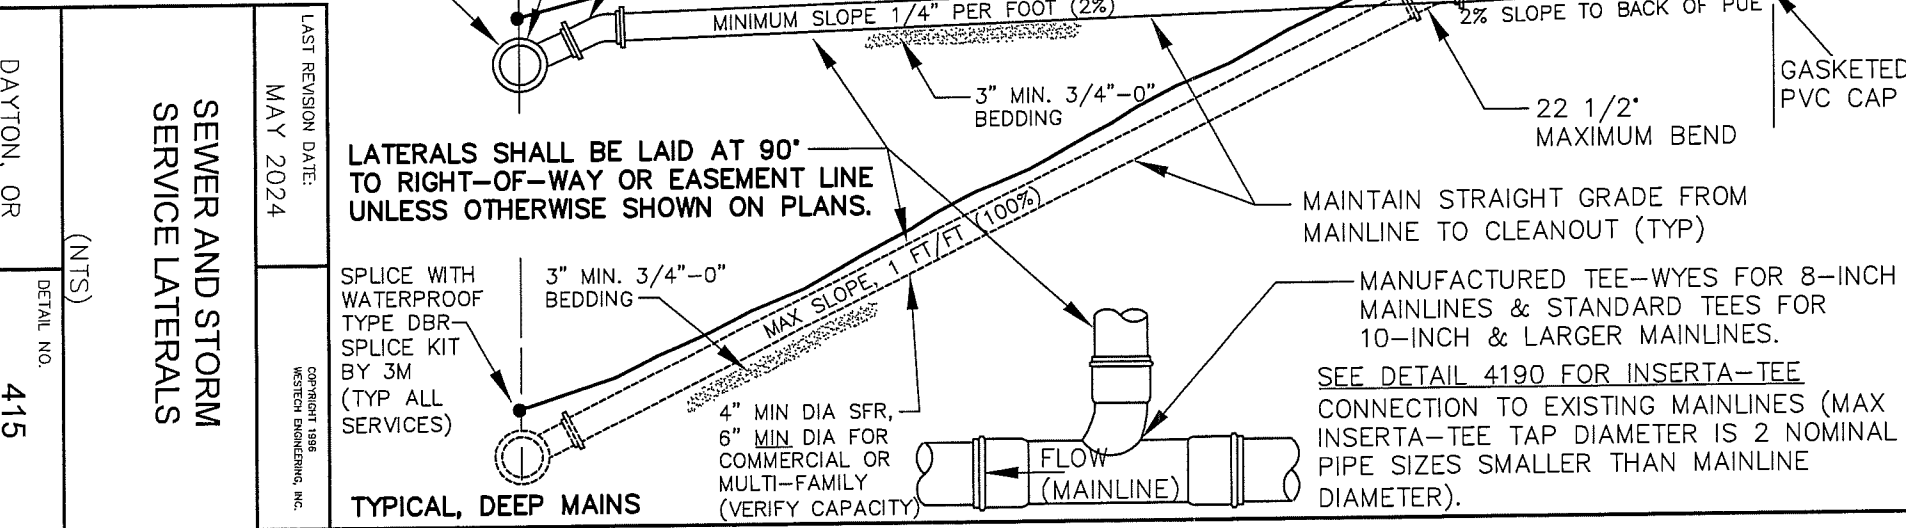


DAYTON, OR	(NTS)	LAST REVISION DATE:
		MAY 2024
DETAIL NO.	415	COPYRIGHT 1998
		WESTTECH ENGINEERING, INC.

**SEWER AND STORM SERVICE LATERALS**

**TYPICAL, DEEP MAINS**

CLEANOUT COVERS: ALL SEWER CLEANOUT LIDS TO READ "SEWER"  
 ALL STORM CLEANOUT LIDS TO READ "STORM" OR "C/O".

- NON-TRAFFIC AREAS:  
 CARSON MODEL 910 T-COVER OR EQUAL (GREEN FOR SEWER, GREY FOR STORM).
- TRAFFIC AREAS, INCLUDING DRIVEWAYS:  
 8" X 4" CAST IRON FRAME & COVER, OLYMPIC M1007 OR EQUAL.  
 8" X 6" CAST IRON FRAME & COVER, OLYMPIC M1018 OR EQUAL.  
 (FOR CI CLEANOUTS IN UNPAVED AREAS, SET IN 6" THICK CONCRETE PAD)

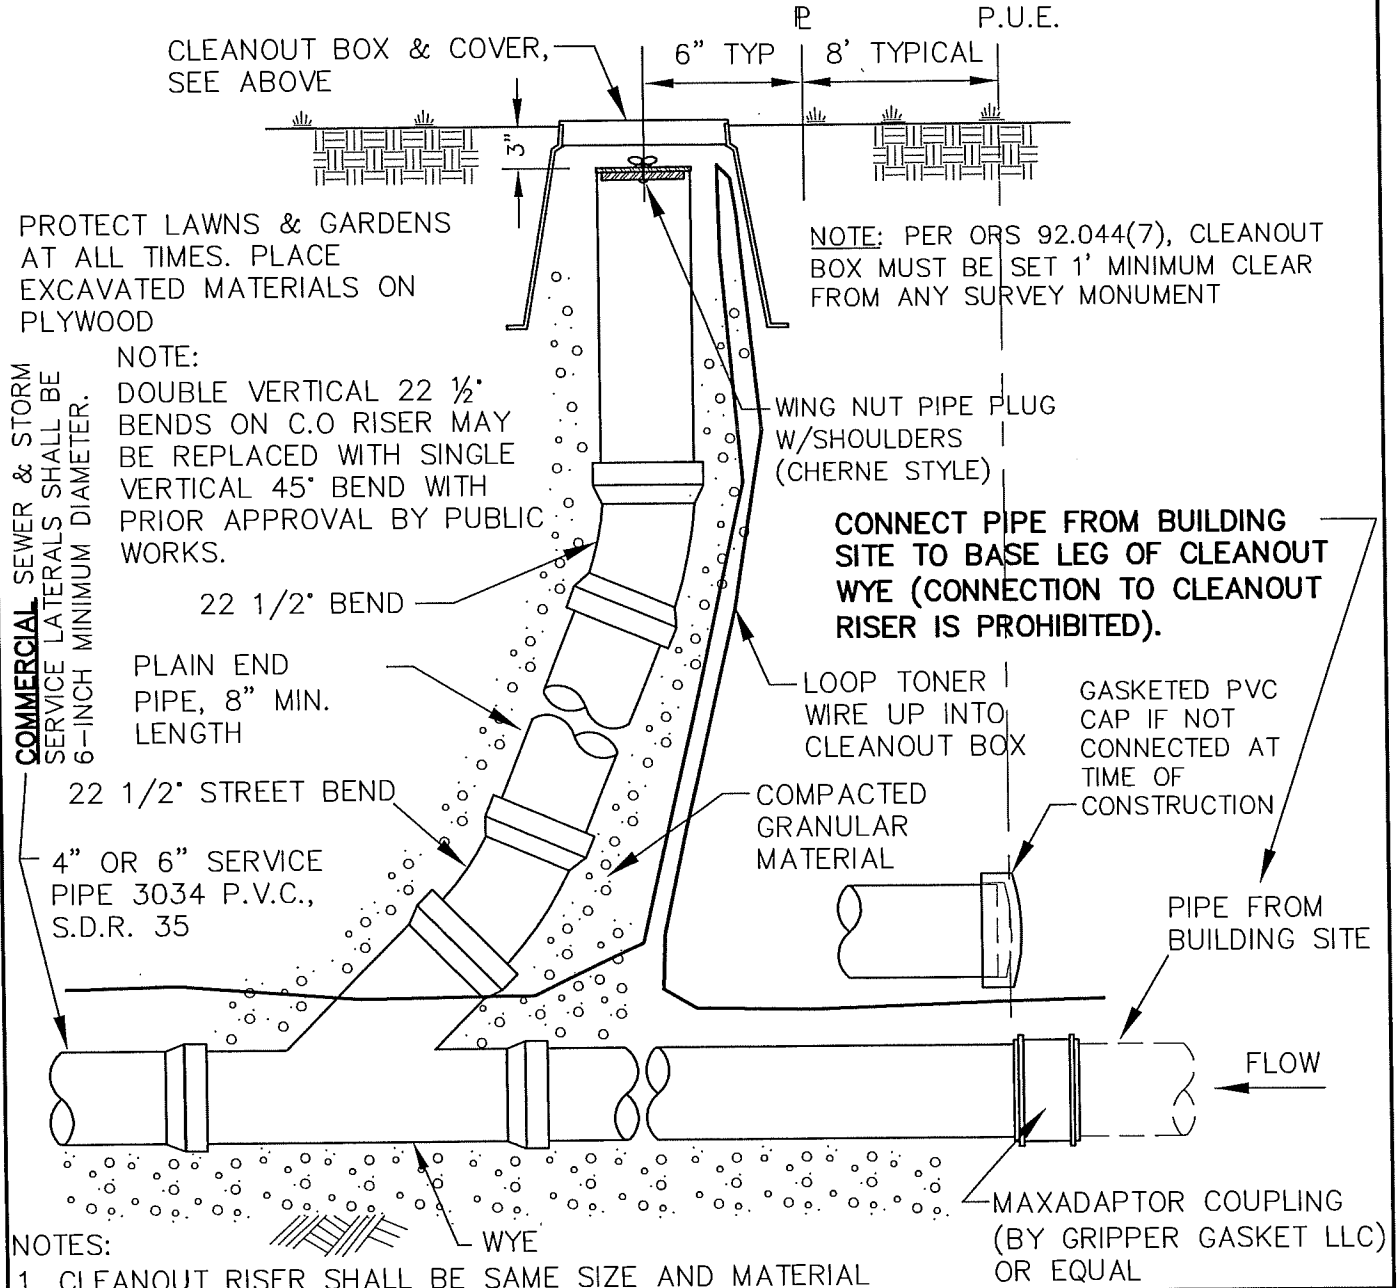

PROTECT LAWNS & GARDENS AT ALL TIMES. PLACE EXCAVATED MATERIALS ON PLYWOOD

NOTE: PER ORS 92.044(7), CLEANOUT BOX MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT



NOTE:  
 DOUBLE VERTICAL 22 1/2° BENDS ON C.O RISER MAY BE REPLACED WITH SINGLE VERTICAL 45° BEND WITH PRIOR APPROVAL BY PUBLIC WORKS.

COMMERCIAL SEWER & STORM SERVICE LATERALS SHALL BE 6-INCH MINIMUM DIAMETER.

CONNECT PIPE FROM BUILDING SITE TO BASE LEG OF CLEANOUT WYE (CONNECTION TO CLEANOUT RISER IS PROHIBITED).

- NOTES:
- CLEANOUT RISER SHALL BE SAME SIZE AND MATERIAL AS LATERAL PIPE.
  - PROVIDE CONCRETE PAD FOR CLEANOUTS LOCATED IN UNPAVED DRIVEWAYS OR TRAFFIC AREAS (6" THICK PAD TO BE 6" LARGER THAN CLEANOUT BOX FRAME).
  - CLEANOUT PIPE SHALL BE LEFT A MINIMUM OF 18" ABOVE EXISTING GRADE UNTIL ALL CURBING IS INSTALLED AND ALL PRIVATE UTILITY TRENCHES ARE BACKFILLED. CLEANOUTS SHALL THEN BE SET NO MORE THAN 6" BELOW FINISH GRADE, AND CLEANOUT BOXES SET FLUSH WITH FINISH GRADE.

LAST REVISION DATE: FEB 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>STANDARD SERVICE LATERAL CLEANOUT (SEWER &amp; STORM)</b> (NTS)	
DAYTON, OR	DETAIL NO. 416

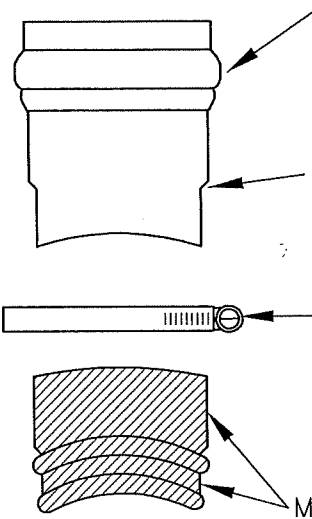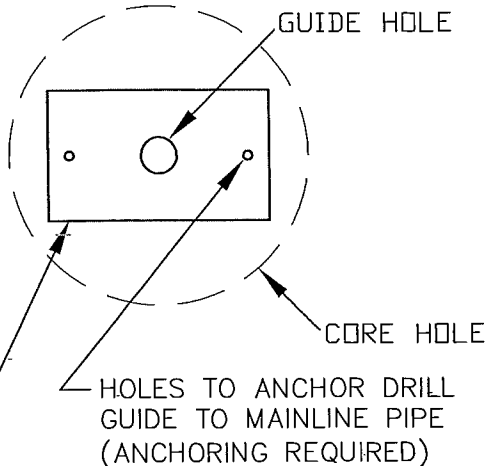

PVC HUB (ASTM D-3034 SDR 35). DRIVE INTO CENTER OF RUBBER BOOT AFTER BOOT IS PLACED IN CORE HOLE.

MOLDED PVC SHOULDER TO ACT AS POSITIVE INSERTION STOP (4" & 6" TAPS).


#316 STAINLESS STEEL BAND CLAMP (9/16" SERIES 300) TO SECURE UPPER HALF OF RUBBER SLEEVE TO THE PVC HUB.

MOLDED RUBBER SLEEVE (ASTM C-443) INCLUDES MOLDED RIBS TO HOLD THE SLEEVE IN PLACE IN MAINLINE PIPE TAP, STYLE TO MATCH MAINLINE PIPE MATERIAL & DIAMETER.

INSERTA-DRILL GUIDE (PROVIDED BY FITTING MANUFACTURER), SIZED TO FIT ENTIRELY WITHIN CORE HOLE DIAMETER (REQUIRED FOR ALL TAPS)

PVC HUB TO BE SHAPED TO MATCH PIPE I.D. AND SHALL NOT PROTRUDE BEYOND INSIDE DIAMETER OF RUBBER BOOT.

25-30° TYP. FOR SHALLOWER LATERALS (SEE DETAIL 4150)

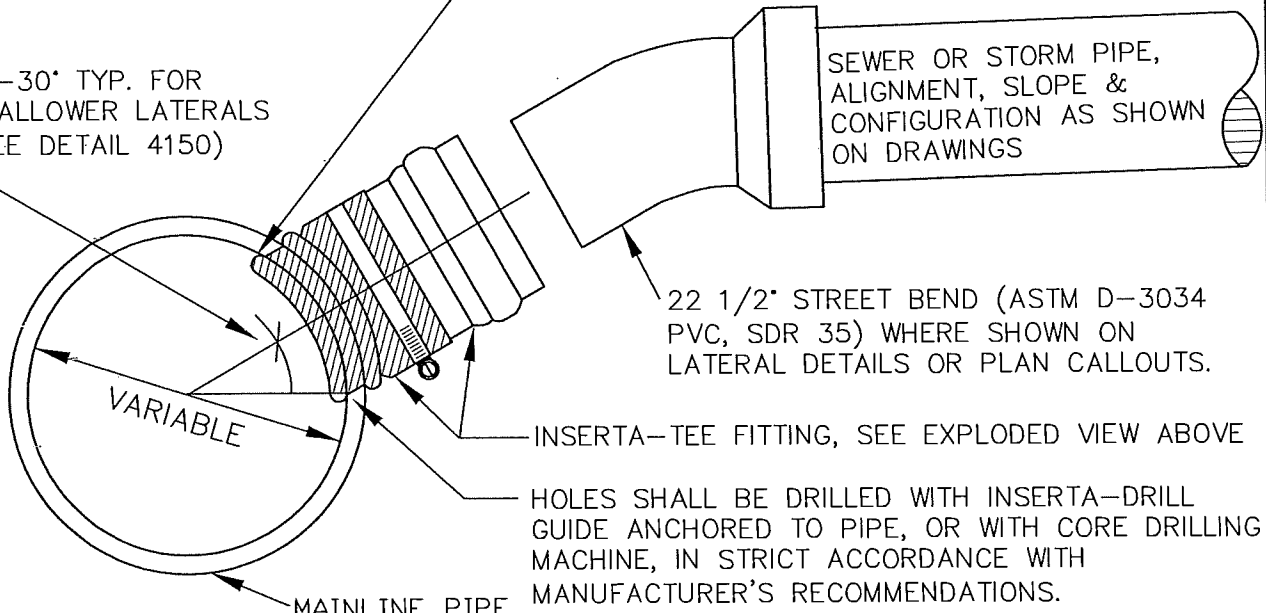

SEWER OR STORM PIPE, ALIGNMENT, SLOPE & CONFIGURATION AS SHOWN ON DRAWINGS

22 1/2" STREET BEND (ASTM D-3034 PVC, SDR 35) WHERE SHOWN ON LATERAL DETAILS OR PLAN CALLOUTS.

INSERTA-TEE FITTING, SEE EXPLODED VIEW ABOVE

HOLES SHALL BE DRILLED WITH INSERTA-DRILL GUIDE ANCHORED TO PIPE, OR WITH CORE DRILLING MACHINE, IN STRICT ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

NOTES:

1. MAXIMUM LATERAL SIZE - MAX TAP SIZE SHALL BE 2 NOMINAL PIPE SIZES SMALLER THAN THE MAINLINE PIPE (IE. 4" ON 8", 6" ON 10", ETC.).
2. EXISTING SANITARY SEWERS - INSERTA-TEES ALLOWED ON EXISTING PVC OR DUCTILE IRON SEWER MAINS. USE ON OTHER PIPE TYPES IS SUBJECT TO CITY APPROVAL AND ACCEPTABLE PIPE CONDITION.
3. EXISTING STORM DRAINS - INSERTA-TEES ALLOWED ON ALL PIPE TYPES, SUBJECT TO CITY APPROVAL AND ACCEPTABLE PIPE CONDITION.
4. NEW MAINLINES - MANUFACTURED FITTINGS (PER DETAIL 415) SHALL BE USED FOR CONNECTION ON ALL NEW SEWER AND STORM MAINLINES.
5. THE TAP SHALL NOT BE MADE EXCEPT IN THE PRESENCE OF A CITY INSPECTOR; NOR SHALL ANY CONNECTION BE MADE WITHOUT PRIOR CITY APPROVAL.
6. CENTERLINE OF TAP SHALL BE ABOVE SPRINGLINE.

**INSERTA-TEE "FATBOY" FITTING SHALL BE USED FOR ALL 4" & 6" TAPS ON EXTG PIPE (TV & 95% MANDREL TESTING OF EXISTING MAINLINES AFTER TAP MAY BE REQUIRED AT DISCRETION OF PUBLIC WORKS DIRECTOR).**

LAST REVISION DATE: JAN 2024	JO # STANDARD
<b>INSERTA-TEE CONNECTION TO EXISTING SEWER OR STORM DRAIN</b> (NTS)	
DAYTON, OR	DETAIL NO. 419

# MANHOLE VACUUM TEST REPORT

Project Location: (City)	Project Name:
Inspector: (Print)	Date: (Separate Report Required for Each Test Session)
Testing Company: (Name & Phone #)	

Manhole No.	Manhole Diameter (inch)	Manhole Depth (ft)	Surface Restoration Complete?	Time Required <sup>3</sup> (sec)	Time to Drop from 10" Hg to 9" Hg (sec)	Results	Comments
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	

1. All adjacent surface restoration shall be completed prior to conducting manhole acceptance tests, including finish paving and final adjustments to grade. Any test conducted prior to completion of surface restoration shall be considered informal, and will not count for acceptance.
2. The vacuum test head seal shall be inflated in accordance with the manufacturer's recommendations, but in all cases the grade rings and casting shall be included in the test. A vacuum of 10-inches of mercury shall be drawn and the vacuum pump shut off. With the valves closed, the time shall be measured for the vacuum to drop to 9-inches.
3. The manhole shall pass if the time for the vacuum reading to drop to 9-inches meets or exceeds the values indicated on the following table. Times for deeper depths as required by the City Engineer. Note: Visible groundwater infiltration or leakage constitutes a failed test.

REQUIRED MANHOLE VACUUM TEST TIMES			
Manhole Depth (feet)	Required Time (sec)		
	48-inch diameter	60-inch diameter	72-inch diameter
8	20	26	33
10	25	33	41
12	30	39	49
14	35	46	57
18	40	52	65
20	45	59	73
22	50	65	81



# SANITARY SEWER AIR TEST REPORT

Project Location:	Project Name:
Inspector: (Print)	Date: (Separate Report Required for Each Test Session)
TV Inspection Required? Yes / No	Mandrel Testing Completed? Date Completed or Scheduled:
Verify that all sewer laterals and associated cleanouts installed and cleanout risers are visible at or above finish grade? Yes / No	Verify that all franchise utilities which cross sewer laterals have been installed and trenches backfilled? Yes / No

Station (& Manhole #)		Main/ Lateral	Size & Material	Total Length (ft)	C <sup>1</sup>	K <sup>1</sup>	Test Time (Seconds) for Pressure Drop Shown (psi)			Comments
							Required <sup>2</sup>	4.0 - 3.5	3.5 - 2.5	
From	To									
		Main								Pass / Fail
		Laterals								
		Totals								
		Main								Pass / Fail
		Laterals								
		Totals								
		Main								Pass / Fail
		Laterals								
		Totals								
		Main								Pass / Fail
		Laterals								
		Totals								

<sup>1</sup> For C and K values, see table and formulas on reverse side.  
<sup>2</sup> For total C ≤ 1.0, test time (seconds) required = 2 times K  
For total C > 1.0, test time (seconds) required = 2 times (K/C)

**TEST PROCEDURE**

1. Add air slowly to the portion of the pipe installation under test until the internal air pressure is raised to 4.0 psig (or higher pressure as required to address groundwater). Increase the test pressure by 0.433 psi for each foot of average ground water depth over the exterior crown of the pipe under test, with the maximum test pressure not to exceed 9.0 psi.
2. Add air slowly until the internal air pressure is raised to 4.0 psig (or higher pressure as required due to groundwater).
3. After required test pressure is reached, allow 2-minutes minimum for air temperature to stabilize, adding only the amount of air required to maintain pressure.
4. After the temperature stabilization period, disconnect the air supply.
5. Record the time required for the internal air pressure to drop from 3.5 psi (or higher as required due to groundwater backpressure) to 2.5 psi (or higher as required due to groundwater backpressure). If this time exceeds the required time (or if there is less than 1.0 psi pressure drop), the test is successful.

**ACCEPTANCE:** The tested sewer section shall be considered acceptable if the pressure drop during the test time is less than 1.0 psi from the starting pressure.

### SEWER AIR TEST C AND K VALUES

Pipe Size (inch)	C-Value <sup>1</sup> per foot length	K-Value <sup>2</sup> per foot length
4	0.00155	0.176
6	0.00233	0.396
8	0.00311	0.704
10	0.00388	1.100
12	0.00466	1.584
15	0.00582	2.475
18	0.00699	3.564
21	0.00815	4.851

<sup>1</sup> C = 0.0003882dL      Where d = diameter (inches)  
<sup>2</sup> K = 0.011d<sup>2</sup>L      L = Length (ft)

Example:

Air Test a system consisting of two mainline segments as follows:

Segment 1: 395 feet of 8-inch mainline, 100 feet of 4-inch laterals, and 35 feet of 6 inch laterals.

Segment 2: 200 feet of 8-inch mainline, 30 feet of 4-inch laterals, and 20 feet of 6 inch laterals.

Station (& Manhole #)		Main/ Lateral	Size & Material	Total Length (ft)	C <sup>1</sup>	K <sup>1</sup>	Test Time (Seconds) for Pressure Drop Shown (psi)			Comments	
							Required <sup>2</sup>	4.0 - 3.5	3.5 - 2.5		
From	To										
0+00 MH A1	3+95 MH A2	Main	8" PVC	395	1.227	278.1	310/1.46= 212			Pass / Fail	
		Laterals	4" PVC 6" PVC	100 35	0.155 0.082	17.6 13.86					212*2= 414 sec
		Totals			1.464	309.54					
3+95 MH A2	5+95 MH A3	Main	8" PVC	200	0.621	140.8	2*154= 308 sec			Pass / Fail	
		Laterals	4" PVC 6" PVC	20 30	0.047 0.047	5.28 7.92					
		Totals			0.714	154.0					

Note: For total C  $\leq$  1.0, test time (seconds) required = 2 times K  
 For total C > 1.0, test time (seconds) required = 2 times (K/C)

The tested sewer section shall be considered acceptable when tested as described herein if the section under test does not loose air at a rate greater than 0.0015 cfm per square foot of internal sewer surface.



# SANITARY SEWER MANDREL TEST REPORT

Project Location: (City)	Project Name:
Inspector: (Print)	Date: (Separate Report Required for Each Test Session)
Mandrel Diameters Verified? Yes / No	


Station (& Manhole #)		Size & Material	Length (ft)	Results	Backfill Compaction Completed?	Date Sewer Flushed & Cleaned	Comments
From	To						
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		

1. Mandrel testing shall be conducted on a manhole to manhole (or cleanout) basis and shall be done after the line has been completely flushed out with water.
2. Mandrel testing shall be conducted after trench backfill and compaction has been completed.
3. The mandrel diameter shall be 95% of the pipe initial inside diameter. The inspector shall verify the diameter of each mandrel used during each test session.



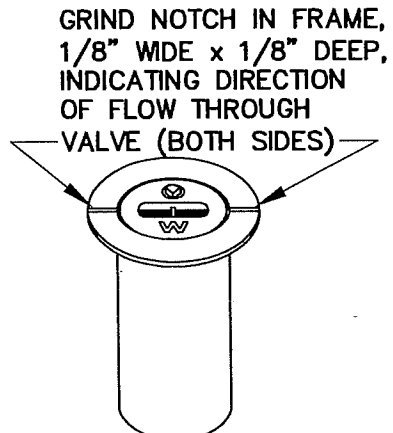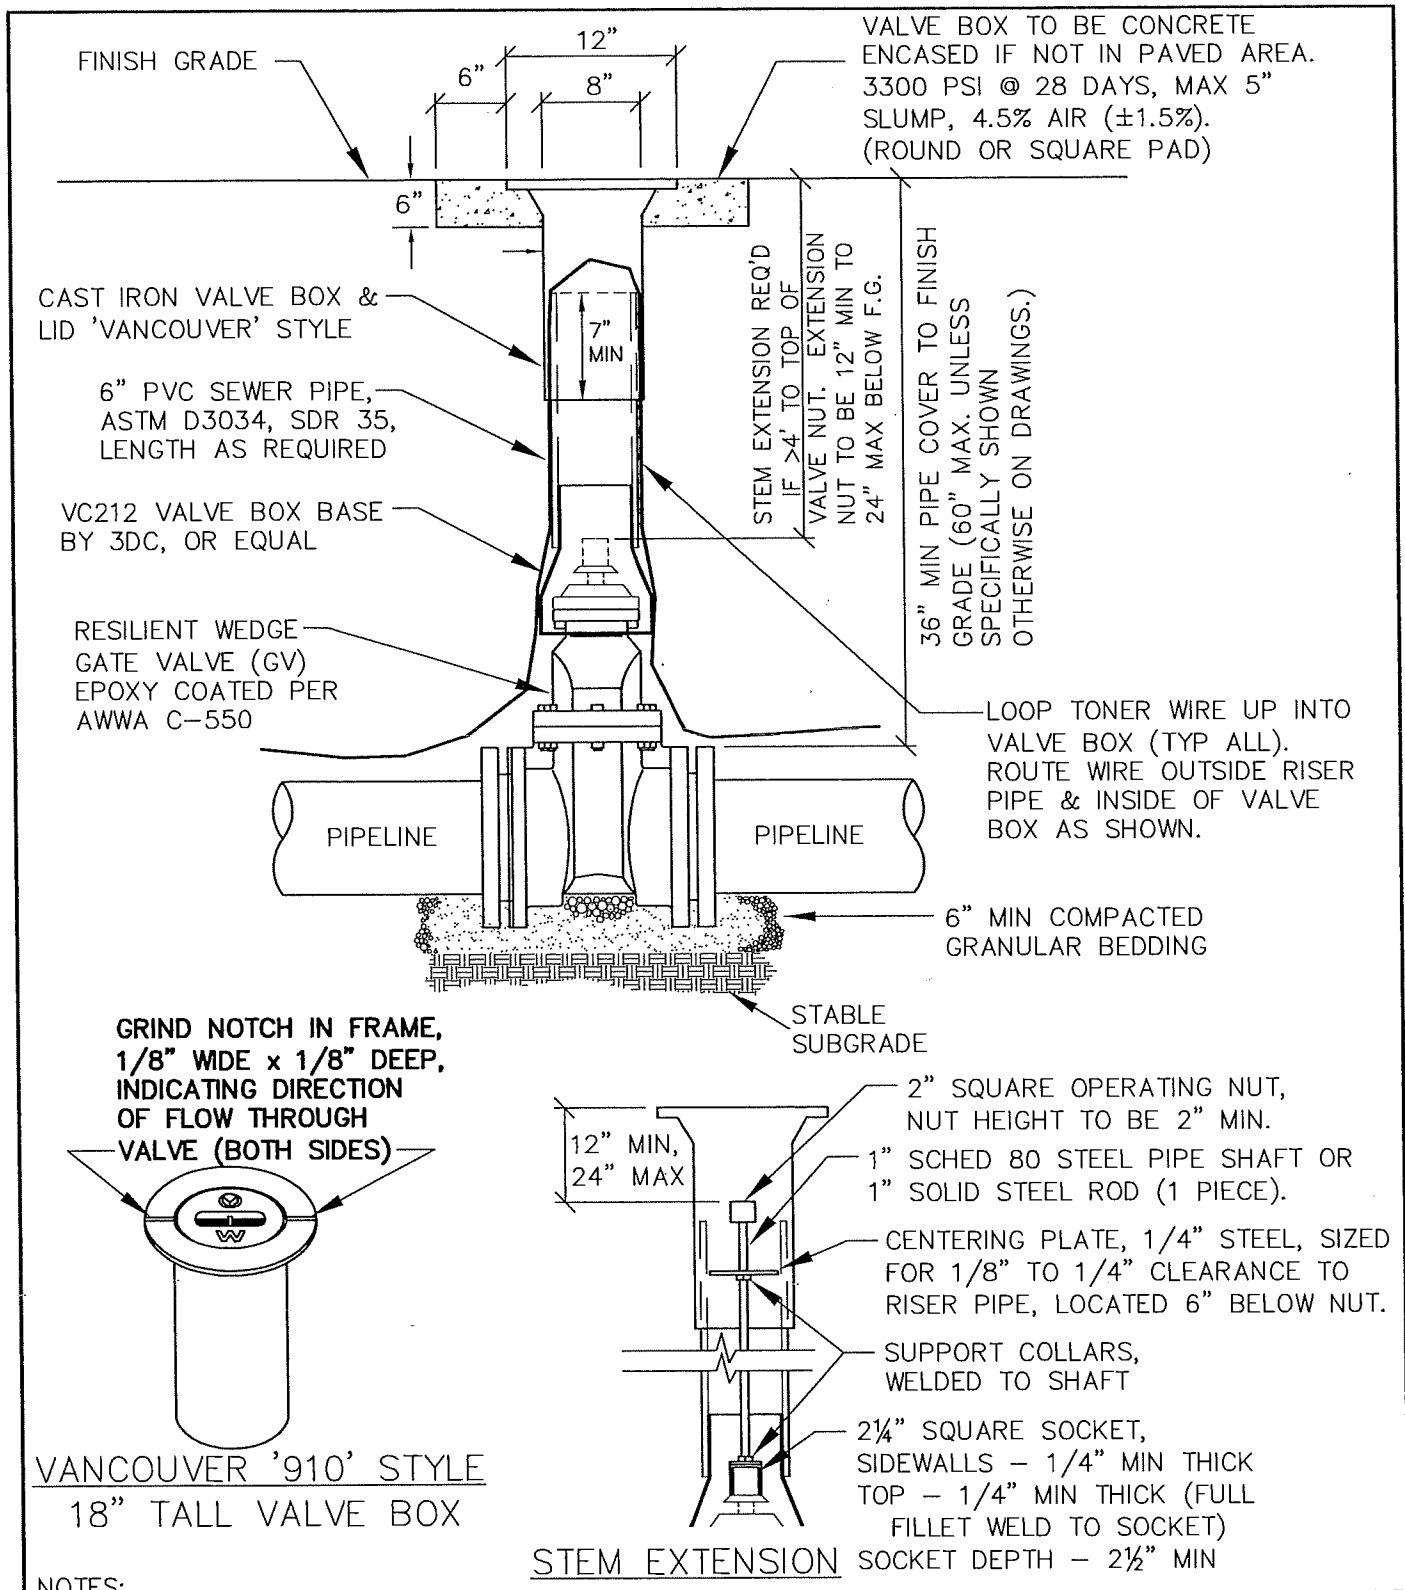

VANCOUVER '910' STYLE  
18" TALL VALVE BOX

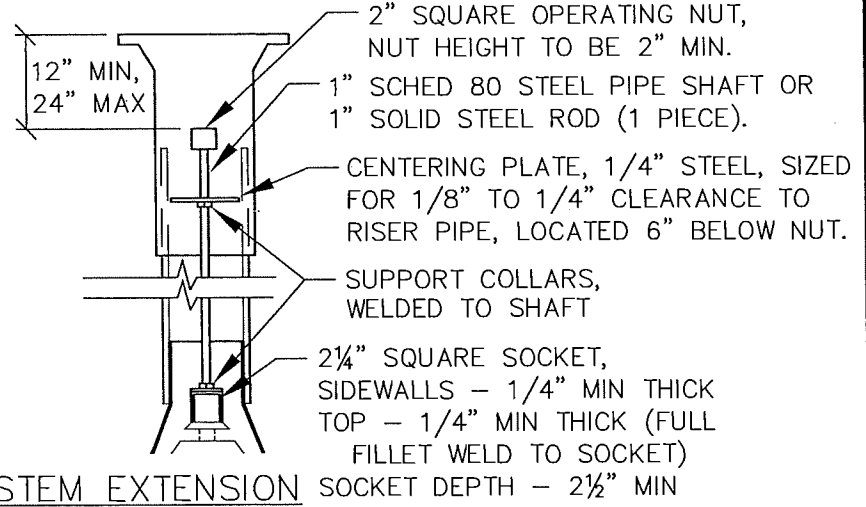


STEM EXTENSION

**NOTES:**

1. GV SHALL CONFORM TO AWWA C-509.
2. VALVE BOXES SHALL BE PLUMB AND CENTERED DIRECTLY OVER THE VALVE NUT, INSTALLED ON VALVE BOX BASE AS SHOWN.
3. VALVE BOX TOP SHALL BE ADJUSTED TO FINISHED GRADE.
4. PVC SHALL BE ONE CONTINUOUS PIECE, NO BELLS OR COUPLERS.
5. VALVE BOX LIDS ON PRESSURE SEWERS TO READ "S" OR "SEWER".
6. COMPLETELY CLEAN OUT ALL VALVE BOX COVER PICKHOLES PRIOR TO REQUESTING FINAL INSPECTION.

LAST REVISION DATE: DEC 2022	JO # STANDARD
<b>GATE VALVE AND VALVE BOX DETAIL</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 501

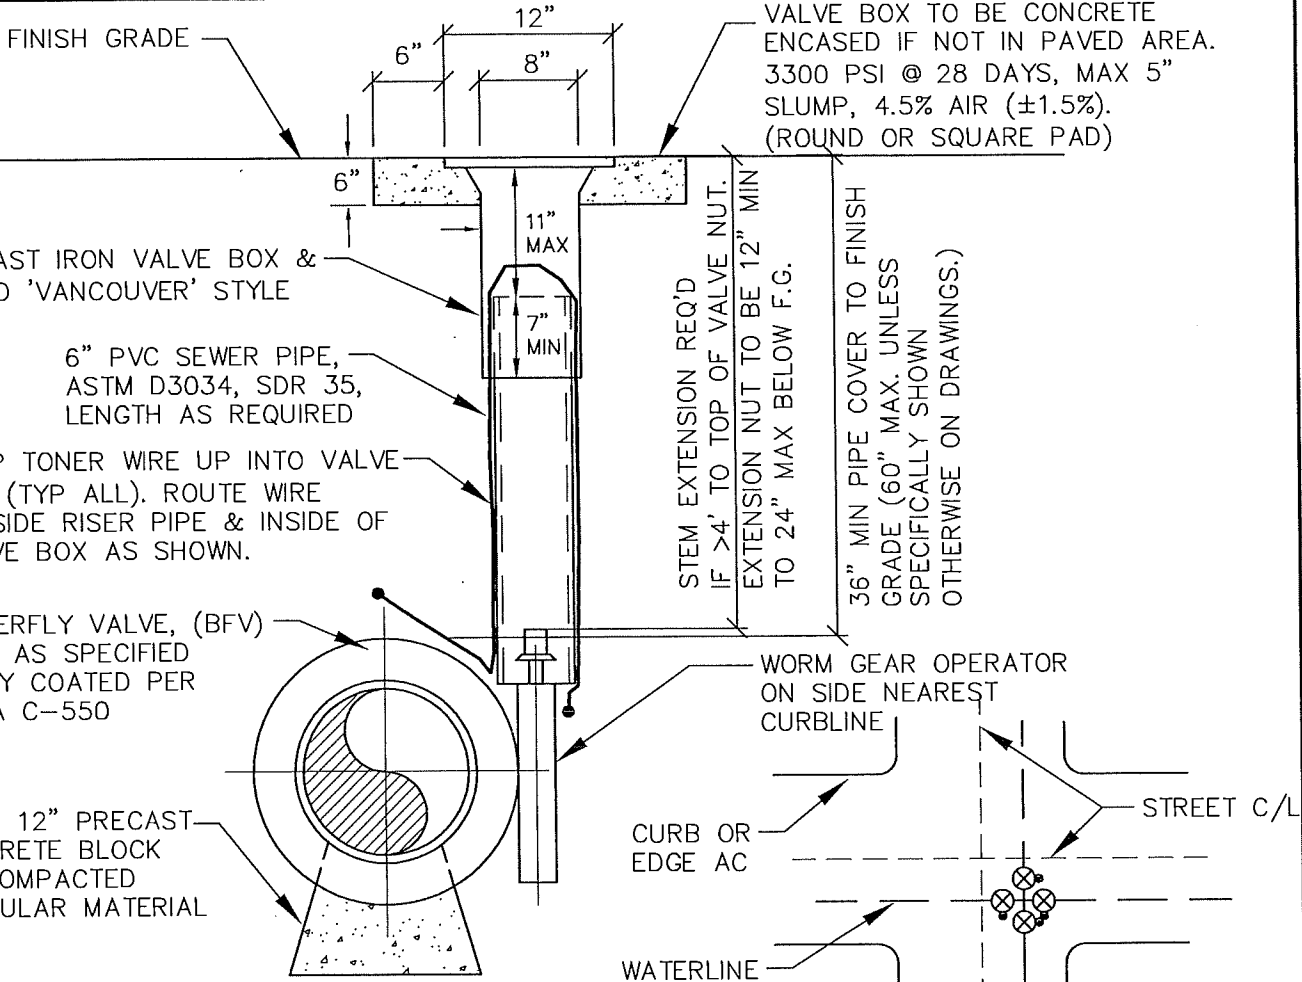

VALVE BOX TO BE CONCRETE ENCASED IF NOT IN PAVED AREA. 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%). (ROUND OR SQUARE PAD)

CAST IRON VALVE BOX & LID 'VANCOUVER' STYLE

6" PVC SEWER PIPE, ASTM D3034, SDR 35, LENGTH AS REQUIRED

LOOP TONER WIRE UP INTO VALVE BOX (TYP ALL). ROUTE WIRE OUTSIDE RISER PIPE & INSIDE OF VALVE BOX AS SHOWN.

BUTTERFLY VALVE, (BFV) ENDS AS SPECIFIED EPOXY COATED PER AWWA C-550

12" X 12" PRECAST CONCRETE BLOCK ON COMPACTED GRANULAR MATERIAL

STEM EXTENSION REQ'D IF >4' TO TOP OF VALVE NUT. EXTENSION NUT TO BE 12" MIN TO 24" MAX BELOW F.G.

36" MIN PIPE COVER TO FINISH GRADE (60" MAX. UNLESS SPECIFICALLY SHOWN OTHERWISE ON DRAWINGS.)

WORM GEAR OPERATOR ON SIDE NEAREST CURBLINE


CURB OR EDGE AC

STREET C/L


WATERLINE

BFV OPERATOR POSITION

GRIND NOTCH IN FRAME, 1/8" WIDE x 1/8" DEEP, INDICATING DIRECTION OF FLOW THROUGH VALVE (BOTH SIDES)

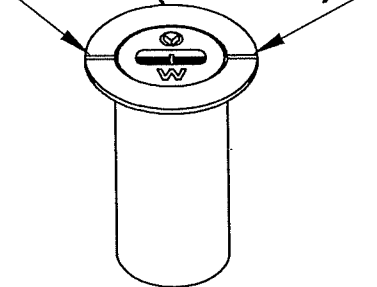

VANCOUVER '910' STYLE  
18" TALL VALVE BOX

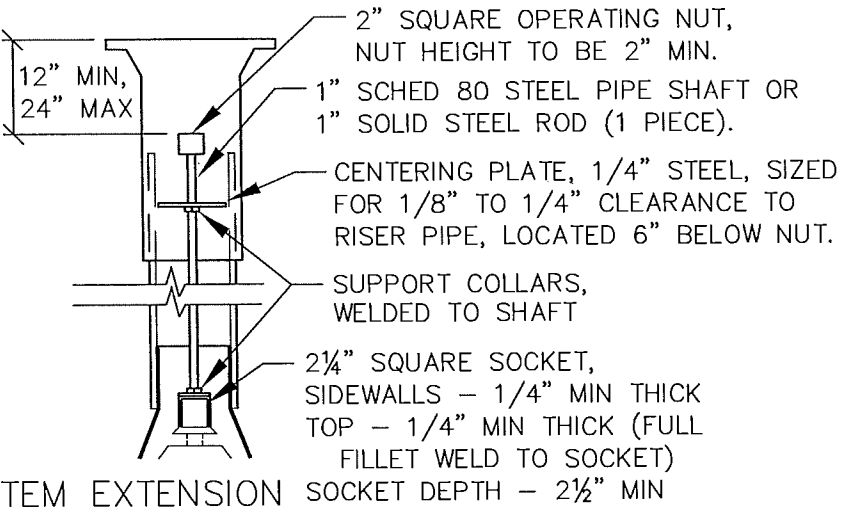

STEM EXTENSION


SOCKET DEPTH - 2 1/2" MIN

NOTES:

1. BFV SHALL BE SHORT BODY TYPE B PER AWWA C-504.
2. VALVE BOXES SHALL BE PLUMB AND CENTERED DIRECTLY OVER THE VALVE NUT.
3. VALVE BOX TOP SHALL BE ADJUSTED TO FINISHED GRADE.
4. PVC SHALL BE ONE CONTINUOUS PIECE, NO BELLS OR COUPLERS.
5. BFV ACTUATOR TO BE LOCATED ON THE CURBLINE SIDE OF WATERLINE AS SHOWN. INSTALL DI SPOOLS OR FLEX ADAPTER IF REQUIRED FOR ACTUATOR CLEARANCE.
6. COMPLETELY CLEAN OUT ALL VALVE BOX COVER PICKHOLES PRIOR TO REQUESTING FINAL INSPECTION.

LAST REVISION DATE: DEC 2022	JO # STANDARD
<b>BUTTERFLY VALVE AND VALVE BOX DETAILS</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 502

**NOTE: HYDRANT COLOR TO BE FACTORY YELLOW**

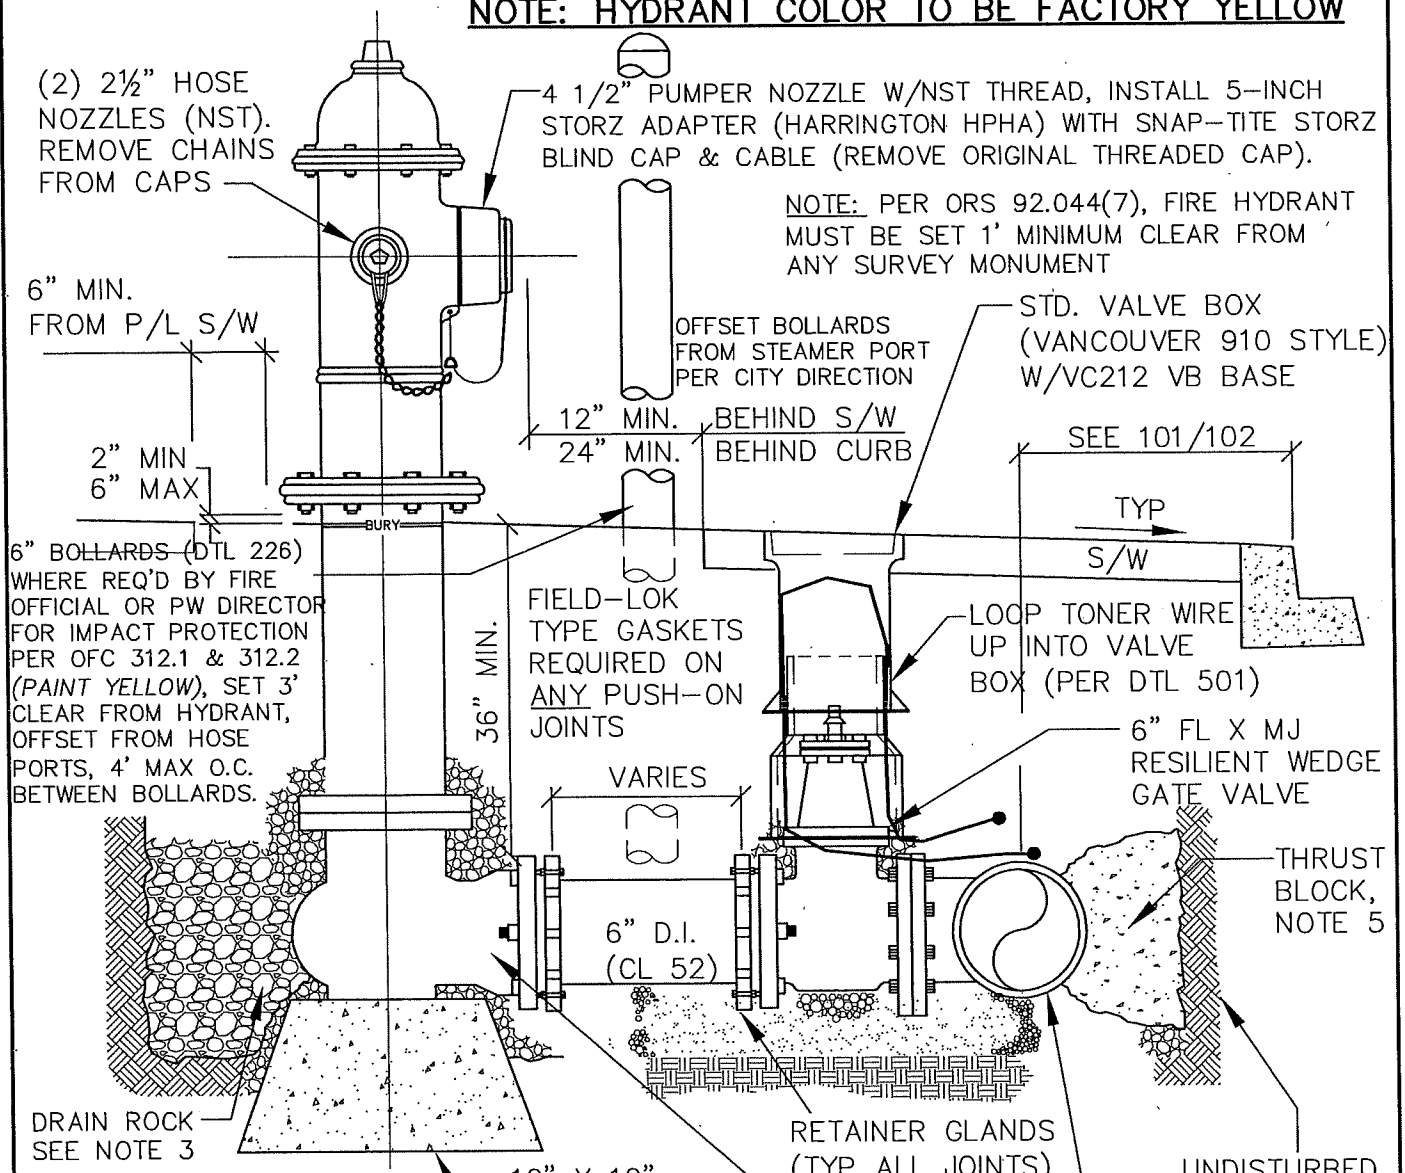

(2) 2½" HOSE NOZZLES (NST). REMOVE CHAINS FROM CAPS

4 1/2" PUMPER NOZZLE W/NST THREAD, INSTALL 5-INCH STORZ ADAPTER (HARRINGTON HPHA) WITH SNAP-TITE STORZ BLIND CAP & CABLE (REMOVE ORIGINAL THREADED CAP).

NOTE: PER ORS 92.044(7), FIRE HYDRANT MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

6" MIN. FROM P/L S/W

2" MIN 6" MAX

OFFSET BOLLARDS FROM STEAMER PORT PER CITY DIRECTION

STD. VALVE BOX (VANCOUVER 910 STYLE) W/VC212 VB BASE

12" MIN. 24" MIN. BEHIND S/W BEHIND CURB

SEE 101/102

TYP

S/W

6" BOLLARDS (DTL 226) WHERE REQ'D BY FIRE OFFICIAL OR PW DIRECTOR FOR IMPACT PROTECTION PER OFC 312.1 & 312.2 (PAINT YELLOW), SET 3' CLEAR FROM HYDRANT, OFFSET FROM HOSE PORTS, 4' MAX O.C. BETWEEN BOLLARDS.

FIELD-LOK TYPE GASKETS REQUIRED ON ANY PUSH-ON JOINTS

LOOP TONER WIRE UP INTO VALVE BOX (PER DTL 501)

6" FL X MJ RESILIENT WEDGE GATE VALVE

VARIES

6" D.I. (CL 52)

THRUST BLOCK, NOTE 5

DRAIN ROCK SEE NOTE 3

RETAINER GLANDS (TYP ALL JOINTS)

UNDISTURBED EARTH (TYP)

12" X 12" CONC. BLOCK


6" FLG X MJ SHOE

MAINLINE TEE 6" SIDE OUTLET FLANGED

**NOTES:**

1. HYDRANTS TO BE KENNEDY GUARDIAN K81D WITH FULL SIZE (5¼") FOOT VALVE.
2. **ALL FITTINGS IN CONTACT WITH CONCRETE SHALL BE WRAPPED IN PLASTIC.** HYDRANT DRAIN HOLES TO REMAIN OPEN TO DRAIN ROCK AND OPERATIONAL.
3. 1-1/2" TO 3/4" CLEAN DRAIN ROCK SHALL BE PLACED TO A MIN. OF 6" ABOVE DRAIN OUTLET.
4. WHERE PLANTER STRIP EXISTS, HYDRANT SHALL BE PLACED SO FRONT PORT IS A MIN. OF 24" BEHIND FACE OF CURB.
5. THRUST BLOCK AT STANDARD 6" FIRE HYDRANT TEE SHALL HAVE MIN. 3.7 SQ. FT. BEARING AREA.
6. ALL HYDRANTS SHALL BE SET PLUMB.
7. FOR HYDRANT LEADS LONGER THAN 30', AN ADDITIONAL GATE VALVE SHALL BE PROVIDED WITHIN 3 FT. OF THE HYDRANT.
8. RESTRAIN ALL JOINTS ON ALL HYDRANT LEADS. RETAINER GLANDS SHALL TO BE USED IN LEIU OF THRUST BLOCK BEHIND HYDRANT.
9. PAINT CURB (TOP & FACE) YELLOW 10 FEET EACH WAY FROM HYDRANT & INSTALL REFLECTIVE BLUE TRAFFIC MARKER @ STREET CENTERLINE.


LAST REVISION DATE: OCT 2023	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>STANDARD FIRE HYDRANT ASSEMBLY</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 503

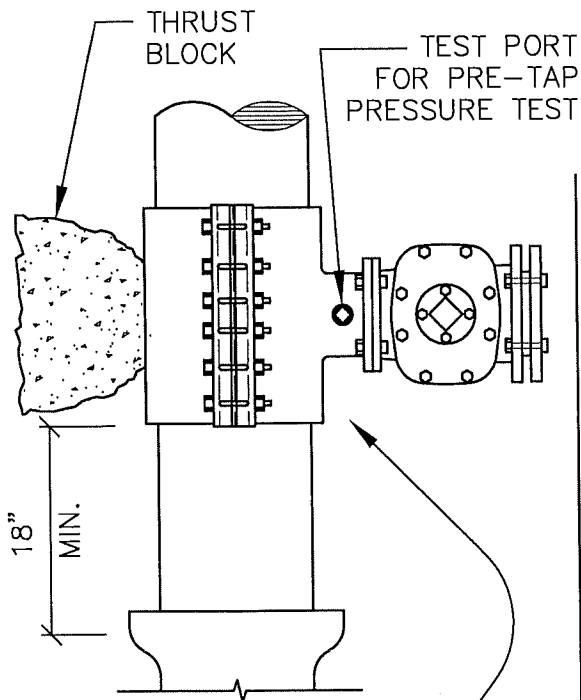

ROMAC SST/SSTIII, MUELLER H304,  
JCM MODEL 432 OR APPROVED EQUAL  
(STAINLESS STEEL SLEEVE AND STAINLESS  
STEEL FLANGE)

TOP VIEW

STD. VALVE BOX  
(VANCOUVER '910'  
STYLE) W/VC212 VB  
BASE & PVC RISER

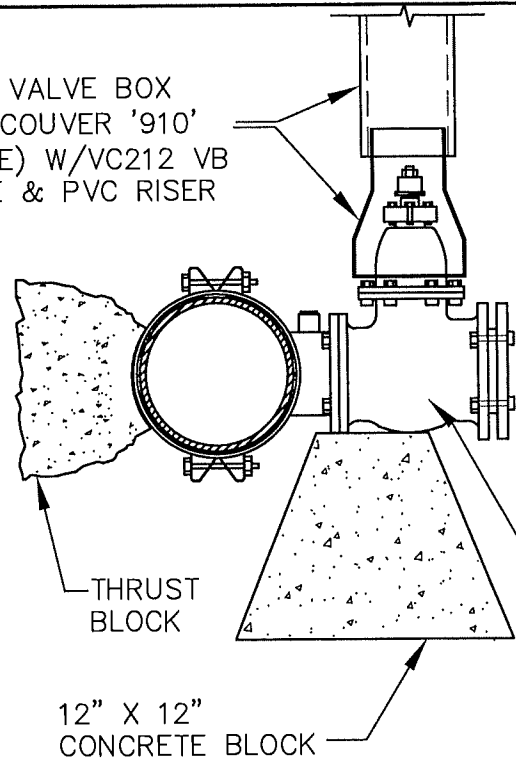

RESILIENT WEDGE GATE VALVE  
(FL x MJ UNLESS OTHERWISE  
NOTED ON PLANS)

SIDE VIEW

NOTES:


1. WATER MAIN SHALL BE CLEANED & SPRAYED WITH CHLORINE SOLUTION IN TAP AREA BEFORE ATTACHING SLEEVE.
2. TAPPING SLEEVE SHALL BE ALL STAINLESS STEEL WITH FULL PERIMETER GASKET.
3. TAPPING VALVE SHALL BE EPOXY COATED PER AWWA C-550.
4. PRE-TAP PRESSURE TEST. SLEEVE AND VALVE SHALL BE PRESSURE TESTED BEFORE MAKING TAP. PRESSURE TEST AND TAP SHALL BE MADE IN THE PRESENCE OF AN AUTHORIZED WATER SYSTEM REPRESENTATIVE.
5. APPROVED TAPPING MACHINE SHALL BE USED TO MAKE TAP.
6. 3/4" GRANULAR BACKFILL SHALL BE PLACED AND COMPACTED TO 92% OF MAXIMUM DENSITY AS DETERMINED BY AASHTO T-180.
7. THRUST BLOCKING PER DETAIL 510.
8. TAP SHALL BE MADE NO CLOSER THAN 18" FROM THE NEAREST JOINT.
9. **SLEEVE AND VALVE SHALL BE WRAPPED WITH 8 MIL PLASTIC PRIOR TO CONCRETE PLACEMENT.**
10. CONCRETE BLOCK(S) SHALL COMPLETELY SUPPORT TAPPING TEE AND VALVE.
11. CONTRACTOR SHALL COORDINATE ALL TAPS WITH CITY AND PERFORM ALL TAPS WITH PUBLIC WORKS STAFF PRESENT.
12. ALL TAPPING EQUIPMENT (AND ANY TOOL COMING IN CONTACT WITH THE PIPE THROUGH THE TAPPING SLEEVE) SHALL BE CHLORINE DISINFECTED WITH A 300 MG/L CHLORINE SOLUTION.

LAST REVISION DATE: SEPT 2018	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>TAPPING TEE AND VALVE</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>505</b>



BLOW-OFF SIZES REQUIRED (ASSUMES 40 PSI RESIDUAL PRESS.)	
MAIN SIZE	BLOW-OFF SIZE
6" - 8"	2"
10" - 12"	4"
>12"	BY ENGR.


PROVIDE ONE RISER ASSEMBLY TO CITY FOR EACH 3 BLOWOFFS OR PORTION THEREOF.

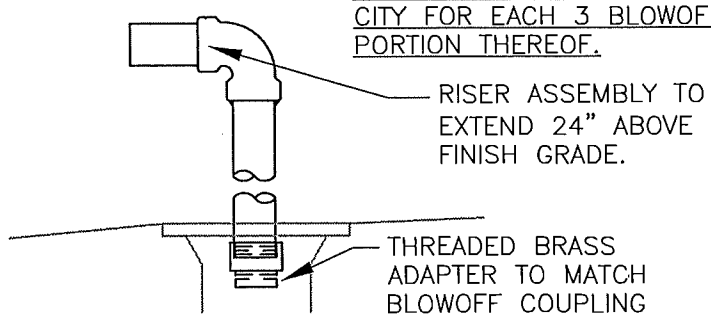

**RISER ASSEMBLY**  
(BY CONTRACTOR)

NOTE: PER ORS 92.044(7), VALVE BOXES MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

USE OF PURPLE PVC PRIMER ON ALL PVC SOLVENT CEMENT JOINTS IS MANDATORY (SEE ALSO OPSC 605.12.2).

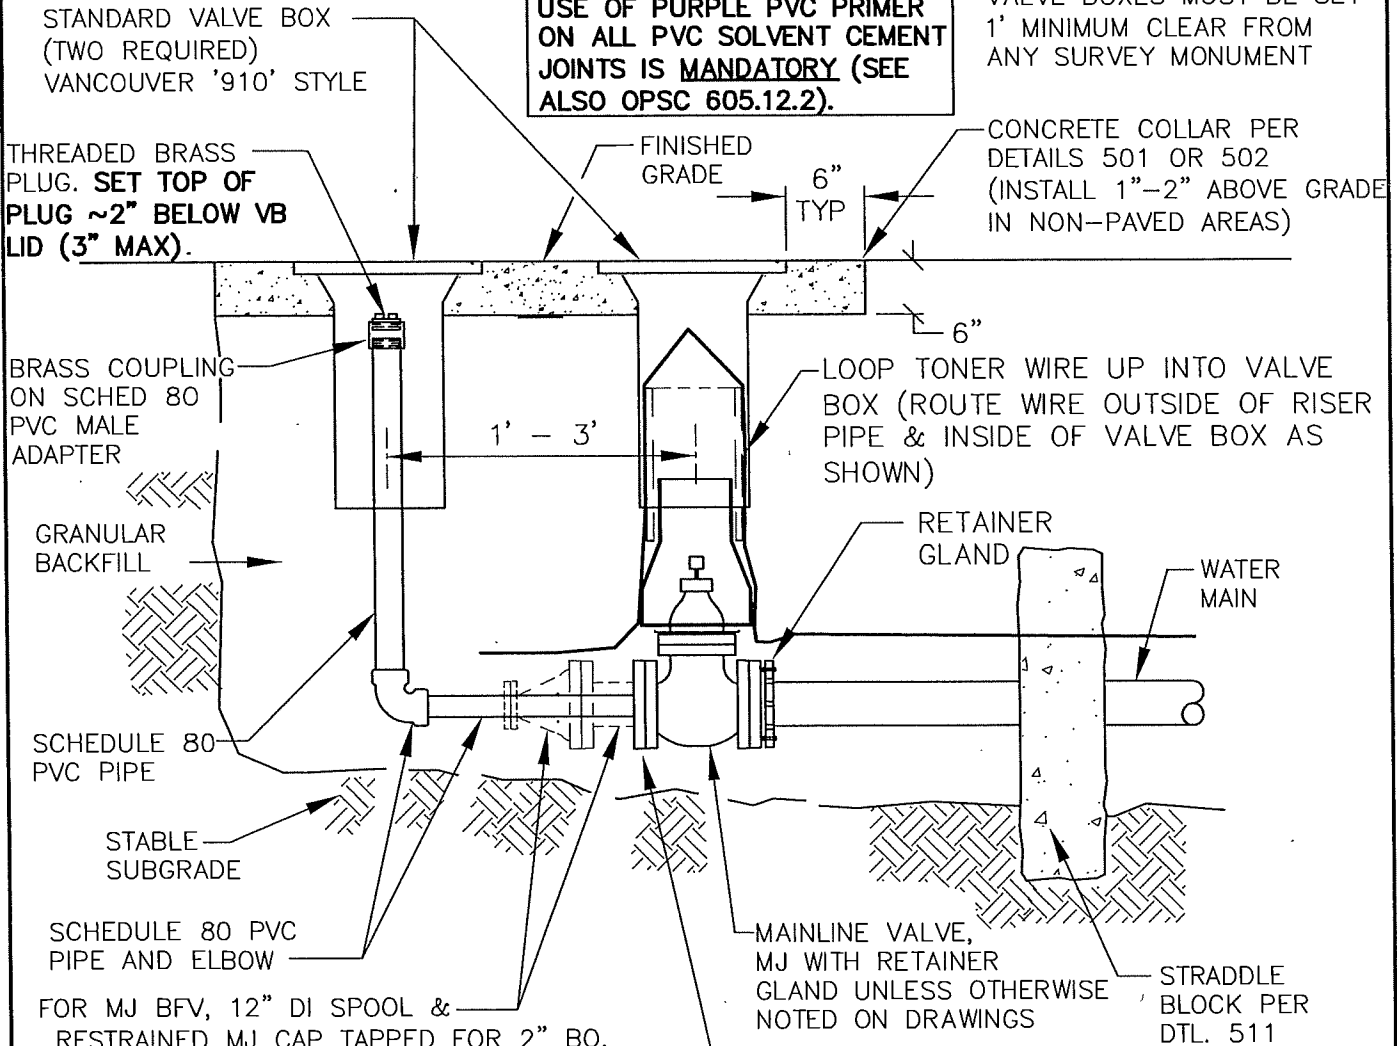

BRASS COUPLING ON SCHED 80 PVC MALE ADAPTER

SCHEDULE 80 PVC PIPE AND ELBOW

FOR MJ BFV, 12" DI SPOOL & RESTRAINED MJ CAP TAPPED FOR 2" BO.  
FOR FL. BFV, 12" FLG X FLG SPOOL & BLIND FL TAPPED FOR 2" BO.  
REDUCERS REQ'D FOR LARGER BLOWOFFS.

FOR GV, RESTRAINED MJ PLUG TAPPED TO BLOW-OFF SIZE

NOTES:

- BACKFILL WITH GRANULAR BACKFILL.
- REQUIRED ON ALL LINES WHICH MAY BE EXTENDED IN FUTURE OR AS DIRECTED BY CITY ENGINEER.
- FLANGED VALVE, DUCTILE IRON PIPE & FITTINGS MAY BE REQUIRED FOR 4" & LARGER BLOWOFFS.
- BLOWOFFS NOTED ON DWGS AS "TEMPORARY" SHALL BE REMOVED BY CONTRACTOR PRIOR TO FINAL SURFACE RESTORATION.

ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).


LAST REVISION DATE: FEB 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
---------------------------------	---

**MAINLINE BLOWOFF ASSEMBLY**  
(NTS)

DAYTON, OR	DETAIL NO. 506
------------	-------------------

NOTE: PER ORS 92.044(7), VALVE BOXES MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT


PROVIDE ONE RISER ASSEMBLY TO CITY FOR EACH 3 BLOWOFFS OR PORTION THEREOF.

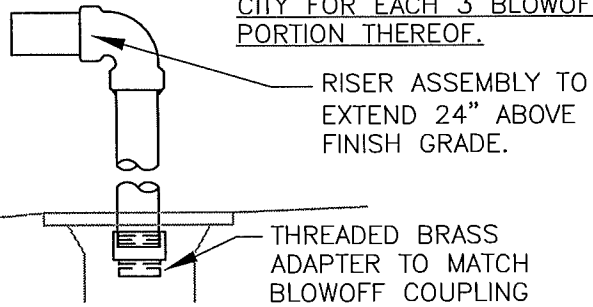

**RISER ASSEMBLY**  
(BY CONTRACTOR)

**USE OF PURPLE PVC PRIMER ON ALL PVC SOLVENT CEMENT JOINTS IS MANDATORY (SEE ALSO OPSC 605.12.2).**

NOTE: PER ORS 92.044(7), VALVE BOXES MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

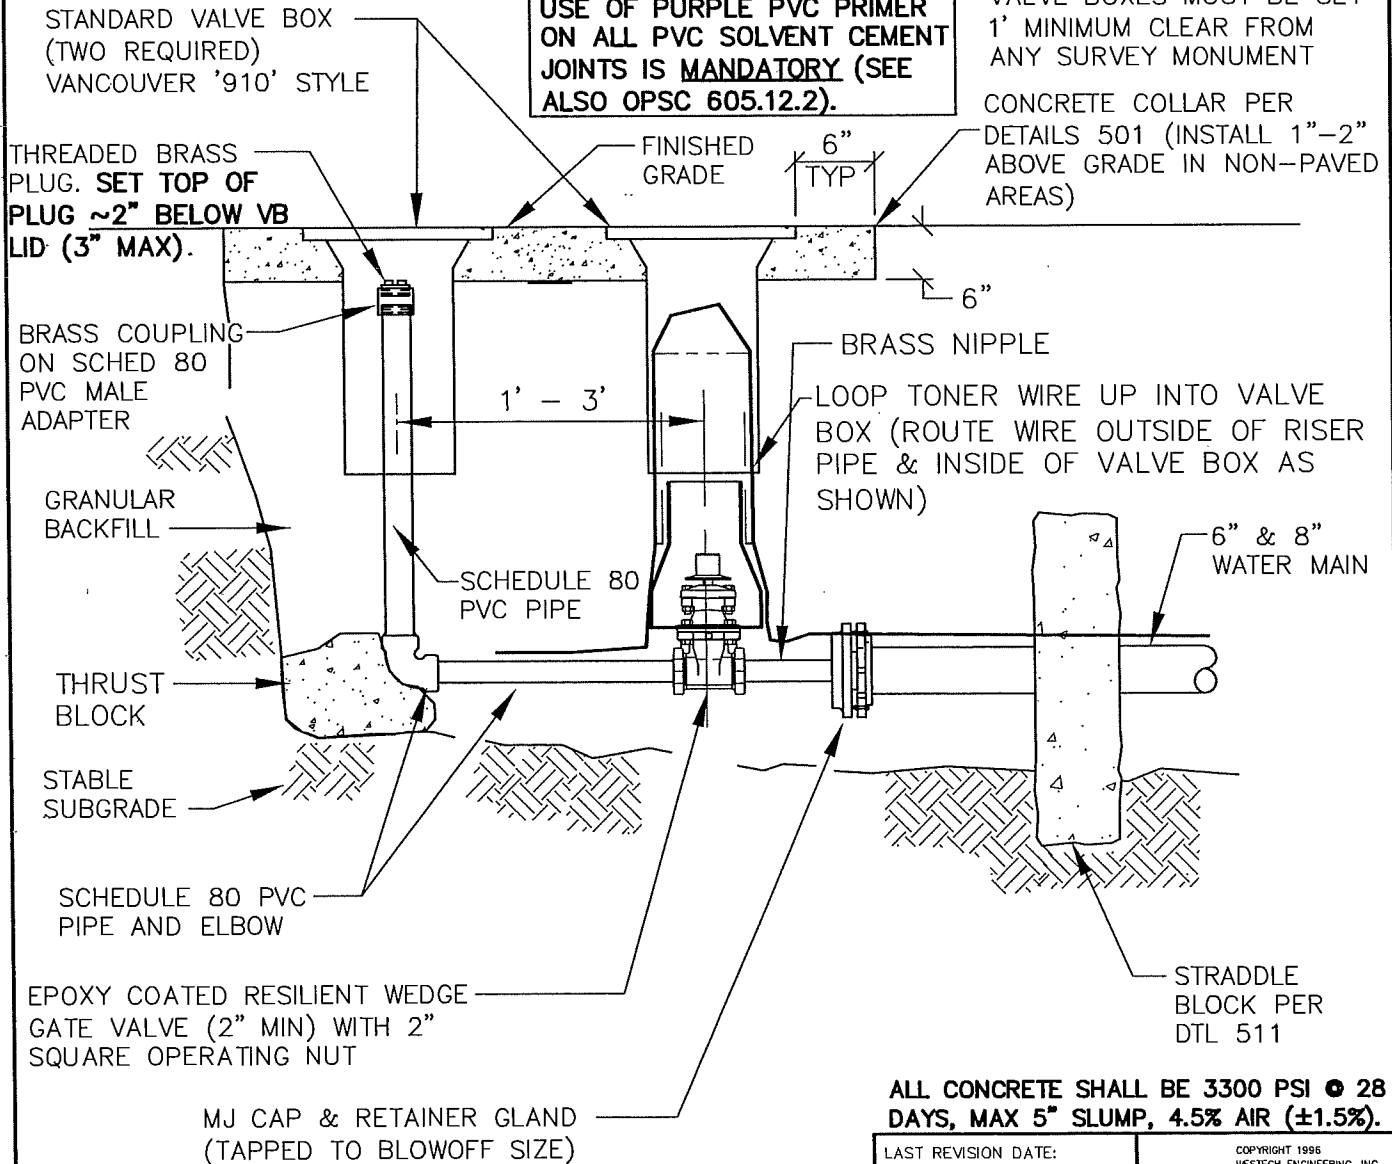

CONCRETE COLLAR PER DETAILS 501 (INSTALL 1"-2" ABOVE GRADE IN NON-PAVED AREAS)

**ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).**


NOTES:

1. BACKFILL WITH GRANULAR BACKFILL.
2. ALLOWED ONLY ON PERMANENT DEAD END LINES IN CUL-DE-SACS WHICH CANNOT BE EXTENDED IN THE FUTURE.
3. 2" BLOWOFF SIZE ASSUMES 40 PSI RESIDUAL PRESSURE MIN.
4. BLOWOFFS NOTED ON DWGS AS "TEMPORARY" SHALL BE REMOVED BY CONTRACTOR PRIOR TO FINAL SURFACE RESTORATION.

LAST REVISION DATE: FEB 2024	COPYRIGHT 1986 WESTECH ENGINEERING, INC.
<b>STANDARD BLOWOFF WITH PLUGGED END</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 507

FITTING SIZE (Inches)	TEE, WYE, & ① HYDRANTS	90° BEND ② PLUGGED CROSS TEE PLUGGED-RUNS	45° BEND ③	22 1/2° BEND ③	11 1/4° BEND ③
2	*	*	*	*	*
4	1.7	2.4	1.3	*	*
6	3.7	5.3	2.9	1.5	*
8	6.7	9.5	5.1	2.7	1.3
10	10.5	14.8	8	4.1	2
12	15.1	21.3	11.6	5.9	2.9
16	26.8	37.9	20.5	10.4	5.2
18	33.9	47.9	25.9	12.8	6.7
LARGER	* *	* *	* *	* *	* *
BEARING AREA OF THRUST BLOCKS (sq. ft.)					


- ALL VALUES ARE BASED ON THE FOLLOWING ASSUMPTIONS:  
AVG. PRESSURE = 100 PSI x 2 (safety factor); 1500 PSF SOIL BEARING CAPACITY;  
NORMAL DISTRIBUTION SYSTEM DESIGN VELOCITY NOT TO EXCEED 5 FPS.
- ALL FITTINGS SHALL BE WRAPPED IN PLASTIC PRIOR TO PLACEMENT OF CONCRETE.**
- BEARING SURFACE OF THRUST BLOCKING SHALL BE AGAINST UNDISTURBED SOIL.
- TRUCK-MIXED CONCRETE MIX SHALL HAVE A MIN. 28 DAY STRENGTH OF 3300 PSI (5" MAX SLUMP). USE OF HAND-MIXED SACK-CRETE TYPE CONCRETE REQUIRES WRITTEN CITY APPROVAL PRIOR TO USE, AND SHALL BE 4000 PSI MIX, MIXED WITH MIN AMOUNT OF WATER NECESSARY FOR WORKABILITY (5" MAX SLUMP). USE OF DRY SACK-CRETE MIX (BAGS OR LOOSE MIX) IS PROHIBITED FOR PERMANENT THRUST RESTRAINT.
- ALL PIPE ZONES SHALL BE BACKFILLED WITH GRANULAR BACKFILL AND COMPACTED.
- THRUST BLOCKS FOR PLUGGED CROSS AND PLUGGED TEE SHALL HAVE #4 REBAR LIFTING LOOPS INSTALLED AS SHOWN.
- VERTICAL THRUST DETAILS-SEE DWG. 512.
- STRADDLE BLOCK DETAILS-SEE DWG. 511.
  - \* BLOCK TO UNDISTURBED TRENCH WALLS
  - \* \* THRUST BLOCKS FOR PIPES LARGER THAN 18" WILL BE INDIVIDUALLY DESIGNED BY THE ENGINEER.

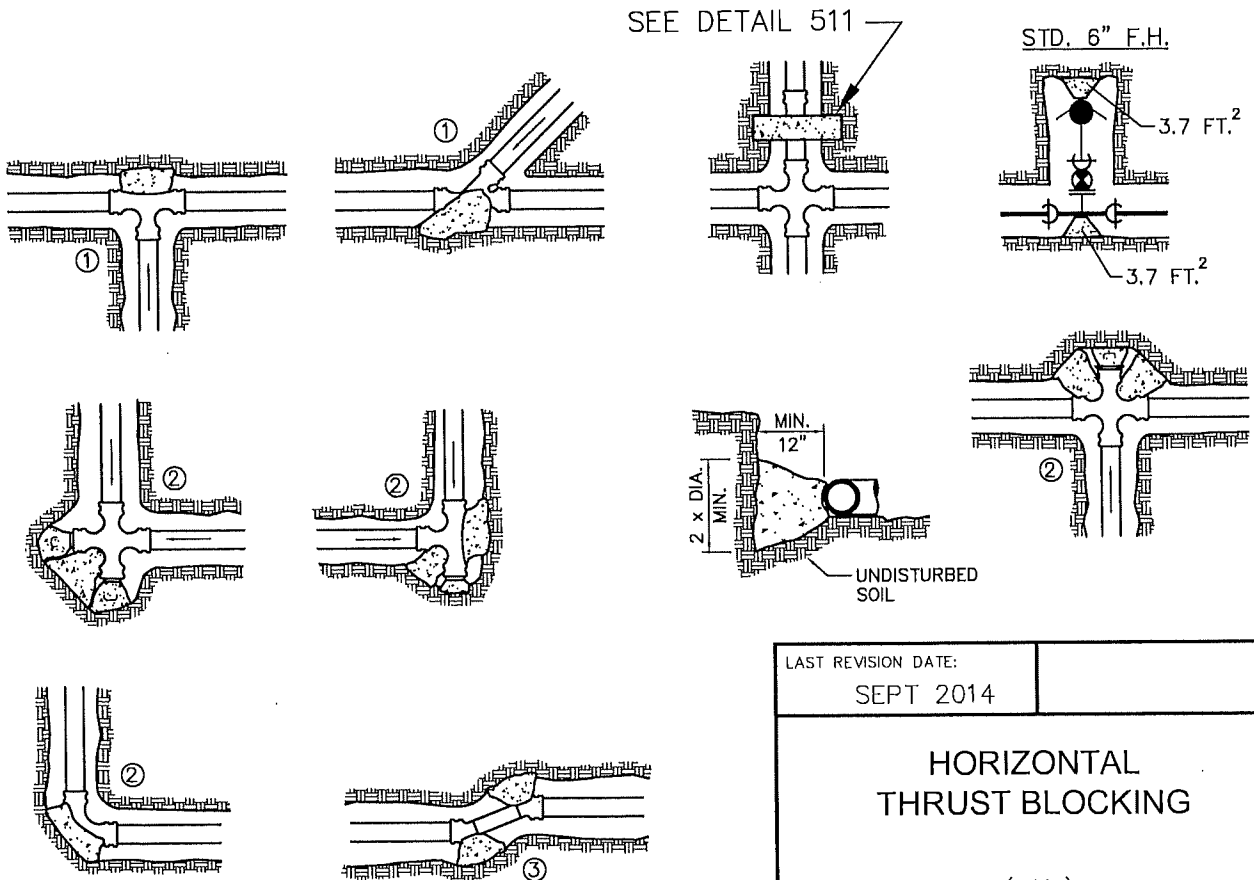

LAST REVISION DATE: SEPT 2014	
<b>HORIZONTAL THRUST BLOCKING</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 510

## MATERIALS


- ① CONCRETE STRADDLE BLOCK.
- ② -EITHER **(2a)** ONE SERRATED-LOCK STYLE SPLIT-RING RESTRAINT HARNESS (ROMAC 600 OR EQUAL), OR **(2b)** TWO RETAINER GLAND WEDGE-STYLE RESTRAINTS, SET OPPOSED (EBBA MEGA-LUG OR EQUAL).  
-WEDGE STYLE RESTRAINTS SHALL BE WRAPPED WITH PLASTIC PRIOR TO CONCRETE PLACEMENT.
- ③  $\leq 12"$  PIPE, #4 REBAR @12" O.C. E.W.,  
**(3a)** INSTALL REBAR EACH SIDE OF RESTRAINT FITTING INSIDE CONCRETE AS SHOWN. **(3b)** INSTALL 3 MATS OF REBAR FOR PIPE LARGER THAN 12" DIAMETER.
- ④ RETAINER GLAND, ON ADJACENT FITTING.
- ⑤ MJ FITTING, BEND, VALVE OR BLOWOFF.

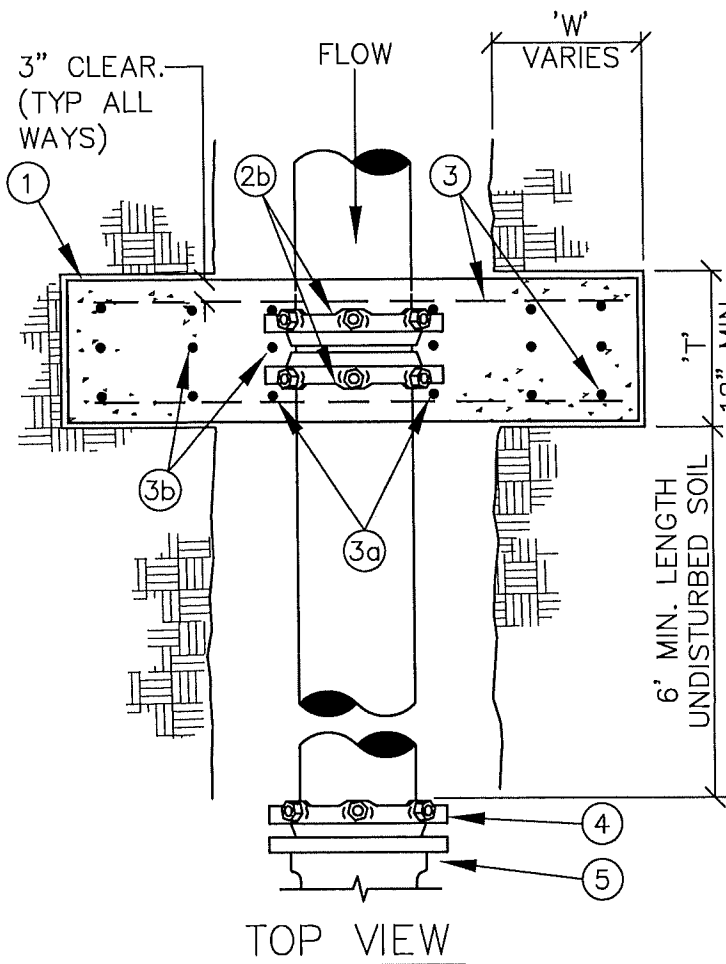

PIPE SIZE	'W'	'D'	'T'
6"	12"	8"	12"
8"	16"	10"	12"
10"	20"	12"	12"
12"	24"	18"	18"
14"&16"	28"	24"	18"
18"	32"	30"	18"
>12"	SIZE TO BE VERIFIED BY DESIGN ENG (NOTE 1).		

## NOTES:


1. STRADDLE BLOCKS FOR >12" PIPE SHALL BE VERIFIED INDIVIDUALLY FOR APPLICATION BY THE DESIGN ENGINEER AND SHALL BE BASED ON THE FOLLOWING:
  - a.) 200 PSI WATER TEST PRESSURE.
  - b.) SOIL BEARING CAPACITY, REBAR SIZE & SPACING VERIFIED BY THE ENGINEER.
2. BEARING AREA OF BLOCK SHALL BE AGAINST UNDISTURBED SOIL.
3. STRADDLE BLOCK SHALL HAVE A MINIMUM OF 18" COVER.
4. CONCRETE SHALL HAVE A MIN. 28 DAY STRENGTH OF 3300 PSI.

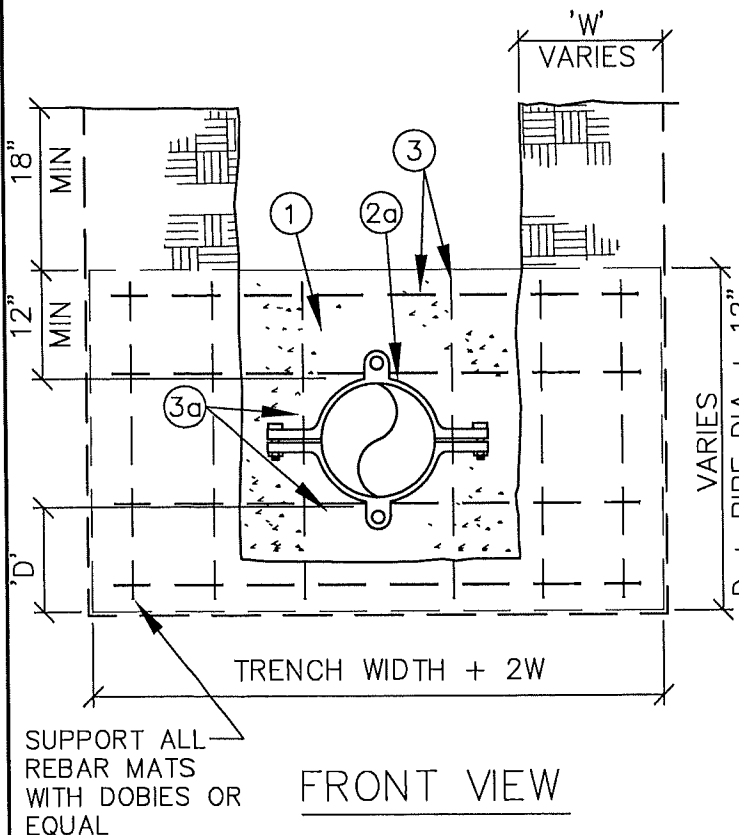


LAST REVISION DATE: DEC 2021	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
STRADDLE BLOCK FOR WATERLINE PIPE & PRESSURE SEWER PIPE (NTS)	
DAYTON, OR	DETAIL NO. 511

**NOTES:**

1. GRAVITY VERTICAL THRUST BLOCKS SHALL BE DESIGNED BY THE ENGINEER.
2. **KEEP CONCRETE CLEAR OF JOINT AND JOINT ACCESSORIES. FITTINGS SHALL BE WRAPPED IN PLASTIC PRIOR TO PLACEMENT OF CONCRETE.**
3. CONCRETE THRUST BLOCKING SHALL BE POURED AGAINST UNDISTURBED EARTH.
4. CONCRETE MIX SHALL HAVE A MIN. 28 DAY STRENGTH OF 3000 P.S.I.
5. THRUST BLOCK VOLUMES FOR VERTICAL BENDS HAVING UPWARD RESULTANT THRUSTS ARE BASED ON TEST PRESSURE OF 150 P.S.I.G. AND THE WEIGHT OF CONCRETE = 4050 LBS./CU.YD.
6. VERTICAL BENDS THAT REQUIRE A THRUST BLOCK VOLUME EXCEEDING 5 CUBIC YARDS REQUIRE SPECIAL BLOCKING DETAILS. SEE PLANS FOR VOLUMES SHOWN INSIDE HEAVY LINE IN TABLE.
7. ALL REBAR SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM-123 (MIN. 3.4 MIL). REBAR SHALL BE BENT BEFORE GALVANIZATION, AND LAST 4" OF BAR SHALL BE BENT 90 DEGREES WITH A 1/2" RADIUS BEND. REBAR SHALL BE TIGHTLY FIT TO RESTRAINED FITTING.
8. FOR HORIZONTAL THRUST BLOCK DETAILS SEE DRAWING NO. 510.

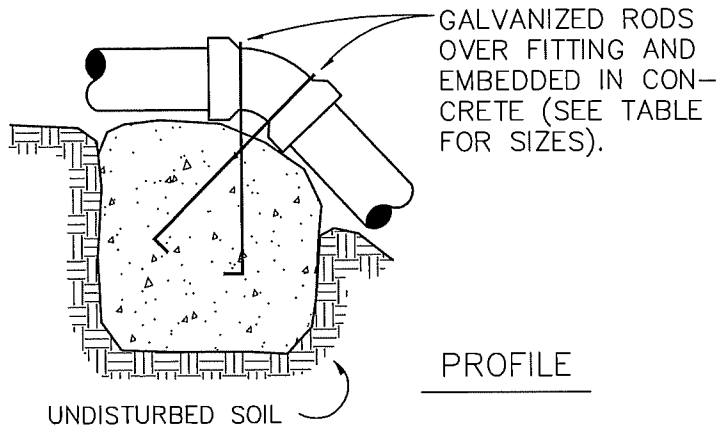

GRAVITY VERTICAL THRUST BLOCK

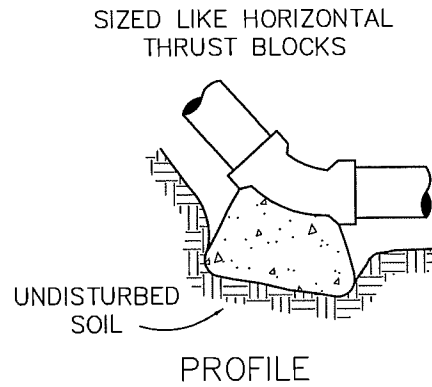


NORMAL VERTICAL THRUST BLOCK

VOLUME OF THRUST BLOCK IN CUBIC YARDS (VERTICAL BENDS)			
FITTING SIZE	BEND ANGLE		
	45°	22 1/2°	11 1/4°
4	1.1	0.4	0.2
6	2.7	1.0	0.4
8	4.0	1.5	0.6
10	6.0	2.3	0.9
12	8.5	3.2	1.3
14	11.5	4.3	1.8
16	14.8	5.6	2.3


FITTING SIZE	ROD SIZE	EMBEDMENT
12" AND LESS	#6	30"
14" - 16"	#8	36"

LAST REVISION DATE: SEPT 2006	
<b>VERTICAL THRUST BLOCKING</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 512

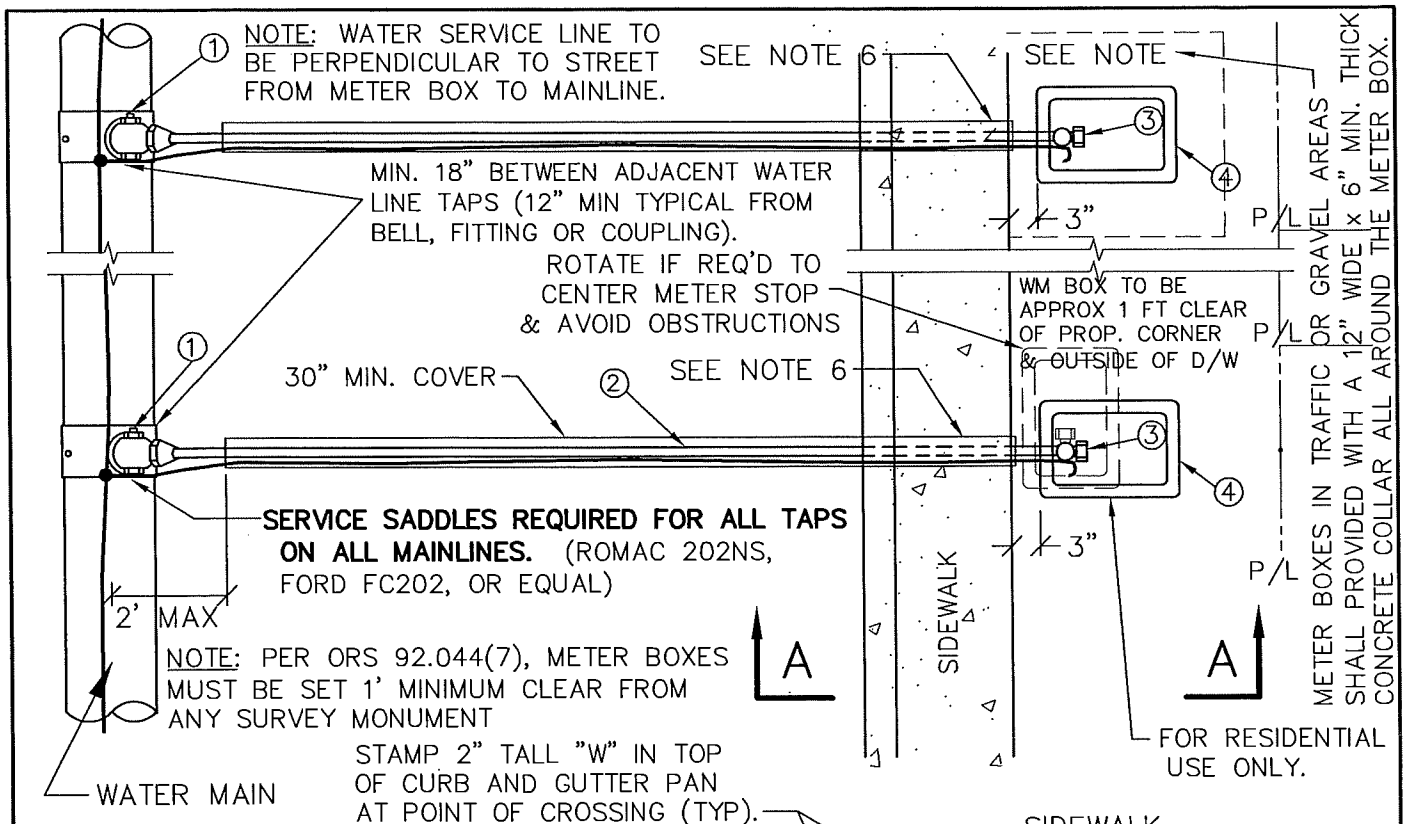

**MATERIALS:**

- ① 1" BALL STYLE CORPORATION STOP FORD FB-1100. SET AT 30° ANGLE UP FROM HORIZONTAL.
- ② 1" CENCORE BLUE HDPE (CTS OD, SDR 9, 200 PSI) CONFORMING TO AWWA C901, USE 2-3/8" LONG INSERTS ON COMPRESSION FITTINGS (McDONALD 6133T). SINGLE RESIDENTIAL SERVICE: 1" TYP
- ③ 1" BALL STYLE LOCKING ANGLE METER STOP, FORD BA43-444WQ OR EQUAL. PROVIDE ALL METER STOPS WITH 1" x 3/4" METER ADAPTER (FORD A24 OR EQUAL).
- ④ WATER METER BOX PER PWDS 5.8.h.1 (13"x24" ID, H20, GREY): -DFW1324C4-12-BODY W/ DFW1324C-4-LID. PROVIDE METER BOXES WITHOUT KNOCKOUTS FOR SENSOR HEADS.

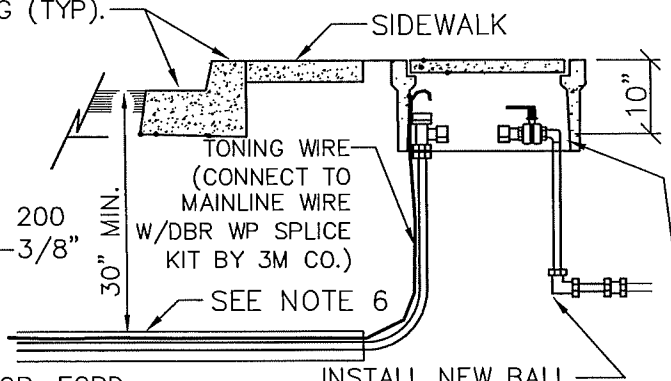


**SECTION A-A**

**NOTES:**


- 1. SUBSTITUTES FOR ANY MATERIALS SHOWN SHALL BE APPROVED BY THE PUBLIC WORKS DIRECTOR.
- 2. ALL PIPE AND BACKFILL ZONES SHALL BE BACKFILLED USING 3/4" MINUS GRANULAR MATERIAL AND COMPACTED TO 92% MAX. DENSITY DETERMINED BY AASHTO T-180.
- 3. SET FRONT OF METER BOX BEHIND BACK OF SIDEWALK LOCATION AS SHOWN.
- 4. METER BOX SHALL BE CENTERED OVER THE COMPLETED METER ASSEMBLY.
- 5. 1 1/2-INCH MIN. PIPE SIZE FOR COMMERCIAL SERVICES.
- 6. FAR SIDE COMMERCIAL SERVICES SHALL BE INSTALLED IN A 4" MIN DIA SCHED 40 PVC SLEEVE WHICH BEGINS 2' FROM MAIN AND EXTENDS TO BACK OF FAR SIDE SIDEWALK.
- 7. TRACER WIRE SPLICES SHALL USE USE WATERTIGHT CONNECTION, TYPE DBR DIRECT BURY SPLICE KIT BY 3M COMPANY (OR EQUAL).

METER COUPLING (TAIL), BALL-VALVE W/HANDLE (NO PADLOCK TABS), COMPRESSION OUTLET & 90° ELBOW. PROVIDE PRIOR TO WATER METER INSTALLATION.

LAST REVISION DATE: APR 2024	COPYRIGHT 1996 WESTECH ENGINEERING, INC.
<b>TYPICAL 1" WATER SERVICE (HDPE SERVICE LINE)</b> (NTS)	
DAYTON, OR	DETAIL NO. <b>515</b>

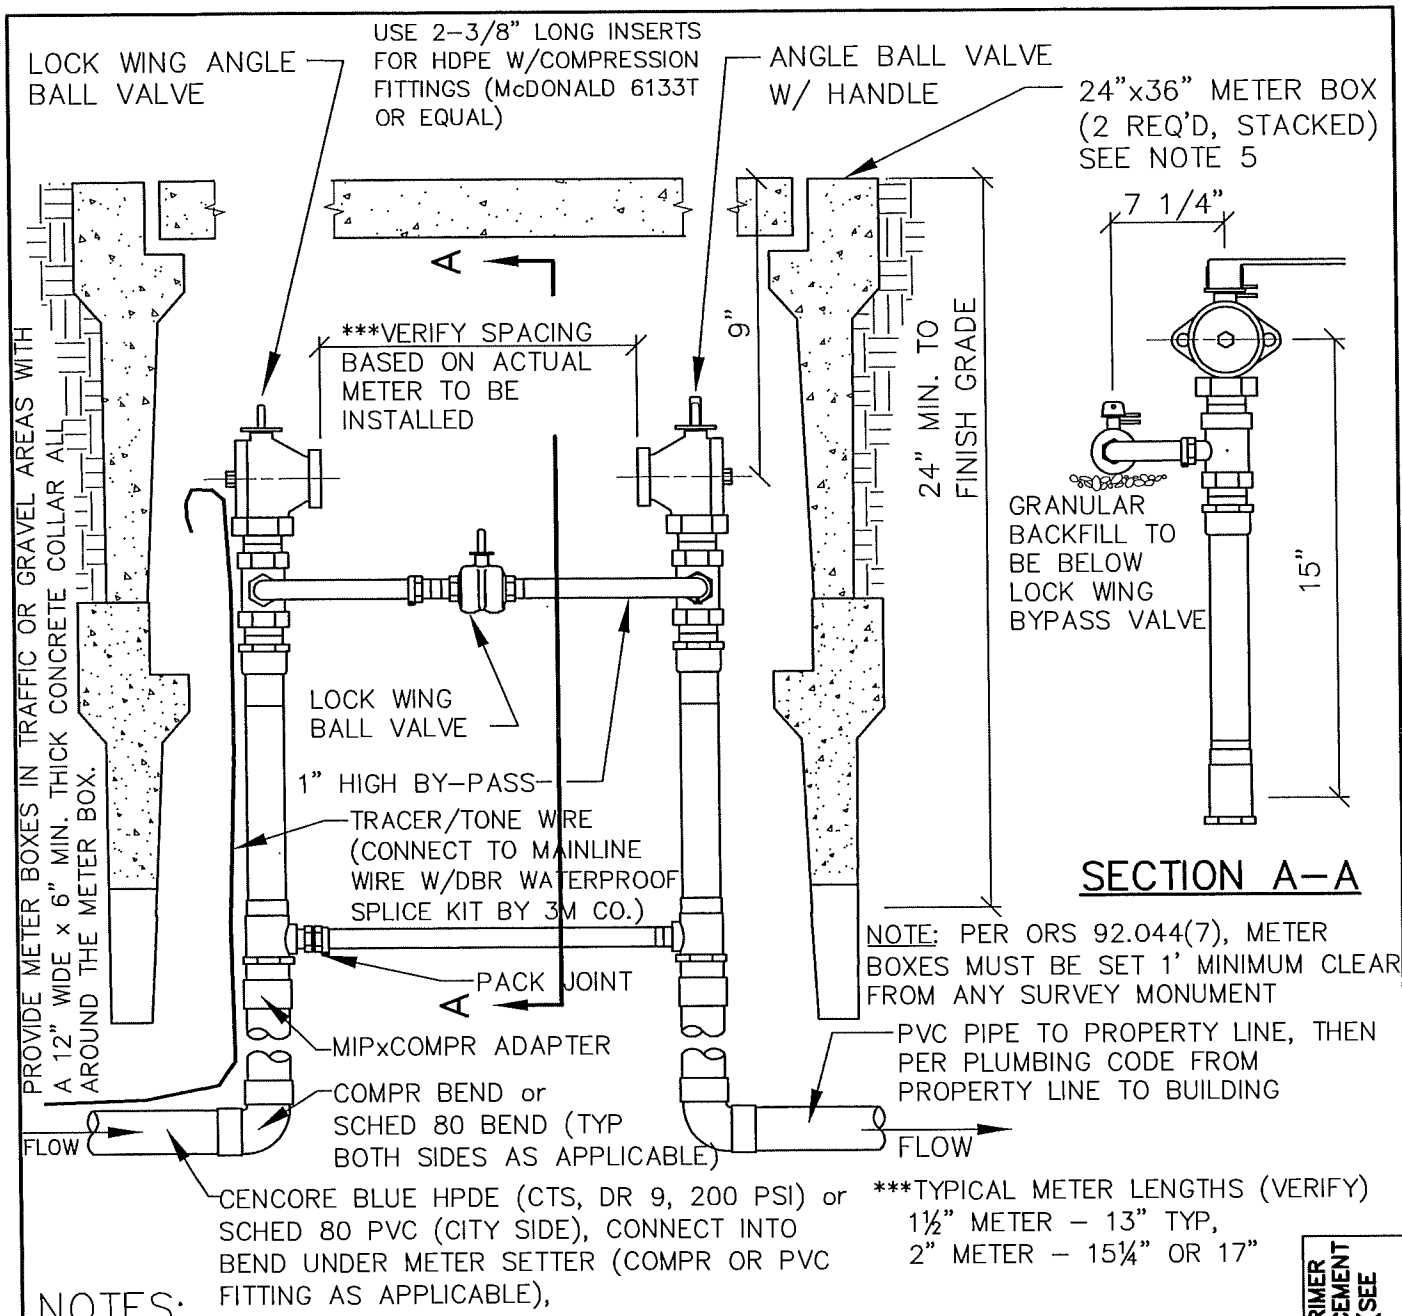

24"x36" METER BOX  
(2 REQ'D, STACKED)  
SEE NOTE 5

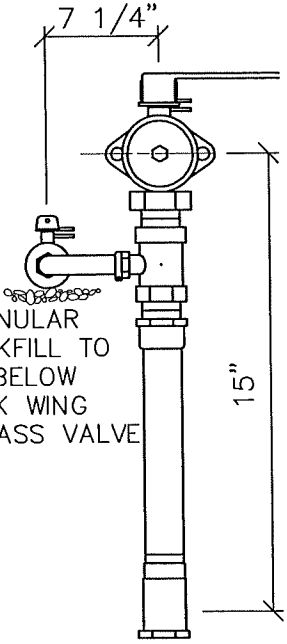

**SECTION A-A**

NOTE: PER ORS 92.044(7), METER BOXES MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

PVC PIPE TO PROPERTY LINE, THEN PER PLUMBING CODE FROM PROPERTY LINE TO BUILDING


\*\*\*TYPICAL METER LENGTHS (VERIFY)  
1 1/2" METER - 13" TYP,  
2" METER - 15 1/4" OR 17"

USE OF PURPLE PVC PRIMER ON ALL PVC SOLVENT CEMENT JOINTS IS MANDATORY (SEE ALSO OPSC 605.12.2).

**NOTES:**

1. METERS SET TO BE FORD BOTTOM INLET COPPERSETTER, #VBB86-15HB-11-66 (1 1/2") OR #VBB87-15HB-11-77 (2") WITH RAISED HIGH LOCKING BYPASS OR APPROVED EQUAL.
2. SUBSTITUTES FOR ANY MATERIALS SHOWN SHALL BE APPROVED BY THE CITY ENGINEER.
3. ALL PIPE AND BACKFILL ZONES SHALL BE BACKFILLED USING 3/4" MINUS GRANULAR MATERIAL AND COMPACTED TO 92% OPTIMUM DENSITY PER AASHTO T-180.
4. SET FRONT OF METER BOX 3-INCHES BEHIND SIDEWALK (TYPICAL) FOR CURBLINE WALKS. NO METERS ON PRIVATE PROPERTY WITHOUT A RECORDED EASEMENT.
5. METER BOX SHALL BE CENTERED OVER THE COMPLETED METER ASSEMBLY. METER BOX PER PWDS 5.8.H.1 (24"x36" LID, H20, GREY)  
- DFWB40WBCNP4-14-4M BODY (2) W/ DFWB40C-4M LID. PROVIDE WITHOUT KNOCKOUTS FOR SENSOR HEADS.
6. COPPERSETTER, METER BOX, & ALL FITTINGS PROVIDED BY CONTRACTOR. CONTRACTOR TO VERIFY DIMENSIONS & CLEARANCE BASED ON ACTUAL METER TO BE PROVIDED BY THE CITY. WATER METER INSTALLED BY CONTRACTOR UNDER CITY INSPECTION & APPROVAL.
7. SEE DETAIL 517 FOR TAPPING REQUIREMENTS.
8. **THREADED FEMALE PVC FITTINGS ARE NOT ALLOWED.**

LAST REVISION DATE: MAY 2024	COPYRIGHT WESTTECH ENGINEERING, INC.
<b>1-1/2" AND 2" METER SET W/OFFSET 1" HIGH BY-PASS (HDPE or PVC SERVICE LINE)</b> (NTS)	
DAYTON, OR	DETAIL NO. <b>516</b>

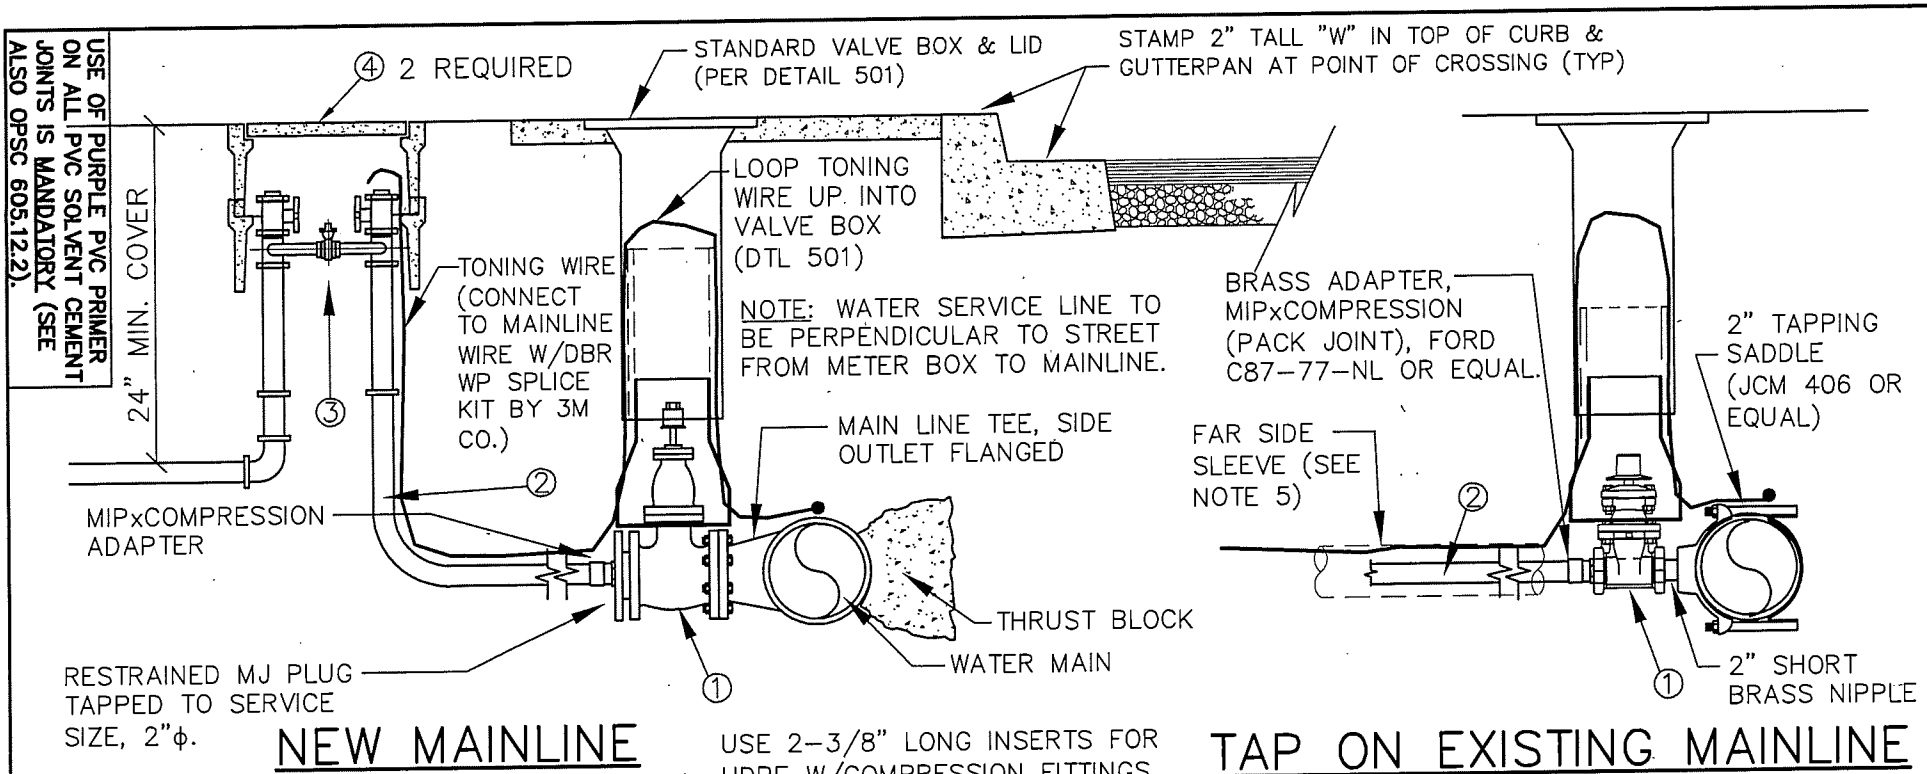

USE 2-3/8" LONG INSERTS FOR HDPE W/COMPRESSION FITTINGS (McDONALD 6133T OR EQUAL)

**MATERIALS**


- ① FLG X MJ RESILIENT WEDGE GATE VALVE PER AWWA C-509. EPOXY COATED PER AWWA C-550.
- ② CENCORE BLUE HDPE (CTS, DR 9, 200 PSI, ≤2"φ) W/OUT JOINTS or SCHEDULE 80 PVC PIPE & FITTINGS PER DETAIL 516 (30" MIN COVER TO METER). **FEMALE THREADED PVC FITTINGS ARE NOT ALLOWED.**
- ③ METER STOP ASSEMBLY W/BYPASS PER PUBLIC WORKS REQUIREMENTS. SEE DETAIL 516 FOR 1-1/2" & 2" SERVICES.
- ④ METER BOX FOR 1-1/2" AND 2" SHALL BE PER DETAIL 516. USE TRAFFIC RATED VERSION OF BOX/LID FOR TRAFFIC AREAS.

**NOTES**

- 1. SUBSTITUTES FOR ANY MATERIAL SHOWN SHALL BE APPROVED BY THE CITY ENGINEER.
- 2. ALL PIPE AND STRUCTURE ZONES SHALL BE BACKFILLED USING 3/4" MINUS GRANULAR MATERIAL AND COMPACTED TO 95% MAX DENSITY AS DETERMINED BY ASHTO T-180.
- 3. METER BOX SHALL BE CENTERED OVER THE COMPLETED METER AND FITTING ASSEMBLY.
- 4. CUSTOMER SHALL INSTALL AN APPROVED BACKFLOW PREVENTION DEVICE ON PRIVATE PROPERTY IMMEDIATELY DOWNSTREAM OF WATER METER IF REQUIRED BY PUBLIC WORKS.
- 5. FAR SIDE COMMERCIAL SERVICES SHALL BE INSTALLED IN A 4" MIN DIA SCHED 40 PVC SLEEVE WHICH BEGINS 6" FROM MAINLINE VALVE & EXTENDS TO EDGE OF FAR SIDE METER BOX.
- 6. METER BOXES IN TRAFFIC OR GRAVEL AREAS SHALL PROVIDED WITH A 12" WIDE x 6" MIN. THICK CONCRETE COLLAR ALL AROUND THE METER BOX.

DAYTON, OR	(NTS)	LAST REVISION DATE: MAR 2024	COPYRIGHT WESTERN ENGINEERING, INC.
		TAPPING REQUIREMENTS, 1-1/2" & 2" SERVICE (HDPE or SCHED 80 PVC SERVICE LINE)	
DETAIL NO. 517A			



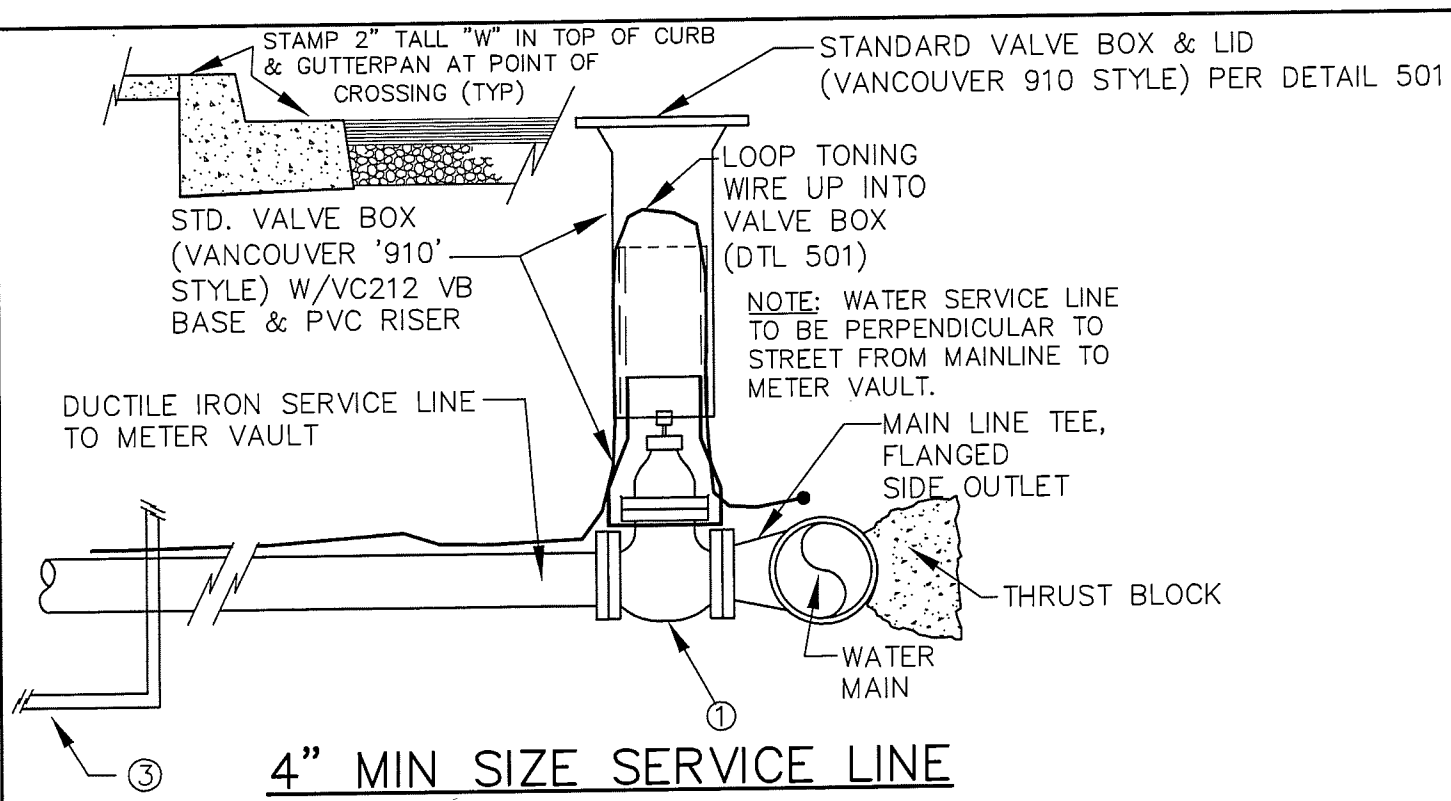

NOTES

1. SUBSTITUTES FOR ANY MATERIAL SHOWN SHALL BE APPROVED BY THE CITY ENGINEER.
2. ALL PIPE AND STRUCTURE ZONES SHALL BE BACKFILLED USING 3/4" MINUS GRANULAR MATERIAL AND COMPACTED TO 95% MAX DENSITY AS DETERMINED BY ASHTO T-180.
3. METER BOX SHALL BE CENTERED OVER THE COMPLETED METER AND FITTING ASSEMBLY.
4. CUSTOMER SHALL INSTALL AN APPROVED BACKFLOW PREVENTION DEVICE ON PRIVATE PROPERTY IMMEDIATELY DOWNSTREAM OF WATER METER IF REQUIRED BY PUBLIC WORKS.
5. FOR EXISTING MAINLINES, INSTALL APPLICABLE SIZE HOT TAP PER DETAIL 505.

MATERIALS

- ① FLG X MJ RESILIENT WEDGE GATE VALVE PER AWWA C-509. 4" MIN OR SERVICE SIZE, WHICHEVER IS LARGER. EPOXY COATED PER AWWA C-550.
- ② SERVICE PIPE TO BE CL 52 DI PIPE TO METER VAULT.
- ③ SEE DETAILS 523-526 FOR CONFIGURATION AT METER VAULT.

DAYTON, OR	LAST REVISION DATE: MAR 2024	COPYRIGHT 1986 WESTERN ENGINEERING, INC.
	(NTS)	
DETAIL NO. 517B	<b>TAPPING REQUIREMENTS, 3" AND LARGER METER</b>	

1" ALUMINUM SCREENED TEE VENT  
(DOWN ORIENTED DOUBLE OUTLET)  
(MORRISON MR 155 OR EQUAL),  
MOUNT WITH SCREEN 12" MINIMUM  
ABOVE GRADE.

4" or 6" φ PIPE BOLLARD  
PER DTIL 226. LOCATION PER  
PLANS (2 WHERE REQ'D TO  
PROTECT METER BOX,  
PAINT BLUE FOR POTABLE  
WATER, SEE NOTE 2).

17"X30" ARMORCAST  
METER BOX W/LID

SECURE TO BOLLARD  
WITH 1"x1/8" STAINLESS  
STEEL CLAMP & BOLT  
PER DETAIL @ LEFT.

1"x3" BRASS NIPPLE

PYLWOOD FORM &  
PLASTIC AS REQUIRED  
TO AVOID CONCRETE  
ENCASEMENT OF RISER  
PIPE.

1/2"x1" 90° BEND.

1" BRASS OR  
COPPER PIPE,  
LENGTH VARIES

1" A.R.I D-040-C  
COMB. AIR/VAC  
VALVE (DUCTILE IRON  
BODY) OR EQUAL

1" BRASS  
UNION

12"  
MIN

17"X30" ARMORCAST  
METER BOX W/OUT LID

ORIENTATION OF VENT PIPE  
THROUGH BOX WALL AS  
SHOWN ON PLANS OR AS  
DIRECTED (ORIENTATION ON  
DETAIL IS FOR CLARITY).

1" HDPE PIPE W/OUT  
JOINTS, SEE NOTE BELOW

5% MIN.  
SLOPE

1" BRASS  
90° ELL

90° ELL,  
BRASS OR  
BRONZE

1" BRASS OR  
COPPER PIPE

1" BRASS NIPPLE &  
COUPLING

1" BRASS 90° ELL

SERVICE  
SADDLE PER  
DETAIL 515

1" BALL STYLE  
CORPORATION STOP  
FORD FB-1100 OR  
APPROVED EQUAL (ORIENT  
NUT ON HORIZONTAL CORP  
STOP TO FACE UPWARD)

1"x3" BRASS NIPPLE

1" BRASS COUPLING

CONCRETE SUPPORT BLOCK


COMPACTED 3/4"-0  
GRAVEL, 12" THICK (MIN)

PIPE NOTE. CENCORE BLUE HDPE (CTS OD, SDR 9, 200  
PSI) CONFORMING TO AWWA C901, USE 2-3/8" LONG  
INSERTS ON COMPRESSION FITTINGS (McDONALD 6133T).

**NOTES:**

1. RISER SHALL BE PROTECTED FROM VEHICULAR OR PEDESTRIAN TRAFFIC AS APPROVED BY THE CITY ENGINEER & PUBLIC WORKS.
2. PAINT BOLLARD & TOP SAFETY BLUE FOR POTABLE WATER APPLICATIONS.
3. WHERE ARV ASSEMBLIES ARE INSTALLED ADJACENT TO FENCES, BOLLARDS SHALL BE SET 3" MIN CLEAR FROM FENCE UNLESS OTHERWISE APPROVED BY PROPERTY OWNER.
4. EXACT LOCATION OF RISER PENTRATION THROUGH BOX & BOLLARDS TO BE VERIFIED IN FIELD WITH CITY ENGINEER & PUBLIC WORKS PRIOR TO RISER & BOLLARD INSTALLATION.

LAST REVISION DATE: MAR 2020	JO #
<b>1" COMBINATION AIR RELEASE VALVE (CARV) (NTS)</b>	
DAYTON, OR	DETAIL NO. <b>518</b>

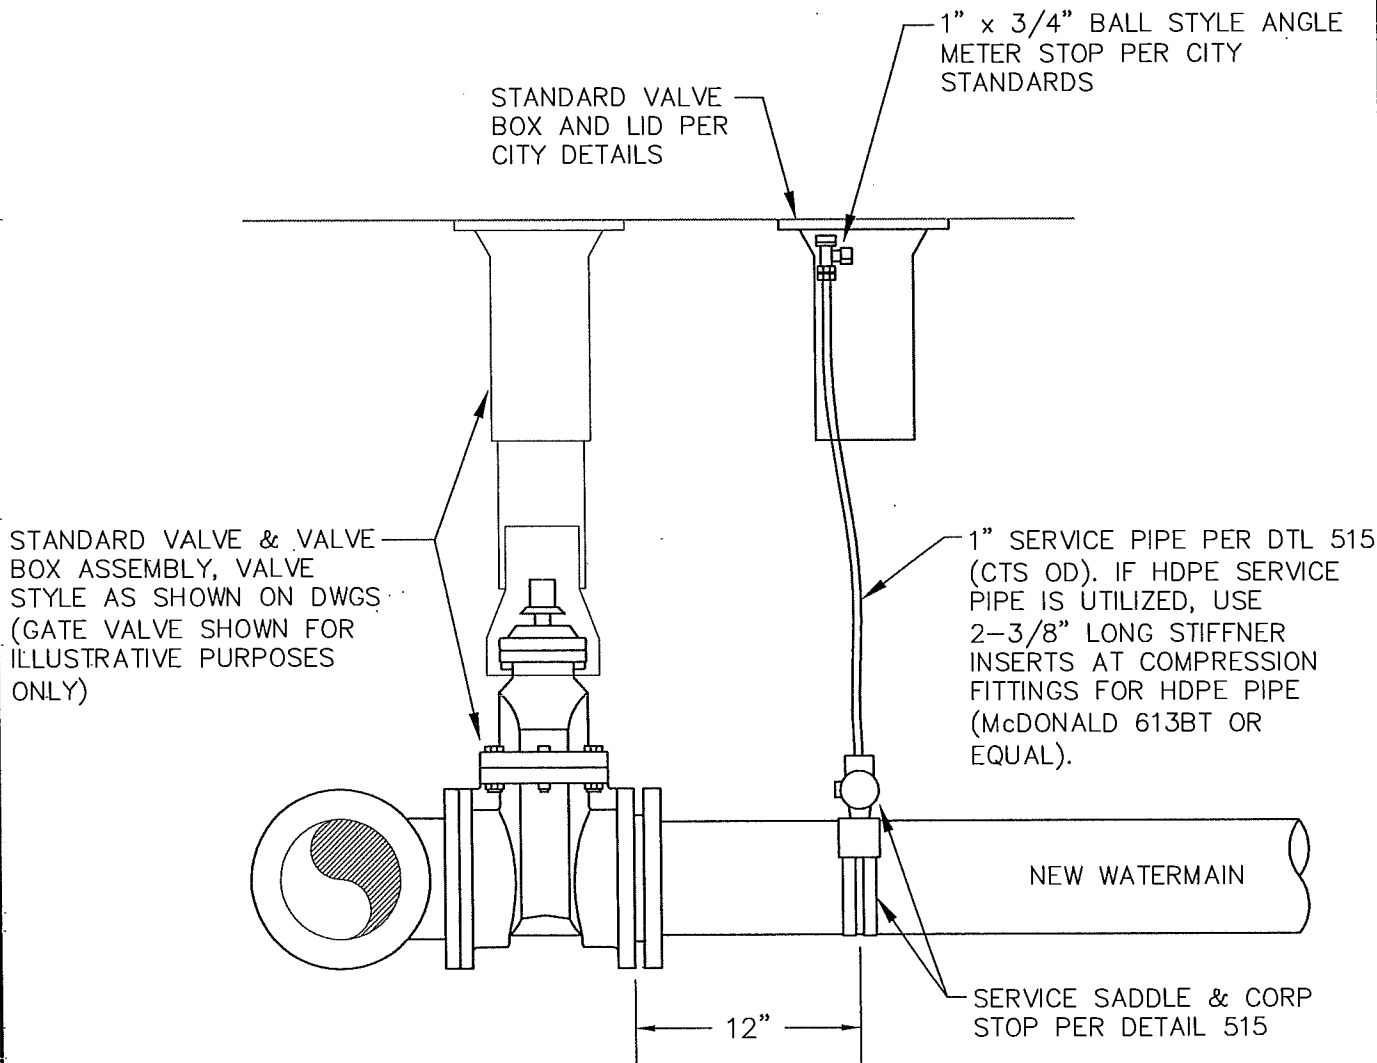


**NOTES:**

1. DISTANCE FROM WATERLINE VALVE TO CHLORINE TAP SHALL BE 12" UNLESS OTHERWISE DIRECTED OR APPROVED IN WRITING BY THE PUBLIC WORKS DIRECTOR OR DESIGNEE.
2. THE VALVE BOX SHOWN (OVER THE CHLORINATION METER STOP) IS NOT REQUIRED IF THE CHLORINATION LINE TERMINATES WITH THE METER STOP LOCATED BEHIND THE CURB. IF THE CHLORINATION LINE TERMINATES BEHIND THE CURB, THE METER STOP SHALL BE SET 6" ABOVE FINISH GRADE AND CLEARLY MARKED WITH ORANGE FLAGGING AND A TRAFFIC CONE.
3. UNLESS OTHERWISE DIRECTED BY THE CITY, THE CHLORINATION PROCESS SHALL BE COMPLETED BY THE CONTRACTOR PER CITY STANDARDS, UNDER THE OBSERVATION OF PUBLIC WORKS STAFF.
4. UNLESS OTHERWISE DIRECTED BY THE CITY, THE CONTRACTOR SHALL NOT REMOVE THE CHLORINATION ASSEMBLY UNTIL AFTER RECEIVING NOTICE OF NEGATIVE BACTERIOLOGICAL TEST RESULTS AND AFTER APPROVAL FROM PUBLIC WORKS. CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIAL, EXCAVATION, BACKFILL, FINAL SURFACE RESTORATION, ETC.
5. UNLESS OTHERWISE APPROVED OR REQUIRED (IN WRITING) BY THE PUBLIC WORKS DIRECTOR, ALL EXTRA PIPE & FITTINGS ASSOCIATED WITH THE CHLORINATION TAP ASSEMBLY SHALL BE REMOVED AFTER THE NEW WATERLINE IS PLACED IN SERVICE. THE CHLORINATION TAP SHALL BE CAPPED WITH A BRASS CAP ON THE CORP STOP (TO AVOID DEPRESSURIZING THE MAINLINE AFTER DISINFECTION). EACH CAPPED CORP STOP SHALL BE WRAPPED IN PLASTIC PRIOR TO BACKFILLING.
6. THE LOCATION OF EACH CAPPED CHLORINATION CORP STOP SHALL BE SHOWN ON THE CONTRACTOR'S RECORD DRAWINGS AND ALSO ON THE FINAL AS-BUILTS.


LAST REVISION DATE: JAN 2024	JO #
<b>POTABLE WATERLINE CHLORINATION TAP ASSEMBLY</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 519

NOTES:

- METER VAULT & PIPING SHALL CONFORM TO REQUIREMENTS OF ALL PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
- METER VAULT SHALL BE PLACED WITHIN RIGHT-OF-WAY UNLESS OTHERWISE APPROVED (RECORDED EASEMENT TO THE CITY REQUIRED FOR ANY METER ON PRIVATE PROPERTY).
- ALL MATERIALS (EXCEPT THE METER) SHALL BE FURNISHED & INSTALLED BY THE CONTRACTOR. THE CONTRACTOR SHALL INSTALL A TEMPORARY SPACER SPOOL BETWEEN METER ISOLATION VALVES FOR TESTING. THE TEMPORARY SPOOL SHALL MATCH THE LENGTH OF THE ACTUAL METER TO BE PROVIDED BY THE CITY.
- PIPING INSIDE VAULT & THROUGH WALLS TO BE CL 52 DUCTILE IRON, EXCEPT AS OTHERWISE SHOWN.
- METER WILL BE SUPPLIED BY THE CITY, BUT SHALL BE INSTALLED BY THE CONTRACTOR UNDER CITY INSPECTION AND APPROVAL, AFTER PRESSURE & OTHER TESTING OF METER VAULT PIPING (SEE \*\*).
- ISOLATION VALVES IN METER VAULT SHALL BE NON-RISING STEM GATE VALVE (EPOXY COATED) WITH 2-INCH SQUARE OPERATING NUT.
- ALL MJ CONNECTIONS (INCLUDING BYPASS LINE FITTINGS) SHALL BE ASSEMBLED WITH RETAINER GLANDS (EBBA MEGA-LUGS OR APPROVED EQUAL). ROMAC ALPHA FC ALLOWED AS EQUAL FOR HYMAX GRIP FC.
- ALL PIPE OPENINGS SHALL BE CORE DRILLED (REGARDLESS OF PRESENCE OF 'KNOCKOUTS'), AND SEALED WATERTIGHT WITH NON-SHRINK GROUT.
- PIPE SUPPORTS SHALL BE HOT DIP GALVANIZED STANDON OR APPR'D EQUAL AT ISOLATION VALVES (S89) AND AT BYPASS VALVE (S92).
- METER VAULT TO BE UTILITY VAULT 687-WA OR APPROVED EQUAL, CONFORMING WITH ASTM C-857. PROVIDE ALUMINUM ANGLE FRAME HATCH (48"x 72" MIN) BY USF FABRICATION OR APPROVED EQUAL (HATCH COVER TOP TO BE SAND BLASTED NON-SLIP).
  - TO BE 300 PSF PEDESTRIAN RATED WHERE LID IS SET MIN. OF 9" ABOVE GRADE.
  - TO BE H-20 RATED IF LID IS LESS THAN 9" ABOVE GRADE, OR IF LOCATED IN TRAFFIC AREA.
- METER VAULT SHALL BE PROVIDED WITH AN OSHA APPROVED GALVANIZED STEEL LADDER AND ALUMINUM LADDER SAFETY EXTENSION. ATTACH TO VAULT WITH STAINLESS STEEL BOLTS.
- CONTRACTOR TO INSTALL SUMP PUMP (5 GPM MIN) WITH 120V POWER SUPPLY, ALONG WITH PRIVATE POWER SOURCE (RESPONSIBILITY OF CONTRACTOR INSTALLING VAULT). SCHED 40 CONDUIT, WIRE, ETC. FOR SUMP PUMP POWER SHALL CONFORM WITH NEC REQUIREMENTS.
- SUMP PUMP DISCHARGE PIPE SHALL BE 1½-INCH SCHEDULE 40 PVC, PROVIDED WITH UNION (FOR PUMP REMOVAL), CHECK VALVE AND ISOLATION BALL VALVE. CONNECT DISCHARGE TO GRAVITY STORM DRAIN OR CURB WEEP HOLE (AT LOCATION APPROVED BY PUBLIC WORKS).
- SUMP TO BE 18" OR 24" φ CONCRETE PIPE OR EQUAL. PROVIDE FRP GRATE (OR SLOTTED MH LID) WITH COPED CUTOUT FOR DISCHARGE PIPING (IE. LID TO BE REMOVABLE WITHOUT DISASSEMBLING DISCHARGE PIPING). SUMP TO BE LARGE ENOUGH & DEEP ENOUGH TO HOUSE PUMP & FLOAT, AND KEEP WATER LEVEL BELOW SLOPED FLOOR.

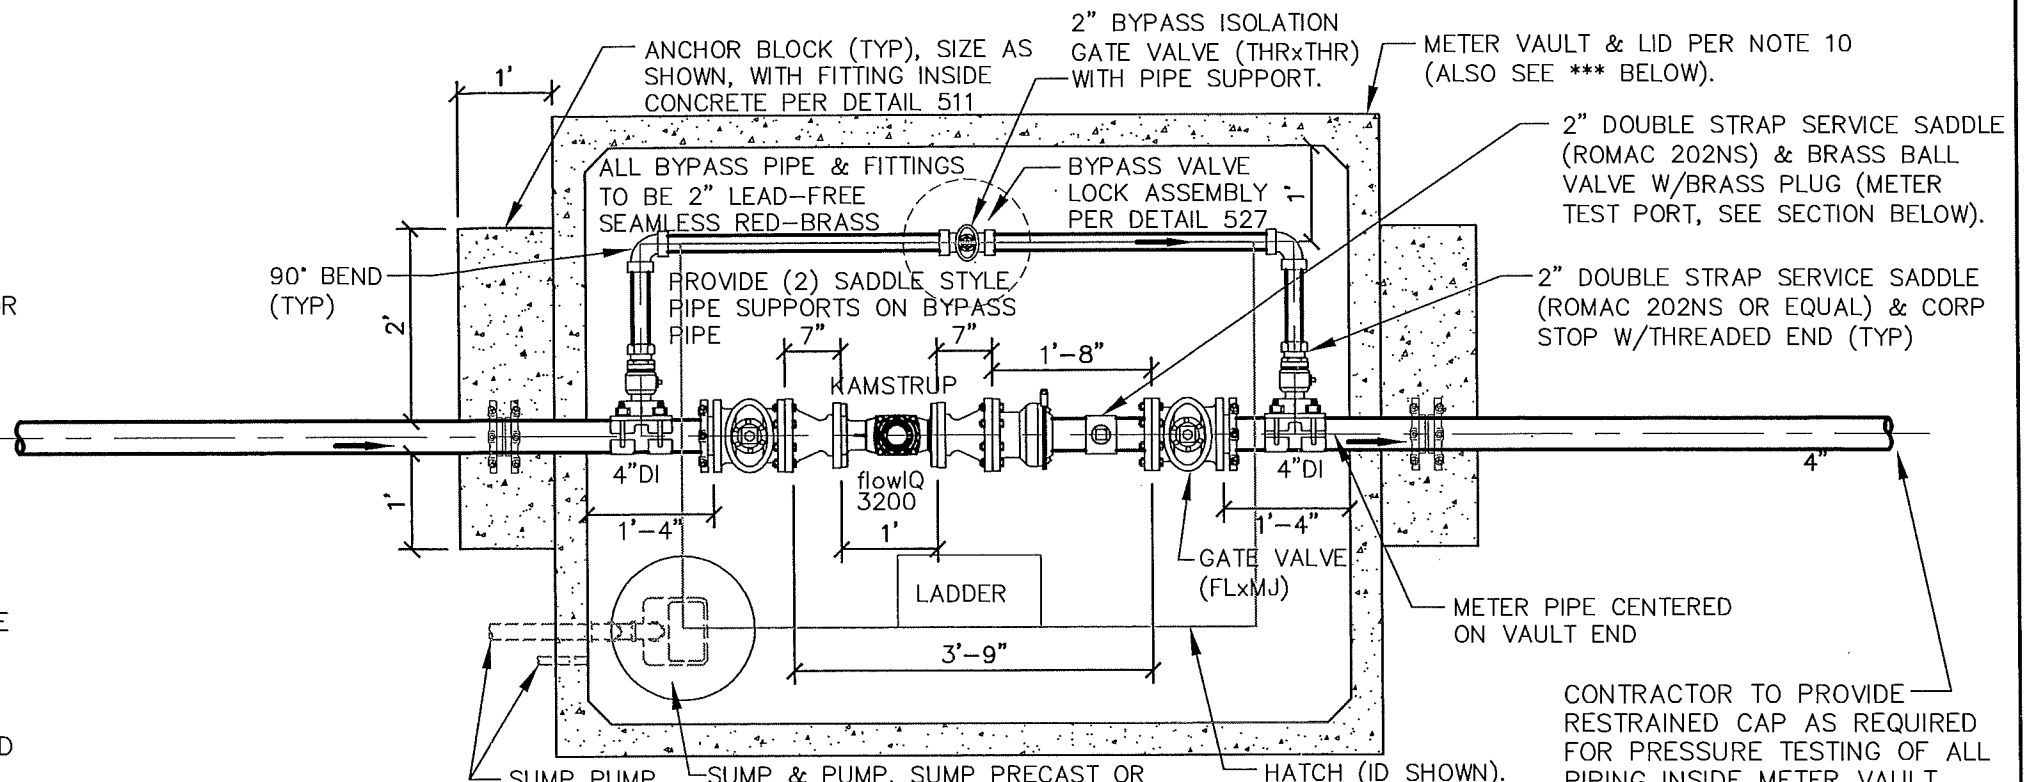

PLAN  
NTS

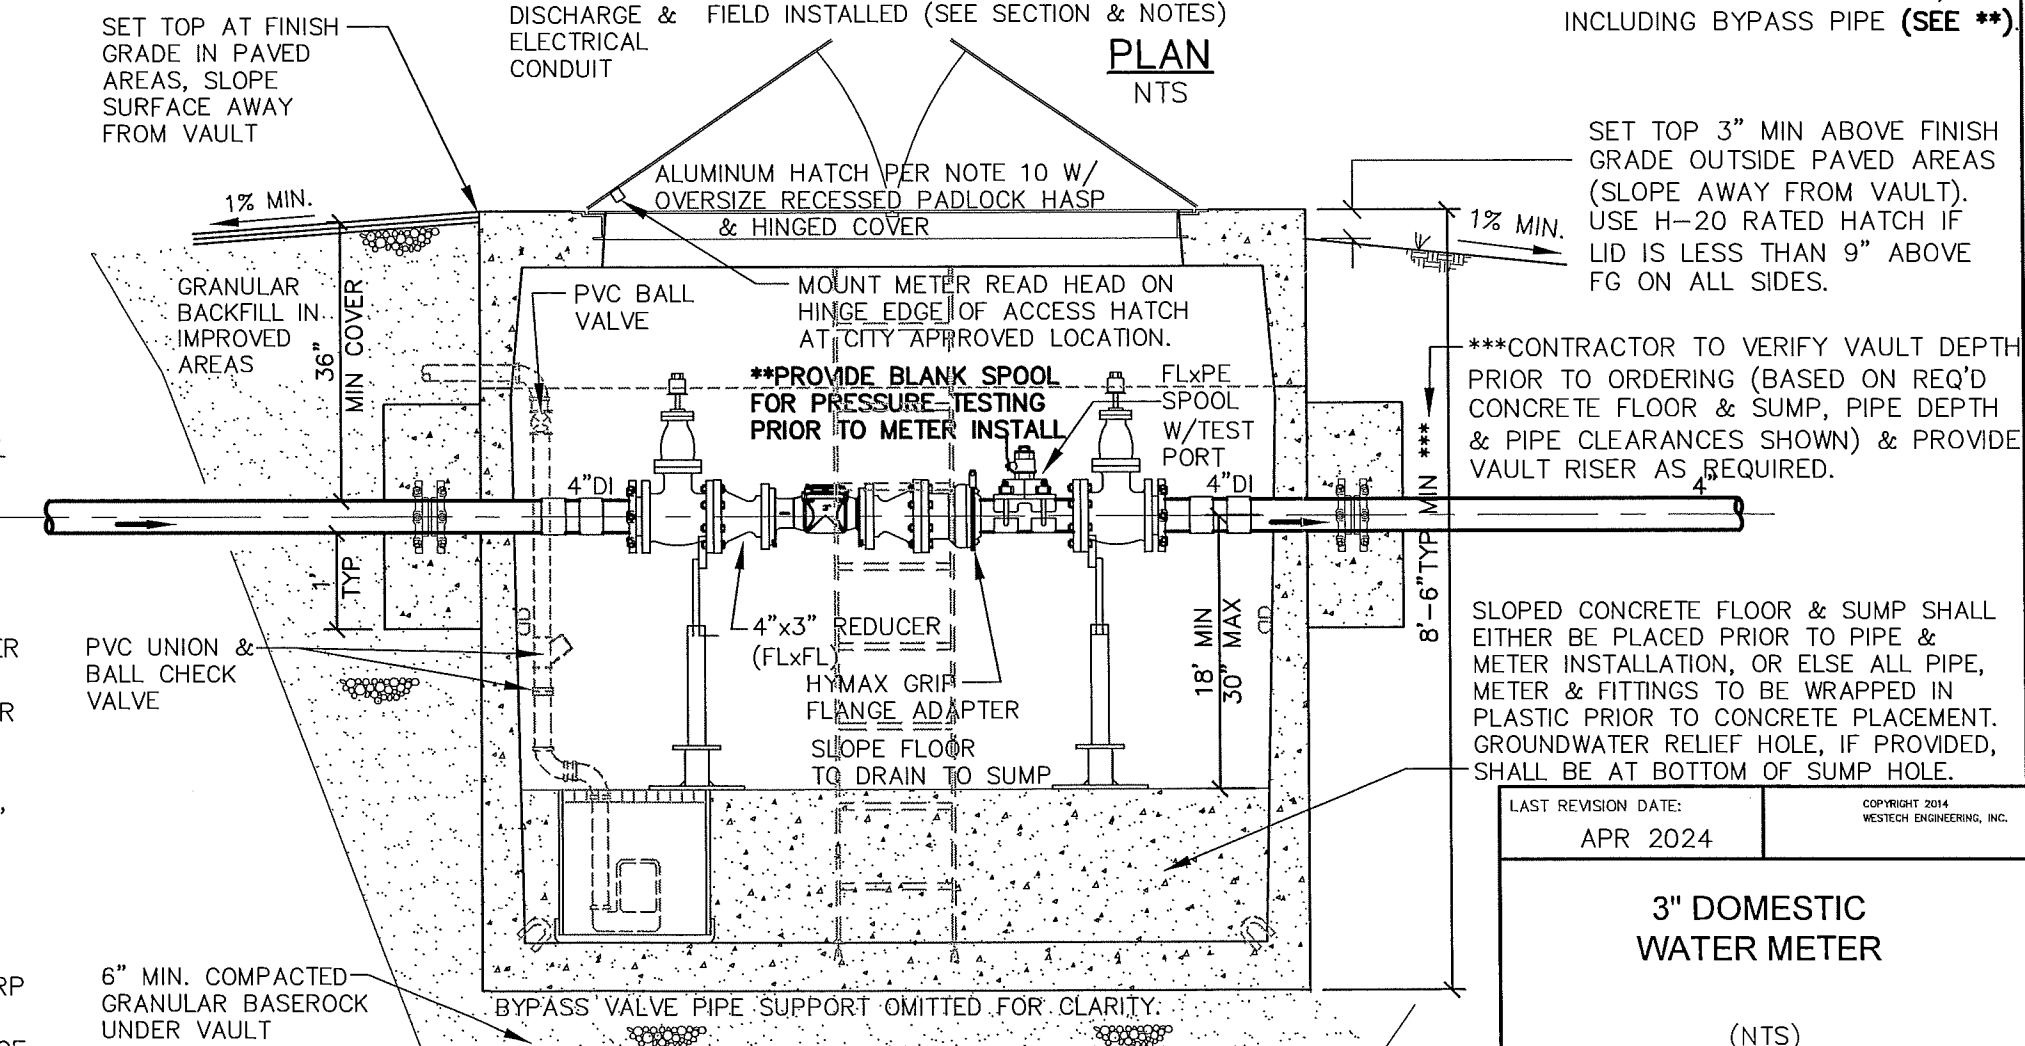


SECTION  
NTS


LAST REVISION DATE: APR 2024	COPYRIGHT 2014 WESTECH ENGINEERING, INC.
<b>3" DOMESTIC WATER METER</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 523

NOTES:

- METER VAULT & PIPING SHALL CONFORM TO REQUIREMENTS OF ALL PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
- METER VAULT SHALL BE PLACED WITHIN RIGHT-OF-WAY UNLESS OTHERWISE APPROVED (RECORDED EASEMENT TO THE CITY REQUIRED FOR ANY METER ON PRIVATE PROPERTY).
- ALL MATERIALS (EXCEPT THE METER) SHALL BE FURNISHED & INSTALLED BY THE CONTRACTOR. THE CONTRACTOR SHALL INSTALL A TEMPORARY SPACER SPOOL BETWEEN METER ISOLATION VALVES FOR TESTING. THE TEMPORARY SPOOL SHALL MATCH THE LENGTH OF THE ACTUAL METER TO BE PROVIDED BY THE CITY.
- PIPING INSIDE VAULT & THROUGH WALLS TO BE CL 52 DUCTILE IRON, EXCEPT AS OTHERWISE SHOWN.
- METER WILL BE SUPPLIED BY THE CITY, BUT SHALL BE INSTALLED BY THE CONTRACTOR UNDER CITY INSPECTION AND APPROVAL, AFTER PRESSURE & OTHER TESTING OF METER VAULT PIPING (SEE \*\*).
- ISOLATION VALVES IN METER VAULT SHALL BE NON-RISING STEM GATE VALVE (EPOXY COATED) WITH 2-INCH SQUARE OPERATING NUT.
- ALL MJ CONNECTIONS (INCLUDING BYPASS LINE FITTINGS) SHALL BE ASSEMBLED WITH RETAINER GLANDS (EBBA MEGA-LUGS OR APPROVED EQUAL). ROMAC ALPHA FC ALLOWED AS EQUAL FOR HYMAX GRIP FC.
- ALL PIPE OPENINGS SHALL BE CORE DRILLED (REGARDLESS OF PRESENCE OF 'KNOCKOUTS'), AND SEALED WATERTIGHT WITH NON-SHRINK GROUT.
- PIPE SUPPORTS SHALL BE HOT DIP GALVANIZED STANDON OR APPR'D EQUAL AT ISOLATION VALVES (S89) AND AT BYPASS VALVE (S92).
- METER VAULT TO BE UTILITY VAULT 687-WA OR APPROVED EQUAL, CONFORMING WITH ASTM C-857. PROVIDE ALUMINUM ANGLE FRAME HATCH (48"x 72" MIN) BY USF FABRICATION OR APPROVED EQUAL (HATCH COVER TOP TO BE SAND BLASTED NON-SLIP).
  - TO BE 300 PSF PEDESTRIAN RATED WHERE LID IS SET MIN. OF 9" ABOVE GRADE.
  - TO BE H-20 RATED IF LID IS LESS THAN 9" ABOVE GRADE, OR IF LOCATED IN TRAFFIC AREA.
- METER VAULT SHALL BE PROVIDED WITH AN OSHA APPROVED GALVANIZED STEEL LADDER AND ALUMINUM LADDER SAFETY EXTENSION. ATTACH TO VAULT WITH STAINLESS STEEL BOLTS.
- CONTRACTOR TO INSTALL SUMP PUMP (5 GPM MIN) WITH 120V POWER SUPPLY, ALONG WITH PRIVATE POWER SOURCE (RESPONSIBILITY OF CONTRACTOR INSTALLING VAULT). SCHED 40 CONDUIT, WIRE, ETC. FOR SUMP PUMP POWER SHALL CONFORM WITH NEC REQUIREMENTS.
- SUMP PUMP DISCHARGE PIPE SHALL BE 1½-INCH SCHEDULE 40 PVC, PROVIDED WITH UNION (FOR PUMP REMOVAL), CHECK VALVE AND ISOLATION BALL VALVE. CONNECT DISCHARGE TO GRAVITY STORM DRAIN OR CURB WEEP HOLE (AT LOCATION APPROVED BY PUBLIC WORKS).
- SUMP TO BE 18" OR 24" φ CONCRETE PIPE OR EQUAL. PROVIDE FRP GRATE (OR SLOTTED MH LID) WITH COPED CUTOUT FOR DISCHARGE PIPING (IE. LID TO BE REMOVABLE WITHOUT DISASSEMBLING DISCHARGE PIPING). SUMP TO BE LARGE ENOUGH & DEEP ENOUGH TO HOUSE PUMP & FLOAT, AND KEEP WATER LEVEL BELOW SLOPED FLOOR.

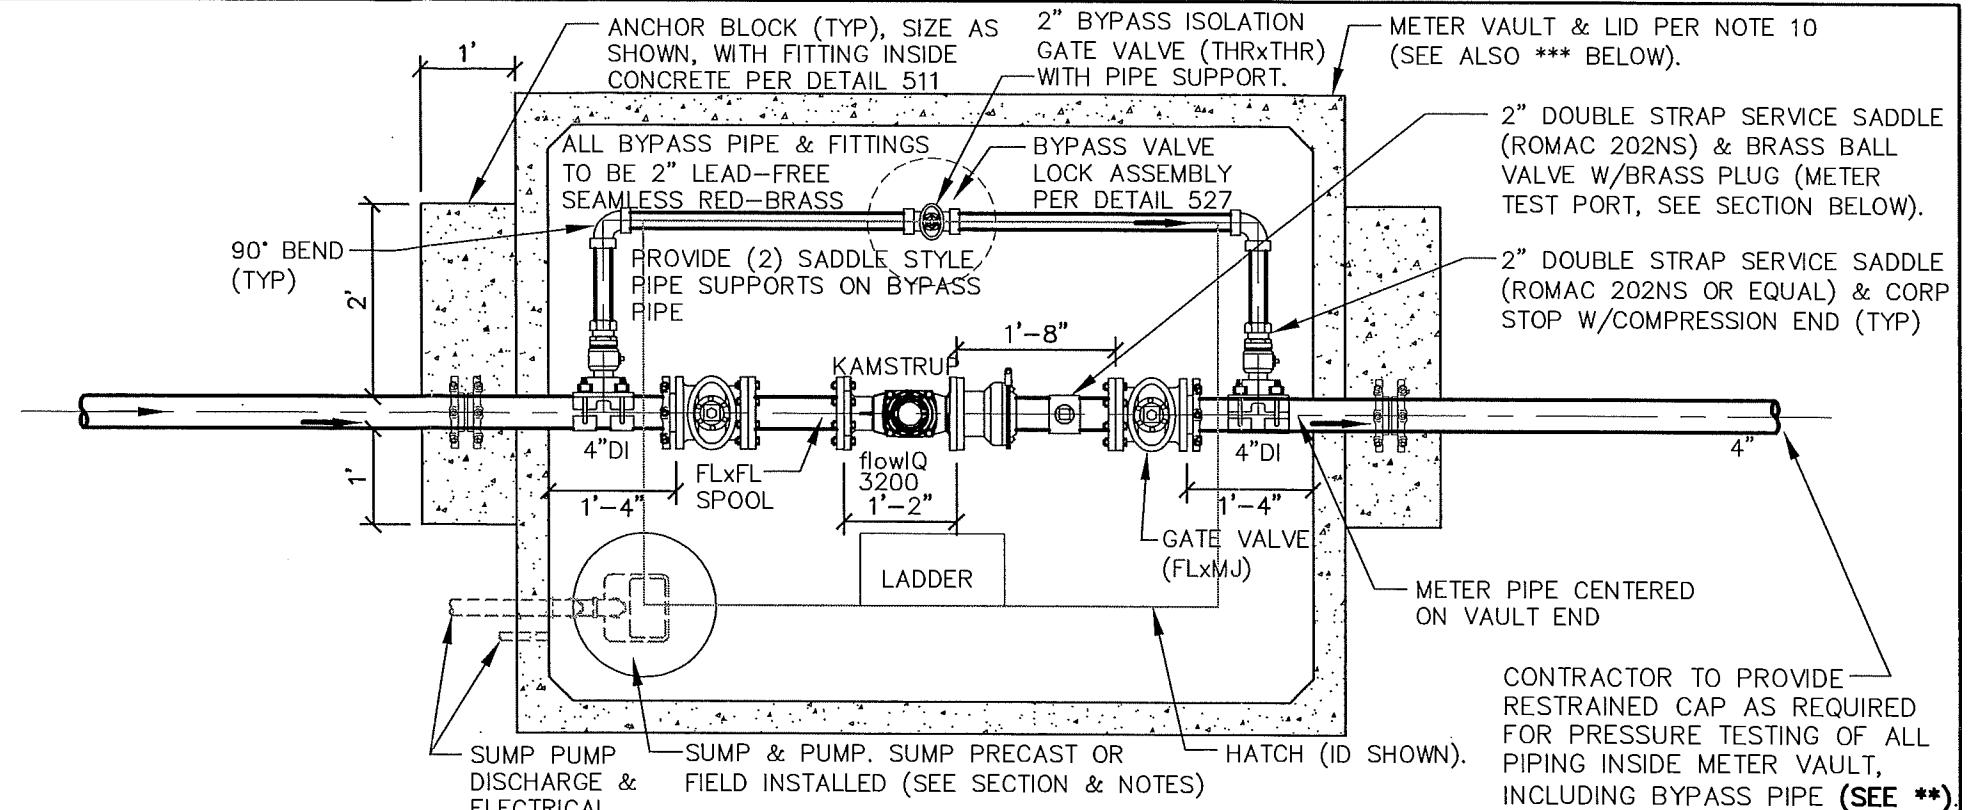

PLAN  
NTS

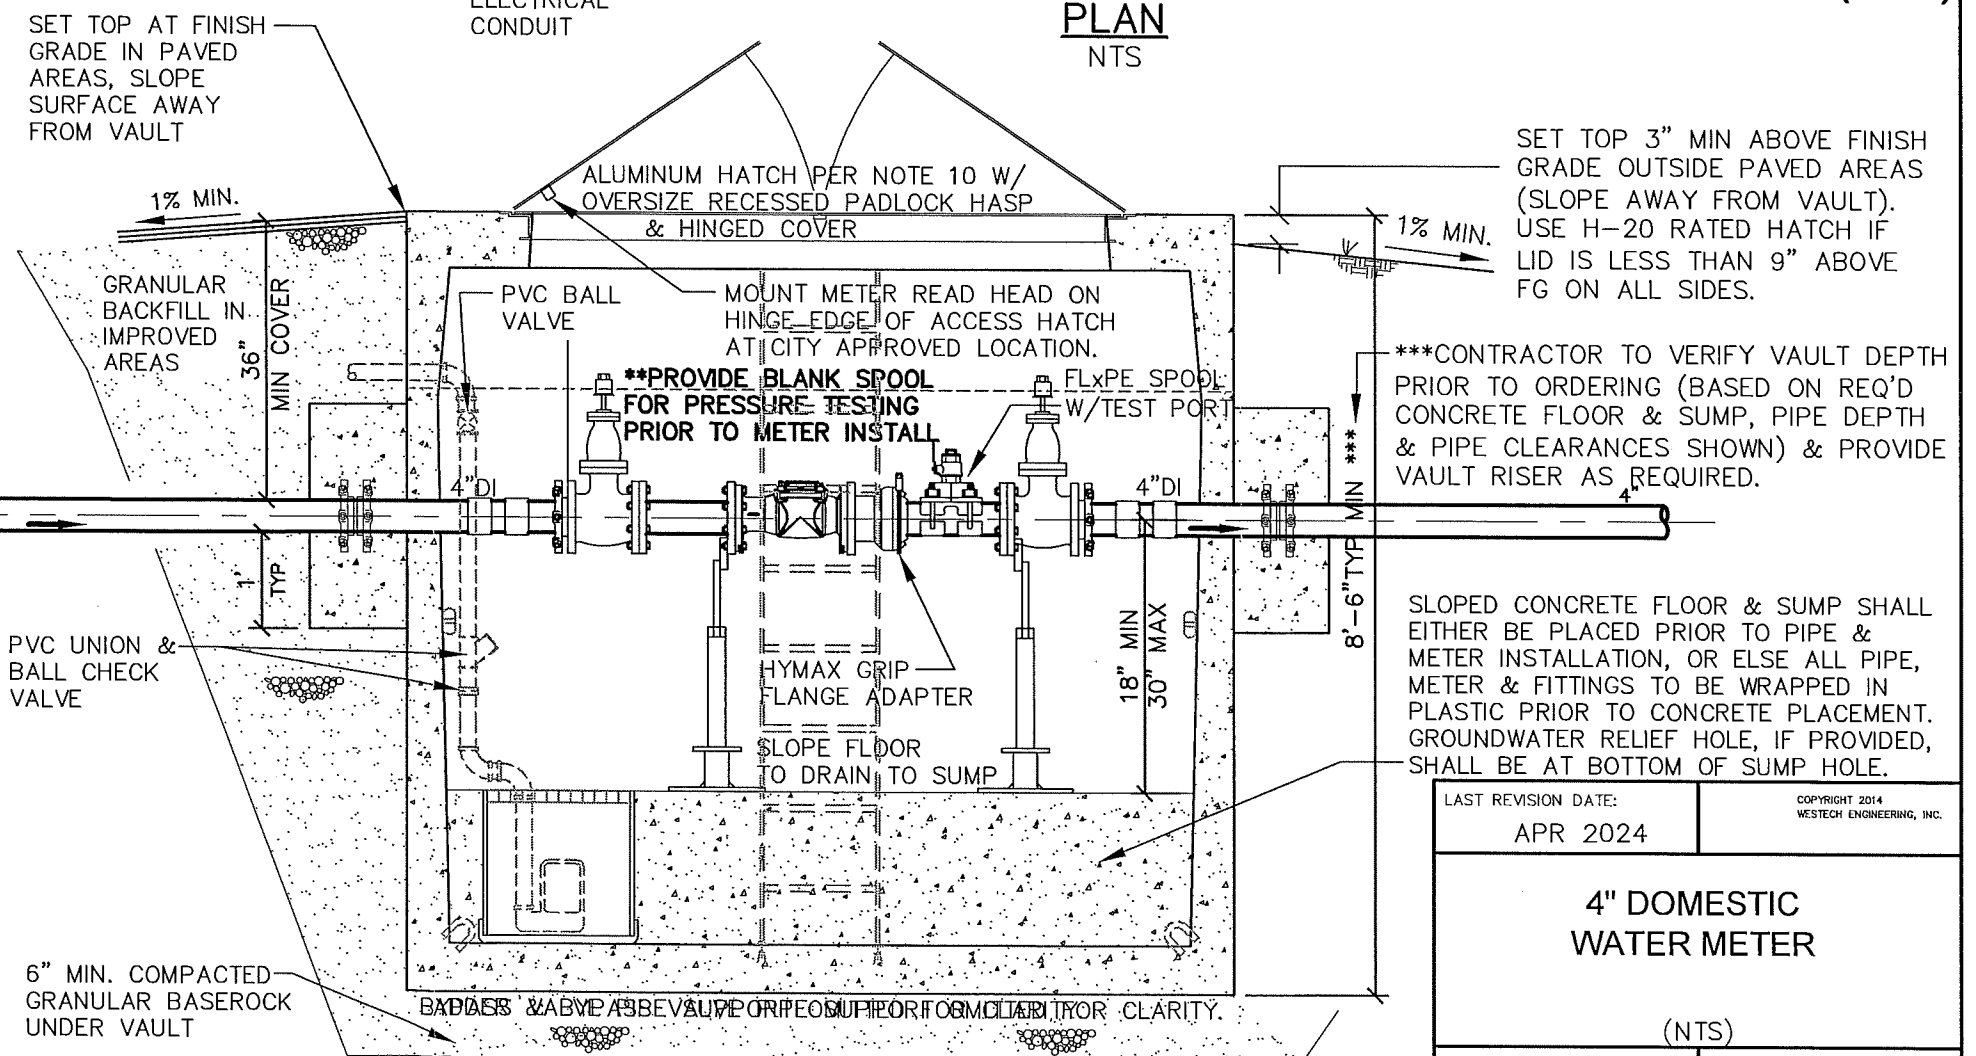


SECTION  
NTS


LAST REVISION DATE: APR 2024	COPYRIGHT 2014 WESTECH ENGINEERING, INC.
<b>4" DOMESTIC WATER METER</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>524</b>

**NOTES:**

- METER VAULT & PIPING SHALL CONFORM TO REQUIREMENTS OF ALL PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
- METER VAULT SHALL BE PLACED WITHIN RIGHT-OF-WAY UNLESS OTHERWISE APPROVED (RECORDED EASEMENT TO THE CITY REQUIRED FOR ANY METER ON PRIVATE PROPERTY).
- ALL MATERIALS (EXCEPT THE METER) SHALL BE FURNISHED & INSTALLED BY THE CONTRACTOR. THE CONTRACTOR SHALL INSTALL A TEMPORARY SPACER SPOOL BETWEEN METER ISOLATION VALVES FOR TESTING. THE TEMPORARY SPOOL SHALL MATCH THE LENGTH OF THE ACTUAL METER TO BE PROVIDED BY THE CITY.
- PIPING INSIDE VAULT & THROUGH WALLS TO BE CL 52 DUCTILE IRON, EXCEPT AS OTHERWISE SHOWN.
- METER WILL BE SUPPLIED BY THE CITY, BUT SHALL BE INSTALLED BY THE CONTRACTOR UNDER CITY INSPECTION AND APPROVAL, AFTER PRESSURE & OTHER TESTING OF METER VAULT PIPING (SEE \*\*).
- ISOLATION VALVES IN METER VAULT SHALL BE NON-RISING STEM GATE VALVE (EPOXY COATED) WITH 2-INCH SQUARE OPERATING NUT.
- ALL MJ CONNECTIONS (INCLUDING BYPASS LINE FITTINGS) SHALL BE ASSEMBLED WITH RETAINER GLANDS (EBBA MEGA-LUGS OR APPROVED EQUAL). ROMAC ALPHA FC ALLOWED AS EQUAL FOR HYMAX GRIP FC.
- ALL PIPE OPENINGS SHALL BE CORE DRILLED (REGARDLESS OF PRESENCE OF 'KNOCKOUTS'), AND SEALED WATERTIGHT WITH NON-SHRINK GROUT.
- PIPE SUPPORTS SHALL BE HOT DIP GALVANIZED STANDON OR APPR'D EQUAL AT ISOLATION VALVES (S89) AND AT BYPASS VALVE (S92).
- METER VAULT TO BE UTILITY VAULT 687-WA OR APPROVED EQUAL, CONFORMING WITH ASTM C-857. PROVIDE ALUMINUM ANGLE FRAME HATCH (48"x 72" MIN) BY USF FABRICATION OR APPROVED EQUAL (HATCH COVER TOP TO BE SAND BLASTED NON-SLIP).
  - TO BE 300 PSF PEDESTRIAN RATED WHERE LID IS SET MIN. OF 9" ABOVE GRADE.
  - TO BE H-20 RATED IF LID IS LESS THAN 9" ABOVE GRADE, OR IF LOCATED IN TRAFFIC AREA.
- METER VAULT SHALL BE PROVIDED WITH AN OSHA APPROVED GALVANIZED STEEL LADDER AND ALUMINUM LADDER SAFETY EXTENSION. ATTACH TO VAULT WITH STAINLESS STEEL BOLTS.
- CONTRACTOR TO INSTALL SUMP PUMP (5 GPM MIN) WITH 120V POWER SUPPLY, ALONG WITH PRIVATE POWER SOURCE (RESPONSIBILITY OF CONTRACTOR INSTALLING VAULT). SCHED 40 CONDUIT, WIRE, ETC. FOR SUMP PUMP POWER SHALL CONFORM WITH NEC REQUIREMENTS.
- SUMP PUMP DISCHARGE PIPE SHALL BE 1½-INCH SCHEDULE 40 PVC, PROVIDED WITH UNION (FOR PUMP REMOVAL), CHECK VALVE AND ISOLATION BALL VALVE. CONNECT DISCHARGE TO GRAVITY STORM DRAIN OR CURB WEEP HOLE (AT LOCATION APPROVED BY PUBLIC WORKS).
- SUMP TO BE 18" OR 24" φ CONCRETE PIPE OR EQUAL. PROVIDE FRP GRATE (OR SLOTTED MH LID) WITH COPED CUTOUT FOR DISCHARGE PIPING (IE. LID TO BE REMOVABLE WITHOUT DISASSEMBLING DISCHARGE PIPING). SUMP TO BE LARGE ENOUGH & DEEP ENOUGH TO HOUSE PUMP & FLOAT, AND KEEP WATER LEVEL BELOW SLOPED FLOOR.

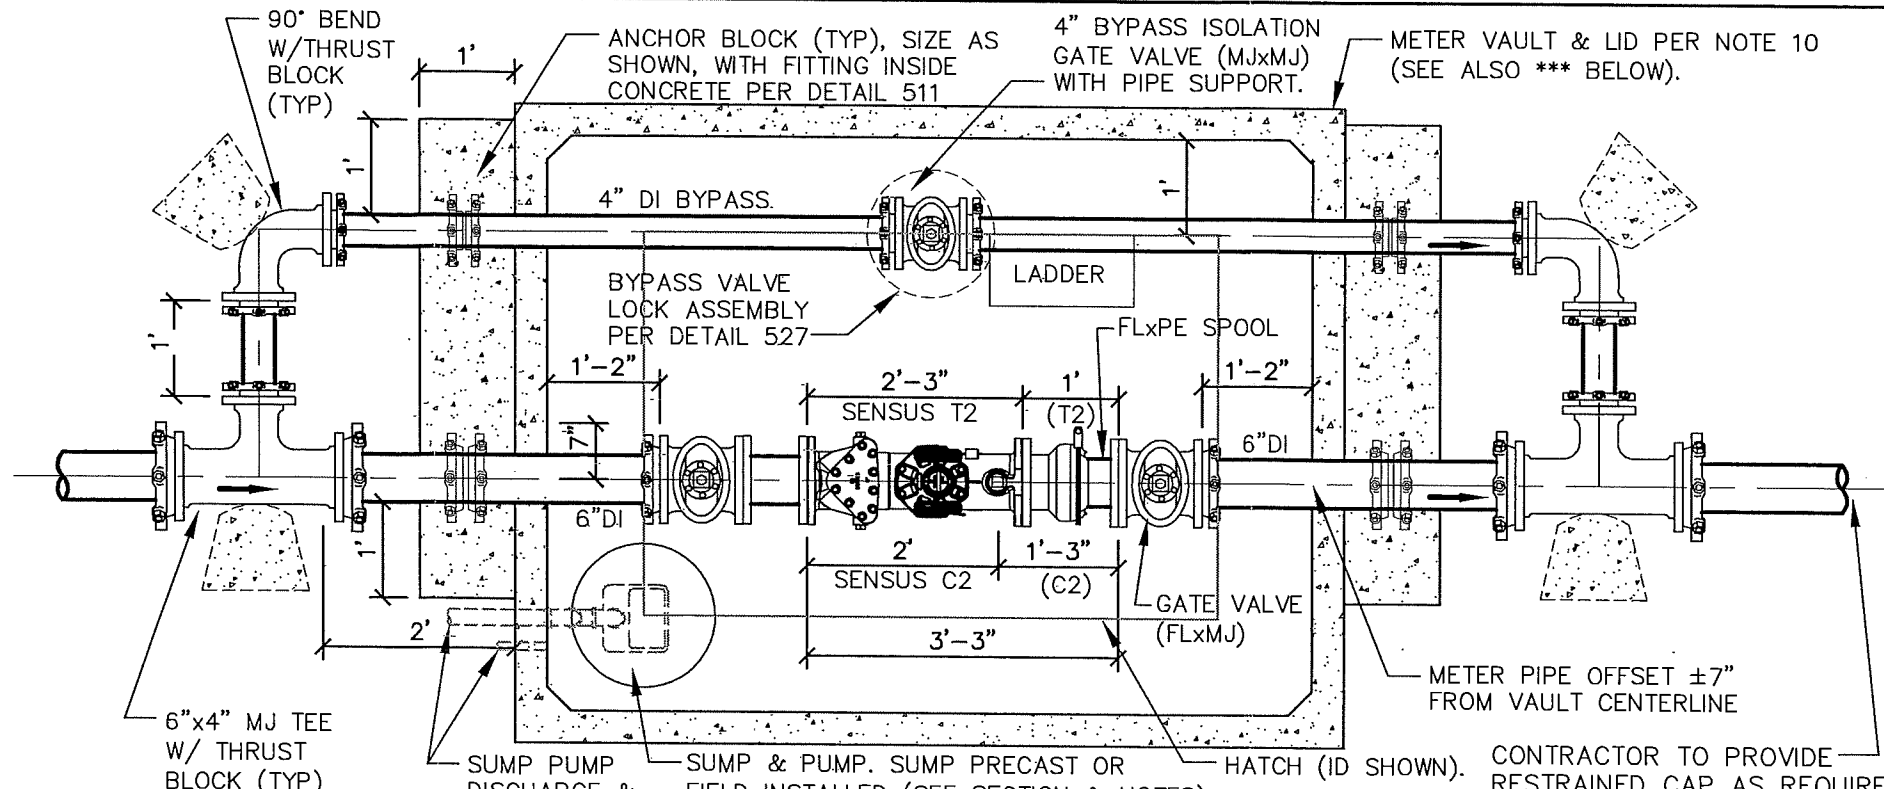

**PLAN**  
NTS

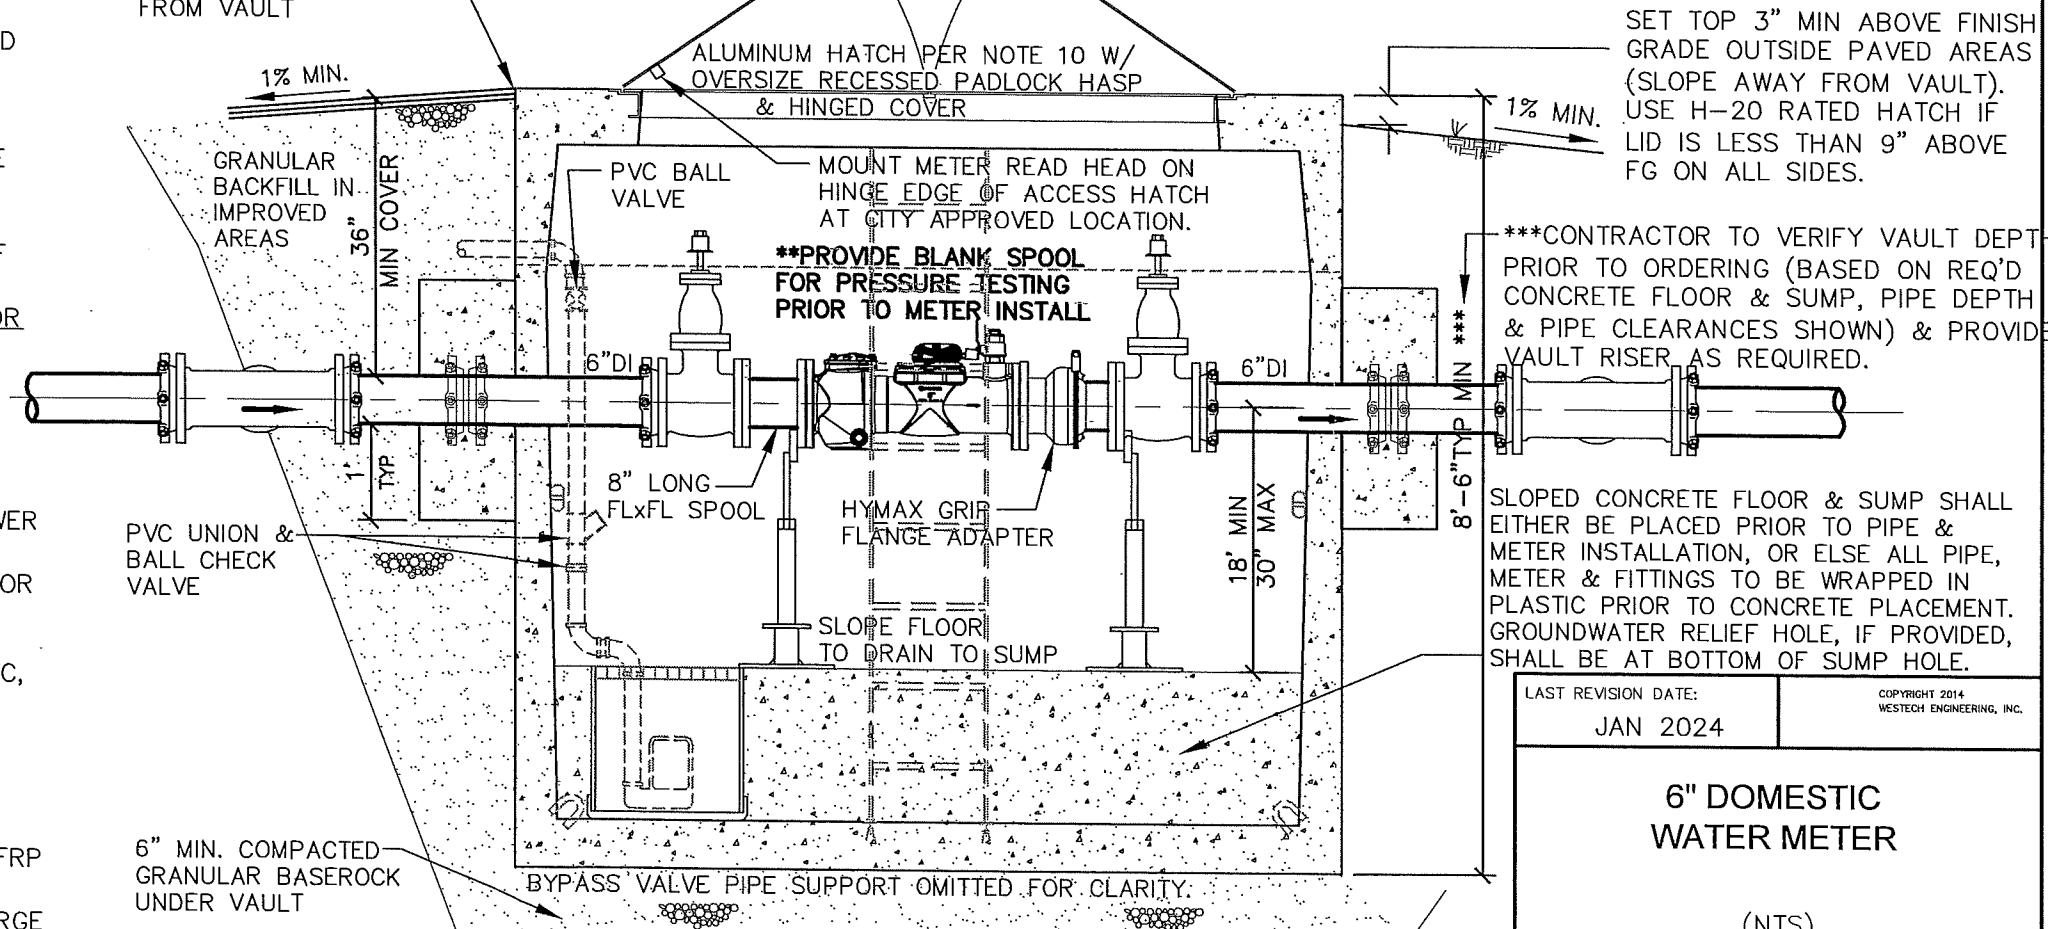

**SECTION**  
NTS

METER VAULT & LID PER NOTE 10 (SEE ALSO \*\*\* BELOW).

CONTRACTOR TO PROVIDE RESTRAINED CAP AS REQUIRED FOR PRESSURE TESTING OF ALL PIPING INSIDE METER VAULT, INCLUDING BYPASS PIPE (SEE \*\*).

SET TOP 3" MIN ABOVE FINISH GRADE OUTSIDE PAVED AREAS (SLOPE AWAY FROM VAULT). USE H-20 RATED HATCH IF LID IS LESS THAN 9" ABOVE FG ON ALL SIDES.

\*\*\*CONTRACTOR TO VERIFY VAULT DEPTH PRIOR TO ORDERING (BASED ON REQ'D CONCRETE FLOOR & SUMP, PIPE DEPTH & PIPE CLEARANCES SHOWN) & PROVIDE VAULT RISER AS REQUIRED.


SLOPED CONCRETE FLOOR & SUMP SHALL EITHER BE PLACED PRIOR TO PIPE & METER INSTALLATION, OR ELSE ALL PIPE, METER & FITTINGS TO BE WRAPPED IN PLASTIC PRIOR TO CONCRETE PLACEMENT. GROUNDWATER RELIEF HOLE, IF PROVIDED, SHALL BE AT BOTTOM OF SUMP HOLE.

LAST REVISION DATE: JAN 2024	COPYRIGHT 2014 WESTECH ENGINEERING, INC.
<b>6" DOMESTIC WATER METER</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>525</b>




**NOTES:**

- METER VAULT & PIPING SHALL CONFORM TO REQUIREMENTS OF ALL PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
- METER VAULT SHALL BE PLACED WITHIN RIGHT-OF-WAY UNLESS OTHERWISE APPROVED (RECORDED EASEMENT TO THE CITY REQUIRED FOR ANY METER ON PRIVATE PROPERTY).
- ALL MATERIALS (EXCEPT THE METER) SHALL BE FURNISHED & INSTALLED BY THE CONTRACTOR. THE CONTRACTOR SHALL INSTALL A TEMPORARY SPACER SPOOL BETWEEN METER ISOLATION VALVES FOR TESTING. THE TEMPORARY SPOOL SHALL MATCH THE LENGTH OF THE ACTUAL METER TO BE PROVIDED BY THE CITY.
- PIPING INSIDE VAULT & THROUGH WALLS TO BE CL 52 DUCTILE IRON, EXCEPT AS OTHERWISE SHOWN.
- METER WILL BE SUPPLIED BY THE CITY, BUT SHALL BE INSTALLED BY THE CONTRACTOR UNDER CITY INSPECTION AND APPROVAL, AFTER PRESSURE & OTHER TESTING OF METER VAULT PIPING (SEE \*\*).
- ISOLATION VALVES IN METER VAULT SHALL BE NON-RISING STEM GATE VALVE (EPOXY COATED) WITH 2-INCH SQUARE OPERATING NUT.
- ALL MJ CONNECTIONS (INCLUDING BYPASS LINE FITTINGS) SHALL BE ASSEMBLED WITH RETAINER GLANDS (EBBA MEGA-LUGS OR APPROVED EQUAL). ROMAC ALPHA FC ALLOWED AS EQUAL FOR HYMAX GRIP FC.
- ALL PIPE OPENINGS SHALL BE CORE DRILLED (REGARDLESS OF PRESENCE OF 'KNOCKOUTS'), AND SEALED WATERTIGHT WITH NON-SHRINK GROUT.
- PIPE SUPPORTS SHALL BE HOT DIP GALVANIZED STANDON OR APPR'D EQUAL AT ISOLATION VALVES (S89) AND AT BYPASS VALVE (S92).
- METER VAULT TO BE UTILITY VAULT 687-WA OR APPROVED EQUAL, CONFORMING WITH ASTM C-857. PROVIDE ALUMINUM ANGLE FRAME HATCH (48"x 72" MIN) BY USF FABRICATION OR APPROVED EQUAL (HATCH COVER TOP TO BE SAND BLASTED NON-SLIP).
  - TO BE 300 PSF PEDESTRIAN RATED WHERE LID IS SET MIN. OF 9" ABOVE GRADE.
  - TO BE H-20 RATED IF LID IS LESS THAN 9" ABOVE GRADE, OR IF LOCATED IN TRAFFIC AREA.
- METER VAULT SHALL BE PROVIDED WITH AN OSHA APPROVED GALVANIZED STEEL LADDER AND ALUMINUM LADDER SAFETY EXTENSION. ATTACH TO VAULT WITH STAINLESS STEEL BOLTS.
- CONTRACTOR TO INSTALL SUMP PUMP (5 GPM MIN) WITH 120V POWER SUPPLY, ALONG WITH PRIVATE POWER SOURCE (RESPONSIBILITY OF CONTRACTOR INSTALLING VAULT). SCHED 40 CONDUIT, WIRE, ETC. FOR SUMP PUMP POWER SHALL CONFORM WITH NEC REQUIREMENTS.
- SUMP PUMP DISCHARGE PIPE SHALL BE 1½-INCH SCHEDULE 40 PVC, PROVIDED WITH UNION (FOR PUMP REMOVAL), CHECK VALVE AND ISOLATION BALL VALVE. CONNECT DISCHARGE TO GRAVITY STORM DRAIN OR CURB WEEP HOLE (AT LOCATION APPROVED BY PUBLIC WORKS).
- SUMP TO BE 18" OR 24" φ CONCRETE PIPE OR EQUAL. PROVIDE FRP GRATE (OR SLOTTED MH LID) WITH COPED CUTOUT FOR DISCHARGE PIPING (IE. LID TO BE REMOVABLE WITHOUT DISASSEMBLING DISCHARGE PIPING). SUMP TO BE LARGE ENOUGH & DEEP ENOUGH TO HOUSE PUMP & FLOAT, AND KEEP WATER LEVEL BELOW SLOPED FLOOR.

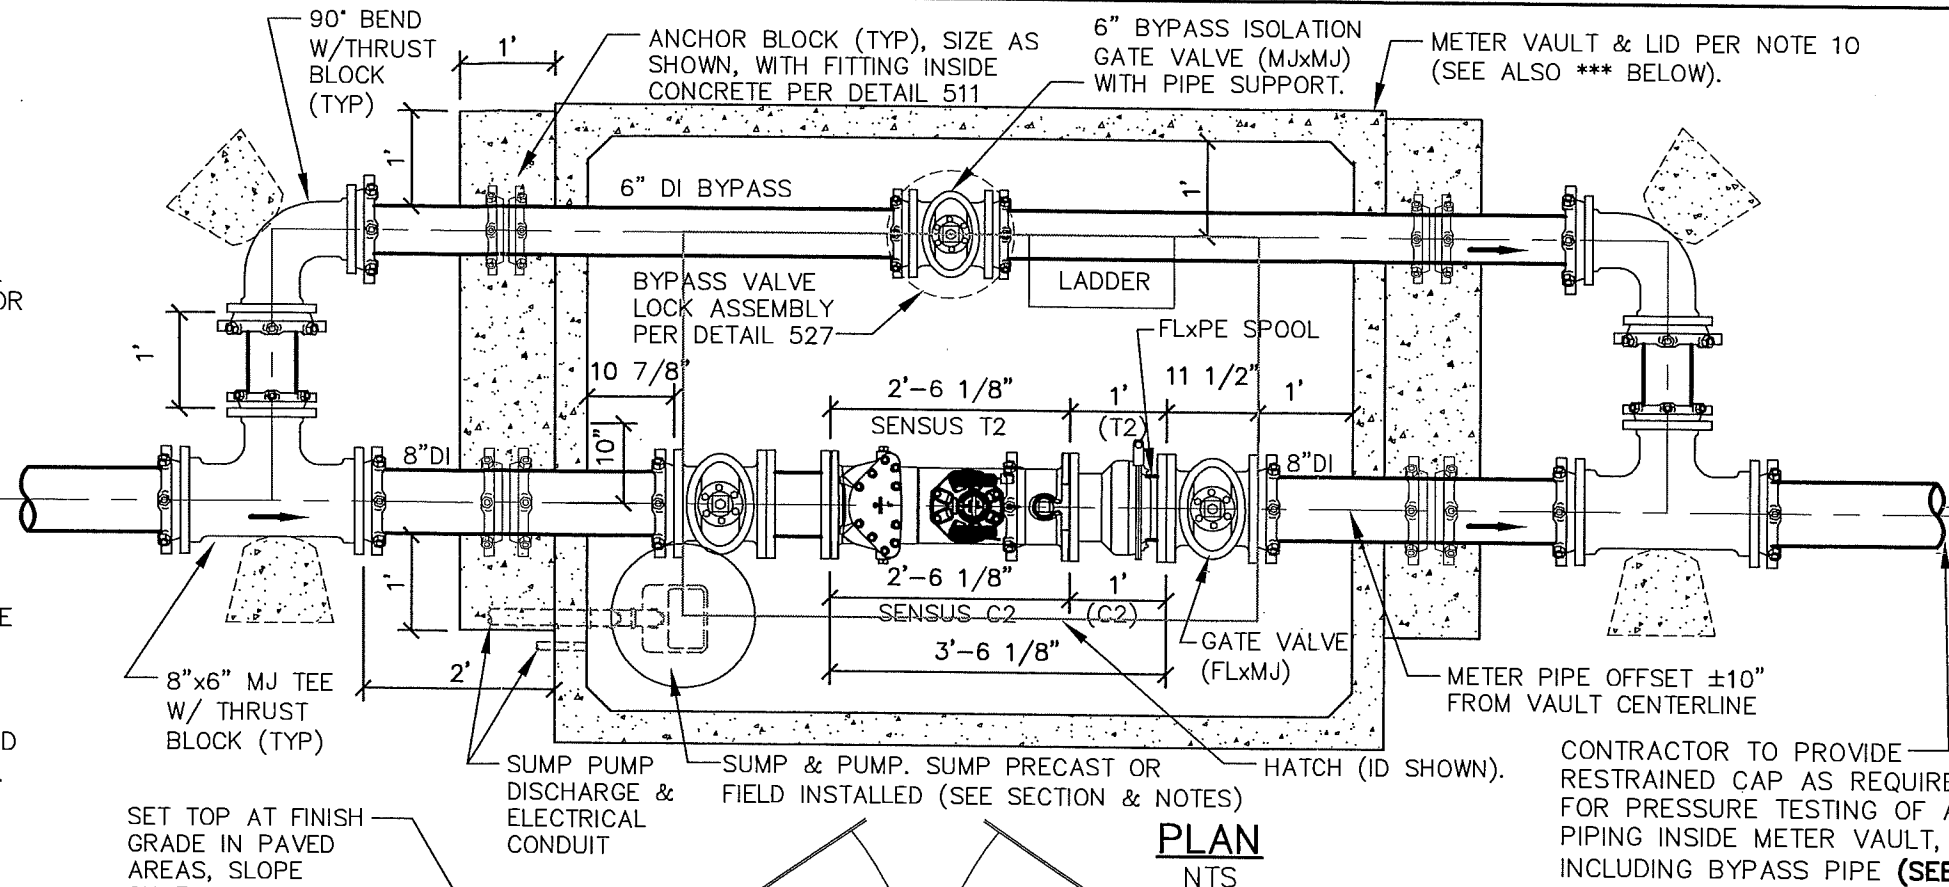


SET TOP AT FINISH GRADE IN PAVED AREAS, SLOPE SURFACE AWAY FROM VAULT


CONTRACTOR TO PROVIDE RESTRAINED CAP AS REQUIRED FOR PRESSURE TESTING OF ALL PIPING INSIDE METER VAULT, INCLUDING BYPASS PIPE (SEE \*\*).

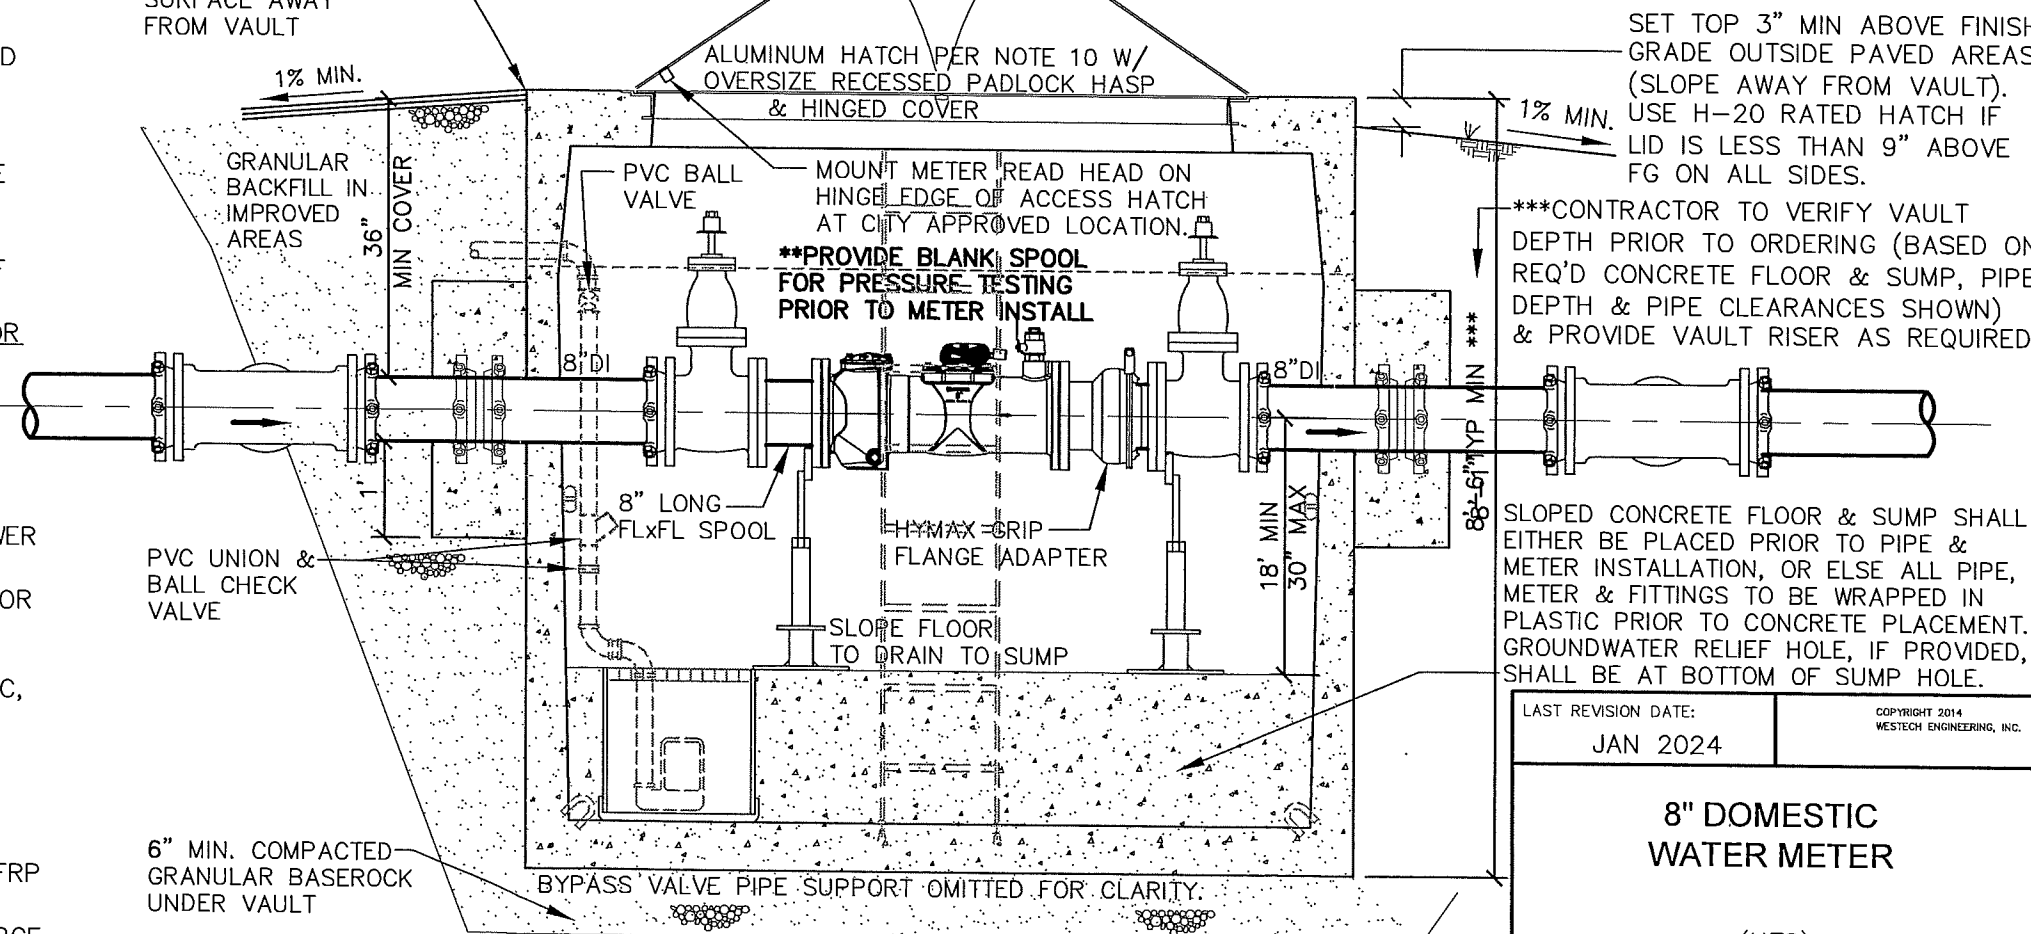

LAST REVISION DATE:		COPYRIGHT 2014 WESTECH ENGINEERING, INC.	
JAN 2024			
<b>8" DOMESTIC WATER METER</b>			
(NTS)			
DAYTON, OR		DETAIL NO. 526	

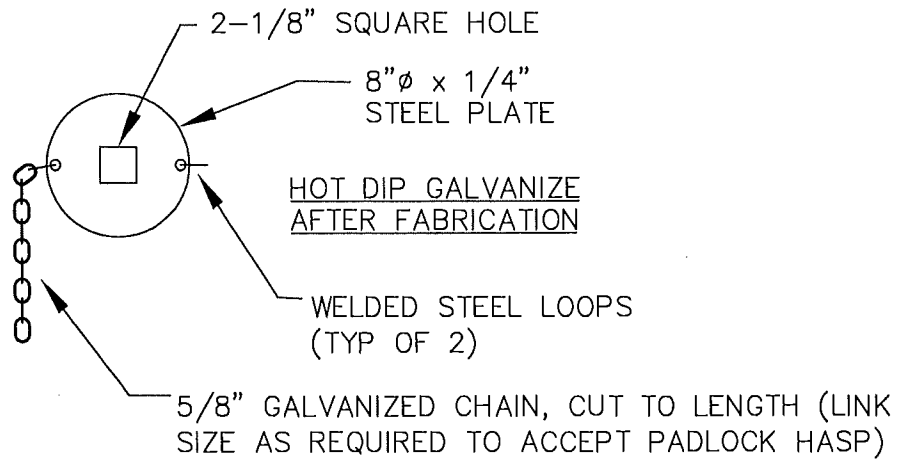

TOP VIEW

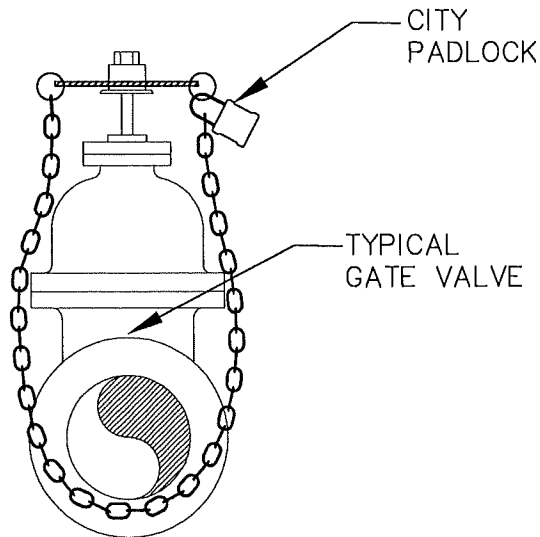

SIDE VIEW


NOTES:

1. UNLESS OTHERWISE REQUIRED BY PUBLIC WORKS, PROVIDE ONE LOCK ASSEMBLY PER VAULT.
2. VALVE LOCK ASSEMBLY TO BE HOT DIP GALVANIZED AFTER FABRICATION.

LAST REVISION DATE: AUG 2014	JO #
WATER METER VAULT BYPASS VALVE LOCK	
(NTS)	
DAYTON, OR	DETAIL NO. 527



METER TEST PORT CONSISTING OF SHORT BRASS NIPPLE, BRASS BALL VALVE PROVISIONS FOR LOCKING HANDLE, & BRASS PLUG IN TOP OF BALL VALVE (SIZE TO MATCH TEST PORT ON METER).

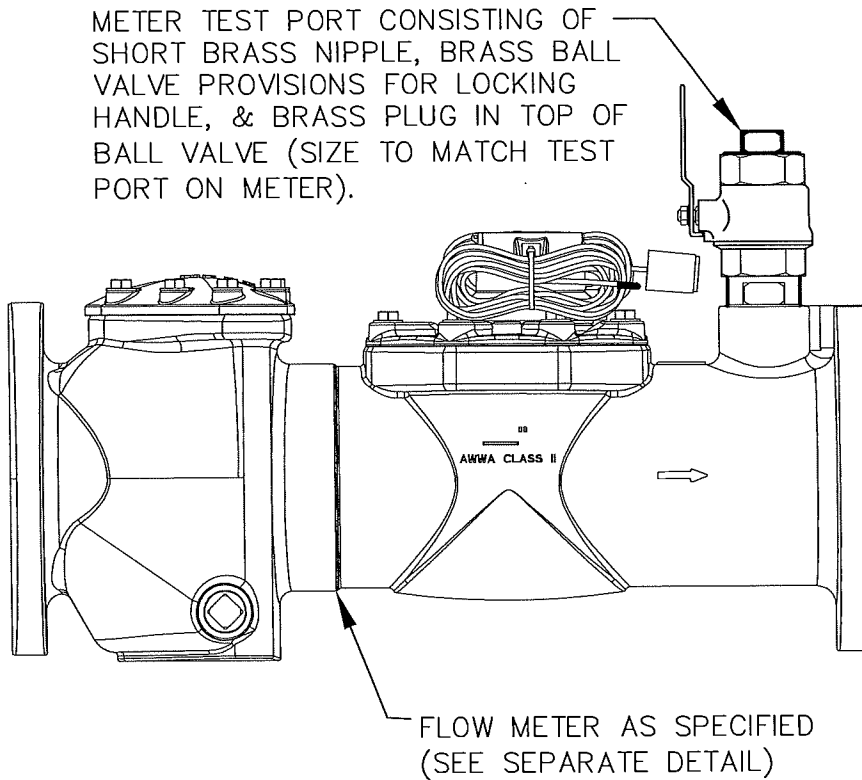


**OPTION A (FOR METER W/TEST PORT TAP)**  
 FOR METERS WITHOUT AN INTEGRAL TEST PORT TAP,  
 SEE NOTE 2 BELOW.

NOTES:

1. UNLESS OTHERWISE APPROVED IN WRITING BY THE PUBLIC WORKS DIRECTOR AND CITY ENGINEER, ALL METERS 3" & LARGER SHALL BE PROVIDED WITH A TEST PORT ASSEMBLY IN THE VAULT (DOWNSTREAM OF THE METER) CONSISTING OF A BRASS NIPPLE, BALL VALVE AND BRASS PLUG AS SHOWN ABOVE.
2. FOR METERS WITHOUT A BUILT-IN TEST PORT TAP, PROVIDE A 2" TEST PORT INSIDE THE VAULT (DOWNSTREAM OF METER) ON A 2" DOUBLE STRAP SERVICE SADDLE (ROMAC 202NS OR EQUAL), WITH BALL VALVE & BRASS PLUG AS SHOWN ABOVE.
3. METER TESTING. THE CONTRACTOR SHALL PROVIDE ALL FITTINGS & HOSES NECESSARY TO TEST FLOW WATER THROUGH THE METER AFTER INSTALLATION, IN ORDER TO DEMONSTRATE PROPER OPERATION OF THE METER WITH PUBLIC WORKS STAFF PRESENT (CONTRACTOR SHALL COORDINATE WITH METER REPRESENTATIVE AS NECESSARY FOR SUCH TESTING & DEMONSTRATION OF PROPER OPERATION).


LAST REVISION DATE:	
APR 2024	
<b>WATER METER TEST PORT ASSEMBLY</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 528

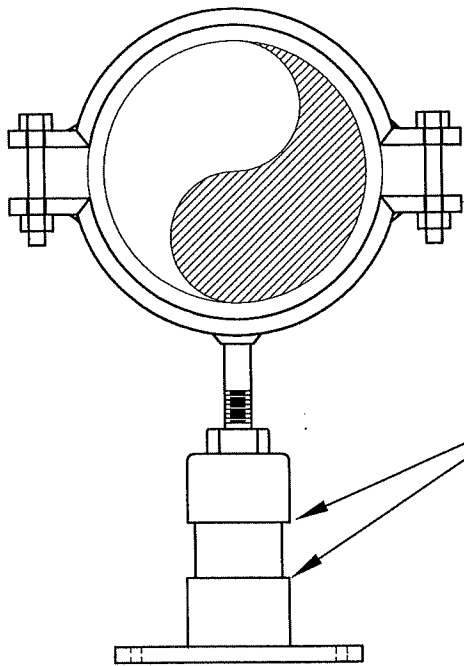

STANDON MODEL C92 ADJUSTABLE PIPE SUPPORT (GALVANIZED STEEL TOP & BASE) OR EQUAL (PROVIDE NEOPRENE LINER FOR STEEL OR PVC PIPE)

WHERE FULLY RESTAINED SUPPORTS ARE SPECIFIED OR NOTED ON THE DRAWING, FILLET TACK WELD SUPPORT PIPE TO BASE AND TOP COLLARS AFTER INSTALLATION (E70XX ELECTRODES FOR WELDS). COAT WELDS WITH HIGH ZINC PAINT (2 COATS), TYP ALL.

**FULL CIRCLE CLAMP STYLE SUPPORT**

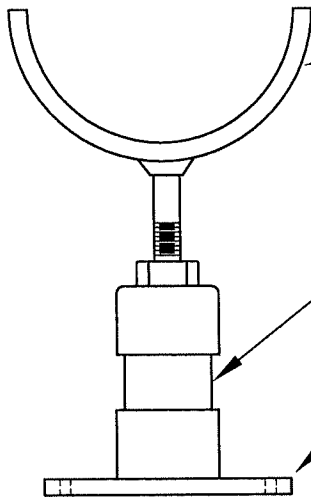


STANDON MODEL S92 ADJUSTABLE PIPE SUPPORT (GALVANIZED STEEL TOP & BASE) OR EQUAL (PROVIDE NEOPRENE LINER FOR STEEL OR PVC PIPE)

SCHEDULE 40 GALVANIZED STEEL PIPE (TYP ALL STYLES, LENGTH AS REQUIRED), DIA. PER MANUFACTURER'S RECOMMENDATIONS

INSTALL (4) EACH 1/2" X 4" STAINLESS STEEL CONCRETE ANCHORS OR STUD ANCHORS WITH NUTS (TYP ALL STYLES).


**SADDLE STYLE SUPPORT**

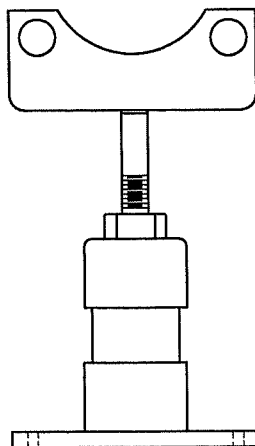

STANDON MODEL C89 ADJUSTABLE PIPE SUPPORT (GALVANIZED STEEL TOP & BASE) OR EQUAL

12" SQUARE CONCRETE PIER BLOCK FOR SUPPORT IN AREAS WITHOUT SLAB OR PAVEMENT. ANCHOR BOLTS/STUDS AS NOTED ABOVE.

**FLANGE STYLE SUPPORT**

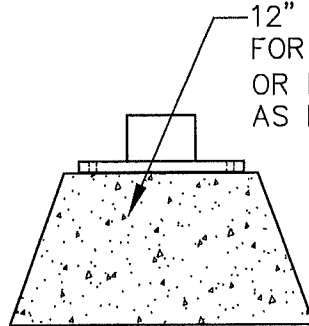

**BASE IN AREA W/OUT HARD SURFACE**

LAST REVISION DATE:

JAN 2018

COPYRIGHT 2018 WESTECH ENGINEERING, INC.


**GALVANIZED PIPE SUPPORTS W/GALVANIZED EXT. PIPE (FLANGE, SADDLE & CLAMP)**

(NTS)

DAYTON, OR

DETAIL NO.

529

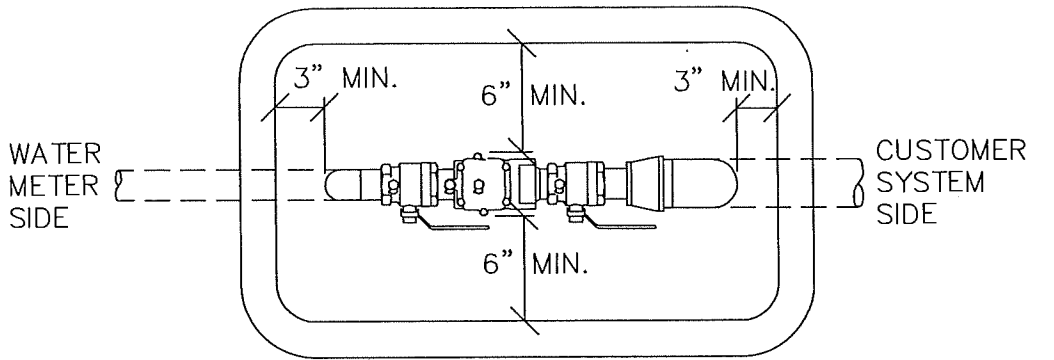


**PLAN**

PLASTIC OR POLYMER CONCRETE BOX, SIZE & DEPTH AS REQUIRED FOR CLEARANCES LISTED.

3/4"-2" FEBCO MODEL 850 DOUBLE CHECK ASSEMBLY (OR EQUAL) (SEE PLANS FOR SPECIFIED SIZE)

INCREASER ALLOWED ON DOWN STREAM SIDE (OPTIONAL)

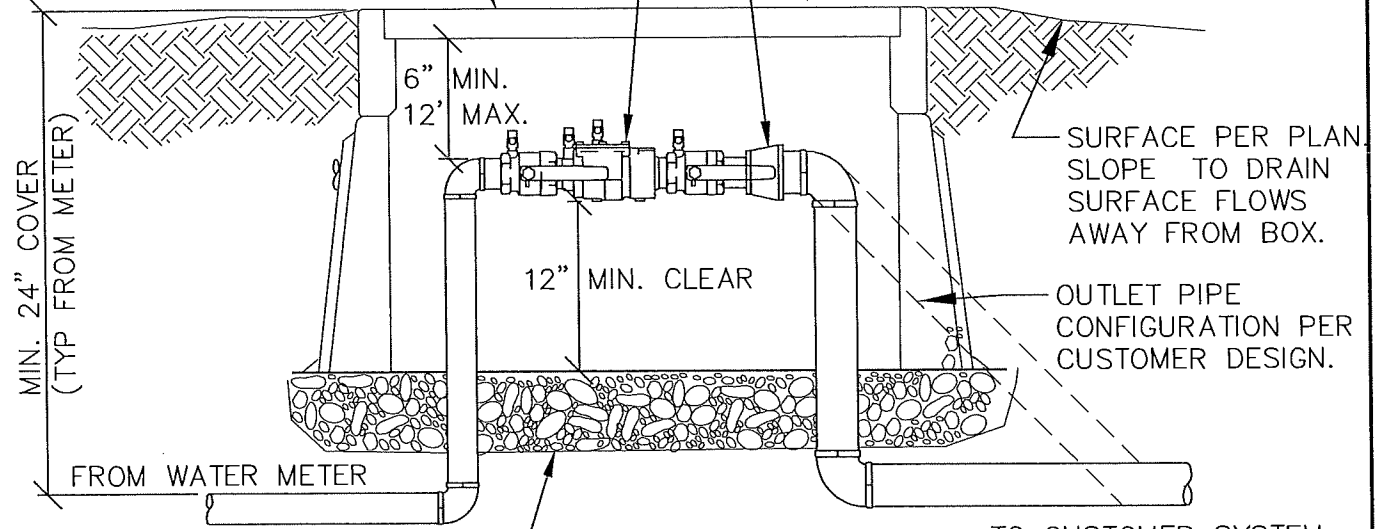

**ELEVATION**

MIN. 6" THICK PEA ROCK OR CLEAN GRANULAR ROCK UNDER BOX FOOTPRINT.

**USE OF PURPLE PVC PRIMER ON ALL PVC SOLVENT CEMENT JOINTS IS MANDATORY (SEE ALSO OPSC 605.12.2).**

**NOTES:**

1. VERIFY THE ENCLOSURE/BOX DIMENSIONS & DEPTH ARE ADEQUATE FOR CLEARANCES SHOWN, BASED ON THE SIZE OF THE DCA AND FITTINGS ACTUALLY PROVIDED & INSTALLED.
2. ENCLOSURE/BOX SHALL BE CENTERED OVER THE COMPLETED DOUBLE CHECK ASSEMBLY.
3. PER OAR 333-61-0071, DCA SHALL NOT BE SUBJECT TO CONTINUOUS IMMERSION.
4. DCA's SHALL BE INSTALLED ABOVE THE 100 YEAR FLOOD LEVEL UNLESS OTHERWISE APPROVED IN WRITING BY THE PUBLIC WORKS DIRECTOR.
5. BYPASS LINES AROUND DOUBLE CHECK ASSEMBLIES ARE NOT ALLOWED.
6. DCA's SHALL BE PROVIDED WITH BRASS OR PLASTIC PLUGS IN ALL TEST PORTS.
7. DCA SHALL BE LOCATED ON PRIVATE PROPERTY, AND SHALL NOT BE INSTALLED IN SIDEWALKS OR AREAS SUBJECT TO VEHICULAR TRAFFIC.
8. THE PROPERTY OWNER IS RESPONSIBLE TO MAINTAIN A MINIMUM OF 3 FEET OF MAINTENANCE ACCESS WORKING CLEARANCE AROUND DCA ENCLOSURES/BOXES.
9. PRIOR TO REQUESTING APPROVAL OR FINAL INSPECTION BY THE CITY, CONTRACTOR SHALL HAVE DCA TESTED, AND COPIES OF TEST REPORTS PROVIDED TO PUBLIC WORKS.
10. PROPERTY OWNER SHALL BE RESPONSIBLE TO PROVIDE FREEZE PROTECTION DURING COLD WEATHER PERIODS AS NECESSARY.

LAST REVISION DATE: AUG 2022	JO # STANDARD
<b>2" AND SMALLER DOUBLE CHECK VALVE ASSEMBLY (DCA)</b> (NTS)	
DAYTON, OR	DETAIL NO. 531

PAD MOUNTED FIBERGLASS INSULATED ENCLOSURE W/HEATER, HOT BOX MODEL AS SHOWN ON TABLE (OR APPROVED EQUIVALENT). ANCHOR ENCLOSURE TO CONCRETE PAD PER MANUFACTURER'S REQUIREMENTS.

RPBA DIAMETER	HOT BOX MODEL
1"	HB1
1½"	HB1
2"	HB1.5

NOTE: VERIFY HB SIZE FOR OTHER CONFIGURATION OR MODEL OF RPBA DEVICE, TO ENSURE 3" MIN CLEARANCE AT EACH END (OAR 333-061-0071).

ELECTRICAL RECEPTACLE FOR HEAT TAPE (GFI). INSTALL HEAT TAPE OR ENCLOSURE HEATER FOR ALL ABOVE GRADE PIPING. MOUNT RECEPTACLE 18" ABOVE SLAB ON TOP OF RIGID CONDUIT OR ON UNI-STRUT.

REDUCED PRESSURE BACKFLOW ASSEMBLY (RPBA) MFR'D BY FEBCO, MODEL 825YA (OR APPROVED EQUAL)

DO NOT OBSTRUCT ENCLOSURE OPENINGS (TYP)

4" CONCRETE PAD

SURFACE PER PLAN SLOPE TO DRAIN

MIN. 2" COMPACTED GRANULAR BASEROCK

COMPACTED SUBGRADE

USE OF PURPLE PVC PRIMER ON ALL PVC SOLVENT CEMENT JOINTS IS MANDATORY (SEE ALSO OPSC 605.12.2).

WYE STRAINER  
12" MIN  
TYP (ALL WAYS)

SCH 80 PVC PIPE, TYPICAL BOTH VERTICAL RISERS

3" PIPE SLEEVE FIELD LOCATE (TYP 2)

ELECTRICAL CONDUIT & WIRE TO POWER SOURCE. COORDINATE AS REQ'D TO INSTALL 120V POWER.


SCHEDULE 40 PVC FROM WATER SERVICE, SIZE AS SHOWN ON PLANS

SCHEDULE 40 PVC TO BUILDING. SIZE AS SHOWN ON PLANS

**NOTES:**

1. RPBA- REDUCED PRESSURE BACKFLOW ASSEMBLY.
2. INSTALLATION OF RPBA & ENCLOSURE SHALL MEET OREGON HEALTH AUTHORITY, DRINKING WATER SERVICES REQUIREMENTS.
3. CONTRACTOR SHALL HAVE RPBA TESTED AND CERTIFIED PRIOR TO APPROVAL BY THE CITY, AND COPIES OF TEST REPORTS PROVIDED TO CITY.
4. RPBA & ENCLOSURE SHALL CONFORM TO REQUIREMENTS OF PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
5. ENCLOSURES SHALL HAVE A MINIMUM OF 3' CLEARANCE FROM ALL OTHER VAULTS OR STRUCTURES.
6. VERIFY ENCLOSURE DIMENSIONS ARE ADEQUATE FOR CLEARANCE BASED ON HEIGHT OF REDUCED PRESSURE ASSEMBLY.
7. ENCLOSURE SHALL BE CENTERED OVER THE COMPLETED REDUCED PRESSURE BACKFLOW ASSEMBLY.
8. POWER SHALL BE INSTALLED IN SCHEDULE 40 RIGID CONDUIT PER NEC REQUIREMENTS.
9. ALL CONCRETE SHALL BE 3,300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).
10. HOT BOX DRAINAGE OPENINGS SHALL NOT BE OBSTRUCTED BY GRADING OR PLANTINGS.
11. RPBA SHALL BE INSTALLED A MIN. OF 12 INCHES ABOVE THE 100-YEAR FLOOD ELEVATION AS DETERMINED BY FEMA.
12. FINISH GRADE TO SLOPE AWAY FROM ENCLOSURE SLAB AT 2% MIN. SLOPE.
13. AFTER CONSTRUCTION COMPLETION & ACCEPTANCE, PROPERTY OWNER IS RESPONSIBLE TO ENSURE FREEZE PROTECTION IS PLUGGED IN & WORKING DURING COLD WEATHER PERIODS AS NECESSARY.

LAST REVISION DATE: JAN 2024	JO # STANDARD
<b>2" AND SMALLER REDUCED PRESSURE BACKFLOW ASSEMBLY</b> (NTS)	
DAYTON, OR	DETAIL NO. 541

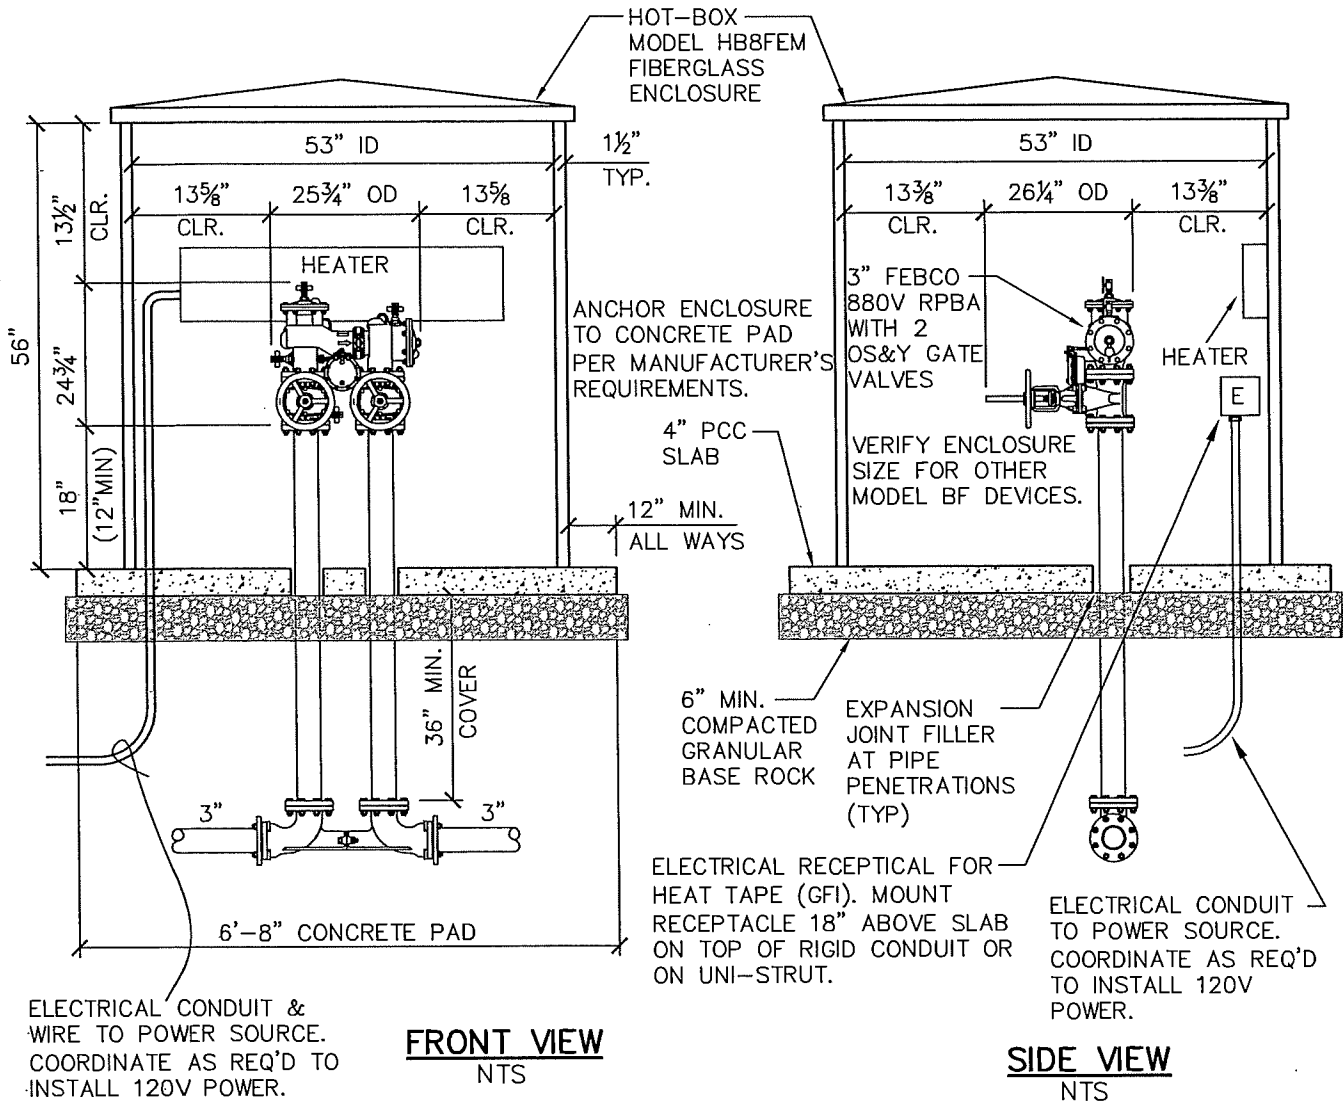


**NOTES:**

1. RPBA- REDUCED PRESSURE BACKFLOW ASSEMBLY.
2. INSTALLATION OF RPBA & ENCLOSURE SHALL MEET OREGON HEALTH AUTHORITY, DRINKING WATER SERVICES REQUIREMENTS.
3. CONTRACTOR SHALL HAVE RPBA TESTED AND CERTIFIED PRIOR TO APPROVAL BY THE CITY, AND COPIES OF TEST REPORTS PROVIDED TO CITY.
4. RPBA & ENCLOSURE SHALL CONFORM TO REQUIREMENTS OF PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
5. ENCLOSURES SHALL HAVE A MINIMUM OF 3' CLEARANCE FROM ALL OTHER VAULTS OR STRUCTURES.
6. VERIFY ENCLOSURE DIMENSIONS ARE ADEQUATE FOR CLEARANCE BASED ON HEIGHT OF REDUCED PRESSURE ASSEMBLY.
7. ENCLOSURE SHALL BE CENTERED OVER THE COMPLETED REDUCED PRESSURE BACKFLOW ASSEMBLY.
8. POWER SHALL BE INSTALLED IN SCHEDULE 40 RIGID CONDUIT PER NEC REQUIREMENTS.
9. ALL CONCRETE SHALL BE 3,300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).
10. HOT BOX DRAINAGE OPENINGS SHALL NOT BE OBSTRUCTED BY GRADING OR PLANTINGS.
11. RPBA SHALL BE INSTALLED A MIN. OF 12 INCHES ABOVE THE 100-YEAR FLOOD ELEVATION AS DETERMINED BY FEMA.
12. FINISH GRADE TO SLOPE AWAY FROM ENCLOSURE SLAB AT 2% MIN. SLOPE.
13. RISER PIPES & ABOVE GRADE PIPING SHALL BE DUCTILE IRON (CL 52 MIN).

LAST REVISION DATE: JAN 2024	JO #
<b>3" REDUCED PRESSURE ASSEMBLY</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>543</b>

MODEL NO. HB4E AS MANUFACTURED BY HOT BOX (1-800-736-0238) ANCHOR ENCLOSURE TO CONCRETE PAD PER MANUFACTURER'S REQUIREMENTS.

ELECTRICAL RECEPTICAL (GFI). MOUNT RECEPTACLE 18" ABOVE SLAB. HOT BOX

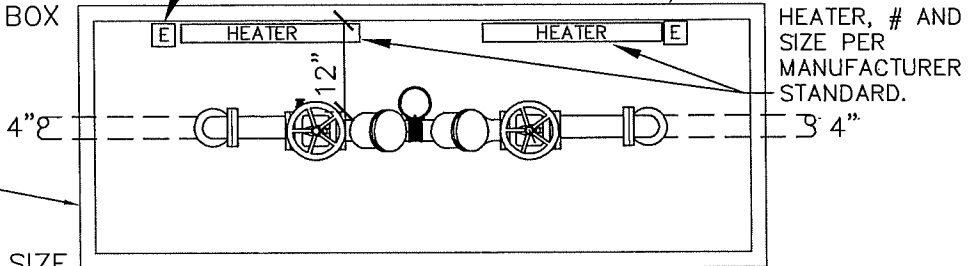

NOTE: VERIFY ENCLOSURE SIZE FOR ACTUAL PROVIDED BF DEVICE.

ACCESS OPENING (CENTERED ON RP ASSY)  
**PLAN**  
NTS


4" FEBCO 860 REDUCED PRESSURE ASSEMBLY (OR APPROVED EQUAL) WITH 2 OS&Y GATE VALVES (TYP)  
90° VERT MJ BEND W/MEGALUGS (TYP EACH SIDE)

OS&Y GATE VALVE (TYP)  
MEGAFLANGE IF MJ BEND USED (TYP EACH END)  
90° VERT BEND (MJ or MJxFL W/MEGALUGS, AS REQUIRED TO FIT ENCLOSURE (TYP EACH END)  
3" MIN. BOTH ENDS  
12" MIN. ALL WAYS

STANDON MODEL S89 FLANGE SUPPORT OR APPROVED EQUAL (TYP).

6" MIN. COMPACTED GRANULAR BASEROCK

PROVIDE EXPANSION JOINT FILLER AT PIPE PENETRATIONS (TYP)

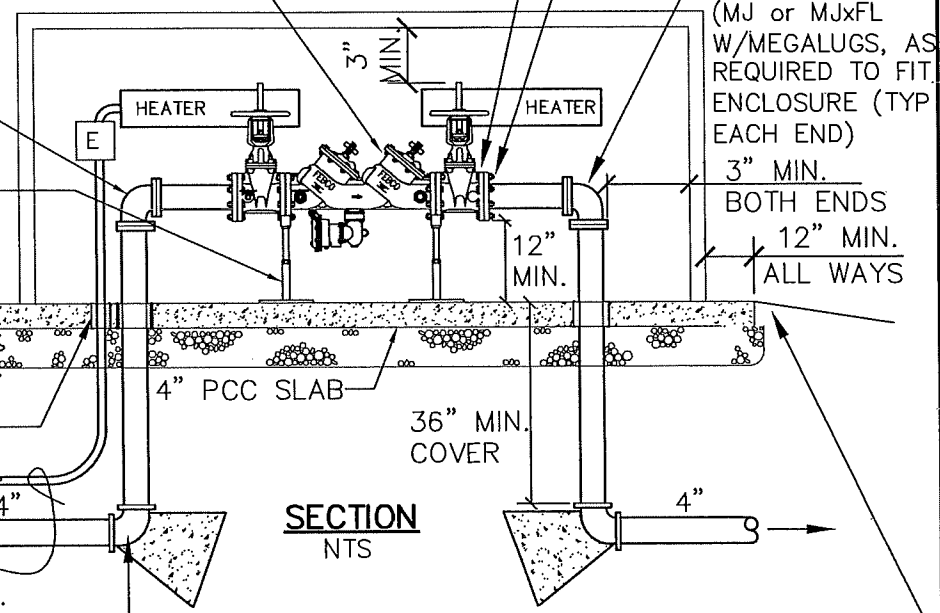

**SECTION**  
NTS

ELECTRICAL CONDUIT & WIRE TO POWER SOURCE. COORDINATE AS REQ'D TO INSTALL 120V POWER.

90° VERT MJ BEND W/THRUST BLOCK (TYP EACH SIDE)

FINISH GRADE TO SLOPE AWAY FROM VAULT AT MIN. SLOPE = 2%

**NOTES:**


1. RPA- REDUCED PRESSURE ASSEMBLY
2. INSTALLATION OF RPA & ENCLOSURE SHALL MEET OREGON HEALTH AUTHORITY, DRINKING WATER SERVICES REQUIREMENTS.
3. CONTRACTOR SHALL HAVE RPA TESTED AND CERTIFIED PRIOR TO APPROVAL BY THE CITY, AND COPIES OF TEST REPORTS PROVIDED TO CITY.
4. RPA & ENCLOSURE SHALL CONFORM TO REQUIREMENTS OF PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
5. ENCLOSURE SHALL HAVE A MINIMUM OF 3' CLEARANCE FROM ALL OTHER VAULTS OR STRUCTURES.
6. VERIFY ENCLOSURE DIMENSIONS ARE ADEQUATE FOR CLEARANCE BASED ON DIMENSIONS OF REDUCED PRESSURE ASSEMBLY PROVIDED.
7. ENCLOSURE SHALL BE CENTERED OVER THE COMPLETED REDUCED PRESSURE ASSEMBLY (LENGTH-WISE).
8. POWER SHALL BE INSTALLED IN SCHEDULE 40 RIGID CONDUIT PER NEC REQUIREMENTS.
9. 'E' INDICATES THE ELECTRICAL RECEPTACLE. IT SHALL BE MOUNTED A MIN. OF 18" ABOVE THE SLAB.
10. ALL CONCRETE SHALL BE 3,300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).
11. HOT BOX DRAINAGE OPENINGS SHALL NOT BE OBSTRUCTED BY GRADING OR PLANTINGS.
12. RPA SHALL BE INSTALLED A MIN. OF 12 INCHES ABOVE THE 100-YEAR FLOOD ELEVATION AS DETERMINED BY FEMA.
13. RISER PIPES & ABOVE GRADE PIPING SHALL BE DUCTILE IRON (CL 52 MIN).

LAST REVISION DATE: JAN 2024	JO # STANDARD
<b>4" REDUCED PRESSURE ASSEMBLY</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>544</b>

MODEL NO. HB4E AS MANUFACTURED BY HOT BOX (1-800-736-0238) ANCHOR ENCLOSURE TO CONCRETE PAD PER MANUFACTURER'S REQUIREMENTS.

ELECTRICAL RECEPTICAL (GFI). MOUNT RECEPTACLE 18" ABOVE SLAB. HOT BOX

HEATER, # AND SIZE PER MANUFACTURER STANDARD.

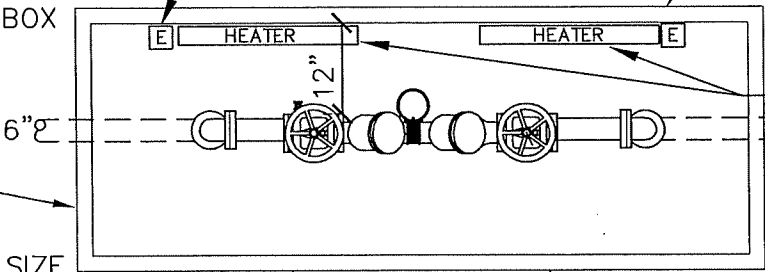

NOTE: VERIFY ENCLOSURE SIZE FOR ACTUAL PROVIDED BF DEVICE.

ACCESS OPENING (CENTERED ON RP ASSY)  
**PLAN**  
NTS

6" FEBCO 860 REDUCED PRESSURE ASSEMBLY WITH 2 OS&Y GATE VALVES (TYP)

90° VERT MJ BEND W/MEGALUGS (TYP EACH SIDE)

STANDON MODEL S89 FLANGE SUPPORT OR APPROVED EQUAL (TYP).

6" MIN. COMPACTED GRANULAR BASEROCK


PROVIDE EXPANSION JOINT FILLER AT PIPE PENETRATIONS (TYP)

ELECTRICAL CONDUIT & WIRE TO POWER SOURCE. COORDINATE AS REQ'D TO INSTALL 120V POWER.

OS&Y GATE VALVE (TYP) MEGAFLANGE IF MJ BEND USED (TYP EACH END)

90° VERT BEND (MJ or MJxFL W/MEGALUGS, AS REQUIRED TO FIT ENCLOSURE (TYP EACH END)

3" MIN. BOTH ENDS 12" MIN.

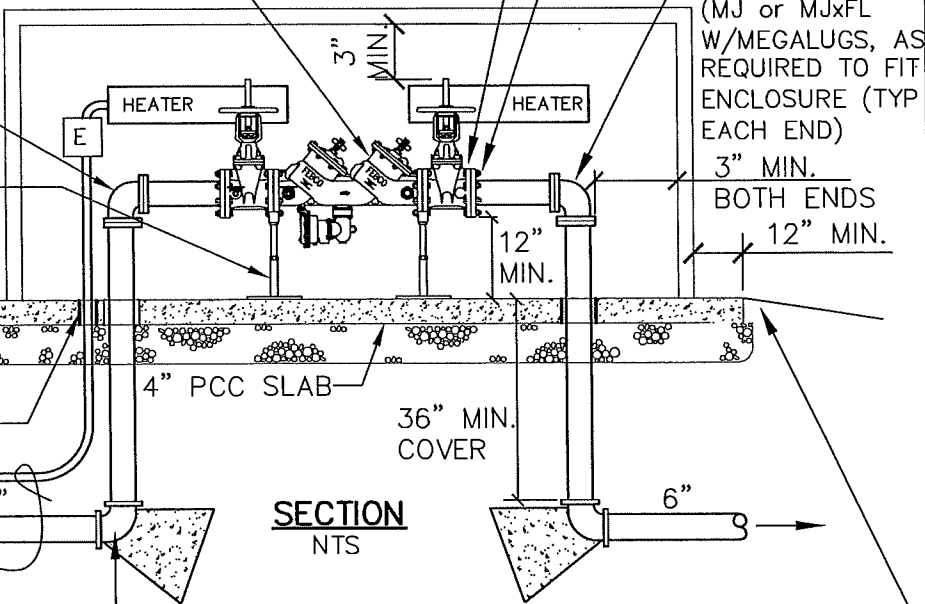

**SECTION**  
NTS

90° VERT MJ BEND W/THRUST BLOCK (TYP EACH SIDE)


FINISH GRADE TO SLOPE AWAY FROM VAULT AT MIN. SLOPE = 2%

**NOTES:**

1. RPA- REDUCED PRESSURE ASSEMBLY
2. INSTALLATION OF RPA & ENCLOSURE SHALL MEET OREGON HEALTH AUTHORITY, DRINKING WATER SERVICES REQUIREMENTS.
3. CONTRACTOR SHALL HAVE RPA TESTED AND CERTIFIED PRIOR TO APPROVAL BY THE CITY, AND COPIES OF TEST REPORTS PROVIDED TO CITY.
4. RPA & ENCLOSURE SHALL CONFORM TO REQUIREMENTS OF PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
5. ENCLOSURE SHALL HAVE A MINIMUM OF 3' CLEARANCE FROM ALL OTHER VAULTS OR STRUCTURES.
6. VERIFY ENCLOSURE DIMENSIONS ARE ADEQUATE FOR CLEARANCE BASED ON DIMENSIONS OF REDUCED PRESSURE ASSEMBLY PROVIDED.
7. ENCLOSURE SHALL BE CENTERED OVER THE COMPLETED REDUCED PRESSURE ASSEMBLY (LENGTH-WISE).
8. POWER SHALL BE INSTALLED IN SCHEDULE 40 RIGID CONDUIT PER NEC REQUIREMENTS.
9. 'E' INDICATES THE ELECTRICAL RECEPTACLE. IT SHALL BE MOUNTED A MIN. OF 18" ABOVE THE SLAB.
10. ALL CONCRETE SHALL BE 3,300 PSI @ 28 DAYS, MAX 5" SLUMP, 4.5% AIR (±1.5%).

11. HOT BOX DRAINAGE OPENINGS SHALL NOT BE OBSTRUCTED BY GRADING OR PLANTINGS.
12. RPA SHALL BE INSTALLED A MIN. OF 12 INCHES ABOVE THE 100-YEAR FLOOD ELEVATION AS DETERMINED BY FEMA.
13. RISER PIPES & ABOVE GRADE PIPING SHALL BE DUCTILE IRON (CL 52 MIN).

LAST REVISION DATE: JAN 2024	JO # STANDARD
<b>6" REDUCED PRESSURE ASSEMBLY</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 545

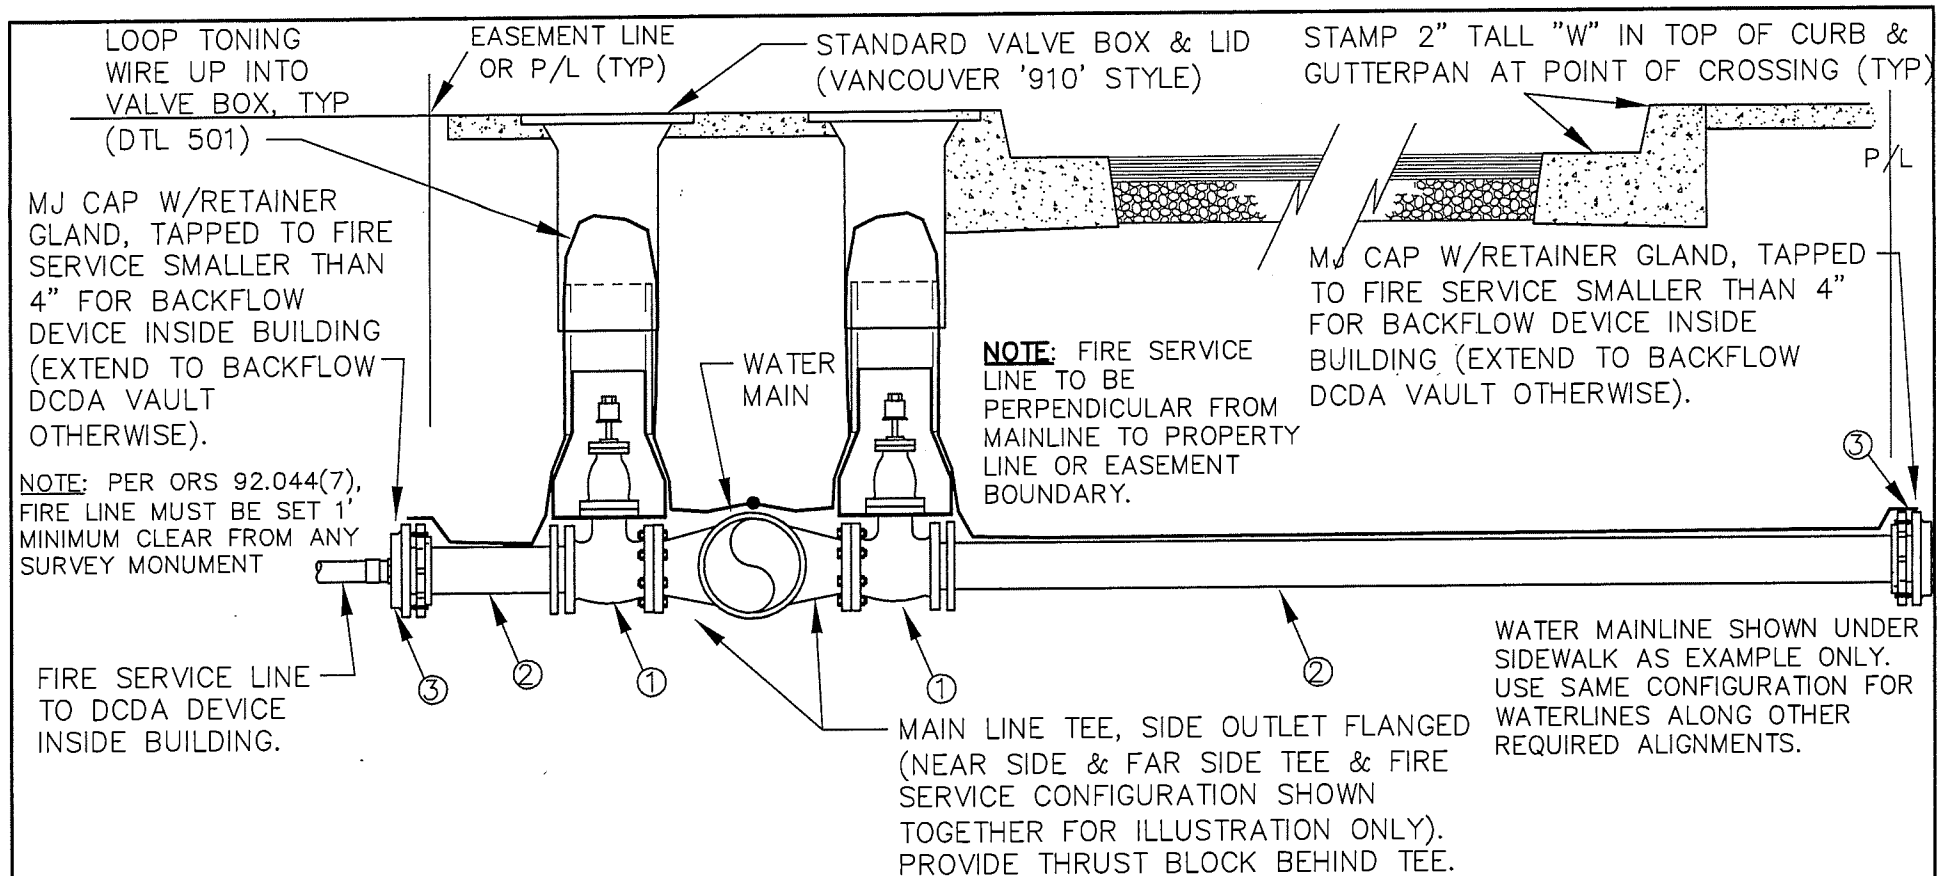

DAYTON, OR	FIRE SERVICE LINE CONNECTION REQUIREMENTS (1-1/2" AND LARGER SERVICE) (NTS)	LAST REVISION DATE:
		MAY 2023
DETAIL NO.	550	COPYRIGHT WESTECH ENGINEERING, INC.

### MATERIALS

- ① FLG X MJ RESILIENT WEDGE GATE VALVE (PER AWWA C-509), 4" DIA. MINIMUM OR FIRE SERVICE SIZE, WHICHEVER IS LARGER. VALVE TO BE EPOXY COATED PER AWWA C-550. PROVIDE APPROVED RETAINER GLAND ON MJ JOINT.
- ② CLASS 52 DUCTILE IRON PIPE REQUIRED WITHIN RIGHT-OF-WAY OR EASEMENT BOUNDARY OR TO DCDA VAULT (WHERE DCDA NOT INSTALLED IN BUILDING), TYP. 4" DIA OR FIRE SERVICE SIZE, WHICHEVER IS LARGER. FIELD-LOK STYLE GASKETS REQUIRED ON ALL PUSH-ON JOINTS BETWEEN MAINLINE VALVE AND DCDA VAULT.
- ③ CONTRACTOR SHALL INSTALL TEMPORARY BLOWOFF TO PROVIDE FOR BLOWOFF, PRESSURE TESTING, DISINFECTION & BACTERIOLOGICAL TESTING PER CITY STANDARDS.

### NOTES

1. SUBSTITUTES FOR ANY MATERIAL SHOWN SHALL BE APPROVED BY THE CITY ENGINEER.
2. ALL PIPE AND BACKFILL ZONES SHALL BE BACKFILLED USING 3/4" MINUS GRANULAR MATERIAL AND COMPACTED TO 92% MAX DENSITY AS DETERMINED BY ASHTO T-180.
3. FIRE SERVICE LINE BEYOND PROPERTY OR EASEMENT LINE (TO BACKFLOW DEVICE) TO BE NFPA & NSF 61 APPROVED.
4. CUSTOMER SHALL INSTALL AN APPROVED BACKFLOW PREVENTION DEVICE ON PRIVATE PROPERTY AT A LOCATION APPROVED BY PUBLIC WORKS.



4" FEBCO 856 DOUBLE CHECK DETECTOR ASSEMBLY WITH 2 OS&Y GATE VALVES, OR APPROVED EQUAL, W/CITY APPR'D METER ON DETECTOR LOOP (ALSO SEE NOTE 13).

PROVIDE BALL DRIP DRAIN VALVE TO DRAIN FDC, EITHER ON CHECK VALVE OR WITH HORIZONTAL TAPPING SADDLE

INSTALL "FORWARD FLOW TEST PORT" PER DTL 559 UNLESS ALT. LOCATION APPROVED.

UTILITY VAULT 676-WA (5'6" x 7'0" ID) W/H-20 RATED LID, OR EQUIVALENT. CONTRACTOR TO VERIFY ALL DIMENSIONS PRIOR TO ORDERING & PROVIDE RISER IF REQUIRED.


POWER CONDUIT FOR SUMP PUMP & CONTROL CONDUIT TO CONNECT OS&Y VALVE TAMPER SWITCHES TO FIRE ALARM CONTROL UNIT.

F.D.C. PER FIRE DEPT. REQUIREMENTS, LOCATE AS SHOWN ON PLANS.


CONTRACTOR TO PROVIDE FDC SIGNS PER OFC 912. LOCATION PER FIRE CHIEF.

**NOTES:**

1. DCDA- DOUBLE CHECK DETECTOR ASSEMBLY FDC-FIRE DEPARTMENT CONNECTION.
2. DCDA SHALL CONFORM TO REQUIREMENTS OF PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
3. DCDA & VAULT INSTALLATION SHALL MEET REQUIREMENTS OF OREGON HEALTH AUTHORITY, DRINKING WATER SERVICES (DWS).
4. CONTRACTOR SHALL HAVE DCDA TESTED AND CERTIFIED PRIOR TO ACCEPTANCE BY OWNER.
5. FDC SHALL NOT EXIT THROUGH THE TOP OF THE VAULT.
6. ALL PIPE OPENINGS SHALL BE SEALED WITH NON-SHRINK WATERTIGHT GROUT.
7. BENDS, CROSSES AND TEES SHALL NOT BE INSTALLED WITHIN 5 FEET OF THE OUTSIDE VAULT WALL.
8. ALL VAULTS SHALL MEET OR EXCEED ASTM C-857. ALL VAULT CONCRETE TO BE 4500 PSI @ 28 DAYS. REBAR TO BE ASTM A-615 GRADE 60.
9. SUMP PUMP WITH POWER SUPPLY SHALL BE INSTALLED UNLESS OTHERWISE APPROVED BY PUBLIC WORKS.
10. SUMP PUMP DISCHARGE PIPE TO BE 1½-INCH SCHED 40 PVC SHALL BE PLUMBED TO FACE OF STREET CURB OR OTHER DISPOSAL POINT APPROVED BY LOCAL JURISDICTION (SEE OAR 333-061-0071.3.f).
11. CONTRACTOR TO INSTALL SUMP PUMP (5 GPM MIN) WITH 120V POWER SUPPLY, ALONG WITH PRIVATE POWER SOURCE (RESPONSIBILITY OF CONTRACTOR INSTALLING VAULT). SCHED 40 CONDUIT, WIRE, ETC. FOR SUMP PUMP POWER SHALL CONFORM WITH NEC REQUIREMENTS.
12. THRUST COLLAR CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
13. PROVIDE REMOTE READER (RADIO READ HEAD) FOR DETECTOR LOOP METER PER LOCAL JURISDICTION REQUIREMENTS, MOUNTED ON HINGE EDGE OF HATCH.
14. ALUMINUM ANGLE FRAME HATCH (3'0"x 5'6" MIN) SHALL BE BY USF FABRICATION OR APPROVED EQUAL (SAND BLASTED NON-SLIP).
  - (1) TO BE 300 PSF PEDESTRIAN RATED WHERE LID IS SET MIN. OF 9" ABOVE GRADE.
  - (2) TO BE H-20 RATED IF LID IS LESS THAN 9" ABOVE GRADE, OR IF LOCATED IN TRAFFIC AREA.
15. OSHA APPROVED GALVANIZED STEEL LADDER & ALUMINUM LADDER SAFETY EXTENSION.
16. PER OFC 903.4, INSTALL APPROVED TAMPER SWITCH ON BOTH OS&Y VALVES IN VAULT, WIRED TO A LISTED FIRE ALARM CONTROL UNIT, UNLESS EXEMPTION IS GRANTED BY FIRE DEPT.

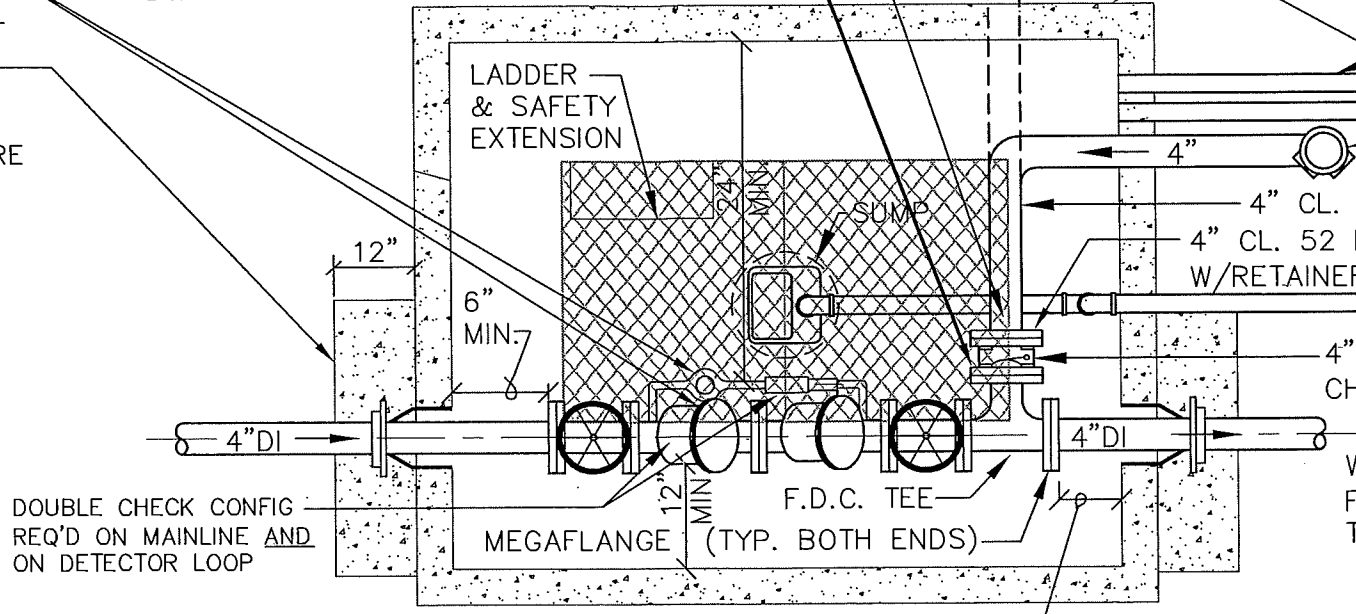


**PLAN**  
NTS

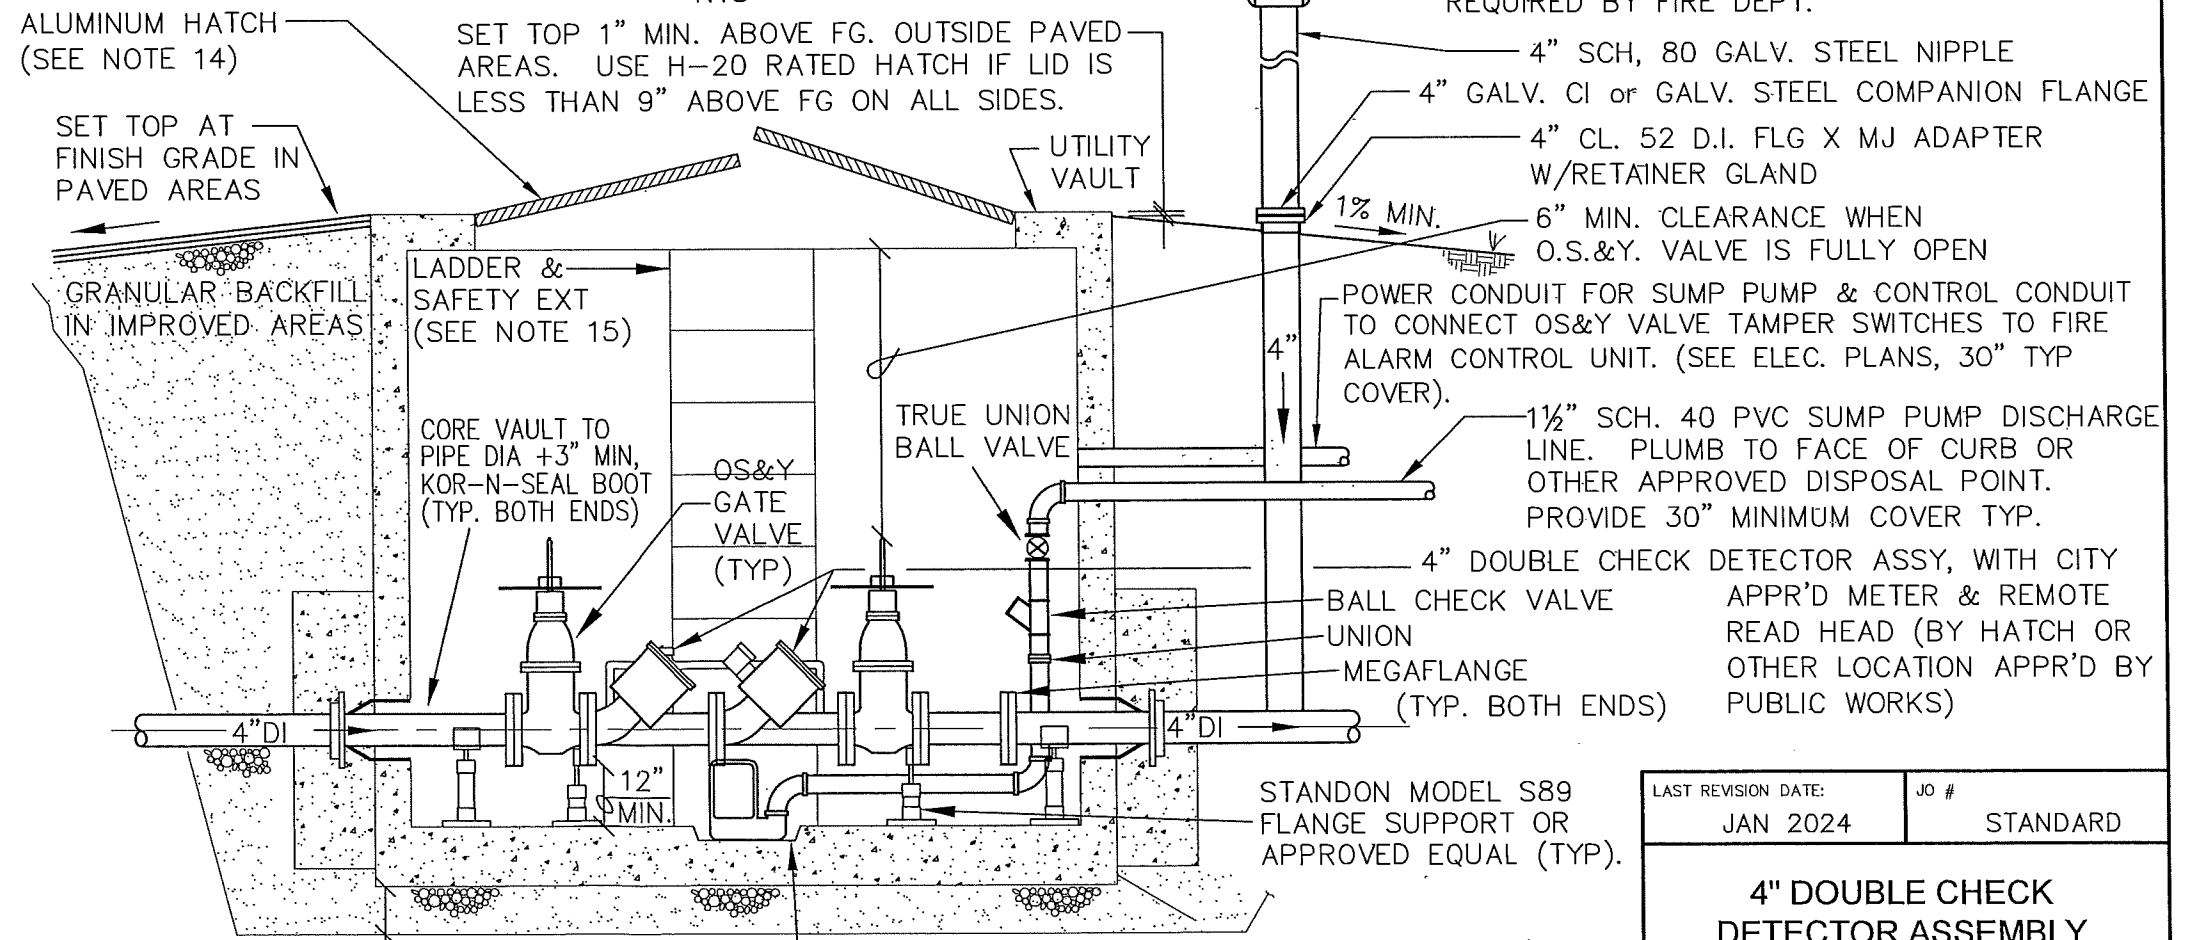

**SECTION**  
NTS

LAST REVISION DATE:	JO #
JAN 2024	STANDARD
<b>4" DOUBLE CHECK DETECTOR ASSEMBLY W/FDC</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 554

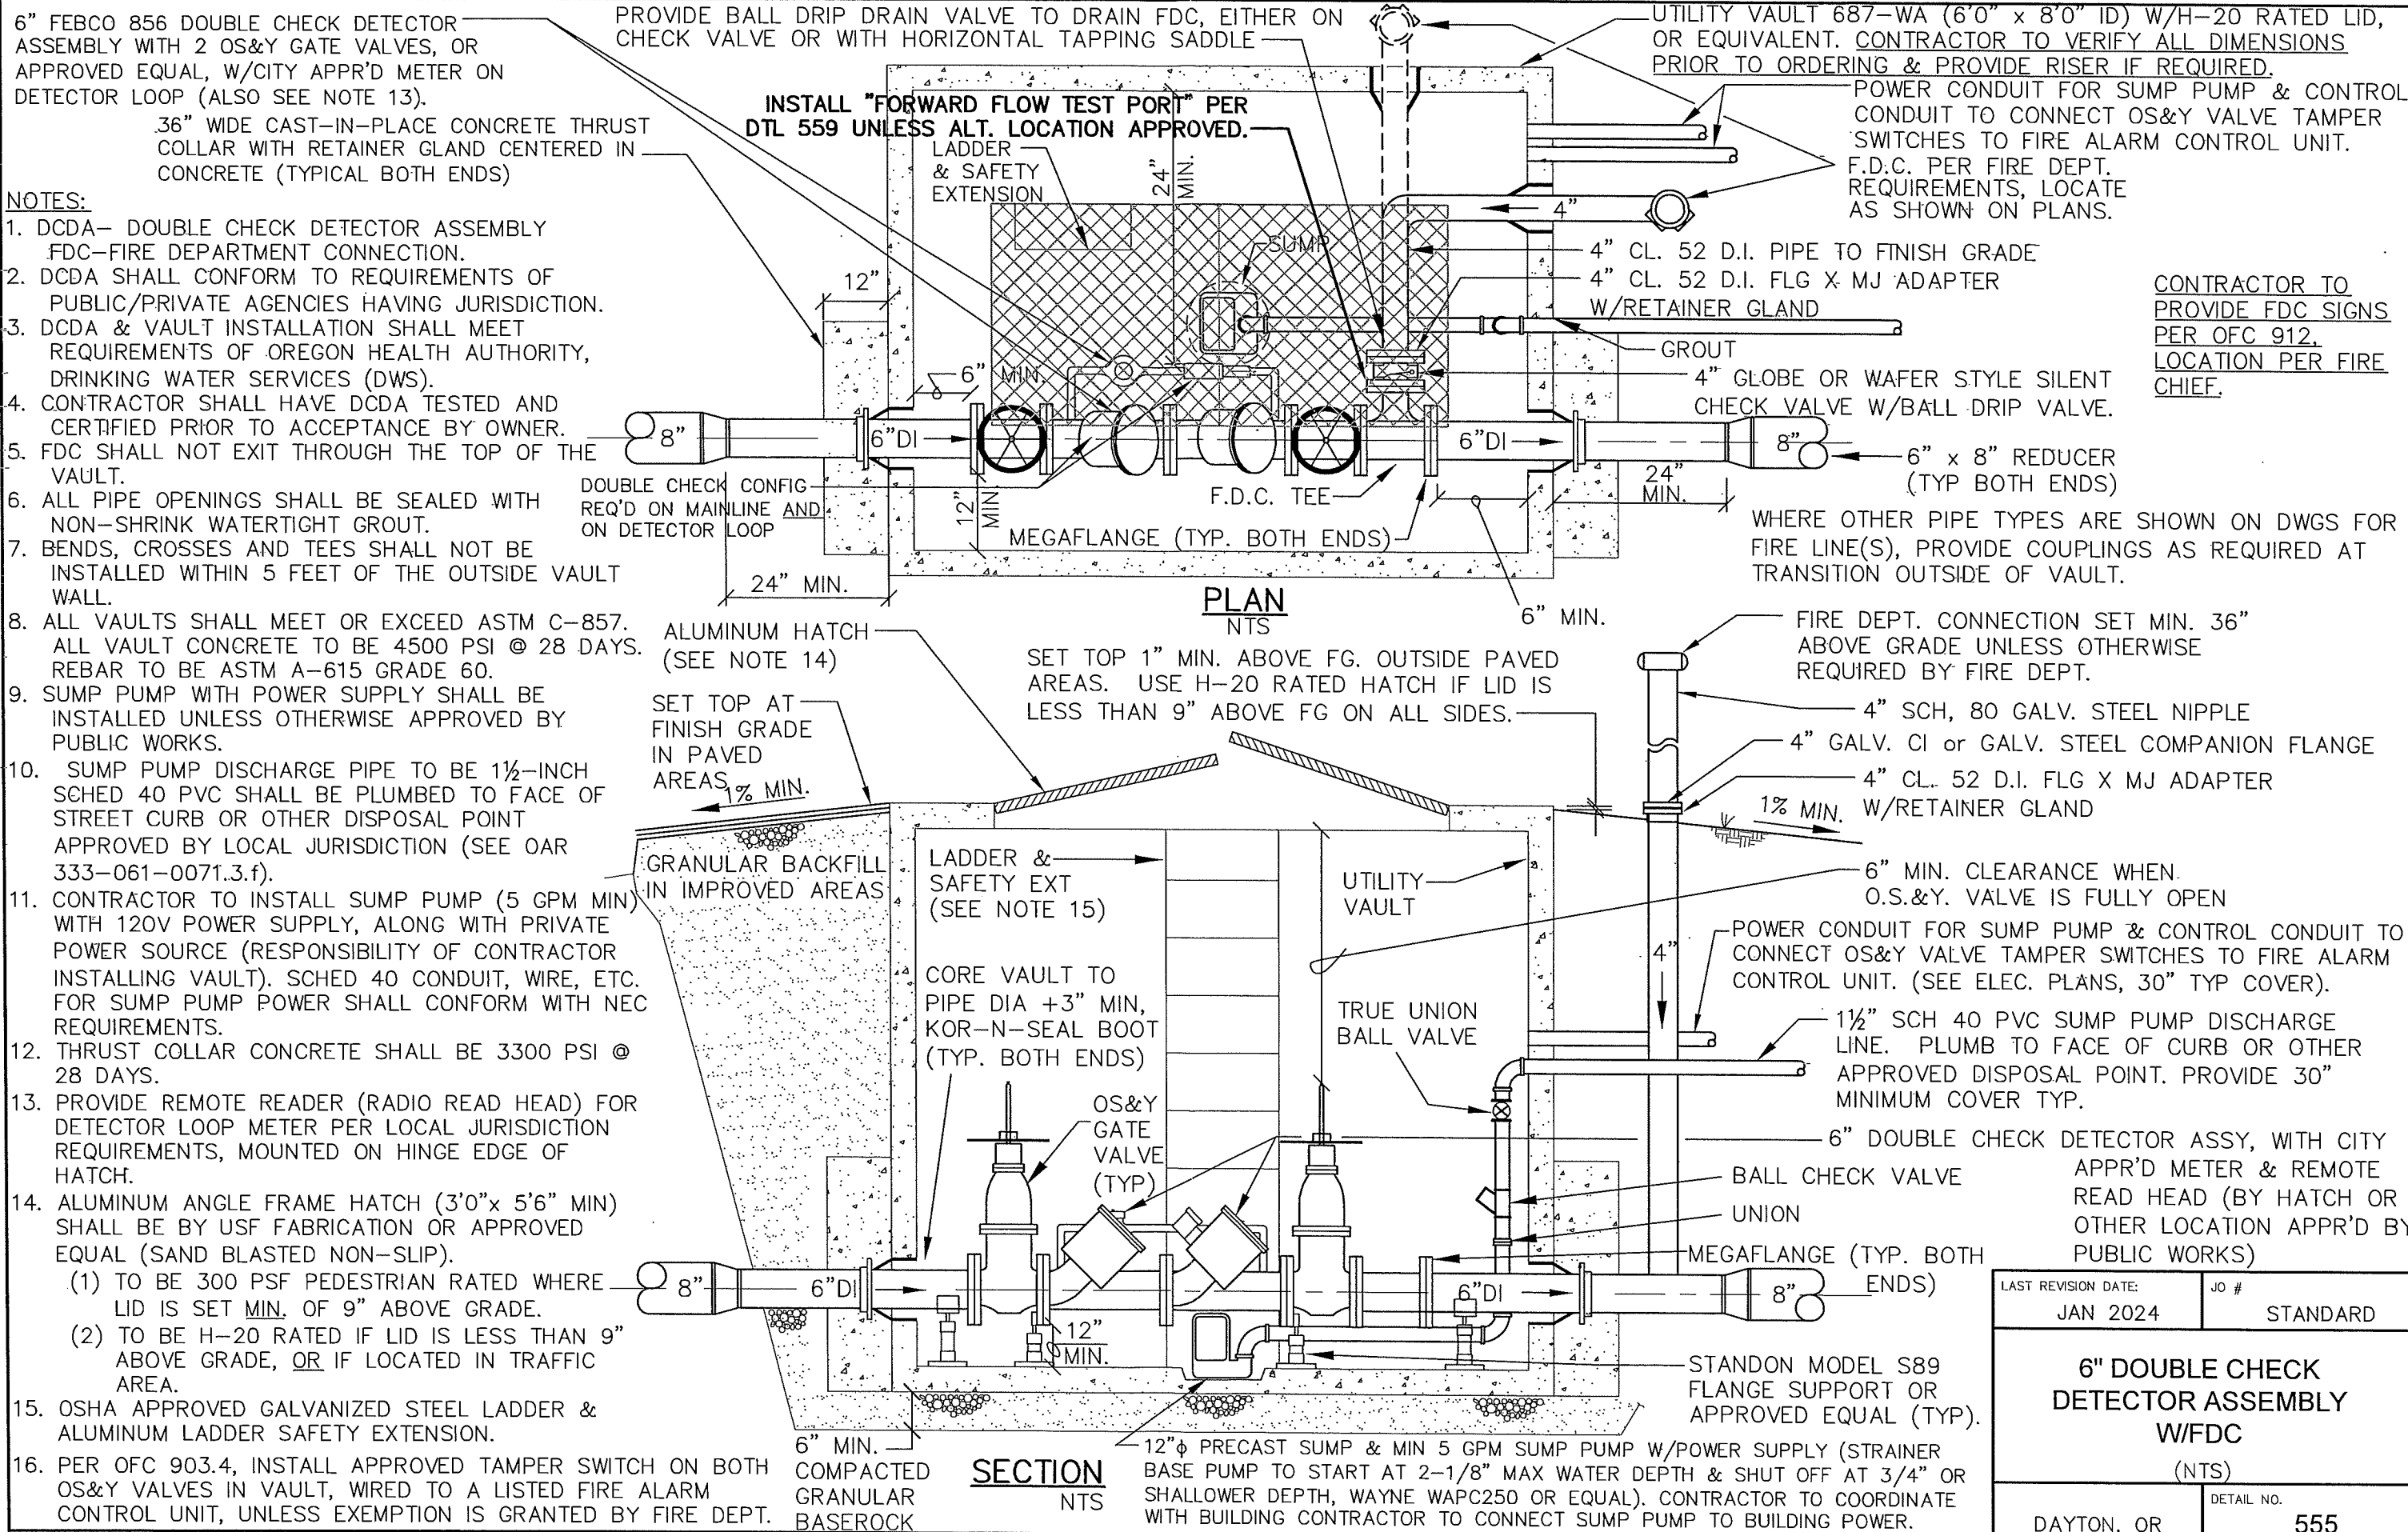

6" FEBCO 856 DOUBLE CHECK DETECTOR ASSEMBLY WITH 2 OS&Y GATE VALVES, OR APPROVED EQUAL, W/CITY APPR'D METER ON DETECTOR LOOP (ALSO SEE NOTE 13).

PROVIDE BALL DRIP DRAIN VALVE TO DRAIN FDC, EITHER ON CHECK VALVE OR WITH HORIZONTAL TAPPING SADDLE

UTILITY VAULT 687-WA (6'0" x 8'0" ID) W/H-20 RATED LID, OR EQUIVALENT. CONTRACTOR TO VERIFY ALL DIMENSIONS PRIOR TO ORDERING & PROVIDE RISER IF REQUIRED.

INSTALL "FORWARD FLOW TEST PORT" PER DTL 559 UNLESS ALT. LOCATION APPROVED.

POWER CONDUIT FOR SUMP PUMP & CONTROL CONDUIT TO CONNECT OS&Y VALVE TAMPER SWITCHES TO FIRE ALARM CONTROL UNIT. F.D.C. PER FIRE DEPT. REQUIREMENTS, LOCATE AS SHOWN ON PLANS.

- NOTES:**
- DCDA- DOUBLE CHECK DETECTOR ASSEMBLY FDC-FIRE DEPARTMENT CONNECTION.
  - DCDA SHALL CONFORM TO REQUIREMENTS OF PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
  - DCDA & VAULT INSTALLATION SHALL MEET REQUIREMENTS OF OREGON HEALTH AUTHORITY, DRINKING WATER SERVICES (DWS).
  - CONTRACTOR SHALL HAVE DCDA TESTED AND CERTIFIED PRIOR TO ACCEPTANCE BY OWNER.
  - FDC SHALL NOT EXIT THROUGH THE TOP OF THE VAULT.
  - ALL PIPE OPENINGS SHALL BE SEALED WITH NON-SHRINK WATERTIGHT GROUT.
  - BENDS, CROSSES AND TEES SHALL NOT BE INSTALLED WITHIN 5 FEET OF THE OUTSIDE VAULT WALL.
  - ALL VAULTS SHALL MEET OR EXCEED ASTM C-857. ALL VAULT CONCRETE TO BE 4500 PSI @ 28 DAYS. REBAR TO BE ASTM A-615 GRADE 60.
  - SUMP PUMP WITH POWER SUPPLY SHALL BE INSTALLED UNLESS OTHERWISE APPROVED BY PUBLIC WORKS.
  - SUMP PUMP DISCHARGE PIPE TO BE 1½-INCH SCHED 40 PVC SHALL BE PLUMBED TO FACE OF STREET CURB OR OTHER DISPOSAL POINT APPROVED BY LOCAL JURISDICTION (SEE OAR 333-061-0071.3.f).
  - CONTRACTOR TO INSTALL SUMP PUMP (5 GPM MIN) WITH 120V POWER SUPPLY, ALONG WITH PRIVATE POWER SOURCE (RESPONSIBILITY OF CONTRACTOR INSTALLING VAULT). SCHED 40 CONDUIT, WIRE, ETC. FOR SUMP PUMP POWER SHALL CONFORM WITH NEC REQUIREMENTS.
  - THRUST COLLAR CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
  - PROVIDE REMOTE READER (RADIO READ HEAD) FOR DETECTOR LOOP METER PER LOCAL JURISDICTION REQUIREMENTS, MOUNTED ON HINGE EDGE OF HATCH.
  - ALUMINUM ANGLE FRAME HATCH (3'0" x 5'6" MIN) SHALL BE BY USF FABRICATION OR APPROVED EQUAL (SAND BLASTED NON-SLIP).
    - TO BE 300 PSF PEDESTRIAN RATED WHERE LID IS SET MIN. OF 9" ABOVE GRADE.
    - TO BE H-20 RATED IF LID IS LESS THAN 9" ABOVE GRADE, OR IF LOCATED IN TRAFFIC AREA.
  - OSHA APPROVED GALVANIZED STEEL LADDER & ALUMINUM LADDER SAFETY EXTENSION.
  - PER OFC 903.4, INSTALL APPROVED TAMPER SWITCH ON BOTH OS&Y VALVES IN VAULT, WIRED TO A LISTED FIRE ALARM CONTROL UNIT, UNLESS EXEMPTION IS GRANTED BY FIRE DEPT.

CONTRACTOR TO PROVIDE FDC SIGNS PER OFC 912, LOCATION PER FIRE CHIEF.

WHERE OTHER PIPE TYPES ARE SHOWN ON DWGS FOR FIRE LINE(S), PROVIDE COUPLINGS AS REQUIRED AT TRANSITION OUTSIDE OF VAULT.

FIRE DEPT. CONNECTION SET MIN. 36" ABOVE GRADE UNLESS OTHERWISE REQUIRED BY FIRE DEPT.

POWER CONDUIT FOR SUMP PUMP & CONTROL CONDUIT TO CONNECT OS&Y VALVE TAMPER SWITCHES TO FIRE ALARM CONTROL UNIT. (SEE ELEC. PLANS, 30" TYP COVER).

1½" SCH 40 PVC SUMP PUMP DISCHARGE LINE. PLUMB TO FACE OF CURB OR OTHER APPROVED DISPOSAL POINT. PROVIDE 30" MINIMUM COVER TYP.

6" DOUBLE CHECK DETECTOR ASSY, WITH CITY APPR'D METER & REMOTE READ HEAD (BY HATCH OR OTHER LOCATION APPR'D BY PUBLIC WORKS)

LAST REVISION DATE:	JO #
JAN 2024	STANDARD

**6" DOUBLE CHECK DETECTOR ASSEMBLY W/FDC**  
(NTS)

DAYTON, OR	DETAIL NO. 555
------------	----------------

8" FEBCO 856 DOUBLE CHECK DETECTOR ASSEMBLY WITH 2 OS&Y GATE VALVES, OR APPROVED EQUAL, W/CITY APPR'D METER ON DETECTOR LOOP (ALSO SEE NOTE 13).


36" WIDE CAST-IN-PLACE CONCRETE THRUST COLLAR WITH RETAINER GLAND CENTERED IN CONCRETE (TYPICAL BOTH ENDS)

**NOTES:**

1. DCDA- DOUBLE CHECK DETECTOR ASSEMBLY  
FDC-FIRE DEPARTMENT CONNECTION.
2. DCDA SHALL CONFORM TO REQUIREMENTS OF PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
3. DCDA & VAULT INSTALLATION SHALL MEET REQUIREMENTS OF OREGON HEALTH AUTHORITY, DRINKING WATER SERVICES (DWS).
4. CONTRACTOR SHALL HAVE DCDA TESTED AND CERTIFIED PRIOR TO ACCEPTANCE BY OWNER.
5. FDC SHALL NOT EXIT THROUGH THE TOP OF THE VAULT.
6. ALL PIPE OPENINGS SHALL BE SEALED WITH NON-SHRINK WATERTIGHT GROUT.
7. BENDS, CROSSES AND TEES SHALL NOT BE INSTALLED WITHIN 5 FEET OF THE OUTSIDE VAULT WALL.
8. ALL VAULTS SHALL MEET OR EXCEED ASTM C-857. ALL VAULT CONCRETE TO BE 4500 PSI @ 28 DAYS. REBAR TO BE ASTM A-615 GRADE 60.
9. SUMP PUMP WITH POWER SUPPLY SHALL BE INSTALLED UNLESS OTHERWISE APPROVED BY PUBLIC WORKS.
10. SUMP PUMP DISCHARGE PIPE TO BE 1½-INCH SCHED 40 PVC SHALL BE PLUMBED TO FACE OF STREET CURB OR OTHER DISPOSAL POINT APPROVED BY LOCAL JURISDICTION (SEE OAR 333-061-0071.3.f).
11. CONTRACTOR TO INSTALL SUMP PUMP (5 GPM MIN) WITH 120V POWER SUPPLY, ALONG WITH PRIVATE POWER SOURCE (RESPONSIBILITY OF CONTRACTOR INSTALLING VAULT). SCHED 40 CONDUIT, WIRE, ETC. FOR SUMP PUMP POWER SHALL CONFORM WITH NEC REQUIREMENTS.
12. THRUST COLLAR CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
13. PROVIDE REMOTE READER (RADIO READ HEAD) FOR DETECTOR LOOP METER PER LOCAL JURISDICTION REQUIREMENTS, MOUNTED ON HINGE EDGE OF HATCH.
14. ALUMINUM ANGLE FRAME HATCH (3'0"x 5'6" MIN) SHALL BE BY USF FABRICATION OR APPROVED EQUAL (SAND BLASTED NON-SLIP).  
(1) TO BE 300 PSF PEDESTRIAN RATED WHERE LID IS SET MIN. OF 9" ABOVE GRADE.  
(2) TO BE H-20 RATED IF LID IS LESS THAN 9" ABOVE GRADE, OR IF LOCATED IN TRAFFIC AREA.
15. OSHA APPROVED GALVANIZED STEEL LADDER & ALUMINUM LADDER SAFETY EXTENSION.
16. PER OFC 903.4, INSTALL APPROVED TAMPER SWITCH ON BOTH OS&Y VALVES IN VAULT, WIRED TO A LISTED FIRE ALARM CONTROL UNIT, UNLESS EXEMPTION IS GRANTED BY FIRE DEPT.

PROVIDE BALL DRIP DRAIN VALVE TO DRAIN FDC, EITHER ON CHECK VALVE OR WITH HORIZONTAL TAPPING SADDLE

UTILITY VAULT 5106-WA (5'0" x 10'6" ID) W/H-20 RATED LID, OR EQUIVALENT. CONTRACTOR TO VERIFY ALL DIMENSIONS PRIOR TO ORDERING & PROVIDE RISER IF REQUIRED.

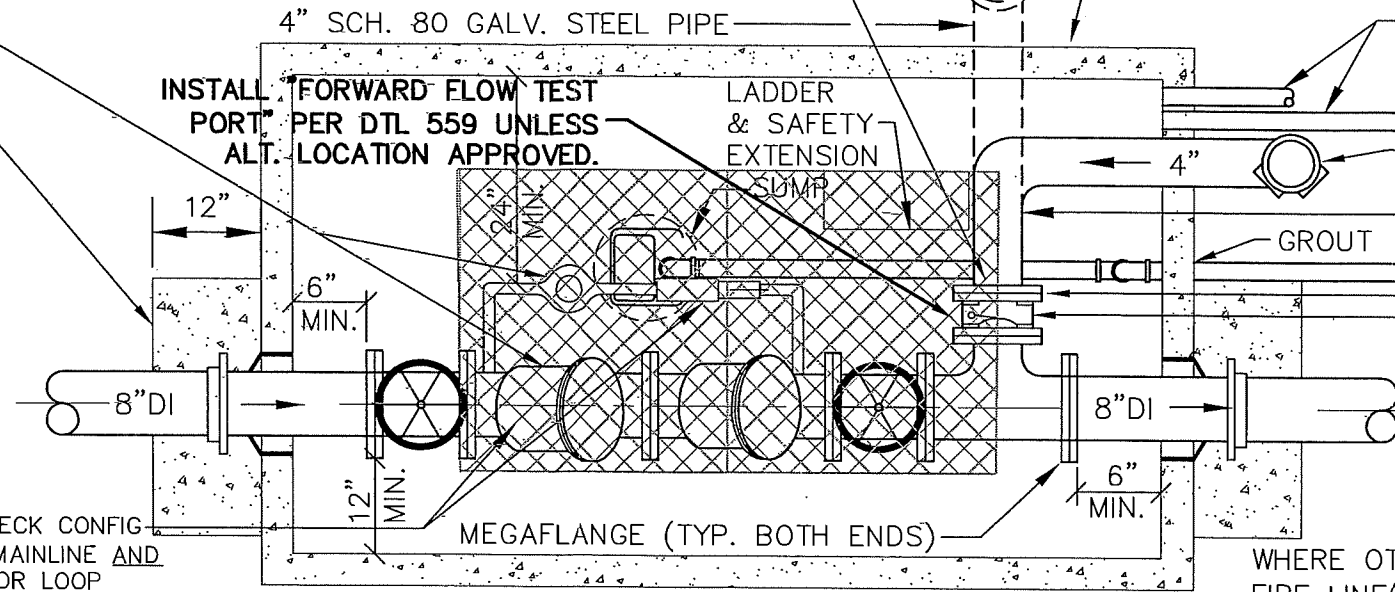

**PLAN**  
NTS

DOUBLE CHECK CONFIG REQ'D ON MAINLINE AND ON DETECTOR LOOP

POWER CONDUIT FOR SUMP PUMP & CONTROL CONDUIT TO CONNECT OS&Y VALVE TAMPER SWITCHES TO FIRE ALARM CONTROL UNIT.

F.D.C. PER FIRE DEPT. REQMNTS. LOCATE AS SHOWN ON PLANS.

CONTRACTOR TO PROVIDE FDC SIGNS PER OFC 912, LOCATION PER FIRE CHIEF.


4" CL. 52 D.I. PIPE TO FINISH GRADE  
4" CL. 52 D.I. FLG X MJ ADAPTER W/RETAINER GLAND  
4" GLOBE OR WAFER STYLE SILENT CHECK VALVE W/BALL DRIP VALVE.

WHERE OTHER PIPE TYPES ARE SHOWN ON DWGS FOR FIRE LINE(S), PROVIDE COUPLINGS AS REQUIRED AT TRANSITION OUTSIDE OF VAULT.

SET TOP 1" MIN. ABOVE FG. OUTSIDE PAVED AREAS. USE H-20 RATED HATCH IF LID IS LESS THAN 9" ABOVE FG ON ALL SIDES.

ALUMINUM HATCH (SEE NOTE 14)  
SET TOP AT FINISH GRADE IN PAVED AREAS

UTILITY VAULT  
1% MIN.

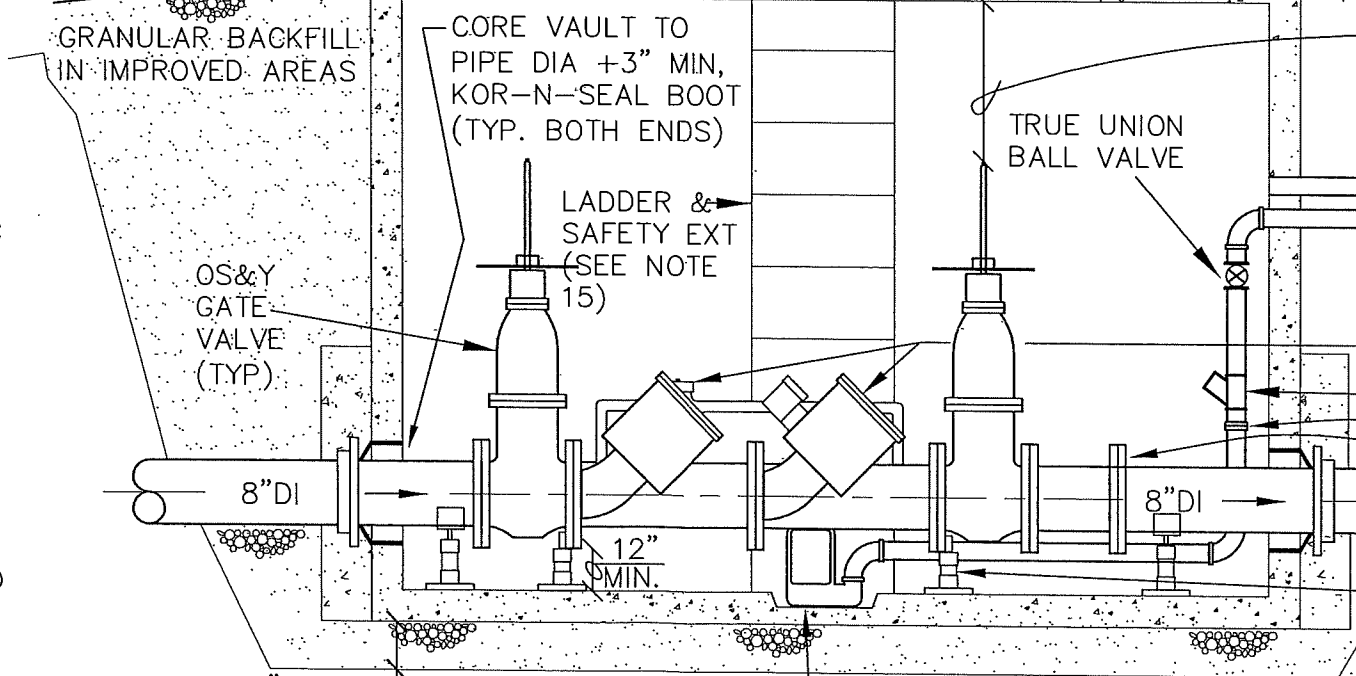

**SECTION**  
NTS

FIRE DEPT. CONNECTION SET MIN. 36" ABOVE GRADE UNLESS OTHERWISE REQUIRED BY FIRE DEPT.

4" SCH. 80 GALV. STEEL NIPPLE  
4" GALV. CI or GALV. STEEL COMPANION FLANGE  
4" CL. 52 D.I. FLG X MJ ADAPTER W/RETAINER GLAND  
6" MIN. CLEARANCE WHEN O.S.&Y. VALVE IS FULLY OPEN

POWER CONDUIT FOR SUMP PUMP & CONTROL CONDUIT TO CONNECT OS&Y VALVE TAMPER SWITCHES TO FIRE ALARM CONTROL UNIT. (SEE ELEC. PLANS, 30" TYP COVER).

1½" SCH 40 PVC SUMP PUMP DISCHARGE LINE. PLUMB TO FACE STREET CURB OR OTHER APPROVED DISPOSAL POINT. PROVIDE 30" MINIMUM COVER TYP.

8" DOUBLE CHECK DETECTOR ASSY, WITH CITY APPR'D METER & REMOTE READ HEAD (BY HATCH OR OTHER LOCATION APPR'D BY PUBLIC WORKS)


STANDON MODEL S89 FLANGE SUPPORT OR APPROVED EQUAL (TYP).

12"φ PRECAST SUMP & MIN 5 GPM SUMP PUMP W/POWER SUPPLY (STRAINER BASE PUMP TO START AT 2-1/8" MAX WATER DEPTH & SHUT OFF AT 3/4" OR SHALLOWER DEPTH, WAYNE WAPC250 OR EQUAL). CONTRACTOR TO COORDINATE WITH BUILDING CONTRACTOR TO CONNECT SUMP PUMP TO BUILDING POWER.


LAST REVISION DATE: JAN 2024	JO # STANDARD
---------------------------------	------------------

**8" DOUBLE CHECK DETECTOR ASSEMBLY W/FDC**  
(NTS)

DAYTON, OR	DETAIL NO. 556
------------	-------------------

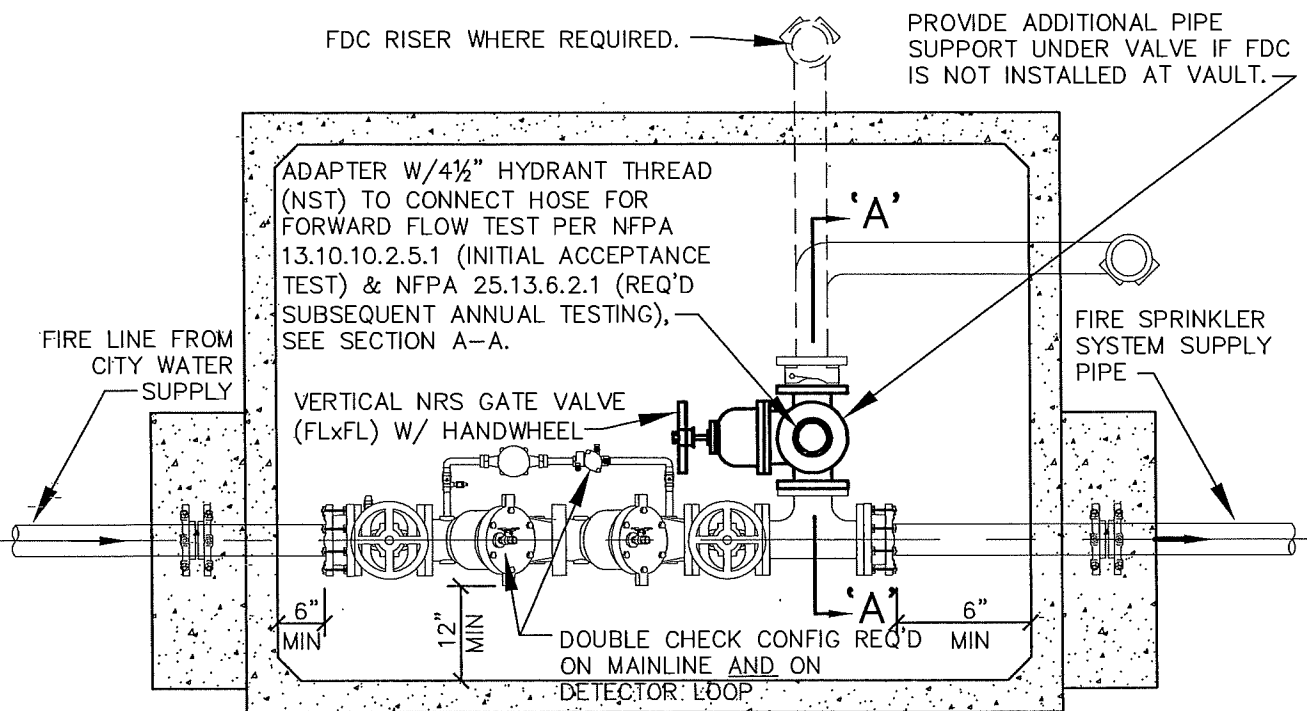

**PLAN**  
NTS

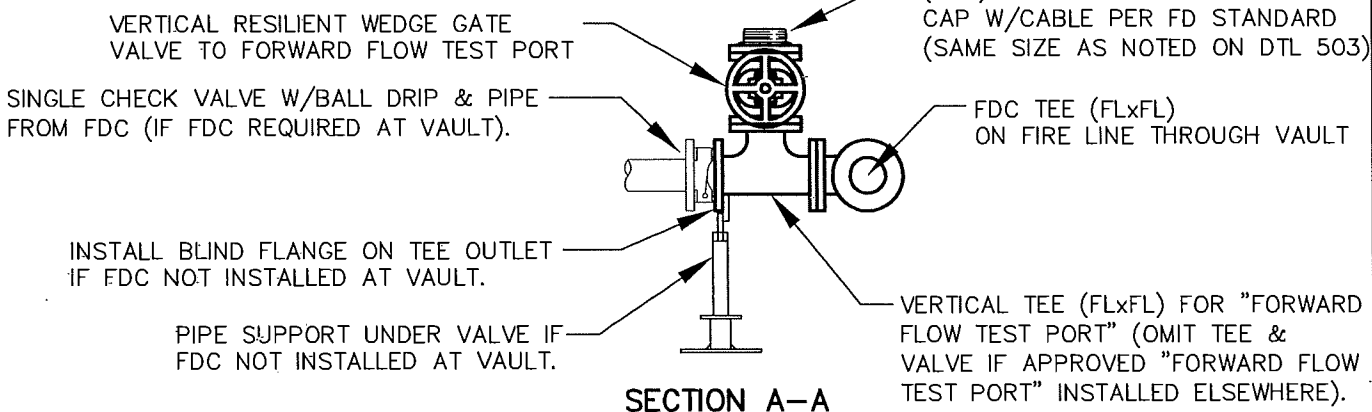

**SECTION A-A**  
NTS


**NOTES:**

1. THE "FORWARD FLOW TEST PORT" SHALL BE INSTALLED IN THE DCDA VAULT AS SHOWN AND SPECIFIED BY THIS DETAIL, UNLESS AN ALTERNATE PERMANENT "FORWARD FLOW TEST PORT" LOCATION IS APPROVED IN WRITING BY THE OWNER'S REPRESENTATIVE AND AN AUTHORIZED FIRE DEPT REPRESENTATIVE, OR IF A PRIVATE FIRE HYDRANT DOWNSTREAM OF THE DCDA VAULT IS DESIGNATED AS THE REQUIRED "FORWARD FLOW TEST PORT".
2. CONTRACTOR IS RESPONSIBLE FOR COORDINATING WITH THE FIRE SPRINKLER SYSTEM DESIGNER/ INSTALLER TO VERIFY THE FLOWRATE REQUIRED FOR THE "FORWARD FLOW TEST" OF THE BACKFLOW DEVICE, AND SHALL COORDINATE TO ENSURE THAT ALL HOSE & FLOW MEASUREMENT EQUIPMENT (HOSE MONSTER OR EQUAL) IS PROVIDED AS REQUIRED TO CONDUCT THE ACCEPTANCE "FORWARD FLOW TEST" AS REQUIRED BY NFPA 13, 6.10.2.5.1.
3. ALL COMPONENTS OF THE FORWARD FLOW TEST PORT (EXCLUDING THE FIRE HOSES & FLOW MEASUREMENT EQUIPMENT) SHALL REMAIN IN PLACE TO ALLOW SUBSEQUENT "FORWARD FLOW TESTS" TO BE CONDUCTED WITHOUT ANY SYSTEM MODIFICATIONS (IE. ANNUAL FLOW TESTS AS REQUIRED PER NFPA 25, 13.7.2.1).
4. CONFORM TO ALL OTHER REQUIREMENTS OF APPLICABLE DOUBLE CHECK DETECTOR ASSEMBLY DETAIL(S), NOTES & SPECIFICATIONS.

LAST REVISION DATE: JAN 2024	JO #
<b>4" FORWARD FLOW TEST PORT INSIDE DCDA VAULT (FOR NFPA 13 &amp; 25 TESTS)</b> (NTS)	
DAYTON, OR	DETAIL NO. <b>559</b>

FIRE CONTRACTOR TO PROVIDE FDC SIGNS PER OFC 912, LOCATION PER FIRE CHIEF.

- FDC LINE CHECK VALVE & BALL DRIP VALVE TO BE INSTALLED IN AN ACCESSIBLE LOCATION (NFPA 13, 16.12.6.1 & NFPA 13, 16.12.7).
- CONTRACTOR TO VERIFY THAT BALL DRIP VALVE INSTALLED IS DESIGNED & LISTED FOR THE ORIENTATION USED (VERTICAL OR HORIZONTAL).

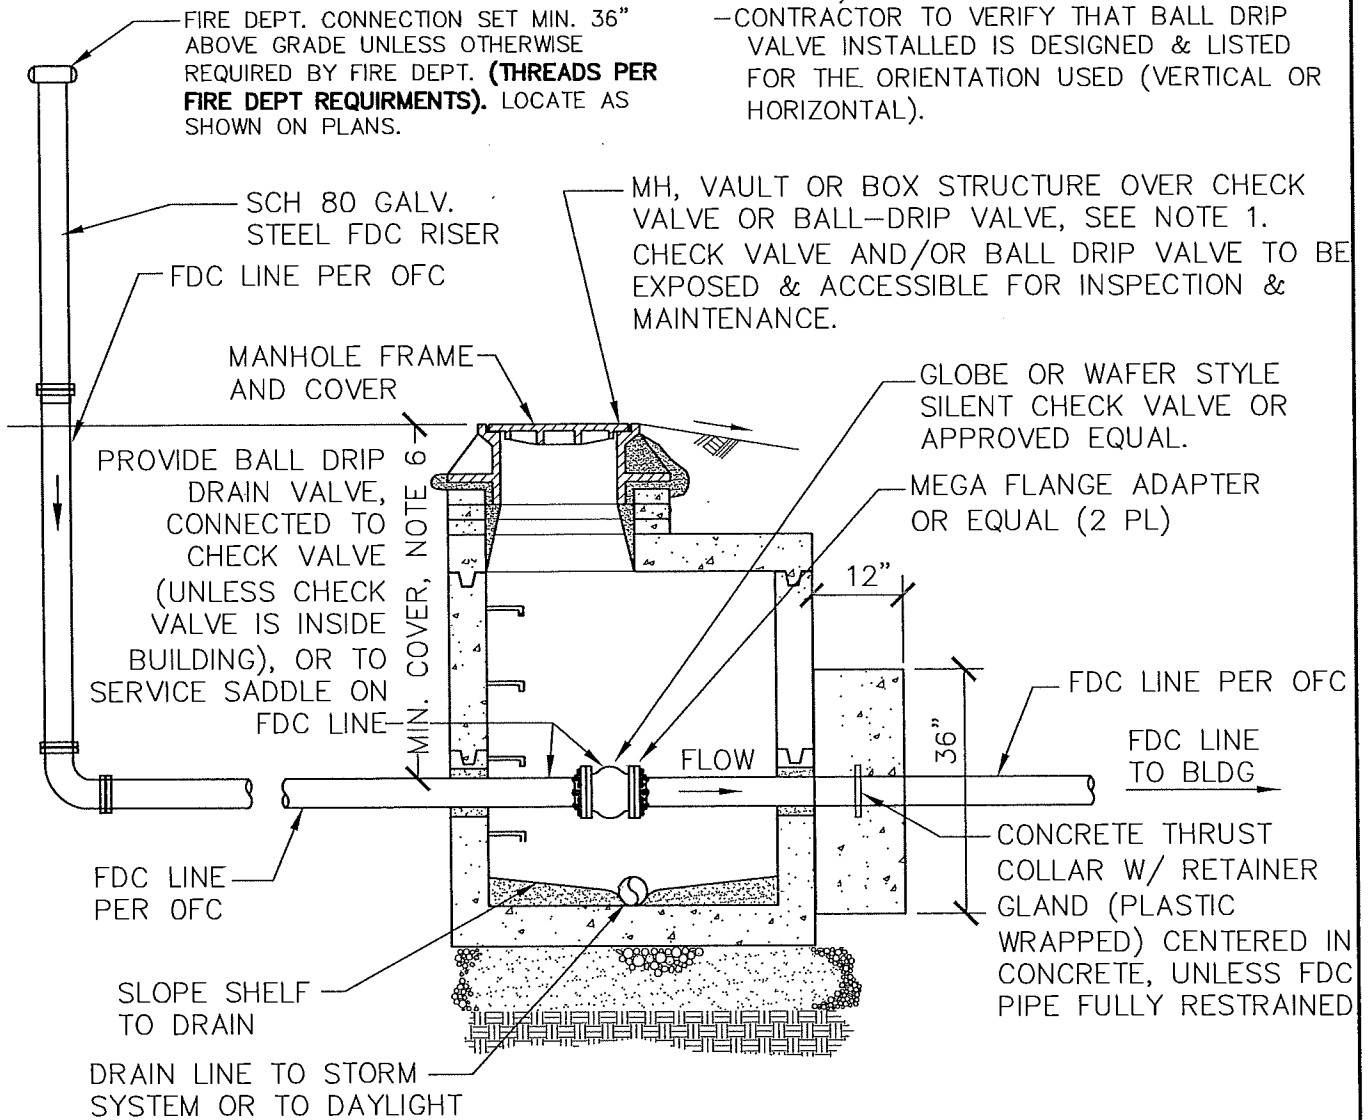


**NOTES:**

1. INSTALL 48" PRECAST MANHOLE PER DETAIL 402, UNLESS OTHER APPROVED VAULT OR BOX IS SHOWN OR NOTED ON DWGS.
2. ALL PIPE OPENINGS SHALL BE SEALED WITH NON-SHRINK WATERTIGHT GROUT.
3. WHERE REQUIRED, THRUST COLLAR CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
4. IF AN FDC LINE CHECK VALVE IS PROVIDED INSIDE BUILDING, AN EXTERIOR FDC LINE CHECK VALVE IS NOT REQUIRED UNLESS OTHERWISE DIRECTED IN WRITING BY FIRE CODE OFFICIAL. A BALL DRIP AUTOMATIC DRAIN VALVE SHALL BE INSTALLED ON CHECK VALVE OR AT THE LOW POINT ON FDC LINE (DETAIL 562), TO DRAIN HORIZONTAL FDC LINE BETWEEN CHECK VALVE & FDC RISER.
5. PER NFPA 13, A10.4.2, 40" MIN COVER IS REQUIRED FOR "WET" FIRE LINES & FDC LINES (ANY PORTION OF LINES WHICH REMAIN FILLED WHEN NOT IN USE AND SUBJECT TO FREEZING). COVER DEPTH MAY BE REDUCED TO 30" MIN ON "DRY" FDC LINE WHICH IS DRAINED COMPLETELY WHEN NOT IN USE (NFPA 13, 6.4.2.2.2 & NFPA 24, 10.4.2.2.2).
6. THIS DETAIL PROVIDES GUIDANCE ONLY, AND DOES NOT SUPERCEDE REQUIREMENTS UNDER THE OREGON FIRE CODE, NFPA STANDARDS OR DIRECTION FROM FIRE CODE OFFICIAL.

LAST REVISION DATE: AUG 2022	JO # STANDARD
<b>BELOW GRADE CHECK VALVE &amp; BALL DRIP VALVE, IN CLOSE BOTTOM DRAIN STRUCT</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 560

FIRE CONTRACTOR TO PROVIDE FDC SIGNS PER OFC 912, LOCATION PER FIRE CHIEF.

- FDC LINE CHECK VALVE & BALL DRIP VALVE TO BE INSTALLED IN AN ACCESSIBLE LOCATION (NFPA 13, 16.12.6.1 & NFPA 13, 16.12.7).
- CONTRACTOR TO VERIFY THAT BALL DRIP VALVE INSTALLED IS DESIGNED & LISTED FOR THE ORIENTATION USED (VERTICAL OR HORIZONTAL).

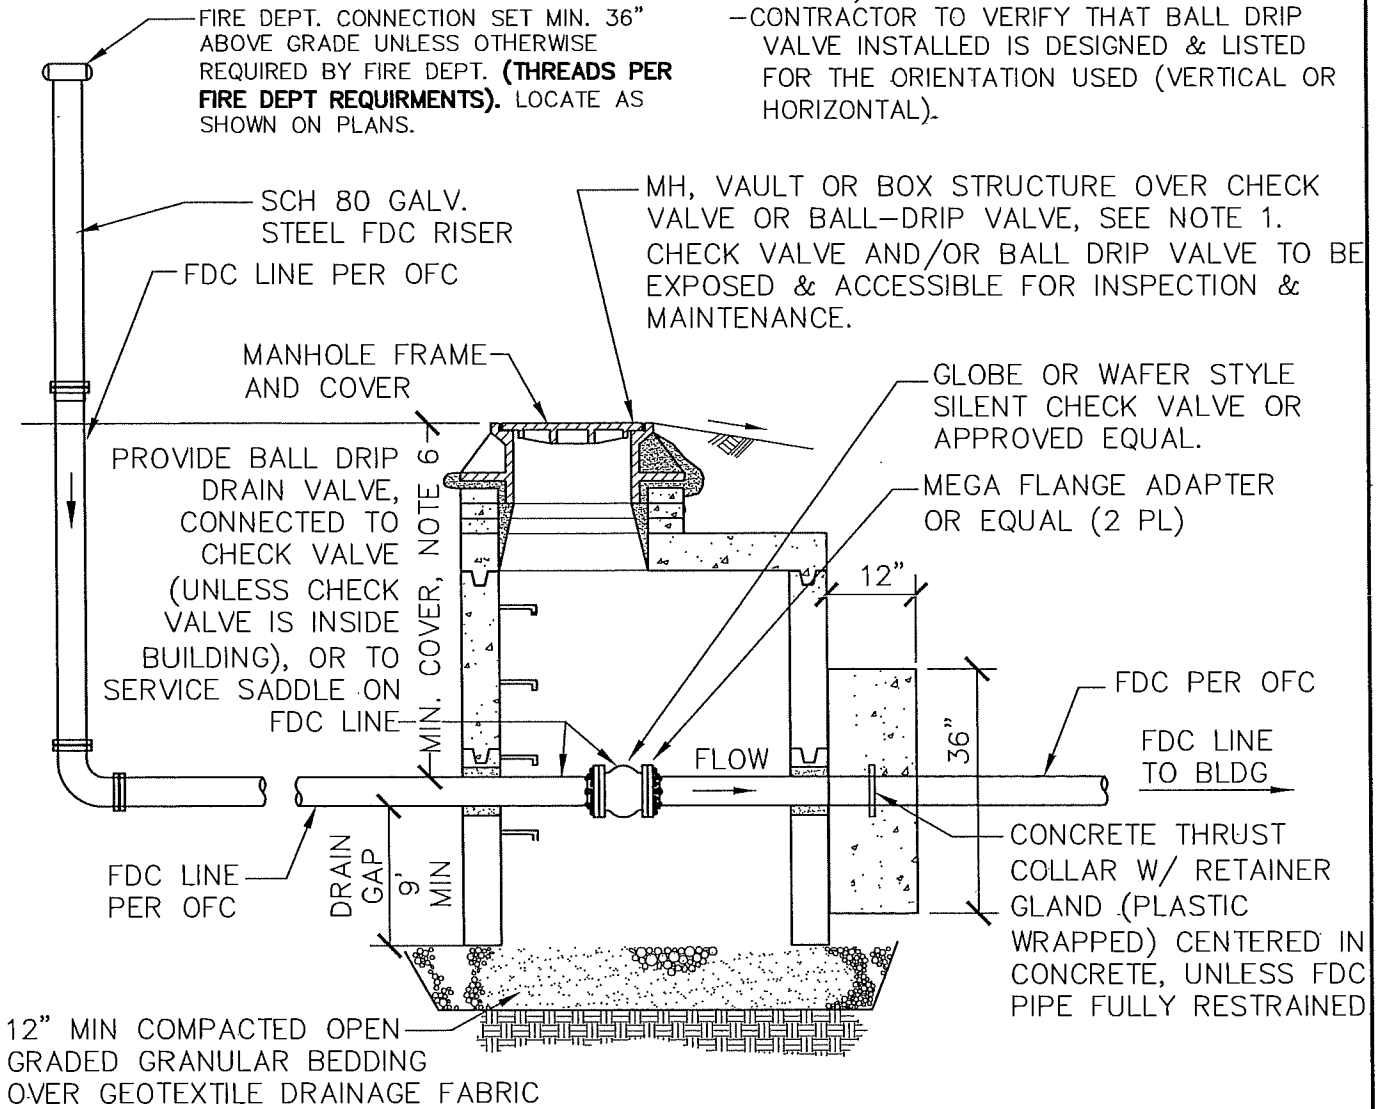

**NOTES:**


1. INSTALL 48" PRECAST MANHOLE PER DETAIL 402, UNLESS OTHER APPROVED VAULT OR BOX IS SHOWN OR NOTED ON DWGS.
2. ALL PIPE OPENINGS SHALL BE SEALED WITH NON-SHRINK WATERTIGHT GROUT.
3. WHERE REQUIRED, THRUST COLLAR CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
4. IF AN FDC LINE CHECK VALVE IS PROVIDED INSIDE BUILDING, AN EXTERIOR FDC LINE CHECK VALVE IS NOT REQUIRED UNLESS OTHERWISE DIRECTED IN WRITING BY FIRE CODE OFFICIAL. A BALL DRIP AUTOMATIC DRAIN VALVE SHALL BE INSTALLED ON CHECK VALVE OR AT THE LOW POINT ON FDC LINE (DETAIL 562), TO DRAIN HORIZONTAL FDC LINE BETWEEN CHECK VALVE & FDC RISER.
5. PER NFPA 13, A10.4.2, 40" MIN COVER IS REQUIRED FOR "WET" FIRE LINES & FDC LINES (ANY PORTION OF LINES WHICH REMAIN FILLED WHEN NOT IN USE AND SUBJECT TO FREEZING). COVER DEPTH MAY BE REDUCED TO 30" MIN ON "DRY" FDC LINE WHICH IS DRAINED COMPLETELY WHEN NOT IN USE (NFPA 13, 6.4.2.2.2 & NFPA 24, 10.4.2.2.2).
6. THIS DETAIL PROVIDES GUIDANCE ONLY, AND DOES NOT SUPERCEDE REQUIREMENTS UNDER THE OREGON FIRE CODE, NFPA STANDARDS OR DIRECTION FROM FIRE CODE OFFICIAL.

LAST REVISION DATE: SEPT 2022	JO # STANDARD
<b>BELOW GRADE CHECK VALVE &amp; BALL DRIP VALVE, IN OPEN BOTTOM DRAIN STRUCTURE</b> (NTS)	
DAYTON, OR	DETAIL NO. <b>561</b>



FIRE CONTRACTOR TO PROVIDE FDC SIGNS PER OFC 912, LOCATION PER FIRE CHIEF.

- FDC LINE CHECK VALVE & BALL DRIP VALVE TO BE INSTALLED IN AN ACCESSIBLE LOCATION (NFPA 13, 16.12.6.1 & NFPA 13, 16.12.7).
- CONTRACTOR TO VERIFY THAT BALL DRIP VALVE INSTALLED IS DESIGNED & LISTED FOR THE ORIENTATION USED (VERTICAL OR HORIZONTAL).

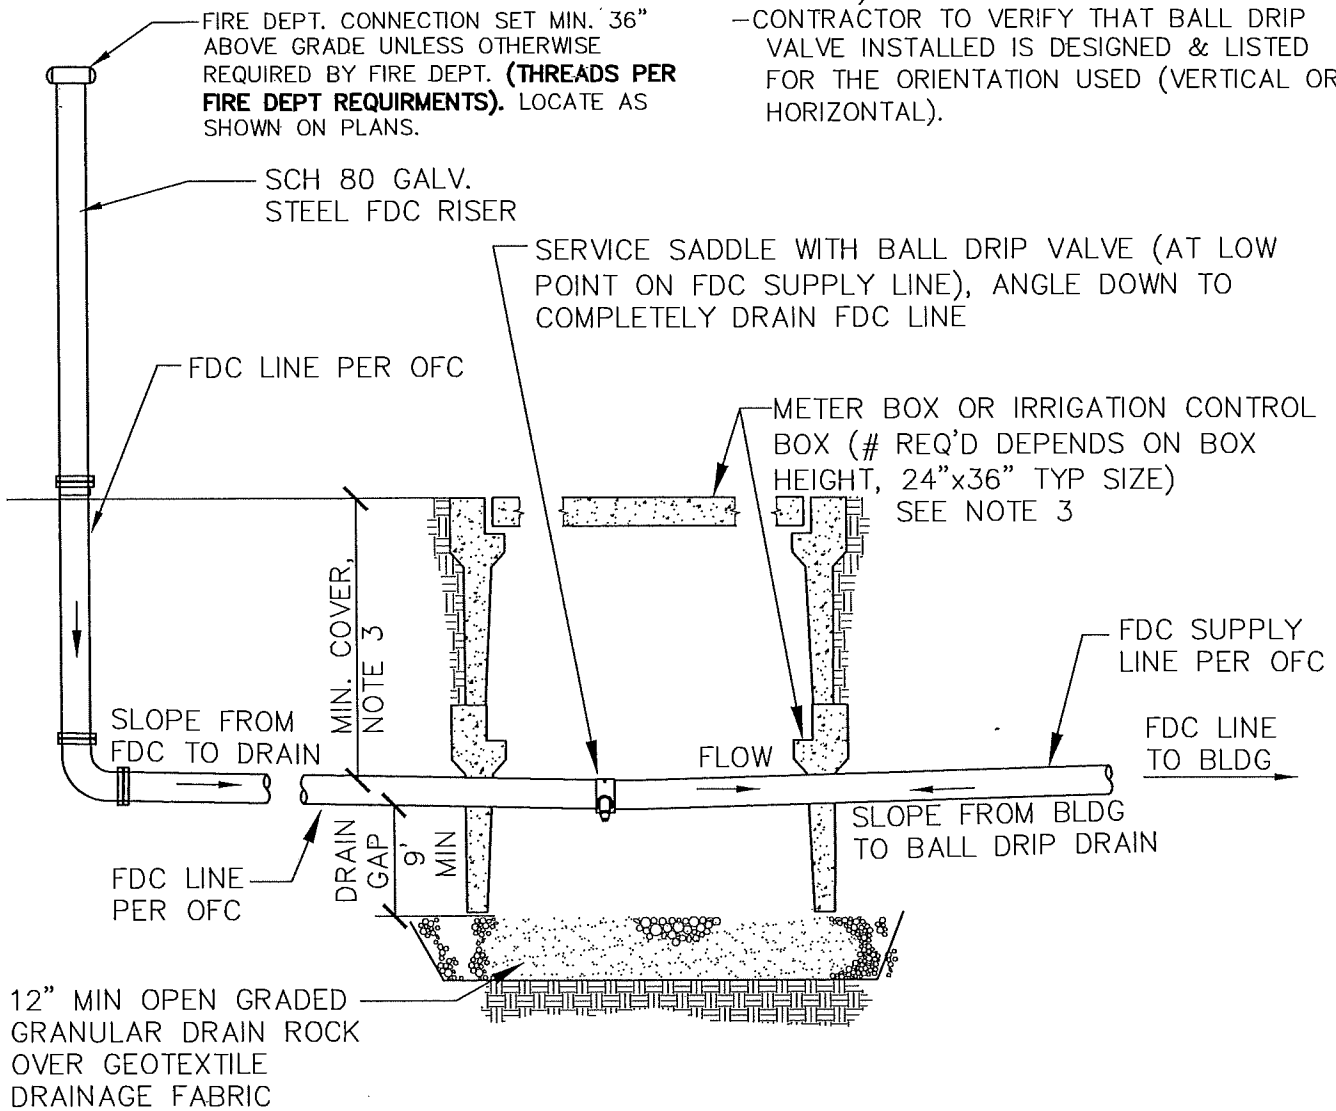

**NOTES:**


1. INSTALL BALL-DRIP DRAIN VALVE & BOX AT LOW POINT IN FDC LINE PROFILE (IE. BALL DRIP VALVE SHALL BE CONFIGURED TO DRAIN ENTIRE HORIZONTAL FDC PIPE BETWEEN FDC RISER & BUILDING WHEN FDC IS NOT IN USE).
2. CONFIGURATION SHOWN IS BASED ON FDC LINE CHECK VALVE INSIDE BUILDING (IE. FDC LINE "DRY" WHEN NOT IN USE).
3. UNLESS DEEPER DEPTH REQUIRED TO ADDRESS UTILITY CONFLICTS OR OTHER ISSUES, COVER DEPTH FOR "DRY" FDC LINE SHALL BE 30" MIN AT ALL LOCATIONS (NFPA 13, 6.4.2.2.2 & NFPA 24, 10.4.2.2.2).
4. BALL DRIP VALVE SHALL BE ACCESSIBLE IN BOX FOR INSPECTION & MAINTENANCE AS SHOWN (PROVIDE LARGER BOXES AS NECESSARY TO ACCOMPLISH THIS).
5. THIS DETAIL PROVIDES GUIDANCE ONLY, AND DOES NOT SUPERCEDE REQUIREMENTS UNDER THE OREGON FIRE CODE, NFPA STANDARDS OR DIRECTION FROM FIRE CODE OFFICIAL.

LAST REVISION DATE: SEPT 2022	JO # STANDARD
<b>FDC LINE BALL DRIP DRAIN VALVE (CHECK VALVE IN BLDG) OPEN BOTTOM DRAIN STRUCT (NTS)</b>	
DAYTON, OR	DETAIL NO. 562

**FDC LOCATION & CONFIGURATION MUST BE APPROVED BY THE LOCAL FIRE CODE OFFICIAL (OFC 912.2).**

**SIGNS:** FIRE CONTRACTOR TO PROVIDE FDC SIGNS PER OFC 912, LOCATION PER FIRE CHIEF.

- FDC LINE CHECK VALVE & BALL DRIP VALVE TO BE INSTALLED IN AN ACCESSIBLE LOCATION (NFPA 13, 16.12.6.1 & NFPA 13, 16.12.7).
- CONTRACTOR TO VERIFY THAT BALL DRIP VALVE INSTALLED IS DESIGNED & LISTED FOR THE ORIENTATION USED (VERTICAL OR HORIZONTAL).

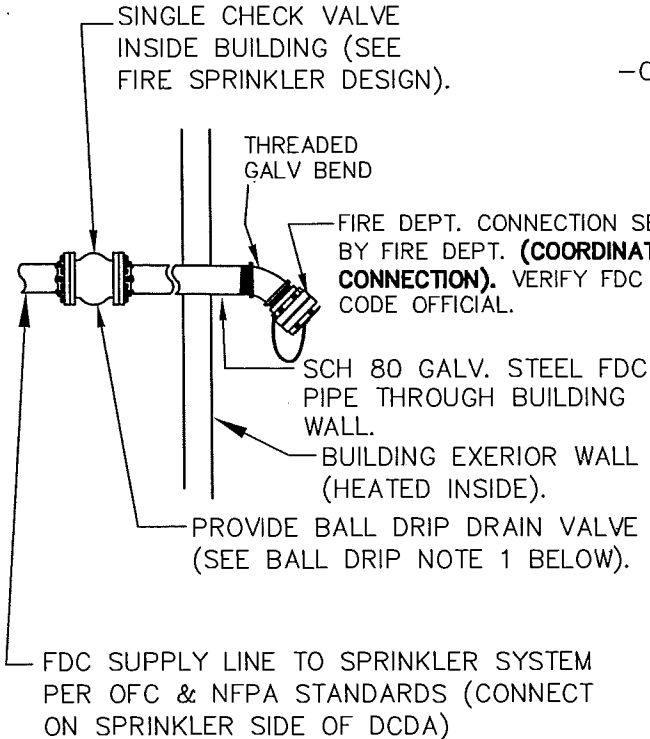


**FORWARD FLOW TEST PORT NOTES:**

1. A PERMANENT VALVED "FORWARD FLOW TEST PORT" SHALL BE INSTALLED ON SPRINKLER SIDE OF DCDA ASSEMBLY, AT A LOCATION AS APPROVED IN WRITING BY THE FIRE CODE OFFICIAL, UNLESS A PRIVATE FIRE HYDRANT DOWNSTREAM OF THE DCDA IS DESIGNATED AS THE REQUIRED "FORWARD FLOW TEST PORT".
2. CONTRACTOR IS RESPONSIBLE FOR COORDINATING WITH THE FIRE SPRINKLER SYSTEM DESIGNER/ INSTALLER TO VERIFY THE FLOWRATE REQUIRED FOR THE "FORWARD FLOW TEST" OF THE BACKFLOW DEVICE, AND SHALL COORDINATE TO ENSURE THAT ALL HOSE & FLOW MEASUREMENT EQUIPMENT (HOSE MONSTER OR EQUAL) IS PROVIDED AS REQUIRED TO CONDUCT THE ACCEPTANCE "FORWARD FLOW TEST" AS REQUIRED BY NFPA 13, 6.10.2.5.1.
3. ALL COMPONENTS OF THE FORWARD FLOW TEST PORT (EXCLUDING THE FIRE HOSES & FLOW MEASUREMENT EQUIPMENT) SHALL REMAIN IN PLACE TO ALLOW SUBSEQUENT "FORWARD FLOW TESTS" TO BE CONDUCTED WITHOUT ANY SYSTEM MODIFICATIONS (IE. ANNUAL FLOW TESTS AS REQUIRED PER NFPA 25, 13.7.2.1).

**FORWARD FLOW TEST DRAIN NOTES:**

1. IF THE FORWARD FLOW TEST PORT IS INSTALLED INSIDE A BUILDING, DRAINS ADEQUATE TO HANDLE THE FULL TEST FLOWS SHALL BE PROVIDED, UNLESS PROVISIONS ARE INCLUDED TO DIRECT THE TEST FLOWS TO THE EXTERIOR OF THE BUILDING IN A LOCATION WHICH WILL NOT CAUSE DAMAGE TO PUBLIC OR PRIVATE PROPERTY

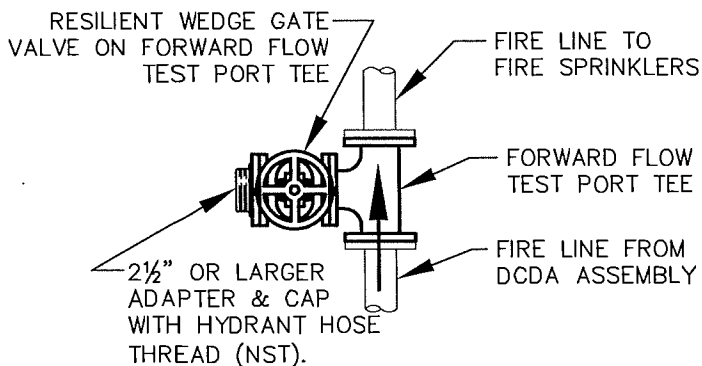

**FORWARD FLOW TEST PORT EXAMPLE**

NTS

**DCDA & DETECTOR LOOP METER NOTES:**

CONFORM TO ALL OTHER REQUIREMENTS OF APPLICABLE DOUBLE CHECK DETECTOR ASSEMBLY DETAIL(S), NOTES & SPECS ON CITY DETAILS OR STANDARDS **(INCLUDING INSTALLATION OF A CITY APPROVED WATER METER & DOUBLE CHECK FOR DCDA DETECTOR LOOP, AT AN ACCESSIBLE LOCATION ACCEPTABLE TO PUBLIC WORKS).**

**BALL DRIP NOTE:**

INSTALL BALL-DRIP DRAIN VALVE AT LOW POINT IN FDC LINE PROFILE (UNLESS FDC LINE IS SLOPED TO DRAIN OUT COMPLETELY FROM CHECK VALVE TO BUILDING EXTERIOR WHEN FDC IS NOT IN USE).

**GENERAL OFC & NFPA NOTE:**

THIS DETAIL PROVIDES GUIDANCE ONLY, AND DOES NOT SUPERCEDE REQUIREMENTS UNDER THE OREGON FIRE CODE (OFC), NFPA STANDARDS OR DIRECTION FROM LOCAL FIRE CODE OFFICIAL OR FIRE CHIEF.

LAST REVISION DATE: JAN 2024	JO # STANDARD
SAMPLE & NOTES, FDC ON BLDG EXTERIOR, FORWARD FLOW TEST PORT, DCDA, ETC. (NTS)	
DAYTON, OR	DETAIL NO. 563



# WATERLINE PRESSURE TEST REPORT

Project Location:	Project Name:	Date:
Inspector: (Print)	<b>Waterline to be tested.</b> From Station:	To Station:
Verify that all in-line valves, including hydrant mainline valves, are open? Yes / No		
Verify that all corp stops are open? Yes / No		
Verify that pressure gauge is mounted at high point of line to be tested? Yes / No If no, correct for elevation difference ( <i>ie. add 0.433 psi per foot elevation difference</i> ).		
System Static Pressure (psi):	Starting Pressure (psi): <i>(greater of 150 psi or 1.5 times static)</i>	Ending Pressure (psi):
Pipe Lengths & φ's:	Starting Time:	Ending Time <i>(2 hours minimum)</i> :
Volume Required to Reach Initial Test Pressure (gal):	Allowable Leakage (gal): <i>(2 times table or calculated value below)</i>	Measured Leakage (gal):
<b>TEST RESULTS:</b> Pass / Fail		

**ALLOWABLE LEAKAGE PER 1,000 FEET OF PIPELINE - gph** (*NOTE: double the values from table below for a 2 hour test*)

Test Pressure <i>psi</i>	NOMINAL PIPE DIAMETER - in.									
	3	4	6	8	10	12	14	16	18	20
200	0.32	0.43	0.64	0.85	1.06	1.28	1.48	1.70	1.91	2.12
175	0.30	0.40	0.59	0.80	0.99	1.19	1.39	1.59	1.79	1.98
150	0.28	0.37	0.55	0.74	0.92	1.10	1.29	1.47	1.66	1.84

If the pipeline under test contains various diameters, the allowable leakage shall be the sum of the allowable leakage for each size. No additional leakage allowance will be given for fire hydrant assemblies or valves.

Sample: 700' 8" and 55' 6" pipe. → → 0.74 gph / 1,000' \* 700' + (0.55 gph / 1,000' \* 55') = 0.548 gph \* 2 hours = ~1.1 gallon allowable leakage loss.

Allowable leakage based on :  $L = SD(P)^{1/2} / 133,200$

Where:

L = allowable leakage, in gallons per hour      D = nominal diameter of the pipe, in inches  
S = length of pipe tested, in feet                      P = test pressure during the leakage test, in psig

**Regardless of leakage, maximum pressure drop during test period shall not exceed 5 psi over the 2 hour test period .**

**Any visible leaks shall be repaired regardless of the whether or not the pipeline meets leakage allowance.**


**TEST PROCEDURE**

1. Apply hydrostatic pressure by pumping water from an auxiliary supply basin. Accurately determine the amount of water required to reach the initial test pressure by refilling the supply basin with a calibrated container following pressurization of pipeline.
2. Monitor test pressure for 2 hour period.
3. At the completion of the test period, re-pressurize the pipeline by pumping water from the auxiliary supply basin (*mark the water surface level in the auxiliary supply basin prior to re-pressurization*).
4. **Accurately determine the amount of water required to reach the test pressure by refilling the supply basin to the marked line with a calibrated container following re-pressurization of pipeline.** If the measured leakage is less than the allowable leakage, the test is successful.

Reference: For summary of disinfection & bacteriological testing procedures, see construction notes under Appendix B.



EXIST. PUBLIC ROAD OR APPROVED ACCESS POINT

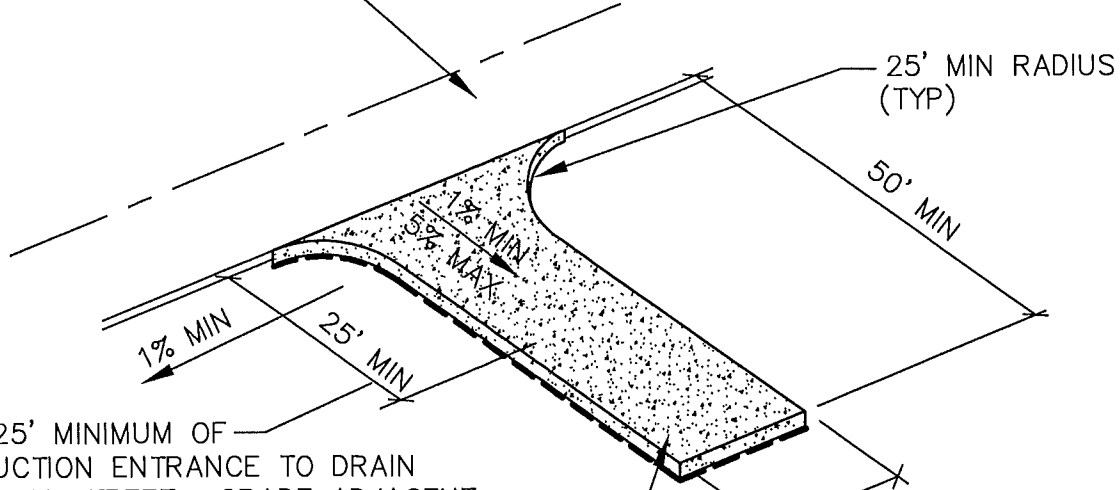

GRADE 25' MINIMUM OF CONSTRUCTION ENTRANCE TO DRAIN AWAY FROM STREET. GRADE ADJACENT AREAS TO DRAIN AWAY FROM TEMPORARY CONSTRUCTION ENTRANCE.

PLACE 3"-6" GRANULAR MATERIAL OVER 8-OUNCE NON-WOVEN GEOTEXTILE FABRIC AS FOLLOWS:

DRY WEATHER ACCESS

14-INCH MIN. DEPTH OVER COMPACTED SUBGRADE & FABRIC

WET WEATHER ACCESS

24-INCH MIN. DEPTH OVER UNDISTURBED SUBGRADE & FABRIC

FULL WIDTH OF PROPOSED STREET OR ACCESS (25' MINIMUM)


CONSTRUCTION NOTES:

1. THE AREA OF THE CONSTRUCTION ENTRANCE SHALL BE STRIPPED OF ALL TOPSOIL, VEGETATION, ROOTS, AND OTHER NON-COMPACTABLE MATERIAL.
2. SUBGRADE SHALL BE COMPACTED AND PROOFROLLED PRIOR TO PLACEMENT OF GRANULAR MATERIAL. FAILURE TO PASS PROOFROLL WILL REQUIRE USE OF WET WEATHER SECTION.
3. FAILURE OR PUMPING OF THE DRY WEATHER SECTION WILL REQUIRE REMOVAL OF THE GRANULAR MATERIAL AND INSTALLATION OF THE WET WEATHER SECTION.

MAINTENANCE NOTES:



1. THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT TRACKING OR FLOW OF SEDIMENT ONTO PUBLIC RIGHT-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH 3"-6" INCH STONE AS CONDITIONS DEMAND, AND REPAIR AND/OR CLEAN-OUT OF STRUCTURES USED TO TRAP SEDIMENT.
2. ALL MATERIALS SPILLED, DROPPED, WASHED OR TRACKED FROM VEHICLES ONTO ROADWAYS OR INTO STORM DRAINS MUST BE REMOVED IMMEDIATELY.
3. ALL TRUCKS TRANSPORTING SATURATED SOILS SHALL BE WELL SEALED. WATER DRIPPAGE FROM TRUCKS MUST BE REDUCED TO 1 GALLON PER HOUR PRIOR TO LEAVING THE SITE.

LAST REVISION DATE: MAY 2013	JO # STANDARD
<b>TEMPORARY CONSTRUCTION ENTRANCE</b> (NTS)	
DAYTON, OR	DETAIL NO. 610

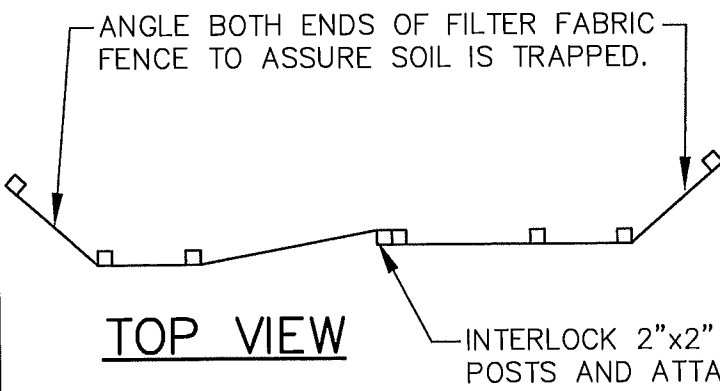

SILT FENCE NOTES:


1. BURY BOTTOM OF FILTER FABRIC 6" VERTICALLY BELOW FINISHED GRADE.
2. TRENCH TO BE DUG WITH DITCH-WITCH, BY HAND OR OTHER METHOD AS REQUIRED TO MINIMIZE WIDTH.
3. BACKFILL & COMPACT NATIVE SOIL IN TRENCH AFTER FENCE INSTALLATION.
4. STITCHED LOOPS TO BE INSTALLED TO THE UPHILL SIDE OF THE FENCE.

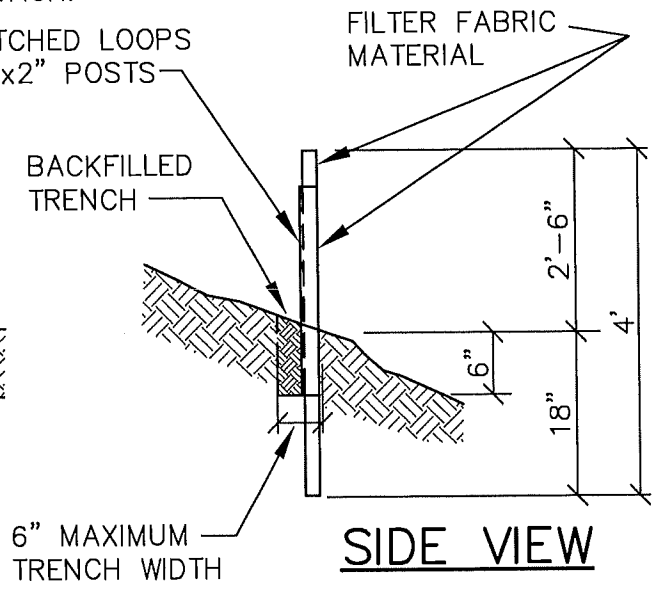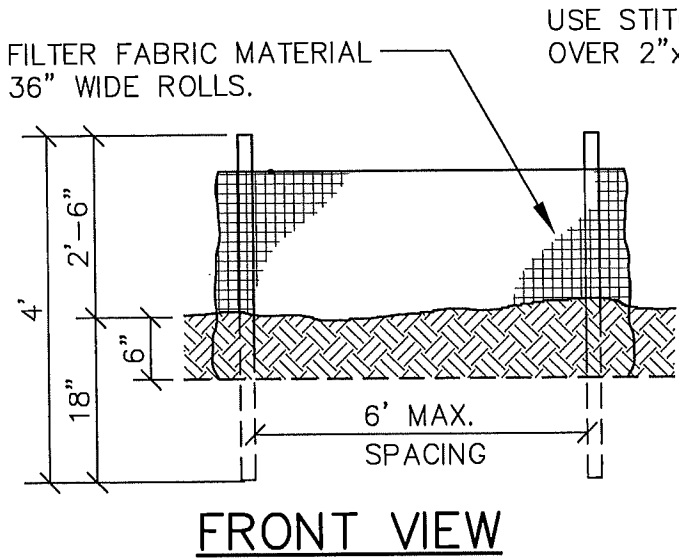

MAINTENANCE NOTES:


1. SEDIMENT BARRIERS SHALL BE MAINTAINED UNTIL UP-SLOPE AREA IS PERMANENTLY STABILIZED.
2. AT NO TIME SHALL MORE THAN ONE FOOT OF SEDIMENT BE ALLOWED TO ACCUMULATE BEHIND SEDIMENT FENCES OR BIOFILTER BAGS.
3. NEW SEDIMENT BARRIERS SHALL BE INSTALLED UPHILL AS REQUIRED TO CONTROL SEDIMENT TRANSPORT.

LAST REVISION DATE: APRIL 2014	JO # STANDARD
<b>SEDIMENT BARRIERS</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>611</b>

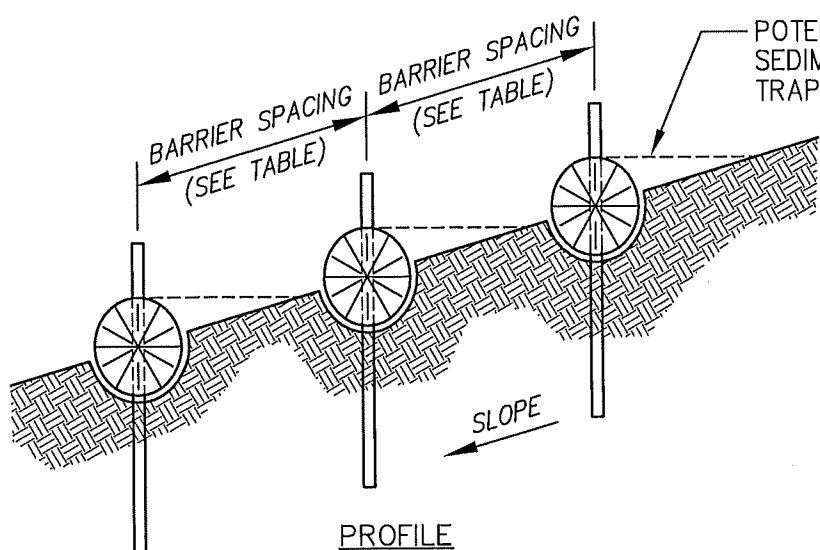


PROFILE

PLACE STRAW WATTLES PARALLEL TO SLOPE CONTOURS

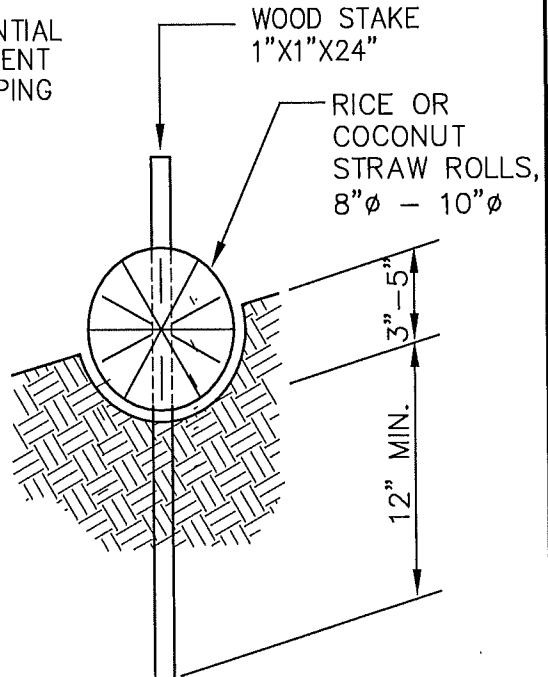

SECTION

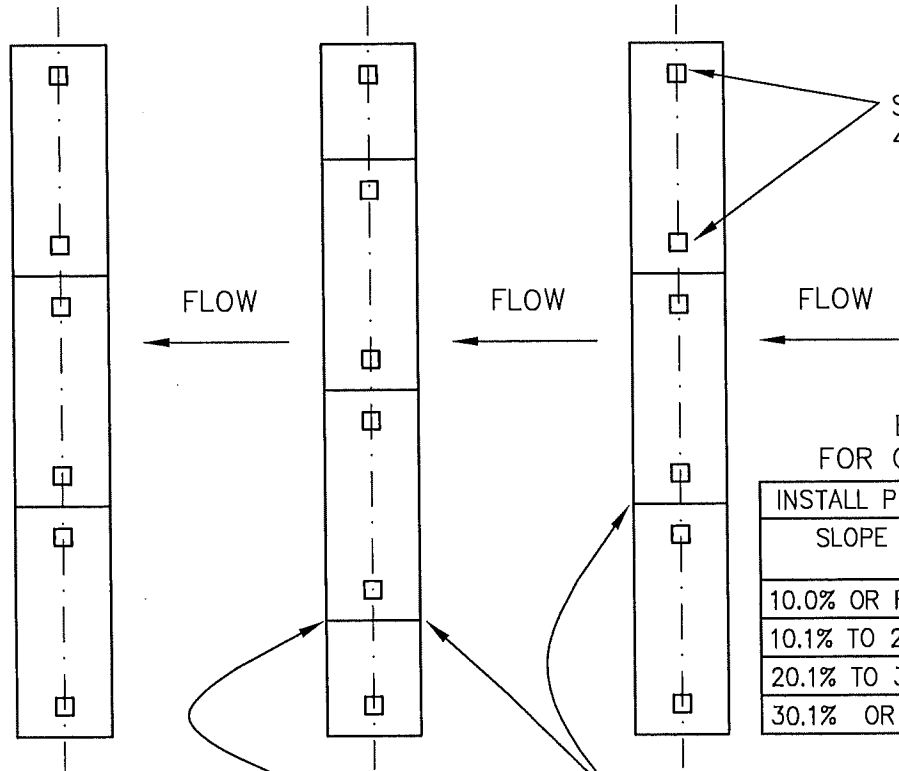

PLAN

STAKE SPACING 4' MAX.

BARRIER SPACING FOR GENERAL APPLICATION

INSTALL PARALLEL TO CONTOURS AS FOLLOWS	
SLOPE RATIO	MAXIMUM SPACING ON SLOPE BETWEEN WATTLES
10.0% OR FLATTER	50' O.C.
10.1% TO 20.0%	25' O.C.
20.1% TO 30.0%	10' O.C.
30.1% OR STEEPER	5' O.C.

TIGHTLY ABUT ADJACENT WATTLES


STAGGER JOINTS

NOTES:


1. ALL MATERIAL SHALL CONFORM TO OSSC (ODOT/APWA) SPECIFICATIONS, CURRENT EDITION.
2. SEDIMENT BARRIERS SHALL BE MAINTAINED UNTIL UP-SLOPE AREA IS PERMANENTLY STABILIZED.
3. AT NO TIME SHALL SEDIMENT BE ALLOWED TO ACCUMULATE ABOVE THE TOP OF THE STRAW WATTLE.
4. NEW SEDIMENT BARRIERS SHALL BE INSTALLED UPHILL AS REQUIRED TO CONTROL SEDIMENT TRANSPORT.

LAST REVISION DATE: JUNE 2015	JO # STANDARD
<b>STRAW WATTLE SEDIMENT BARRIER</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 612


MAY BE USED SHORT TERM  
W/UTILITY WORK AND WITH  
PHASING OF DEVELOPMENT.

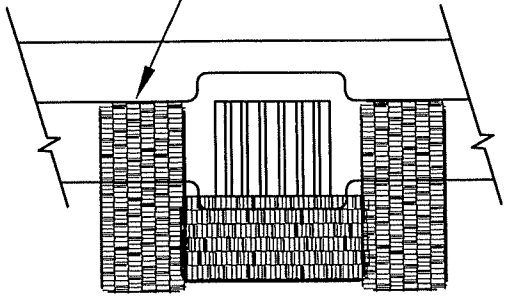

CURB INLET C.B.

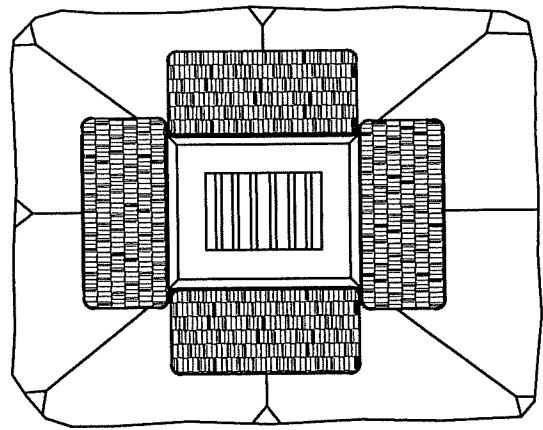


AREA DRAIN

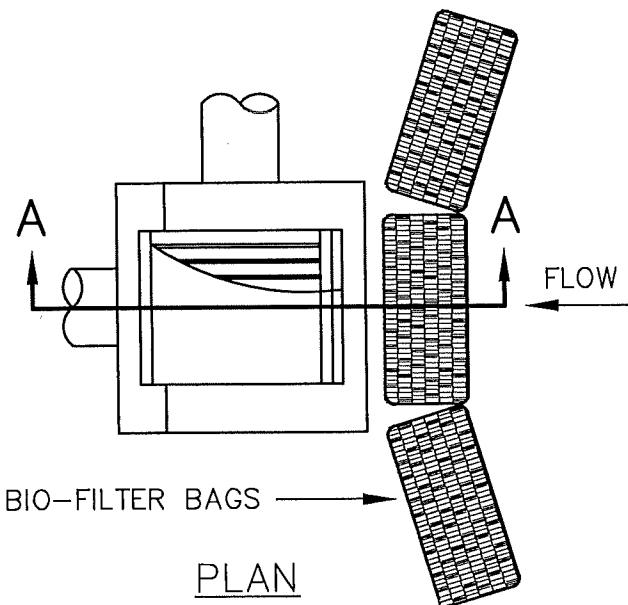

BIO-FILTER BAGS

PLAN

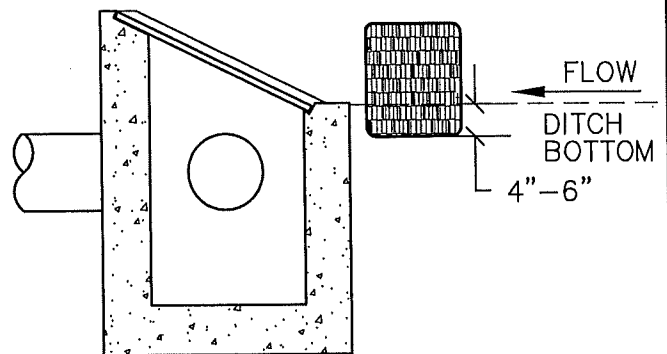


SECTION A-A

DITCH INLET C.B.

MAINTENANCE NOTES:


1. SEDIMENT BARRIERS SHALL BE MAINTAINED UNTIL UP-SLOPE AREA IS PERMANENTLY STABILIZED.
2. AT NO TIME SHALL MORE THAN ONE FOOT OF SEDIMENT BE ALLOWED TO ACCUMULATE BEHIND SEDIMENT FENCES OR BIOFILTER BAGS.
3. NEW SEDIMENT BARRIERS SHALL BE INSTALLED UPHILL AS REQUIRED TO CONTROL SEDIMENT TRANSPORT.

LAST REVISION DATE: APRIL 2014	JO # STANDARD
<b>INLET SEDIMENT CONTROL</b>	
(NTS)	
DAYTON, OR	DETAIL NO. 613

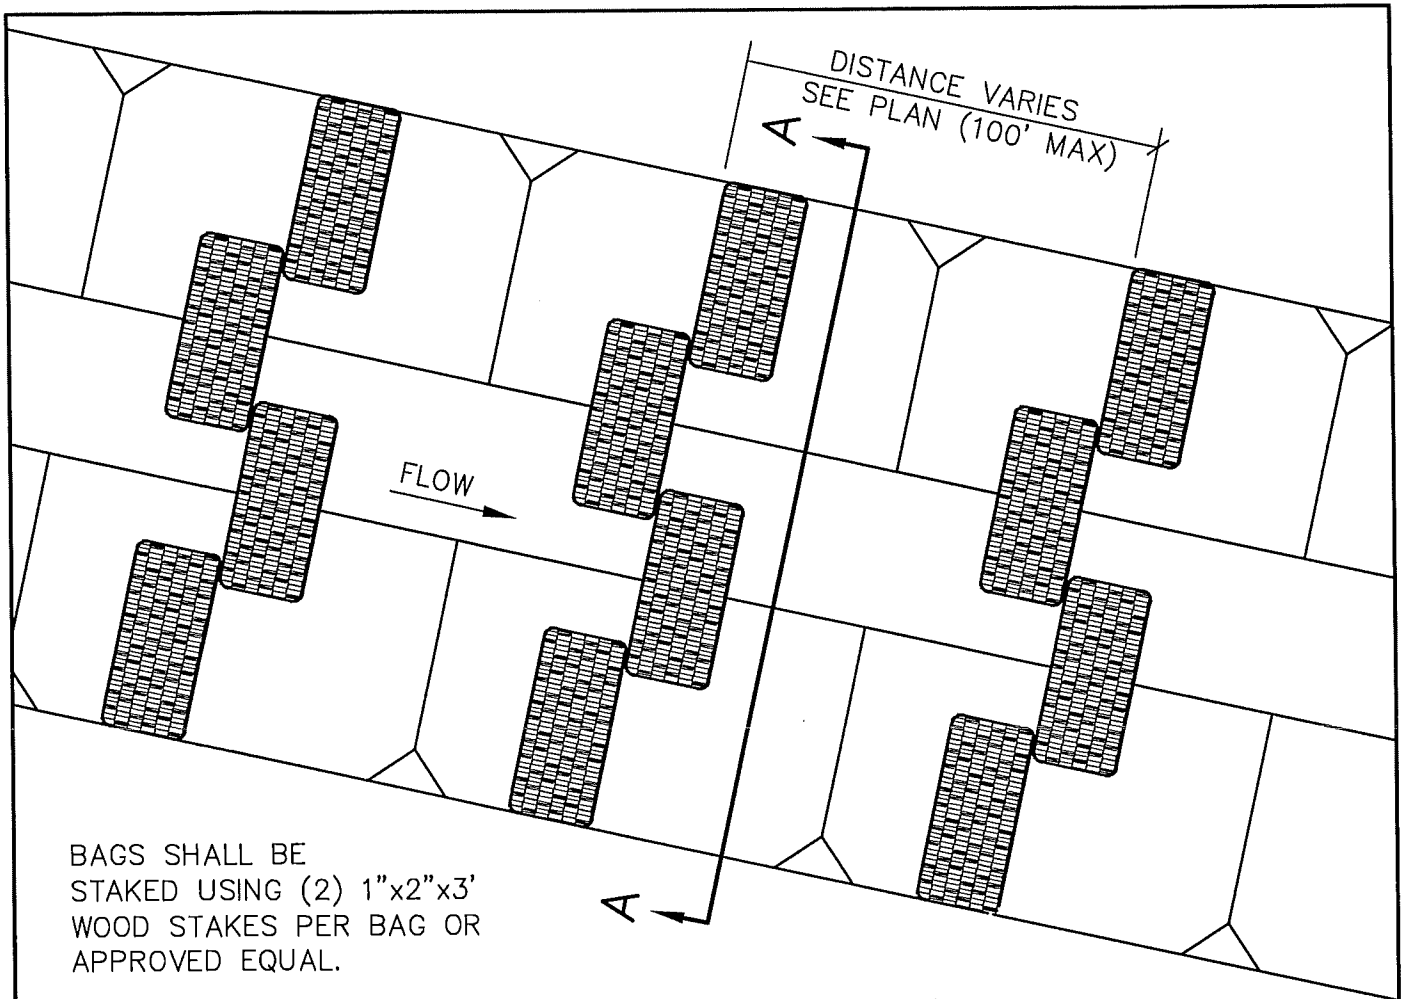

BAGS SHALL BE STAKED USING (2) 1"x2"x3' WOOD STAKES PER BAG OR APPROVED EQUAL.

PLAN VIEW

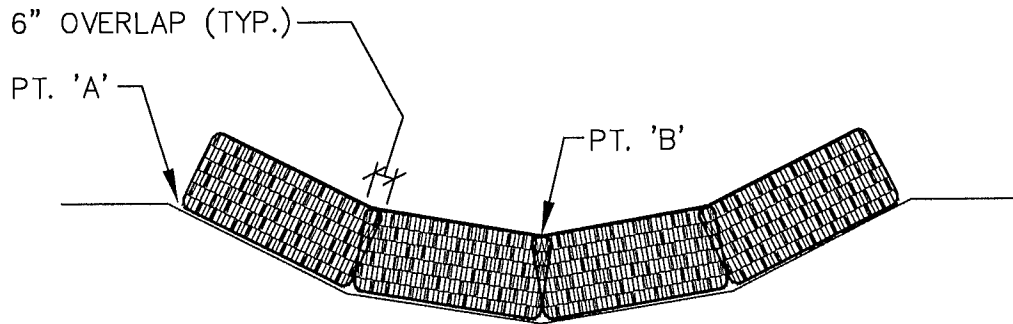


SECTION A-A


MAINTENANCE NOTES:

1. SEDIMENT BARRIERS SHALL BE MAINTAINED UNTIL UP-SLOPE AREA IS PERMANENTLY STABILIZED.
2. AT NO TIME SHALL MORE THAN ONE FOOT OF SEDIMENT BE ALLOWED TO ACCUMULATE BEHIND BIOFILTER BAGS.
3. NEW SEDIMENT BARRIERS SHALL BE INSTALLED UPHILL AS REQUIRED TO CONTROL SEDIMENT TRANSPORT.
4. PT. 'A' SHALL BE 6" MIN. HIGHER THAN PT. 'B'.

LAST REVISION DATE: APRIL 2014	JO # STANDARD
<b>DITCH AND SWALE EROSION PROTECTION</b>	
(NTS)	
DAYTON, OR	DETAIL NO. <b>614</b>

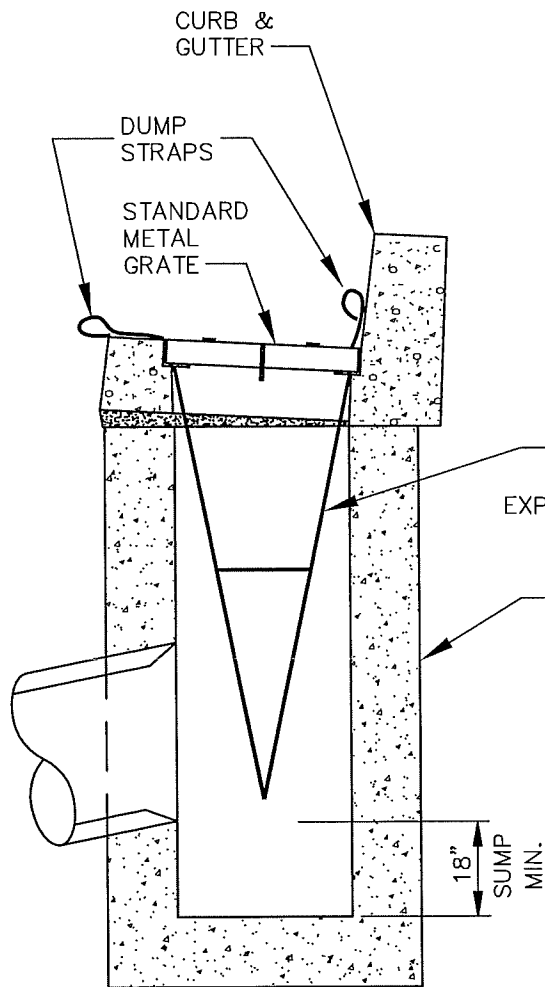

INSTALLATION DETAIL

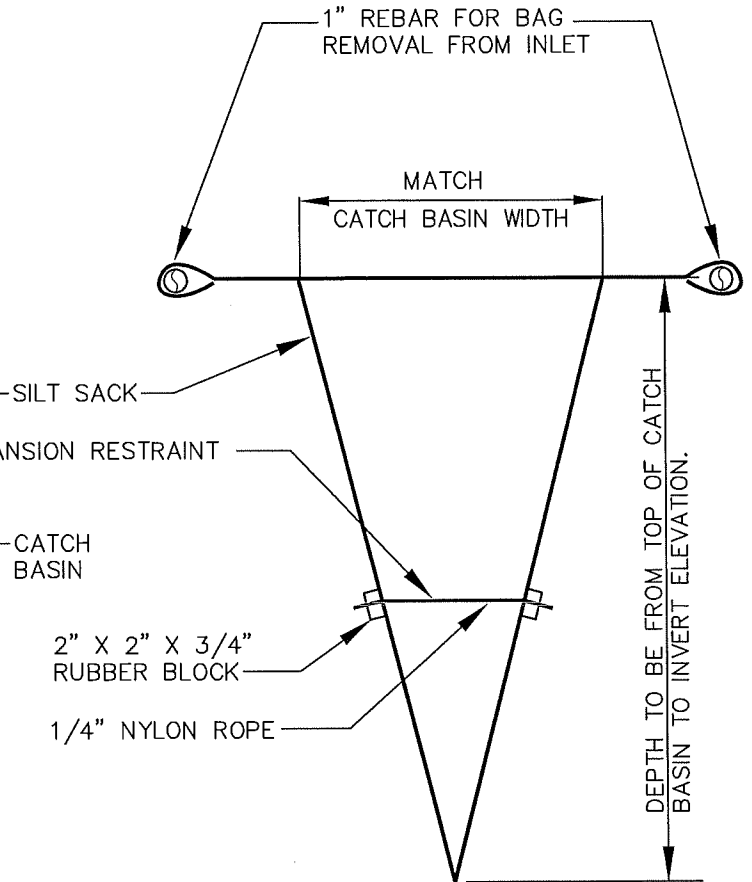


BAG DETAIL

NOTES:


1. EMPTY SILT SACK AS NECESSARY.
2. SILTSACK SEDIMENT CONTROL DEVICE AS MANUFACTURED BY ACF ENVIRONMENTAL AND SUPPLIED BY ACF WEST (503) 771-5115 OR APPROVED EQUAL.

LAST REVISION DATE: SEPT 2006	
SILT SACK INLET DETAIL	
(NTS)	
DAYTON, OR	DETAIL NO. 615




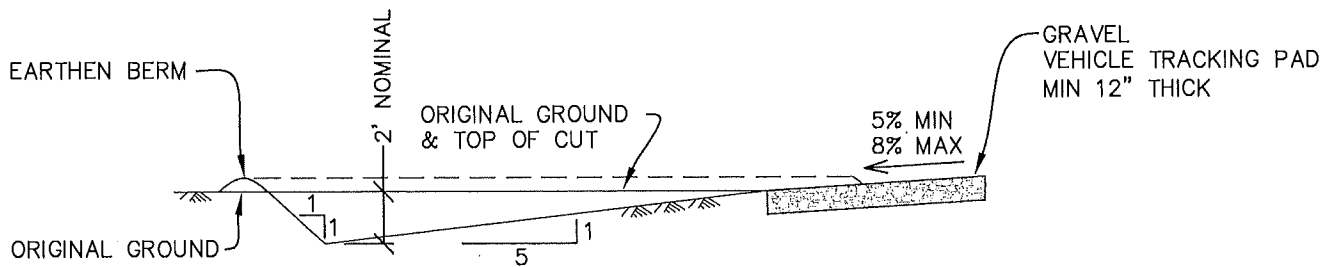

SECTION B-B

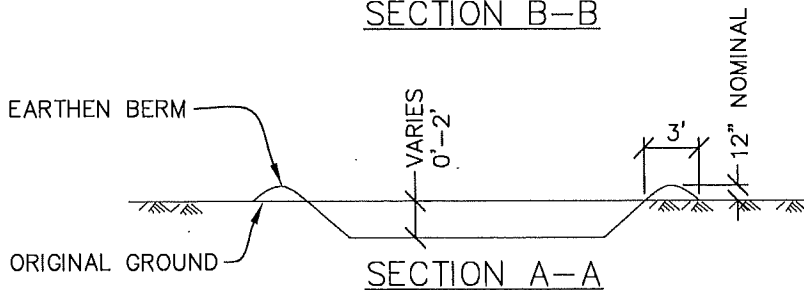

SECTION A-A

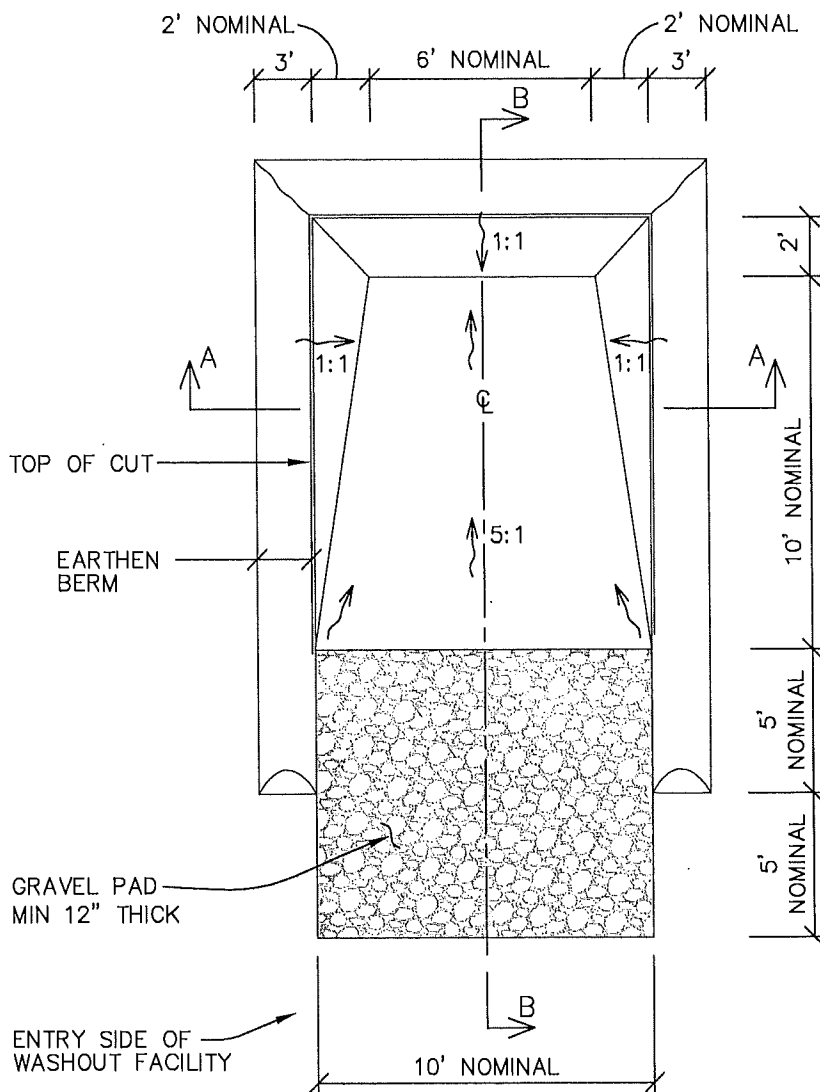

CONCRETE WASHOUT AREA PLAN

N.T.S.


CWA INSTALLATION NOTES:

1. SEE DRAWINGS FOR CWA INSTALLATION LOCATION.
2. DO NOT LOCATE WASHOUT AREA WITHIN 200' OF ANY NATURAL DRAINAGE WAY.
3. THE CWA SHALL BE INSTALLED PRIOR TO CONCRETE PLACEMENT ON SITE.
4. VEHICLE TRACKING PAD SHALL BE SLOPED 5% TOWARDS THE CWA.

CWA MAINTENANCE NOTES:

1. INSPECT BMP'S EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION.
2. THE CWA SHALL BE REPAIRED, CLEANED, OR ENLARGED AS NECESSARY TO MAINTAIN CAPACITY FOR CONCRETE WASTE. CONCRETE MATERIALS ACCUMULATED IN PIT SHALL BE REMOVED ONCE THE MATERIALS HAVE REACHED A DEPTH OF 18".
3. CONCRETE WASHOUT WATER, WASTED PIECES OF CONCRETE, AND ALL OTHER DEBRIS IN THE PIT SHALL BE REMOVED FROM THE JOB SITE.
4. THE CWA SHALL REMAIN IN PLACE UNTIL ALL CONCRETE FOR THE PROJECT IS PLACED.
5. WHEN THE CWA IS REMOVED, COVER THE DISTURBED AREA WITH TOP SOIL, SEED AND MULCH OR OTHERWISE STABILIZED IN A MANNER APPROVED BY THE LOCAL JURISDICTION.

LAST REVISION DATE: NOV 2018	JO # STANDARD
<b>TEMPORARY CONCRETE WASHOUT AREA (CWA)</b> (N.T.S.)	
DAYTON, OR	DETAIL NO. 616

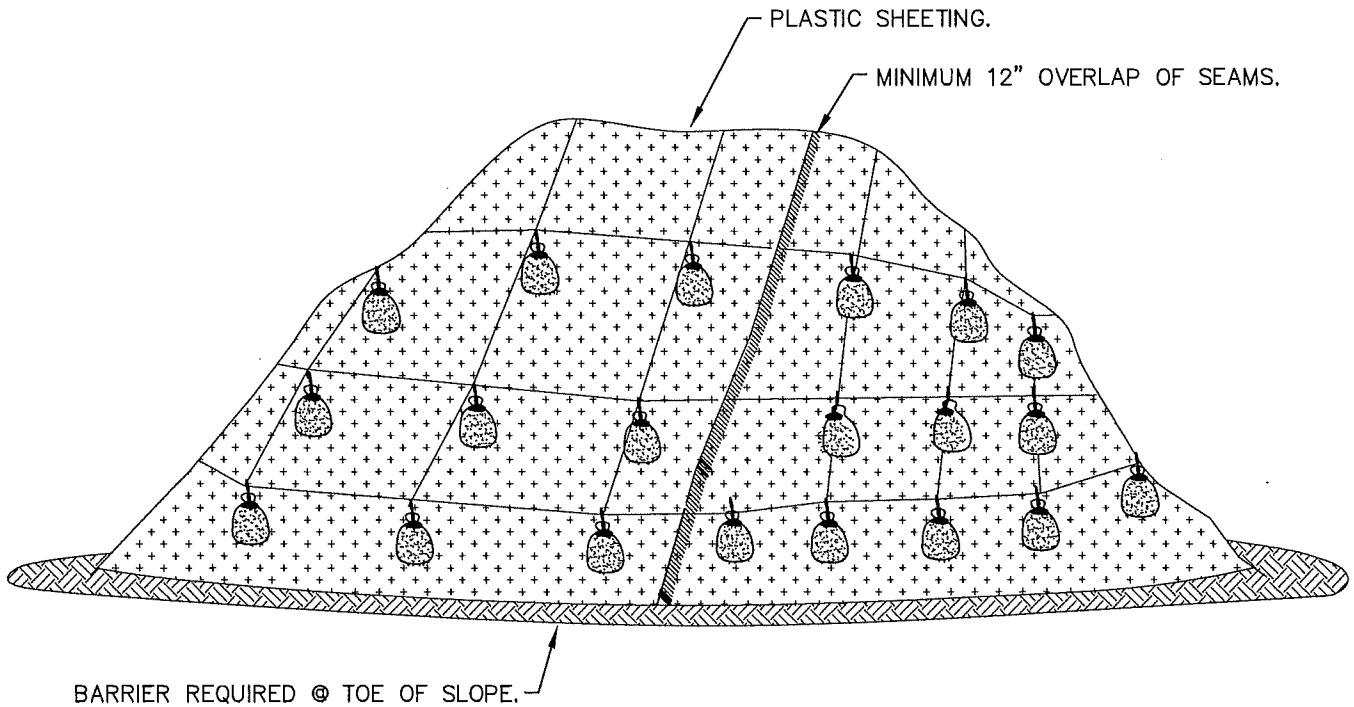

## STOCKPILE DETAIL

### NOTES:

1. MINIMUM 12" OVERLAP OF ALL SEAMS REQUIRED.
2. SEDIMENT BARRIER REQUIRED @ TOE OF STOCK PILE.
3. COVERING MAINTAINED TIGHTLY IN PLACE BY USING SANDBAGS OR TIRES ON ROPES WITH A MAXIMUM 10' GRID SPACING IN ALL DIRECTIONS.
4. PLASTIC SHEETING TO EXTEND A MINIMUM OF 12" PAST THE BOTTOM OF THE PILE ONTO SURROUNDING GRADE ON ALL SIDES.

LAST REVISION DATE: JAN 2019	JO # STANDARD
<b>STOCKPILE COVER DETAIL</b> (NTS)	
DAYTON, OR	DETAIL NO. <b>617</b>